

- (A) EASEMENT TO DRAIN WATER 1.5 WIDE
- (C) POSITIVE COVENANT
- (K) EASEMENT FOR PIPELINE 5.03 WIDE (K545005 & 511411)
- (L) POSITIVE COVENANT
- (M) EASEMENT FOR UNDERGROUND POWERLINES 2 WIDE
- (N) EASEMENT FOR MULTI-PURPOSE ELECTRICAL INSTALLATION 4.2 WIDE


**NOTE:**  
 DRAFT ONLY. BOUNDARIES, AREAS  
 AND EASEMENTS SUBJECT TO FINAL  
 DESIGN AND SURVEY

SURVEYOR Name: GRAHAM McLEOD BURNS Date: 27TH JUNE 2021 Reference: 5153STG3	PLAN OF SUBDIVISION OF LOT 200 DP....	L.G.A: PORT MACQUARIE - HASTINGS Locality: THRUMSTER Reduction Ratio 1:500 Lengths are in metres.	REGISTERED
--	---------------------------------------	--	------------

MGA NORTH  
SCIMS

SCHEDULE OF SHORT LINES	
NO.	BEARING & DISTANCE
7	143° 17' 20" - 5.62
8	53° 17' 20" - 5.695
9	323° 17' 20" - 5.62

- (A) EASEMENT TO DRAIN WATER 1.5 WIDE
- (B) EASEMENT TO DRAIN WATER 3 WIDE
- (D) EASEMENT TO DRAIN WATER 1.5 WIDE (DP)
- (E) RIGHT OF CARRIAGEWAY VARIABLE WIDTH
- (L) POSITIVE COVENANT
- (M) EASEMENT FOR UNDERGROUND POWERLINES 2 WIDE
- (N) EASEMENT FOR MULTI-PURPOSE ELECTRICAL INSTALLATION 4.2 WIDE

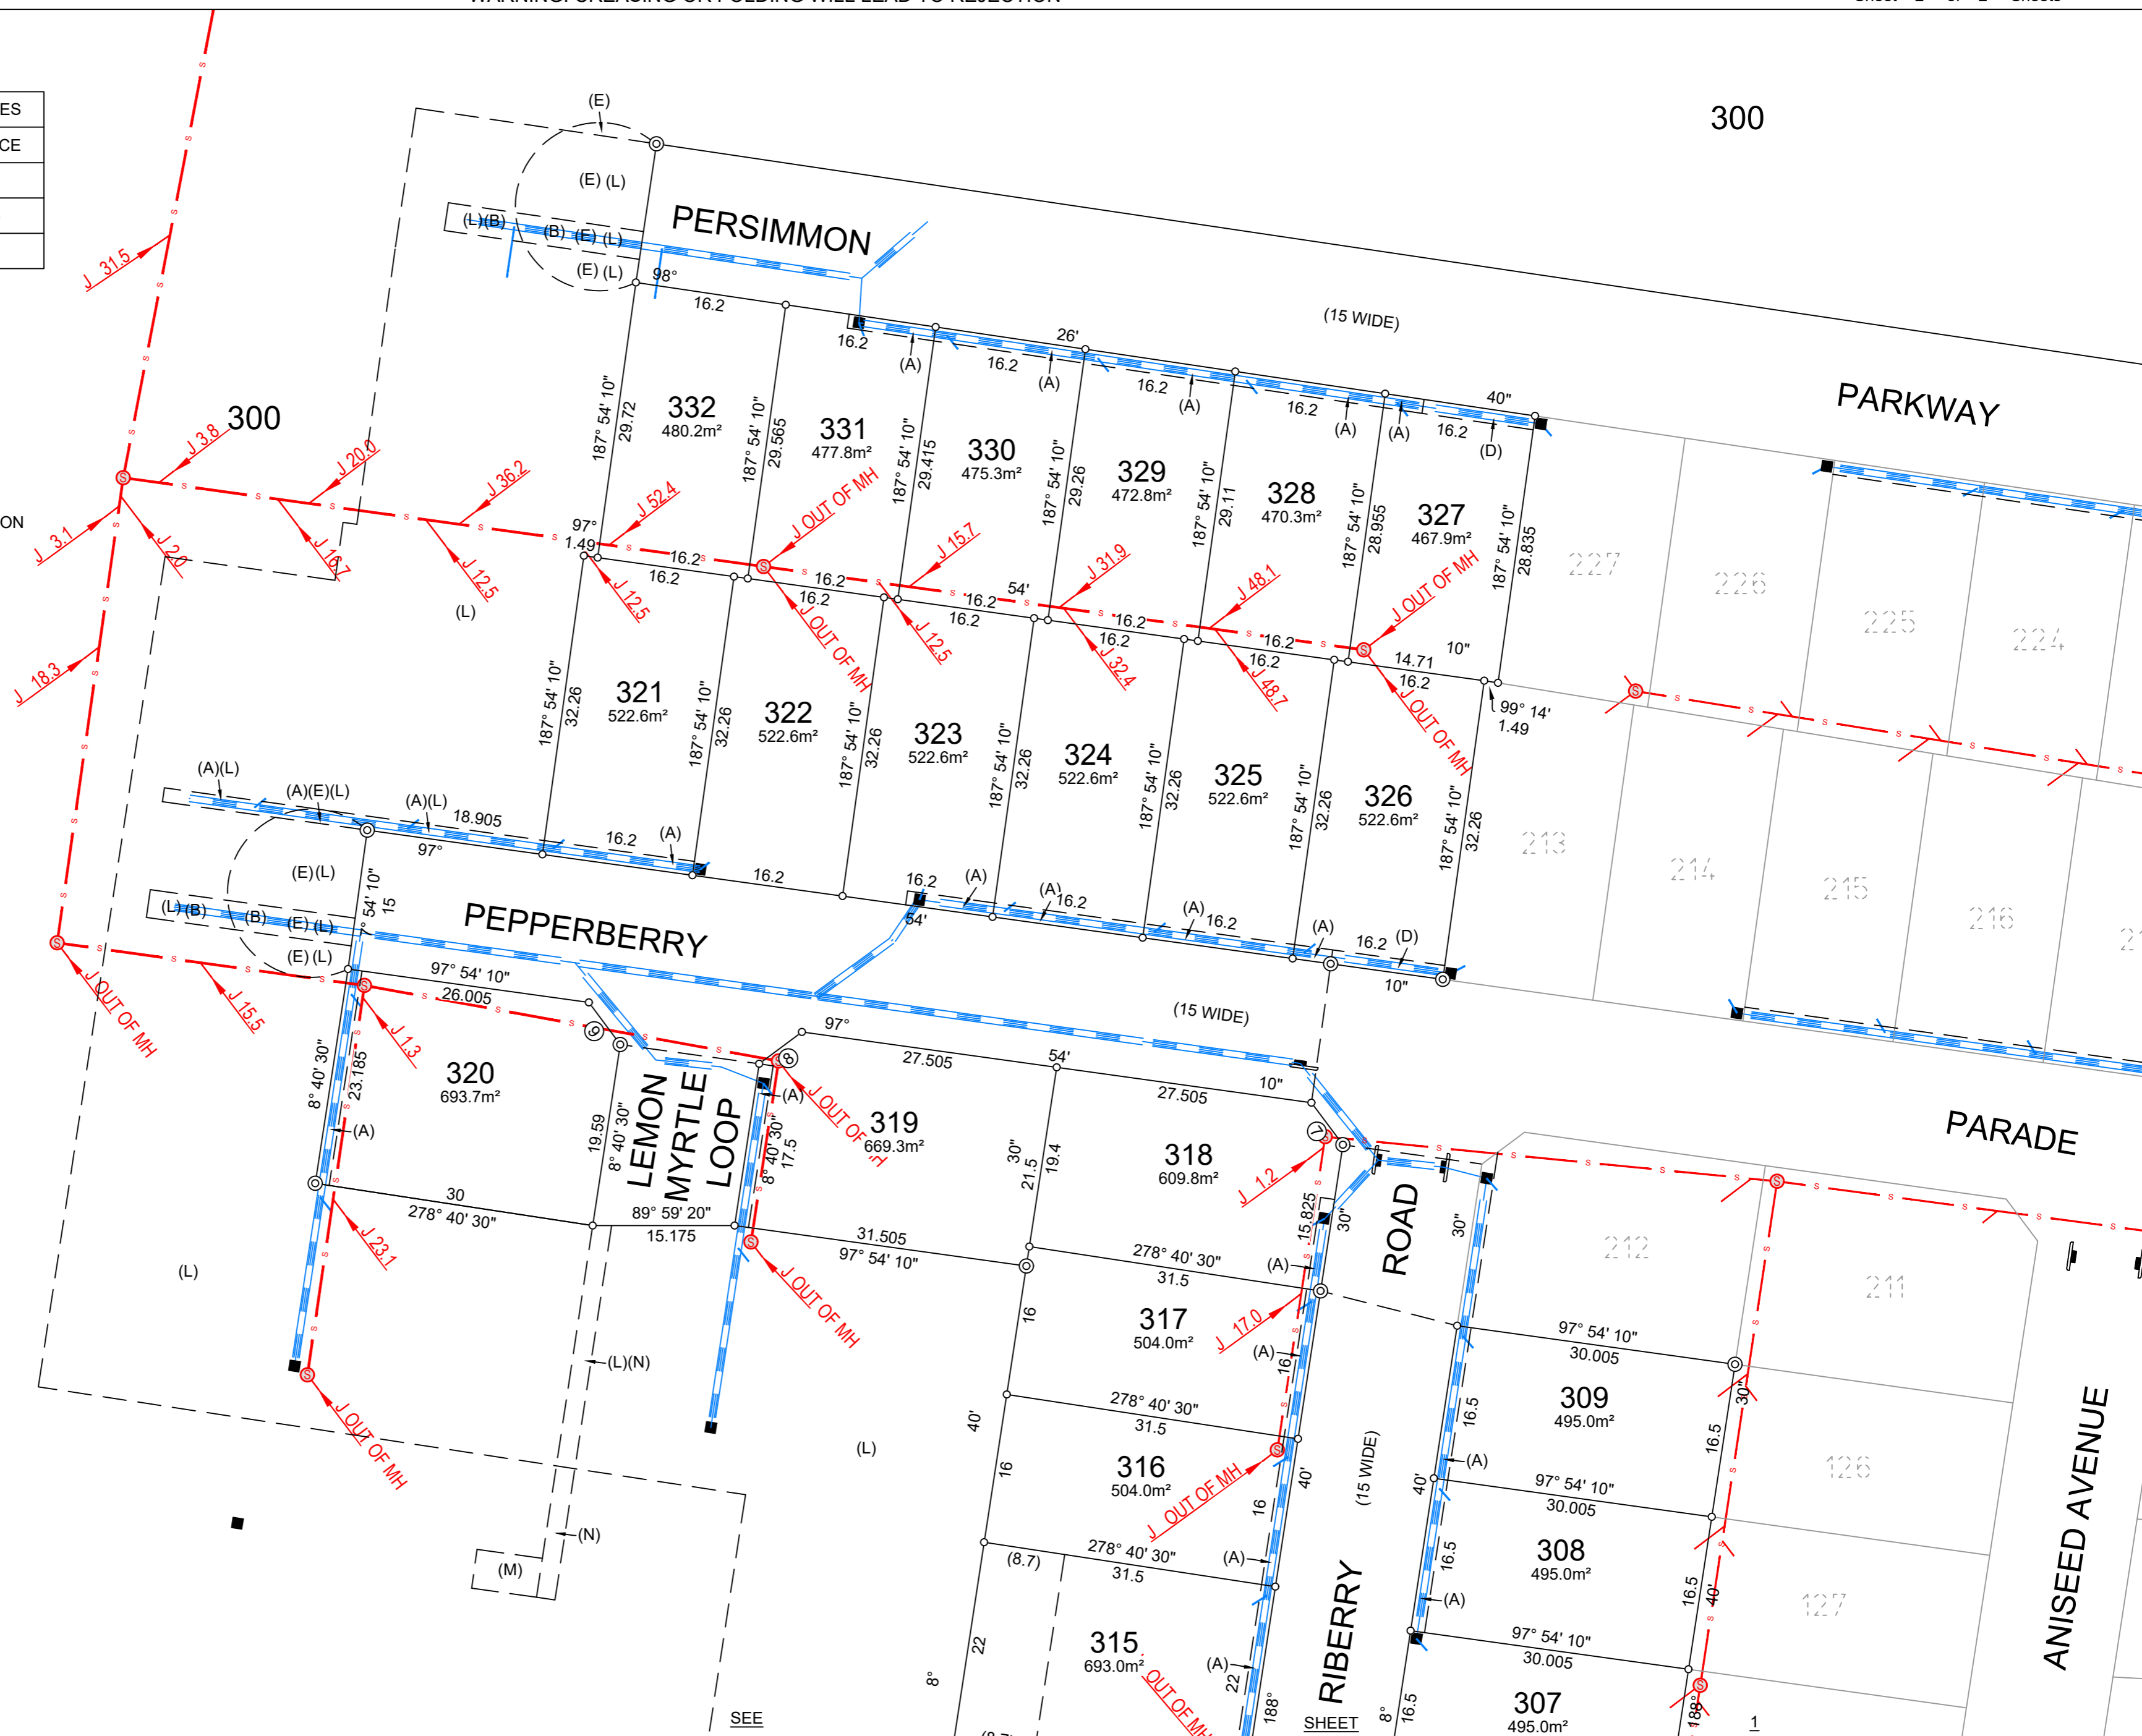

**NOTE:**  
DRAFT ONLY. BOUNDARIES, AREAS  
AND EASEMENTS SUBJECT TO FINAL  
DESIGN AND SURVEY

SURVEYOR Name: GRAHAM McLEOD BURNS Date: 27TH JUNE 2021 Reference: 5153STG3	PLAN OF SUBDIVISION OF LOT 200 DP.....	L.G.A: PORT MACQUARIE - HASTINGS Locality: THURMSTER Reduction Ratio 1:500 Lengths are in metres.	REGISTERED	SHEET 1
--	--	--	------------	---------