

THE SANCTUARY STAGE 8

LOT 300, DP 1307775 - JOHN OXLEY DRIVE, THRUMSTER

CONSTRUCTION DOCUMENTATION

Job No. 7197

FEBRUARY 2026


DA 2014-114

DRAWING SCHEDULE


NO.	DRAWING TITLE	REVISION	NO.	DRAWING TITLE	REVISION
00	COVER SHEET	B	32	SEWER LONGITUDINAL SECTION - LINE A TO C	A
01	ENGINEERING NOTES	A	33	STREET LANDSCAPE PLAN	A
02	SITE ESTABLISHMENT & TREE MANAGEMENT PLAN	B	34	LANDSCAPE DETAILS SHEET 01	A
03	EARTHWORKS CUT AND FILL AND EROSION & SEDIMENT CONTROL PLAN	A	35	LANDSCAPE DETAILS SHEET 02	A
04	GENERAL LAYOUT & DRAINAGE PLAN	B	36	LANDSCAPING NOTES	A
05	RETAINING WALL PLAN	B			
06	STORMWATER BASIN 01 PLAN	A			
07	STORMWATER BASIN 02 PLAN	A			
08	STORMWATER BASIN DETAILS	A			
09	SEWER & WATER RETICULATION PLAN	B			
10	PAVEMENT PLAN	A			
11	ROAD 11 LONGITUDINAL SECTION & TYPICAL SECTIONS	A			
12	ROAD 11 CROSS SECTIONS CH 92.50 TO 140.00	A			
13	ROAD 11 CROSS SECTIONS CH 150.00 TO 200.00	A			
14	ROAD 11 CROSS SECTIONS CH 210.00 TO 259.15	A			
15	ROAD 11 CROSS SECTIONS CH 270.00 TO 321.55	A			
16	ROAD 11 CROSS SECTIONS CH 338.49 TO 371.28	A			
17	ROAD 12 LONGITUDINAL SECTION & TYPICAL SECTION	A			
18	ROAD 12 CROSS SECTIONS CH 7.69 TO 60.00	A			
19	ROAD 12 CROSS SECTIONS CH 64.55	A			
20	ROAD 13 LONGITUDINAL SECTION & TYPICAL SECTION	A			
21	ROAD 13 CROSS SECTIONS CH 13.76 TO 60.00	A			
22	ROAD 13 CROSS SECTIONS CH 70.00 TO 88.61	A			
23	ROAD 12 INTERSECTION DETAIL PLAN - KR 01 & 02	A			
24	ROAD 13 INTERSECTION DETAIL PLAN - KR 03 & 04	A			
25	STORMWATER CATCHMENT PLAN	A			
26	STORMWATER LONGITUDINAL SECTION - LINE 01 TO 04	A			
27	STORMWATER LONGITUDINAL SECTION - LINE 04 TO 08	A			
28	STORMWATER LONGITUDINAL SECTION - LINE 09 TO 12	A			
29	STORMWATER CALCULATIONS SHEET	A			
30	STORMWATER RESULTS - MINOR 20% AND 5% AEP	A			
31	STORMWATER RESULTS - MAJOR 1% AEP	A			

SCHEDULE OF ROAD NAMES

ROAD No.	ROAD NAME
11	DESERT LIME DRIVE
12	SALTBUSH STREET
13	STAGHORN STREET

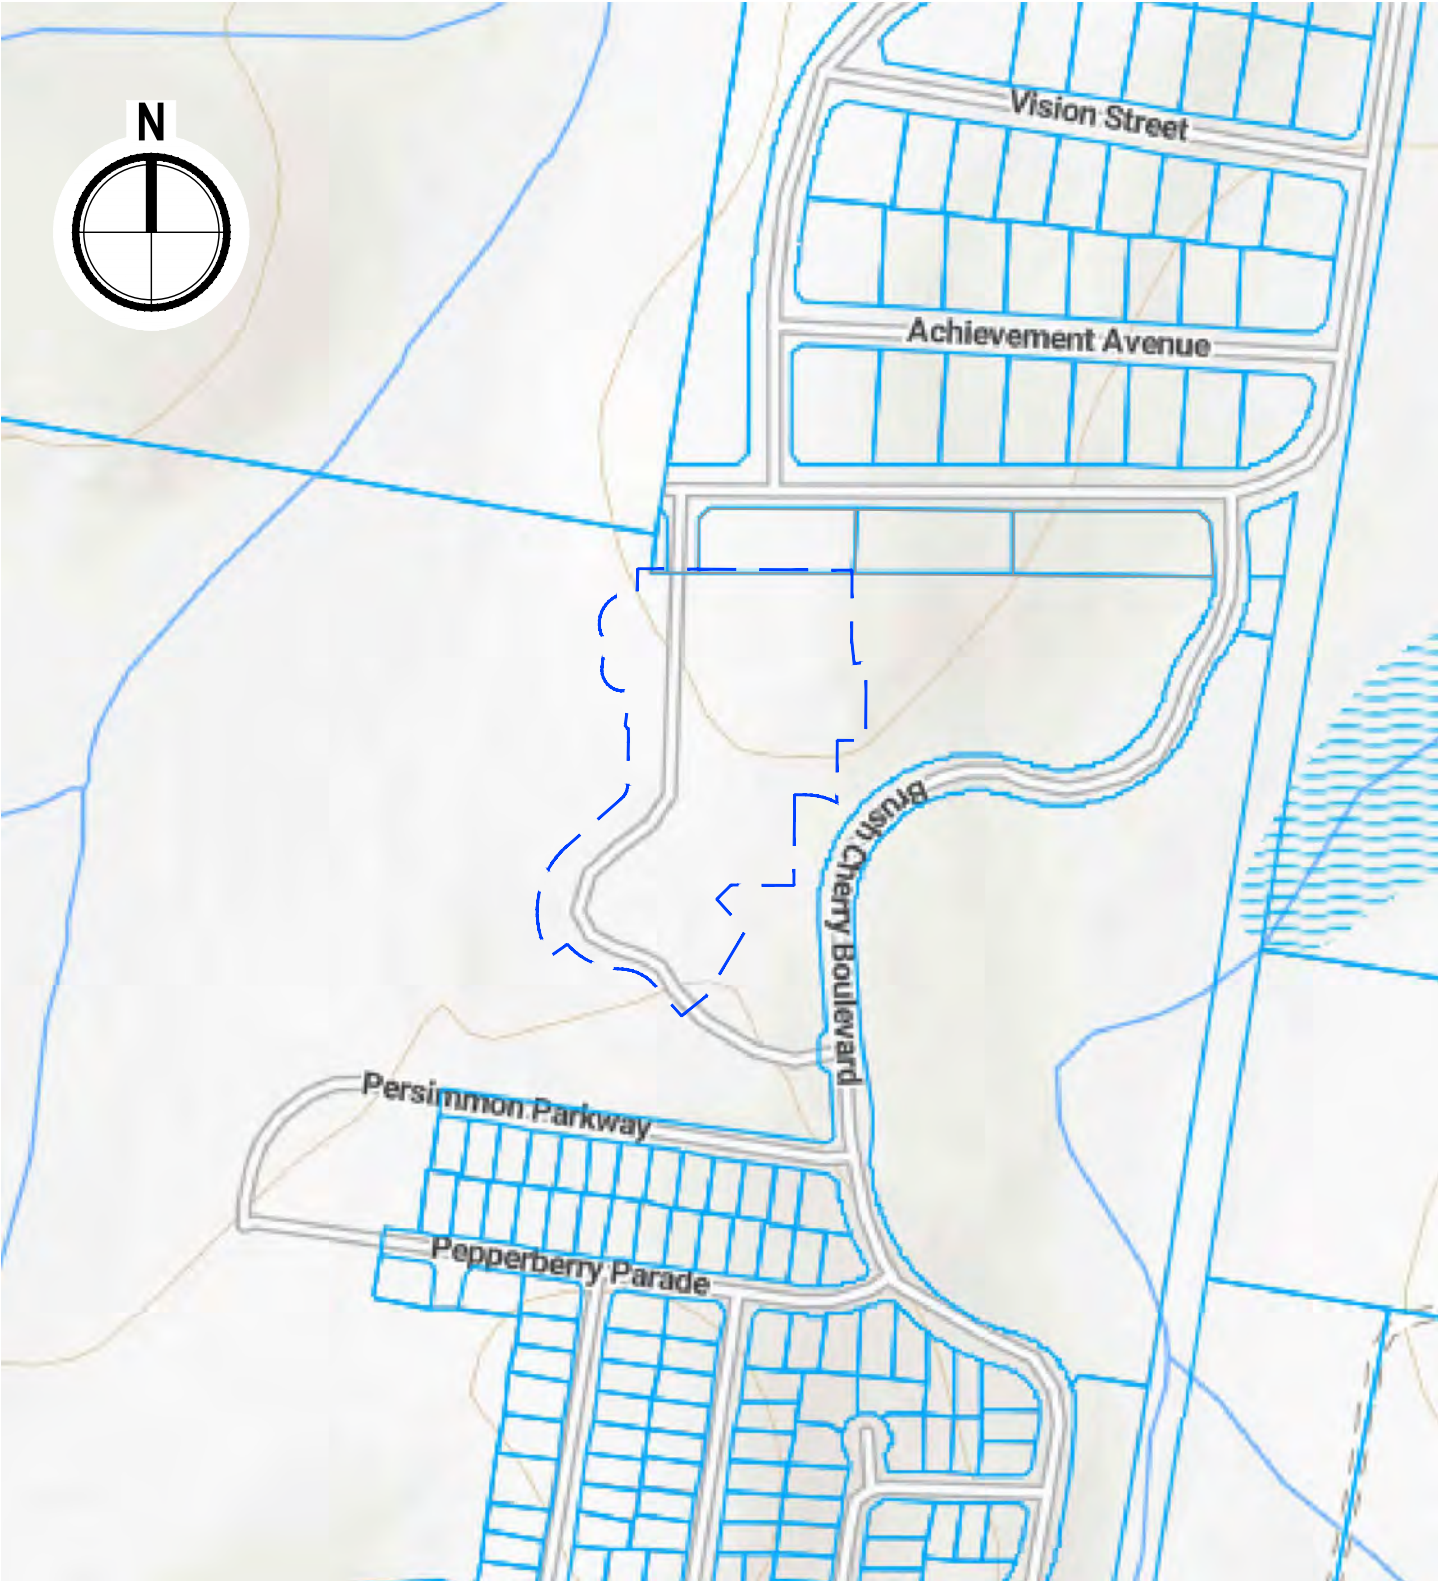

LOCALITY PLAN



prepared for

BIRD IN THE HAND 2 PTY LTD.

KING + CAMPBELL

1st Floor, Colonial Arcade
25-27 Hay Street
Port Macquarie NSW 2444

PO Box 243
Port Macquarie 2444

T: 02 6586 2555
F: 02 6583 4064

E: info@kingcampbell.com.au

NOT TO BE USED FOR CONSTRUCTION UNLESS CONSTRUCTION CERTIFICATE ISSUED FOR THE WORKS

K:\C-REF-01197_The Sanctuary\02_Engineering\Stages 8 and 9\2 STG 8 SWC\0107_Stage 8_SWC_Plan.dwg 4/11/2025 jamesc

CAUTION

1. UNDERGROUND SERVICES HAVE BEEN LOCATED TO A QUALITY OF CLASS C ONLY IN ACCORDANCE WITH AS5488.1-2019. THE CONTRACTOR IS RESPONSIBLE FOR INCREASING THE QUALITY TO CLASS A PRIOR TO CONSTRUCTION.

2. IT IS THE CONTRACTOR'S RESPONSIBILITY TO OBTAIN CURRENT INFORMATION WITH REGARD TO ALL UNDERGROUND SERVICES & TO LOCATE THEM PRIOR TO COMMENCEMENT OF CONSTRUCTION.

3. WHERE LOCATION IS CRITICAL TO THE DESIGN IT IS THE CONTRACTOR'S RESPONSIBILITY TO LOCATE AND LEVEL THE APPROPRIATE SERVICE PRIOR TO CONSTRUCTION

4. ANY DIFFERENCES WITH SERVICES SHOWN ON THE DESIGN ARE TO BE REFERRED TO THE SUPERINTENDENT.

GENERAL NOTES

- ALL WORK TO BE CARRIED OUT TO THE REQUIREMENTS AND SPECIFICATIONS OF AUS-SPEC DESIGN AND CONSTRUCTION GUIDELINES - PORT MACQUARIE HASTINGS COUNCIL VERSION.
- SUBSOIL DRAINAGE SHALL BE PROVIDED AS SHOWN ON THE PLAN, AS DIRECTED BY THE SUPERINTENDENT'S REPRESENTATIVE AND OTHERWISE GENERALLY WHERE THE SUBGRADE LEVEL IS MORE THAN 400mm BELOW NATURAL SURFACE LEVELS, AS PER D4.06 & ASD 305.
- PROVIDE TURFING TO A MINIMUM OF 900mm BEHIND KERB WHERE NOT SPECIFIED ON LANDSCAPING PLANS.
- ALL LANDSCAPING IS TO BE TO THE SATISFACTION OF THE LANDSCAPE ARCHITECT.
- ALL TRENCHING & CONDUIT WORK FOR ESSENTIAL ENERGY IS TO BE IN ACCORDANCE WITH THE ESSENTIAL ENERGY MANUAL FOR NON-ELECTRICAL WORKS REQUIREMENTS.
- PUBLIC LIGHTING TO BE IN ACCORDANCE WITH AS1158 - PUBLIC LIGHTING CODE.
- TRAFFIC CONTROL PLAN (IN ACCORDANCE WITH AS1742.3) TO BE PREPARED, SUBMITTED AND APPROVED BY COUNCIL PRIOR TO CONSTRUCTION.
- PROVIDE TACTILE INDICATORS ON FOOTPATHS ABOVE PRAM RAMPS IN ACCORDANCE WITH AS 1428.4.2002 AND AS SHOWN ON THIS PAGE.
- EXISTING ACCESS TO BE MAINTAINED DURING CONSTRUCTION.
- PERMISSION TO ENTER PROPERTIES TO BE SOUGHT FROM OWNERS BEFORE CONSTRUCTION WORK BEGINS.

STANDARD DOCUMENTS

MANAGING URBAN STORMWATER - SOILS & CONSTRUCTION VOL. 1.


AUS-SPEC - DESIGN & CONSTRUCTION PORT MACQUARIE HASTINGS COUNCIL VERSION.

PORT MACQUARIE HASTINGS COUNCIL STANDARD DRAWINGS.

APPLICABLE AUSTRALIAN STANDARDS AS MENTIONED IN THIS DRAWING SET.

WATER SUPPLY CODE OF AUSTRALIA WSA 03-2011

GRAVITY SEWERAGE CODE OF AUSTRALIA WSA 02-2014

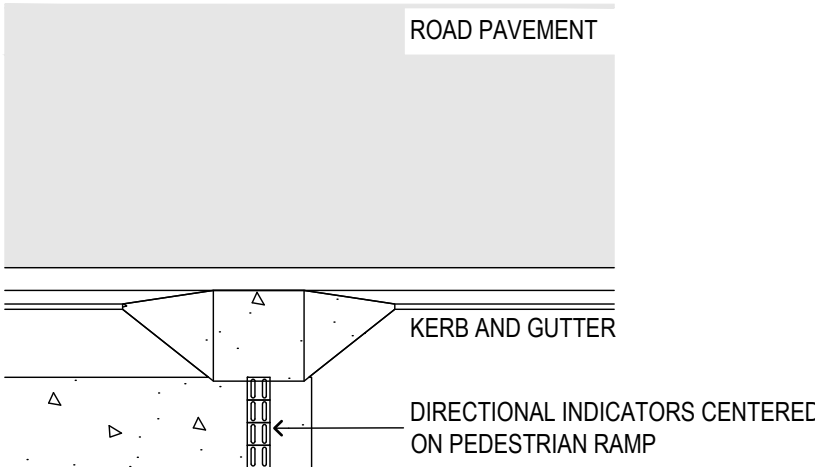

01 PEDESTRIAN RAMP DIRECTIONAL INDICATORS PLAN NTS

SITE REGRADING NOTES

- ALL SITE REGRADING IS TO BE CARRIED OUT IN ACCORDANCE WITH AUS-SPEC DESIGN SPEC D6.
- TOPSOIL TO BE STRIPPED, STOCKPILED AND TO BE USED ON SITE AS DIRECTED. NO TOPSOIL TO BE REMOVED FROM SITE.
- CUT AND FILL SITE, COMPACT FILL TO ACHIEVE A RELATIVE DENSITY IN ACCORDANCE WITH AS3798 GUIDELINES ON EARTHWORKS FOR COMMERCIAL AND RESIDENTIAL DEVELOPMENTS.
- ENSURE EROSION CONTROL AND FILTER FENCES MAINTAINED AT ALL TIMES.
- SUBSOIL DRAINAGE REQUIREMENTS ARE TO BE VERIFIED WITH THE GEOTECHNICAL ENGINEER PRIOR TO FILLING WORK COMMENCING.
- NO WORK TO COMMENCE UNTIL CONTRACTOR HAS DISCUSSED REQUIREMENTS WITH APPOINTED GEOTECHNICAL ENGINEER.

TREE PROTECTION NOTES

- ALL TREES RETAINED TO BE ADEQUATELY PROTECTED BY APPROPRIATE BARRIER FENCING CONSTRUCTED FROM STAR PICKETS AND FLUORESCENT FENCING AT ALL TIMES DURING CONSTRUCTION. THE BARRIER FENCING SHOULD EXTEND TO THE EXTENT OF THE DRIP LINE OF THE TREE WHERE PRACTICABLE.
- WHERE PRACTICABLE NO COMPACTION OF THE ROOTS IS TO BE PERMITTED DURING THE COURSE OF CONSTRUCTION.
- THE EXISTING LEVEL AT THE BASE OF THE TRUNK OF ALL THE LISTED TREES IS TO BE MAINTAINED FOR AT LEAST 1.5m FROM THE BASE OF THE TREES.
- THE REMOVAL OF ANY TREE IS TO FOLLOW THE RECOMMENDATIONS CONTAINED WITHIN THE ECOLOGICAL REPORT AND ASSOCIATED REVIEW OF ENVIRONMENTAL FACTORS. OFFSET PLANTING TO BE UNDERTAKEN IN ACCORDANCE WITH THE ECOLOGICAL REPORT.
- PRIOR TO ANY TREE REMOVAL PRE-CLEARING CHECKS ARE TO BE UNDERTAKEN BY A SUITABILITY QUALIFIED ECOLOGIST.

ABORIGINAL HERITAGE NOTES

- IF ABORIGINAL OBJECTS ARE UNCOVERED DURING GROUND SURFACE WORKS, ALL WORKS MUST CEASE AND HERITAGE NSW SHOULD BE CONTACTED TO DETERMINE A COURSE OF ACTION.
- IF SUSPECTED HUMAN REMAINS ARE FOUND, ALL WORK MUST CEASE, THE SITE SHOULD BE SECURED AND THE NSW POLICE NOTIFIED. NO FURTHER WORKS CAN BE UNDERTAKEN UNTIL THE NSW POLICE PROVIDE WRITTEN ADVICE. IF THE REMAINS ARE DEEMED TO REQUIRE ARCHAEOLOGICAL INVESTIGATION BY THE NSW POLICE OR NSW CORONER, THEN THE NSW HERITAGE AND THE RELEVANT ABORIGINAL PARTIES MUST BE NOTIFIED.
- AS PART OF ANY SITE INDUCTION, THE CONTACT TELEPHONE NUMBERS OF HERITAGE NSW REGIONAL ARCHAEOLOGIST AND ENVIRONMENTAL 131 555 SHOULD BE GIVEN TO ALL SITE WORKERS AND PERSONNEL. IN CASE UNKNOWN OBJECTS OR ITEMS ARE UNCOVERED DURING EXCAVATION.


GENERAL INFORMATION

THE NATIONAL PARKS AND WILDLIFE ACT 1974 (NPW ACT) PROTECTS ABORIGINAL OBJECTS AND ABORIGINAL PLACES IN NSW. IT HAS BEEN AMENDED BY THE NATIONAL PARKS AND WILDLIFE REGULATION 2009 (NPW REGULATION). UNDER THE NPW ACT, THE FOLLOWING ARE OFFENCES UNLESS AN EXEMPTION OR DEFENCE IS PROVIDED FOR UNDER THE ACT:

- A PERSON MUST NOT KNOWINGLY HARM OR DESECRATE AN ABORIGINAL OBJECT (KNOWING OFFENCE)
- A PERSON MUST NOT HARM OR DESECRATE AN ABORIGINAL OBJECT OR ABORIGINAL PLACE (STRICT LIABILITY OFFENCE)

HARM INCLUDES ACTS OR OMISSIONS THAT "DESTROY, DEFACE OR DAMAGE" AN ABORIGINAL OBJECT OR ABORIGINAL PLACE, AND IN RELATION TO AN OBJECT, MOVE THE OBJECT FROM THE LAND ON WHICH IT HAS BEEN SITUATED.

SECTION 91 OF THE ACT ALSO OBLIGES ANY PERSON WHO DISCOVERS AN ABORIGINAL OBJECT TO REPORT IT TO THE HERITAGE NSW FOR IT TO BE ENTERED ON THE ABORIGINAL HERITAGE INFORMATION MANAGEMENT SYSTEMS (AHIMS).

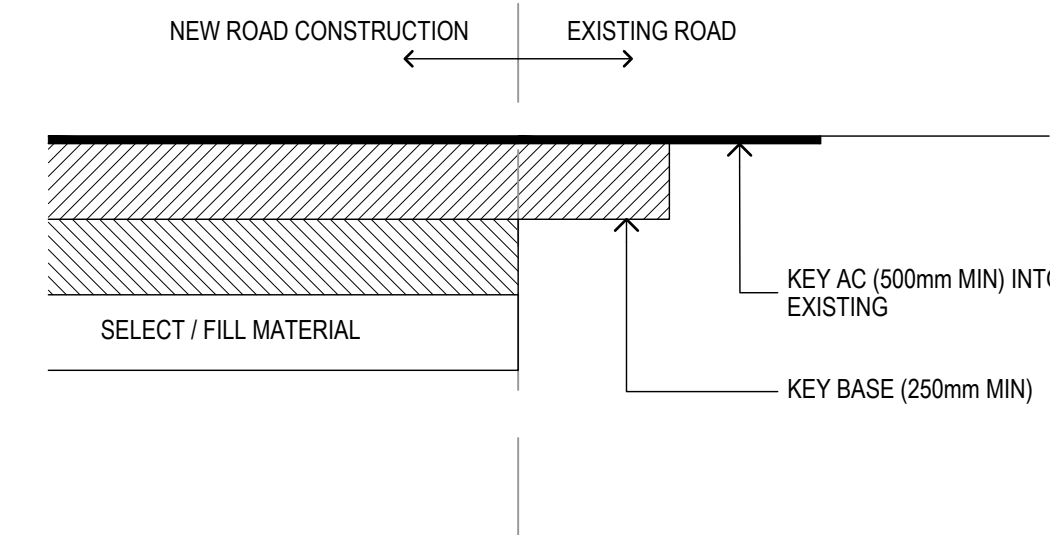

ROAD PAVEMENT TIE IN DETAIL NTS

SURVEY AND PRESERVATION OF SURVEY MARKS

- THE UNAUTHORISED REMOVAL, DISTURBANCE OR DESTRUCTION OF STATE SURVEY MARKS (FM, SSM, TS) OR BOUNDARY REFERENCE MARKS IS COSTLY TO THE COMMUNITY.
- SECTION 24(1) OF THE SURVEYING AND SPATIAL INFORMATION ACT 2020 STATES THAT A PERSON MUST NOT REMOVE, DAMAGE, DESTROY, DISPLACE, OBLITERATE OR DEFACE ANY SURVEY MARK UNLESS AUTHORISED TO DO SO BY THE SURVEYOR GENERAL. THERE ARE SIGNIFICANT PENALTIES IF MARKS ARE REMOVED WITHOUT APPROVAL.
- THERE ARE PROCEDURES IN PLACE IF A SURVEY MARK HAS TO BE REMOVED AND REPLACED. THE SURVEYOR GENERAL HAS GUIDELINES FOR THE REPLACEMENT OF SURVEY MARKS (SURVEYOR GENERAL'S DIRECTIONS NO. 11 PRESERVATION OF SURVEY INFRASTRUCTURE).
- THE CONTRACTOR SHALL CHECK SUSTAINABILITY OF THE STATED COORDINATES PRIOR TO THE COMMENCEMENT OF CONSTRUCTION
- ONLY ESTABLISHED STATE SURVEY MARKS ARE TO BE USED TO ESTABLISH HORIZONTAL AND HEIGHT CONTROL UNLESS THE MARK HAS BEEN APPROVED BY THE SUPERINTENDENT PRIOR TO CONSTRUCTION

WATER MAIN NOTES

- DESIGN AND CONSTRUCTION WORK TO BE CARRIED OUT IN ACCORDANCE WITH AUSPEC DEVELOPMENT DESIGN SPECIFICATION D11 - WATER RETICULATION AND DEVELOPMENT CONSTRUCTION SPECIFICATION C401 - WATER RETICULATION.
- PIPES ARE TO BE PVC-U, PVC-O OR PVC-M CLASS 12 TO AS 4020, AS 1477 SERIES 2, AS 4765 & AS 4441 AS APPROPRIATE, UNLESS SHOWN OTHERWISE ON PLANS - REFER TO ASD 402.
- ALL MAINS ARE TO BE LAID 1.0 METRE BEHIND THE KERB UNLESS OTHERWISE SHOWN ON THE PLANS.
- LOT CORNERS ARE TO BE MARKED BY THE SUPERVISING CONSULTANT TO ENSURE CORRECT LOCATION OF SERVICES.
- MINIMUM COVER IN FOOTPATH AREAS IS 450mm AND UNDER ROAD PAVEMENT AREAS AND IN EASEMENTS IS TO BE 600mm.
- ALL PIPES ARE TO BE LAID WITH CONTINUOUS 200mm PLASTIC MESH WITH COPPER OR STAINLESS STEEL TRACE WIRE FOR RADIO LOCATION.
- ALL FITTINGS ARE TO BE FBE COATED DUCTILE IRON TO AS2280 WITH FBE LINING.
- ALL BENDS, TEES, END CAPS, TAPERS AND VALVES ARE TO BE ANCHORED WITH THRUST BLOCKS - REFER TO ASD 432.
- HYDRANT FITTINGS CONSIST OF A HYDRANT TEE WITH SPRING HYDRANT TO AS 3952 AND SPACERS AS APPROPRIATE. HYDRANT FITTINGS ARE TO HAVE AN APPROVED THERMAL BONDED COATING - REFER TO ASD 440.
- STOP VALVES ARE TO BE RESILIENT SEATED AND HAVE AN APPROVED THERMAL BONDED COATING AND MANUFACTURED TO AS 2638. STOP VALVES SHALL BE CLOCKWISE CLOSING - REFER TO ASD 441.
- VALVE AND HYDRANT COVERS ARE TO IN ACCORDANCE WITH ASD 440 AND 441.
- MARKINGS ARE TO BE IN ACCORDANCE WITH ASD 460, ASD 461 & ASD 462.
- SERVICE CONNECTIONS ARE TO BE IN ACCORDANCE WITH ASD 450, ASD 451 & ASD 452.
- WHEREVER THERE IS A PAVEMENT OVER A WATER MAIN SERVICE TAPPING, A CAST IRON BOX (OR APPROVED EQUIVALENT) WILL BE REQUIRED.
- CONNECTION TO, ADJUSTMENT OF, OR RELOCATION OF EXISTING MAINS ARE TO BE ARRANGED WITH COUNCIL AT CONTRACTOR'S COST.
- WATER MAINS ARE TO BE DISINFECTED IN ACCORDANCE WITH DPW&S STANDARD PROCEDURES PRIOR TO BEING COMMISSIONED.
- THE CONTRACTOR MUST PLACE BENDS IN THE POSITIONS GENERALLY AS SHOWN ON THE PLANS AND NOT TO DELETE A BEND WITHOUT EXPRESS APPROVAL OF COUNCIL'S DEVELOPMENT SUPERVISOR.

WATER MAIN NOTES - PE PIPES

- WORK IS TO BE CARRIED OUT IN ACCORDANCE WITH THE POLYETHYLENE PIPE CODE WSA 01 - 1998, BY A CONTRACTOR TRAINED & ACCREDITED IN POLYETHYLENE PIPE INSTALLATION.
- POLYETHYLENE PIPES ARE TO BE TO AS 4130, TYPE 80B MATERIAL, PRESSURE CLASS PN 16 AND BLUE STRIPE BLACK PIPE.
- POLYETHYLENE PIPE FITTINGS ARE TO BE COMPRESSION OR ELECTROFUSION FITTINGS TO AS 4129(NT), TYPE 80B MATERIAL, PRESSURE CLASS PN 16 AND BLUE OR BLACK IN COLOUR.
- ALL PIPES SHALL BE EXAMINED FOR SURFACE DAMAGE IMMEDIATELY BEFORE INSTALLATION. PIPES WITH SCORES OR SCRATCHES DEEPER THAN 10% OF THE WALL THICKNESS SHALL BE REJECTED. WHERE POSSIBLE, A SINGLE LENGTH OF PIPE IS TO BE USED.
- ONLY PIPE MANUFACTURER SPECIFIED TOOLS AND MATERIALS ARE TO BE USED DURING THE JOINTING OPERATION.
- PE PIPES SHALL NOT BE CURVED TO A RADIUS LESS THAN 25 TIMES PIPE OD.

SEWER NOTES


- ALL WORK TO BE IN ACCORDANCE WITH THE REQUIREMENTS AND SPECIFICATIONS OF AUS-SPEC #1 SERIES NO. D12 & C402. REFER ALSO TO ASD 500 SERIES (COUNCIL STD DWGS) AND GRAVITY SEWERAGE CODE OF AUSTRALIA WSA 02-2014.
- MANHOLE NUMBERS TO BE PAINTED ON LIDS.
- JUNCTION PEGS 0.6M LONG MARKED "J" TO BE PLACED AT EACH JUNCTION CONSTRUCTED. REFER TO ASD 502.
- CONCRETE PROTECTION OTHER THAN SHOWN ON SECTIONS MAY BE REQUIRED FOR PROTECTION FROM TREE ROOTS, SHALLOW TRENCHES, STEEP GRADES, SCOURING, ETC AS DIRECTED BY THE SUPERVISING CONSULTANT.
- ALL PIPES ARE TO BE SEWERPRO, uPVC TYPE SN8 OR AS SPECIFIED ON PLANS AND SECTIONS.
- BOUNDARY CUT CHAINAGES ARE TO BE OBTAINED BY THE CONTRACTOR FROM THE SUPERVISING CONSULTANTS TO ENSURE CORRECT LOCATION OF HOUSE SERVICE JUNCTIONS.
- MANHOLE LIDS TO BE CONSTRUCTED TO A LEVEL ABOVE THE FINISHED SURFACE LEVEL IN ACCORDANCE WITH ASD 504 UNLESS OTHERWISE NOTED (75MM FOR NEW SUBDIVISION) AND GRADED PARALLEL TO SLOPE OF LAND AND INSTALLED IN ACCORDANCE WITH ASD 504.
- STEP IRONS ARE TO BE PROVIDED IN ALL MANHOLES DEEPER THAN 1.2M (MEASURED FROM THE TOP OF BENCHING TO GROUND LEVEL).
- WHERE MULTIPLE INVERT LEVELS ARE SHOWN AT MANHOLES THEY REFER TO INLET AND/OR OUTLET LEVELS RESPECTIVELY AT THE WALL OF THE MANHOLE.
- TRENCH STOPS ARE TO BE PROVIDED ON GRADES IN EXCESS OF 10%. REFER TO ASD 510.
- ALL CONCRETE TO BE MANUFACTURED FROM TYPE D CEMENT.
- ALL TRENCHES UNDER ROADWAYS TO BE FILLED WITH SAND.
- ALL JUNCTIONS ARE TO BE BROUGHT TO WITHIN 1.5 METRES FROM FINISHED SURFACE.
- SIDE LINES ARE TO BE 150mm EXTENSIONS CONSTRUCTED OFF AND AT THE LEVEL OF THE SEWER MAIN. WHERE RISERS ARE REQUIRED, THEY ARE TO BE LOCATED WITHIN THE PROPERTY SERVED. REFER TO ASD 501 & 502.
- CONNECTION TO COUNCIL'S SEWER IS TO BE CARRIED OUT UNDER COUNCIL SUPERVISION.
- GRADE IS CALCULATED FROM INSIDE FACE OF MANHOLES. DEPTH TO INVERT IS CALCULATED FROM TOP OF MANHOLE (75mm ABOVE FINISHED SURFACE R.L.) ENSURE MANHOLES ARE CONSTRUCTED TO LEVELS AS SHOWN.
- A CCTV INSPECTION OF ALL NEW AND MODIFIED SEWER INFRASTRUCTURE IS TO BE UNDERTAKEN IN ACCORDANCE WITH CONDUIT INSPECTION REPORTING CODE OF AUSTRALIA (WSA05) BY SUITABLY QUALIFIED PERSON.

STORMWATER NOTES

- ALL STORMWATER PITS ARE TO INCLUDE 3m OF SUBSOIL DRAINAGE TO BE INSTALLED ON THE UPSTREAM SIDE OF ALL DRAINAGE PITS WITH AN UPSTREAM PIPE. THE UPSTREAM PIPE IS TO BE SEALED AND ENCLOSED IN A SEAMLESS TUBULAR FILTER FABRIC IN ACCORDANCE WITH "AUSPEC".
- PIT SIZES ARE TO BE AS SET OUT IN THE SCHEDULE AND ARE TO BE IN ACCORDANCE WITH AS 3500 AND "AUSPEC".
- PIT GRATES ARE TO BE SUITABLE FOR TRAFFIC LOADING WHERE APPLICABLE & TO CONFORM TO SURFACE CROSSFALLS.
- MAIN STORMWATER LINES ARE TO BE AS SHOWN ON THE LONGITUDINAL SECTIONS.
- FOR STORMWATER PIPE SIZE & CLASS SEE STORMWATER LONGITUDINAL SECTIONS. STORMWATER MAIN LINES PIPE TO BE STORMPRO OR EQUIVALENT CONCRETE PIPE. STORMWATER INTERALLOTMENT AND PROPERTY CONNECTIONS TO BE uPVC OR STORMPRO.
- CHANNELISE THE BASE OF PITS CONTAINING PIPES 525mm OR GREATER.
- ALL HEADWALLS TO HAVE RIPRAP OUTLET PROTECTION TO ASD 306/307

STORMWATER SUPPORT DETAIL

- FOR CLEARANCES LESS THAN 1m BETWEEN A SEWER / WATER PIPE UNDER A 375mm STORMWATER PIPE OR GREATER, BRIDGING IS REQUIRED
- THE BRIDGED SEWER / WATER PIPE IS TO BE WRAPPED IN COMPRESSIBLE MEMBRANE WITH SUPPORTS
- CONCRETE PIERS LENGTH TO BE 250mm BEYOND EACH SIDE OF PIPE BEING SUPPORTED (IE PIPE O.D. + 500mm)

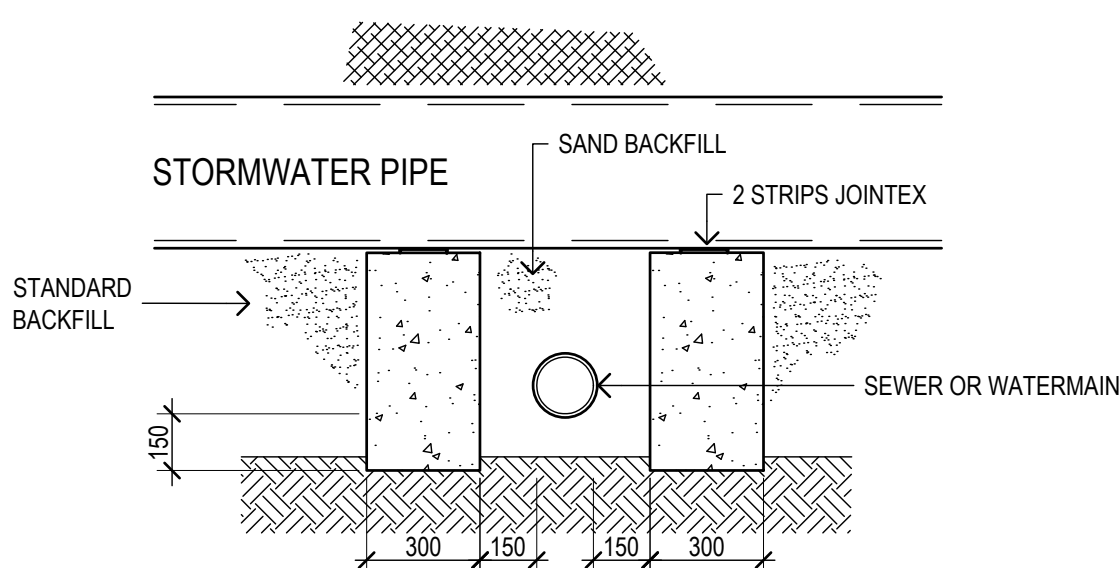

02 STORMWATER SUPPORT DETAIL SECTION NTS

WORK AS EXECUTED INFORMATION

THIS INFORMATION IS TO BE FORWARDED TO KING & CAMPBELL PTY LTD UPON COMPLETION OF SEWER & DRAINAGE WORKS.

SEWER

- A MARKER IS TO BE PLACED DIRECTLY ABOVE ALL SEWER DEAD ENDS (AT GROUND LEVEL), WITH A DISTANCE DOWN TO THE INVERT OF THE PIPE.
- THE DISTANCE FROM THE DOWNSTREAM MANHOLE, A DEPTH BELOW FINISHED SURFACE AND A LENGTH OF PIPE FOR ALL SEWER SIDELINES AND JUNCTIONS IS TO BE WRITTEN ON A COPY OF THE FINAL ENGINEERING PLANS. IT SHOULD ALSO BE INDICATED WHETHER THE SIDELINE IS AT 45° OR 90° TO THE MAIN SEWER LINE.
- IT MUST BE INDICATED IF A RISER HAS BEEN USED.

INTERLOT DRAINAGE

- A MARKER IS TO BE PLACED DIRECTLY ABOVE ALL INTERLOT DRAINAGE DEAD ENDS (AT GROUND LEVEL), WITH A DISTANCE DOWN TO THE INVERT OF THE PIPE.
- THE DISTANCE FROM THE DOWNSTREAM PIT AND A DEPTH BELOW FINISHED SURFACE OF ALL INTERLOT DRAINAGE JUNCTIONS IS TO BE WRITTEN ON A COPY OF THE FINAL ENGINEERING PLANS. IT SHOULD ALSO BE INDICATED WHETHER THE JUNCTION IS AT 45° OR 90° TO THE MAIN DRAINAGE LINE.

STORMWATER

- A CCTV INSPECTION OF ALL NEW AND MODIFIED STORMWATER INFRASTRUCTURE IS TO BE UNDERTAKEN IN ACCORDANCE WITH CONDUIT INSPECTION REPORTING CODE OF AUSTRALIA (WSA05) BY SUITABLY QUALIFIED PERSON.
- INSPECTION TO BE PROVIDED TO COUNCIL PRIOR TO ACCEPTANCE OF WORKS INTO THE NOMINATED 'INTO MAINTENANCE PERIOD'.



THIS DRAWING INCLUDES INFORMATION IN COLOUR. IF YOU HAVE A BLACK AND WHITE COPY YOU DON'T HAVE ALL THE INFORMATION. THIS NOTE IS COLOURED RED.

REV.	DATE	DESCRIPTION	
A	31.10.2025	ISSUED FOR APPROVAL	JSC

DATUM:

SCALE:

PROJECT NO:	7197
DA NO.:	2014-114
DESIGNED BY:	JSC/BC
DRAWN BY:	JSC
CHECKED BY:	BC
DATE CREATED:	JULY 2025

DRAWING TITLE:	ENGINEERING NOTES
PROJECT:	THE SANCTUARY STAGE 8 LOT 300, DP 1307775 - JOHN OXLEY DRIVE, THURMSTER
CLIENT:	BIRD IN THE HAND 2 PTY LTD.

DRAWING NO:	SHEET:	REVISION:
7197_Stage 8_SWC_Plan	01 OF 36	A

NOT TO BE USED FOR CONSTRUCTION UNLESS SUBDIVISION WORKS CERTIFICATE ISSUED FOR THE WORKS



KING + CAMPBELL

[illegible]

PROJECT NO:	7197
DA NO.:	2014-114
DESIGNED BY:	JSC/BC
DRAWN BY:	JSC
CHECKED BY:	BC
DATE CREATED:	JULY 2025

DRAWING NO:	SHEET:	REVISION
7197_Stage 8_SWC_Plan	02 OF 36	B

CAUTION:
NO WORKS TO BE UNDERTAKEN WITHIN BIODIVERSITY CERTIFICATION AGREEMENT LAND.
NO PERSON IS TO ENTER THE BIODIVERSITY CERTIFICATION AGREEMENT LAND WITHOUT
SPECIFIC APPROVAL OF THE SUPERINTENDENT.

THIS DRAWING INCLUDES INFORMATION IN COLOUR. IF YOU HAVE A BLACK AND WHITE COPY YOU DON'T HAVE ALL THE INFORMATION. THIS NOTE IS COLOURED RED

NOT TO BE USED FOR CONSTRUCTION UNLESS SUBDIVISION WORKS CERTIFICATE ISSUED FOR THE WORKS

K:\C-REF-01797_The Sanctuary\02_Engineering\Stages 8 and 9\2 STG 8 SWC\2107_Stage 8_SWC_Plan.dwg 4/11/2025 10:05:25 AM

K:\C-REF-01797_The Sanctuary\02_Engineering\Stages 8 and 9\2 STG 8 SWC\2107_Stage 8_SWC_Plan.dwg 4/11/2025 10:05:25 AM

ORIGIN OF LEVELS: PM 74301 RL 10.845 AHD & ELVIS (ELEVATION & DEPTH FOUNDATION SPATIAL DATA)



- LEGEND**
- EXISTING BOUNDARY
 - PROPOSED STAGE 8 BOUNDARY
 - STAGE 8 EXTENT OF WORKS & SITE EXCLUSION FENCING
 - EXISTING BIODIVERSITY CERTIFICATION BOUNDARY (PLOTTED FROM PDF)
 - CUT & FILL CONTOURS (0.5m INTERVALS)
 - PROPOSED STORMWATER LINE WITH PIT & HEADWALL
 - EXISTING GRAVITY SEWER LINE WITH MANHOLE
 - PROPOSED MULCH BUND TO BE CONSTRUCTED AND MAINTAINED TO AUS-SPEC D7 & C211
 - EXISTING MULCH BUND TO BE INSPECTED AND MAINTAINED TO AUS-SPEC D7 & C211
 - KOALA FOOD TREE (TPZ) (K&C SURVEY JANUARY TO MARCH 2025)

- NOTES**
- STRIP TOPSOIL WITHIN DEVELOPMENT FOOTPRINT, STOCKPILE AND RESPREAD FOLLOWING EARTHWORKS TO DESIGN LEVELS.
 - ENSURE THAT ANY IMPORTED FILL IS EITHER VIRGIN EXCAVATED NATURAL MATERIAL (VENM) OR EXCAVATED NATURAL MATERIAL (ENM). CERTIFICATION IS TO BE PROVIDED TO COUNCIL.
 - MULCH BUNDS / SEDIMENT FENCES ARE TO BE MAINTAINED UNTIL GROUND COVER IS RE-ESTABLISHED.

SEDIMENT BASIN SIZING NOTES

SIZING OF THE SEDIMENT BASINS HAS BEEN UNDERTAKEN IN ACCORDANCE WITH CHAPTER 6.3 OF MANAGING URBAN STORMWATER - SOILS & CONSTRUCTION VOL.1, WITH THE FOLLOWING PARAMETERS USED:

- SOIL TYPE: F - REFER TO RGS GEOTECHNICAL REPORT No. RGS21087.1-AL;
- 5 DAY, 75th PERCENTILE DESIGN RAINFALL DEPTH: 32mm;
- SOIL HYDROLOGIC GROUP: C - MODERATE TO HIGH RUNOFF POTENTIAL;
- RAINFALL EROSIONIVITY R-FACTOR: 4250;
- SOIL ERODIBILITY K-FACTOR: 0.044 - KUNDABUNG SOIL LANDSCAPE;
- SLOPE LENGTH LS-FACTOR: 0.65 (SOUTH), 1.19 (NORTH);
- EROSION CONTROL PRACTICE P-FACTOR: 1.3 - COMPACTED AND SMOOTH SURFACE;
- GROUND COVER AND MANAGEMENT C-FACTOR: 1.0 - ALL GRASS COVER REMOVED;
- REQUIRED SOUTH SEDIMENT BASIN VOLUME = 300 m³;
- REQUIRED NORTH SEDIMENT BASIN VOLUME = 200 m³;
- REQUIRED SEDIMENT BASIN VOLUME < FOOTPRINT OF PROPOSED BIORETENTION BASINS. SEDIMENT BASINS TO BE SHAPED TO ULTIMATE BIORETENTION BASIN FOOTPRINT.

CUT AND FILL LEGEND

From	To	Colour	
-3	-2.5	rgb(204,112,112)	CUT
-2.5	-2	rgb(204,120,120)	
-2	-1.5	rgb(204,128,128)	
-1.5	-1	rgb(204,136,136)	
-1	-0.5	rgb(204,144,144)	
-0.5	0	rgb(204,152,152)	FILL
0	0.5	rgb(152,204,152)	
0.5	1	rgb(144,204,144)	
1	1.5	rgb(136,204,136)	
1.5	2	rgb(128,204,128)	
2	2.5	rgb(120,204,120)	
2.5	3	rgb(112,204,112)	
3	3.5	rgb(104,204,104)	

CAUTION:
NO WORKS TO BE UNDERTAKEN WITHIN BIODIVERSITY CERTIFICATION AGREEMENT LAND.
NO PERSON IS TO ENTER THE BIODIVERSITY CERTIFICATION AGREEMENT LAND WITHOUT SPECIFIC APPROVAL OF THE SUPERINTENDENT.



THIS DRAWING INCLUDES INFORMATION IN COLOUR. IF YOU HAVE A BLACK AND WHITE COPY YOU DON'T HAVE ALL THE INFORMATION. THIS NOTE IS COLOURED RED.

KING + CAMPBELL

King & Campbell Pty Ltd
www.kingcampbell.com.au
A: PO Box 243 Port Macquarie NSW 2444
T: 02 6586 2555
F: 02 6583 4064
E: info@kingcampbell.com.au

REV.	DATE	DESCRIPTION	BY
A	31.10.2025	ISSUED FOR APPROVAL	JSC

DATUM: AHD
SCALE: 1:500 @ A1
(1:1000 @ A3)


NOTE: DO NOT SCALE OFF DRAWINGS. USE FIGURED DIMENSIONS ONLY. REPORT ANY DISCREPANCIES TO THE AUTHOR. THIS DRAWING BEING THE PROPERTY OF KING & CAMPBELL PTY LTD, IS PROTECTED BY COPYRIGHT AND MUST NOT BE USED, REPRODUCED OR COPIED WHOLLY, OR IN PART WITHOUT THE WRITTEN PERMISSION OF KING & CAMPBELL PTY LTD.


© King & Campbell Pty Ltd

PROJECT NO:	7197	DRAWING TITLE:	EARTHWORKS CUT AND FILL AND EROSION & SEDIMENT CONTROL PLAN
DA NO.:	2014-114	PROJECT:	THE SANCTUARY STAGE 8 LOT 300, DP 1307775 - JOHN OXLEY DRIVE, THURMSTER
DESIGNED BY:	JSC/BC	CLIENT:	BIRD IN THE HAND 2 PTY LTD.
DRAWN BY:	JSC	DRAWING NO.:	7197_Stage 8_SWC_Plan
CHECKED BY:	BC	SHEET:	03 OF 36
DATE CREATED:	JULY 2025	REVISION:	A

NOT TO BE USED FOR CONSTRUCTION UNLESS SUBDIVISION WORKS CERTIFICATE ISSUED FOR THE WORKS

A1



- | LEGEND | |
|---|--|
| | EXISTING BOUNDARY |
| | PROPOSED STAGE 8 BOUNDARY |
|  | STAGE 8 EXTENT OF WORKS & SITE EXCLUSION FENCING |
|  | EXISTING BIODIVERSITY CERTIFICATION BOUNDARY (PLOTTED FROM PDF) |
|  | ASSET PROTECTION ZONE BOUNDARY |
|  | DESIGN SURFACE CONTOURS (0.5m INTERVALS) |
|  | PROPOSED STORMWATER LINE WITH PIT, JUNCTION & HEADWALL |
|  | PROPOSED STORMWATER PIT LABELS |
|  | EXISTING / PROPOSED GRAVITY SEWER LINE WITH MANHOLE & INSPECTION SHAFT |
|  | EXISTING / PROPOSED WATER HYDRANT, STOP VALVE, BEND AND TEE |
|  | PROPOSED ROAD |
|  | PROPOSED FOOTPATH |
|  | PROPOSED ROCK RIPRAP SCOUR PROTECTION |
|  | KOALA FOOD TREE (TPZ) (K&C SURVEY JANUARY TO MARCH 2025) |
|  | PROPOSED STREET TREE - REFER TO SHEET 34 FOR DETAILS |
|  | PROPOSED STREET NAME SIGN |

NOTES

1. REFER TO SHEET 01 FOR CONSTRUCTION NOTES.
2. REFER TO SHEET 33 FOR FENCING AND LANDSCAPING DETAILS.
3. ROAD SUBSOIL DRAINAGE TO BE INSTALLED IN ACCORDANCE WITH ASD 307 BEHIND ALL KERBS EXCEPT IN LOCATIONS WHERE STORMWATER PIPELINE IS PROPOSED.
4. REFER TO SHEETS 06 & 07 FOR STORMWATER BASIN PLAN & DETAILS.
5. REFER TO SHEETS 26 TO 28 FOR STORMWATER LONGITUDINAL SECTIONS.
6. REFER TO SHEET 25 FOR STORMWATER CATCHMENT PLAN.
7. STORMWATER PIT 4-2 TO BE A SEALED JUNCTION PIT TO ALLOW 225 mm Ø PIPE TO CROSS THROUGH PUBLIC LAND.

STORMWATER PIT SCHEDULE

NO.	ROAD	CH.	TYPE	MINIMUM INTERNAL SIZE	NOTES
01-1	ROAD 11	106.56	Grated Gully Pit 1.8m Lintel	750 x 900	
01-2	ROAD 11	125.83	Grate Only Gully Pit	628 x 900	
01-3	ROAD 11	150.20	Grated Gully Pit 1.8m Lintel	750 x 900	
01-4	ROAD 11	165.98	Grated Gully Pit 1.8m Lintel	900 x 900	
01-5	ROAD 11	180.75	Grate Only Gully Pit	900 x 900	
01-6	ROAD 11	196.23	Grated Gully Pit 1.8m Lintel	900 x 900	
01-7			Headwall		450mm Pipe
02-1	ROAD 11	196.20	Grated Gully Pit 3.0m Lintel	750 x 900	
03-3			Junction Pit 0.9m x 0.9m	900 x 900	
04-1			Flush Grate Surface Inlet Pit 0.9m x 0.9m	900 x 900	
04-2			Junction Pit 0.9m x 0.9m	900 x 900	
04-3	ROAD 12	56.95	Grated Gully Pit 1.8m Lintel	750 x 900	
04-4	ROAD 12	49.33	Grated Gully Pit 1.8m Lintel	750 x 900	
04-5	ROAD 12	33.33	Grate Only Gully Pit	628 x 900	
04-6	ROAD 12	10.29	Grated Gully Pit 1.8m Lintel	750 x 900	
04-7	ROAD 11	238.89	Grate Only Gully Pit	900 x 900	
04-8	ROAD 11	229.80	Grated Gully Pit 1.8m Lintel	900 x 900	
04-9			Headwall		525mm Pipe
05-1	ROAD 11	287.00	Grated Gully Pit 1.8m Lintel	750 x 900	
05-2	ROAD 11	282.96	Grated Gully Pit 1.8m Lintel	750 x 900	
05-3	ROAD 11	259.15	Grated Gully Pit 1.8m Lintel	750 x 900	
06-1	ROAD 12	16.42	Grated Gully Pit 1.8m Lintel	750 x 900	
07-1			Flush Grate Surface Inlet Pit 0.9m x 0.9m	900 x 900	
07-2			Flush Grate Surface Inlet Pit 0.9m x 0.9m	900 x 900	
07-3			Flush Grate Surface Inlet Pit 0.9m x 0.9m	900 x 900	
07-4			Junction Pit 0.9m x 0.9m	900 x 900	
07-5			Junction Pit 0.9m x 0.9m	900 x 900	
08-1	ROAD 13	78.52	Grated Gully Pit 1.8m Lintel	750 x 900	
08-2	ROAD 13	46.11	Grated Gully Pit 1.8m Lintel	750 x 900	
08-3	ROAD 13	43.34	Grated Gully Pit 1.8m Lintel	900 x 900	
08-4	ROAD 13	13.76	Grated Gully Pit 1.8m Lintel	750 x 900	
08-5			Headwall		375mm Pipe
09-1	ROAD 11	369.68	Grated Gully Pit 1.8m Lintel	750 x 900	
09-2	ROAD 11	350.74	Grate Only Gully Pit	628 x 900	
09-3	ROAD 11	338.49	Grated Gully Pit 1.8m Lintel	750 x 900	
09-4	ROAD 11	336.00	Grated Gully Pit 1.8m Lintel	750 x 900	
09-5	ROAD 11	333.84	Headwall		375mm Pipe
10-1	ROAD 13	15.64	Grated Gully Pit 1.8m Lintel	750 x 900	
11-1			Junction Pit 0.9m x 0.9m	900 x 900	
11-2			Headwall		375mm Pipe
12-1			Dome Grate Field Inlet Pit 0.9m x 0.9m	900 x 900	
12-2			Headwall		375mm Pipe

STAGE 8 EASEMENTS

- | | |
|-----|---|
| (A) | PROPOSED EASEMENT TO DRAIN WATER MINIMUM 1.5m WIDE |
| (B) | PROPOSED EASEMENT TO DRAIN SEWAGE MINIMUM 2.5m WIDE |
| (C) | PROPOSED EASEMENT TO DRAIN WATER VARIABLE WIDTH
(BENEFITING COUNCIL) |

King & Campbell Pty Ltd
www.kingcampbell.com.au
A: PO Box 243 Port Macquarie NSW 2444
T: 02 6586 2555
F: 02 6583 4064
E: info@kingcampbell.com.au

[illegible]

DATUM: AHD

SCALE: 1:500 @ A1
(1:1000 @ A3)

NOTE: DO NOT SCALE OFF DRAWINGS. USE FIGURED DIMENSIONS ONLY. REPORT ANY DISCREPANCIES TO THE AUTHOR. THIS DRAWING, BEING THE PROPERTY OF KING & CAMPBELL PTY LTD, IS PROTECTED BY COPYRIGHT AND MUST NOT BE USED, REPRODUCED OR COPIED WHOLLY, OR IN PART WITHOUT THE WRITTEN PERMISSION OF KING & CAMPBELL PTY LTD.





















© King & Campbell Pty Ltd

PROJECT NO:	7197
DA NO.:	2014-114
DESIGNED BY:	JSC/BC
DRAWN BY:	JSC
CHECKED BY:	BC
DATE CREATED:	JULY 2025


DRAWING TITLE:	GENERAL LAYOUT & DRAINAGE PLAN			A1
PROJECT:	THE SANCTUARY STAGE 8 LOT 300, DP 1307775 - JOHN OXLEY DRIVE, THURMSTER			
CLIENT:	BIRD IN THE HAND 2 PTY LTD.	DRAWING NO:	SHEET:	REVISION:
		7197 Stage 8 SWC Plan	04 OF 36	B

THIS DRAWING INCLUDES INFORMATION IN COLOUR. IF YOU HAVE A BLACK AND WHITE COPY YOU DON'T HAVE ALL THE INFORMATION. THIS NOTE IS COLOURED RED.

NOT TO BE USED FOR CONSTRUCTION UNLESS SUBDIVISION WORKS CERTIFICATE ISSUED FOR THE WORKS

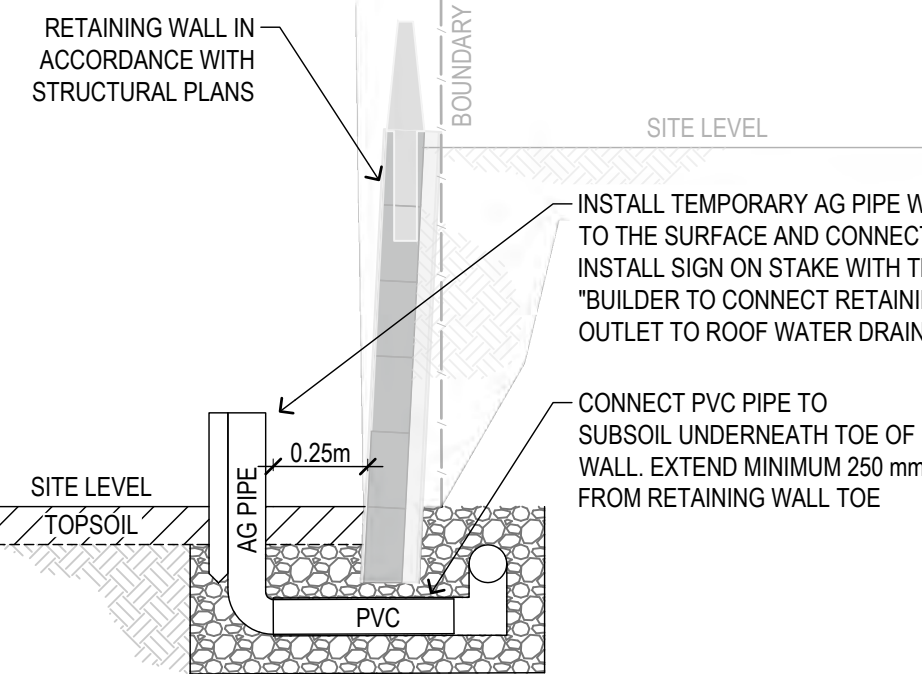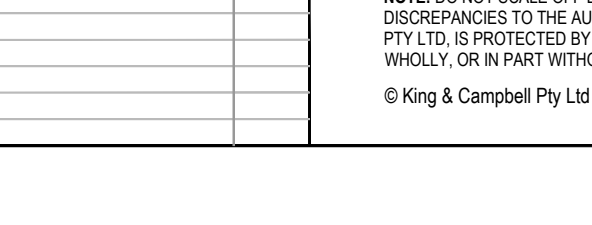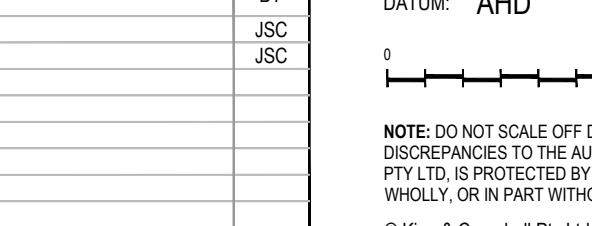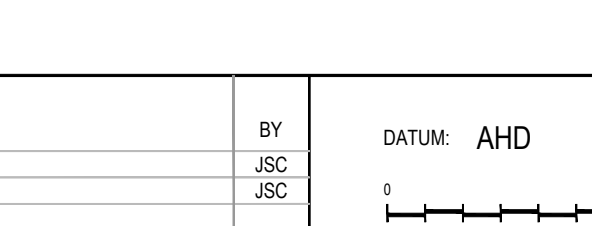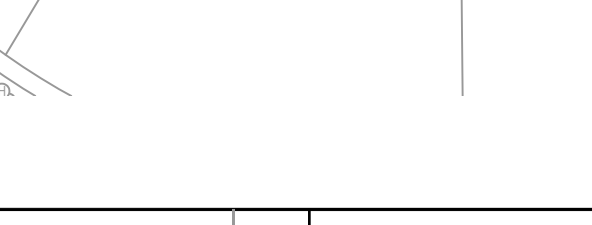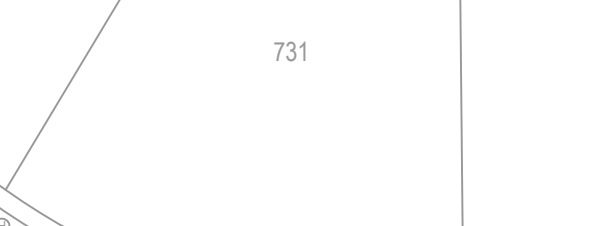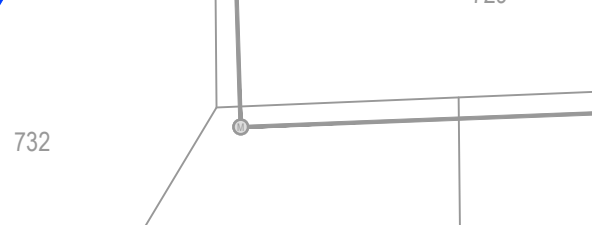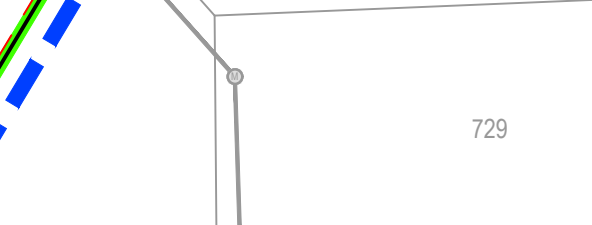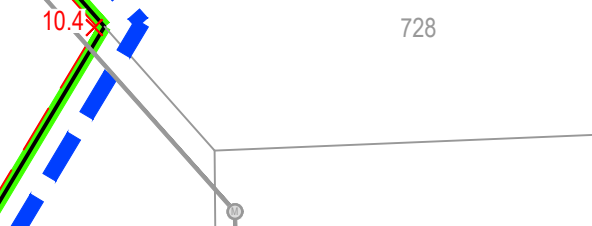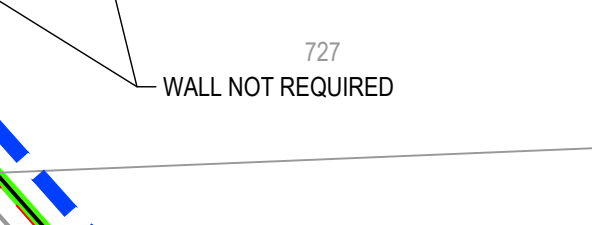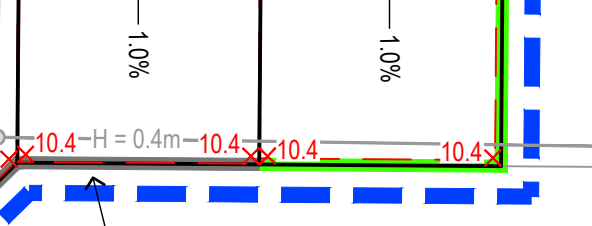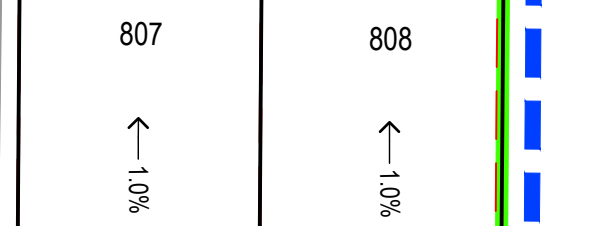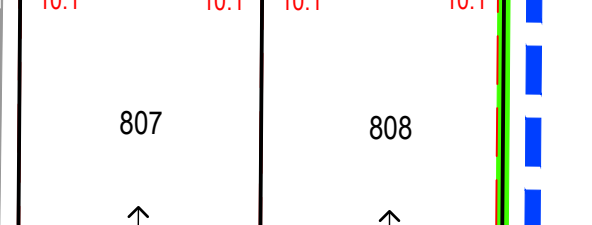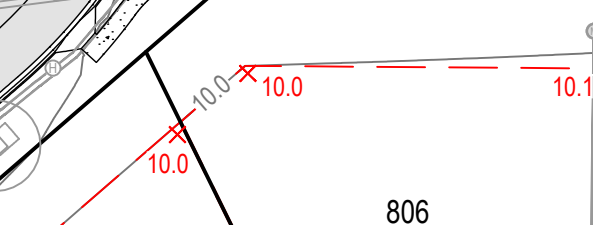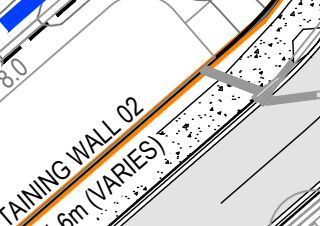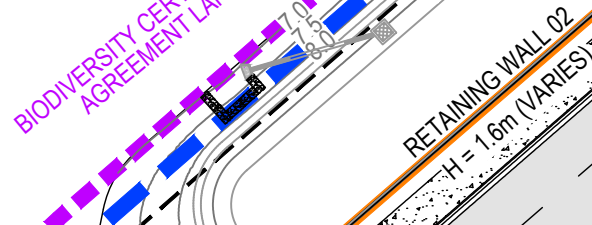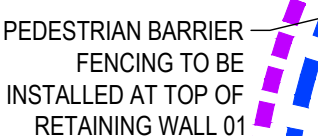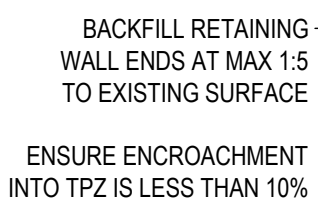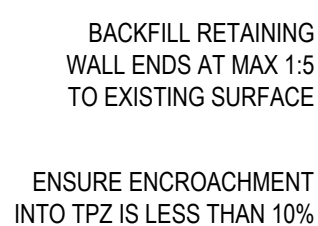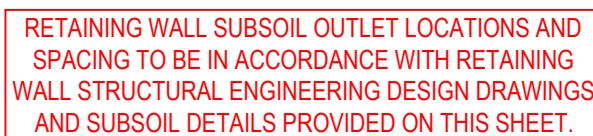


TYPICAL RETAINING WALL SUBSOIL STAKE DETAIL

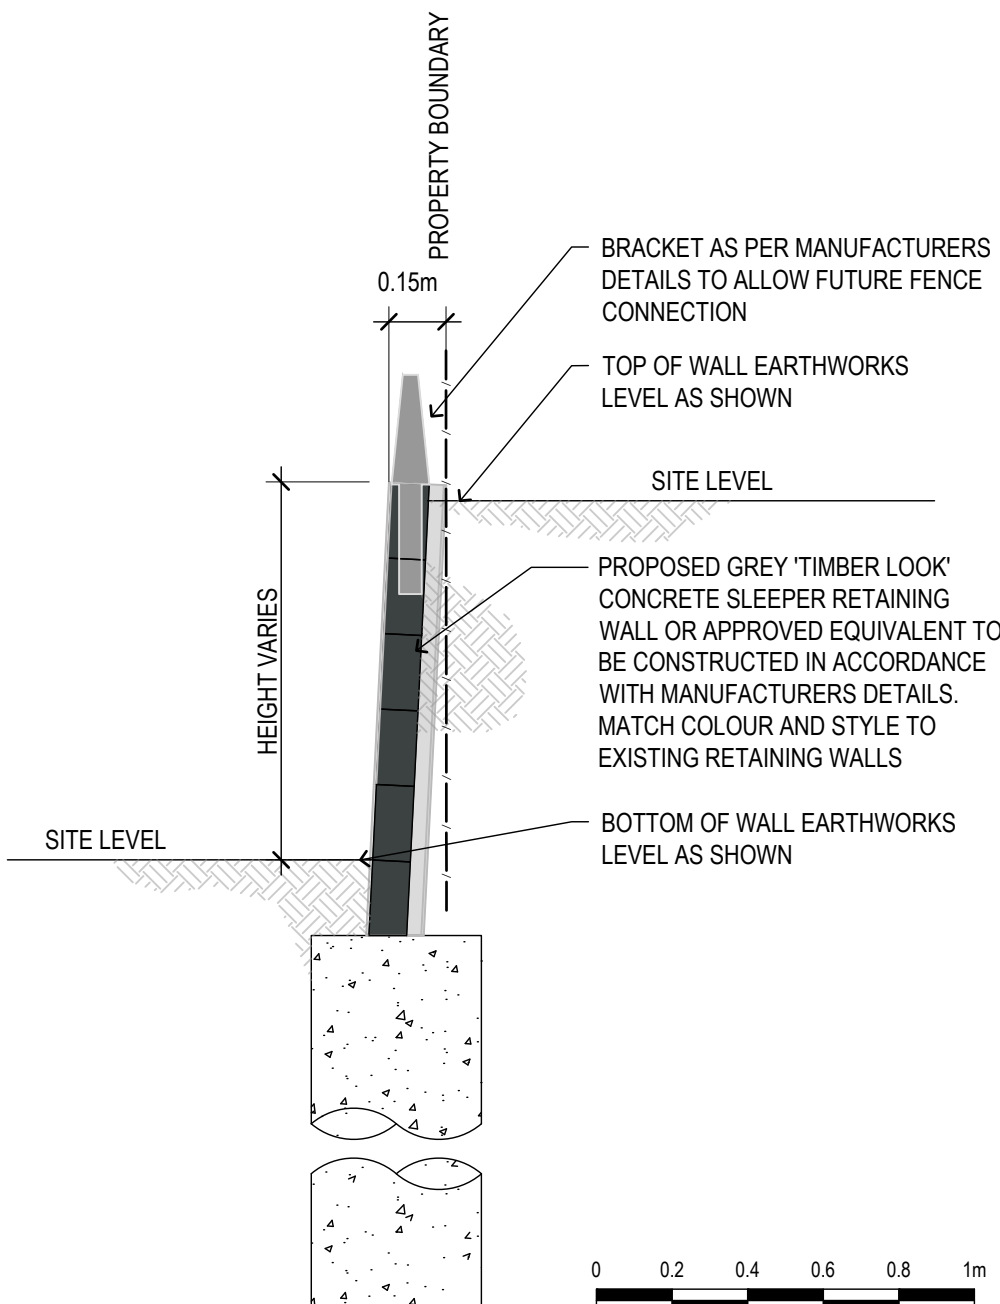

TYPICAL RETAINING WALL DETAIL

- ## NOTES
1. EXISTING RETAINING WALL LEVELS ADOPTED FROM B&K PLAN SET DATED 20 OCTOBER 2024.
 2. CONCRETE SLEEPER RETAINING WALLS TO BE GREY WITH THE TIMBER TEXTURE TO MATCH ADJACENT SUBDIVISION WORKS.
 3. RETAINING WALLS TO CONTINUE BEYOND THE EARTHWORKS PAD EXTENT TOWARD THE ROADWAY TO A LENGTH THAT ALLOWS GRADES EITHER SIDE TO BE +25%.
 4. RETAINING WALL DESIGN AND CERTIFICATION TO BE COMPLETED BY A SUITABLY QUALIFIED STRUCTURAL ENGINEER IN ACCORDANCE WITH PORT MACQUARIE HASTINGS COUNCIL AUSPEC. DESIGN TO BE PROVIDED AND APPROVED BY THE PRINCIPAL PRIOR TO CONSTRUCTION COMMENCING. STRUCTURAL ENGINEER TO PROVIDE AS BUILT CERTIFICATION ON COMPLETION OF THE WORKS.
 5. ALL AREAS WITHIN APZ ZONE ARE TO BE GRADED SUCH THAT THE SURFACE IS SUITABLE FOR MOWING AND MAINTENANCE.

- | LEGEND | |
|---|--|
|  | EXISTING BOUNDARY |
|  | PROPOSED STAGE 8 BOUNDARY |
|  | STAGE 8 EXTENT OF WORKS & SITE EXCLUSION FENCING |
|  | EXISTING BIODIVERSITY CERTIFICATION BOUNDARY (PLOTTED FROM PDF) |
|  | ASSET PROTECTION ZONE BOUNDARY |
|  | EXISTING STAGE 7 RETAINING WALL |
|  | PROPOSED CONCRETE SLEEPER RETAINING WALL |
|  | PROPOSED EARTHWORKS BATTER (0.2m HIGH, 25% MAXIMUM) |
|  | DESIGN SURFACE CONTOURS (0.5m INTERVALS) |
|  | LOT PAD EXTENTS |
|  | LOT PAD LEVELS |
|  | LOT PAD GRADES |
|  | PROPOSED STORMWATER LINE WITH PIT & HEADWALL |
|  | EXISTING / PROPOSED GRAVITY SEWER LINE WITH MANHOLE & INSPECTION SHAFT |
|  | EXISTING / PROPOSED WATER HYDRANT, STOP VALVE, BEND AND TEE |
|  | PROPOSED ROAD |
|  | PROPOSED FOOTPATH |
|  | KOALA FOOD TREE (TPZ) (K&C SURVEY JANUARY TO MARCH 2025) |
|  | PROPOSED STREET TREE - REFER TO SHEET 34 FOR DETAILS |

NOT TO BE USED FOR CONSTRUCTION UNLESS SUBDIVISION WORKS CERTIFICATE ISSUED FOR THE WORKS

K+C REF: 0:17197 The Sanduary\22 Engineering\Stages 8 and 9\2. STG 8 SWC Plan.dwg -A1(L)-RW 24 February 2026. jamesc

Look up and live

For safety tips visit
essentialenergy.com.au/safety
or in an emergency call
13 20 80



THIS DRAWING INCLUDES INFORMATION IN COLOUR. IF YOU HAVE A BLACK AND WHITE COPY YOU DON'T HAVE ALL THE INFORMATION. THIS NOTE IS COLOURED RED.


KING + CAMPBELL

King & Campbell Pty Ltd
www.kingcampbell.com.au
A: PO Box 243 Port Macquarie NSW 2444
T: 02 6586 2555
F: 02 6583 4064
E: info@kingcampbell.com.au

[illegible]

DATUM: AHD

SCALE: 1:500 @ A1
(1:1000 @ A3)




NOTE: DO NOT SCALE OFF DRAWINGS. USE FIGURED DIMENSIONS ONLY. REPORT ANY DISCREPANCIES TO THE AUTHOR. THIS DRAWING, BEING THE PROPERTY OF KING & CAMPBELL PTY LTD, IS PROTECTED BY COPYRIGHT AND MUST NOT BE USED, REPRODUCED OR COPIED WHOLLY, OR IN PART WITHOUT THE WRITTEN PERMISSION OF KING & CAMPBELL PTY LTD.

© King & Campbell Pty Ltd

PROJECT NO:	7197
DA NO.:	2014-114
DESIGNED BY:	JSC/BC
DRAWN BY:	JSC
CHECKED BY:	BC
DATE CREATED:	JULY 2025

DRAWING TITLE:	RETAINING WALL PLAN			A1
PROJECT:	THE SANCTUARY STAGE 8 LOT 300, DP 130775 - JOHN OXLEY DRIVE, THURMSTER			
CLIENT:	BIRD IN THE HAND 2 PTY LTD.	DRAWING NO:	SHEET:	REVISION:
		7197_Stage 8_SWC_Plan	05 OF 36	B

A1

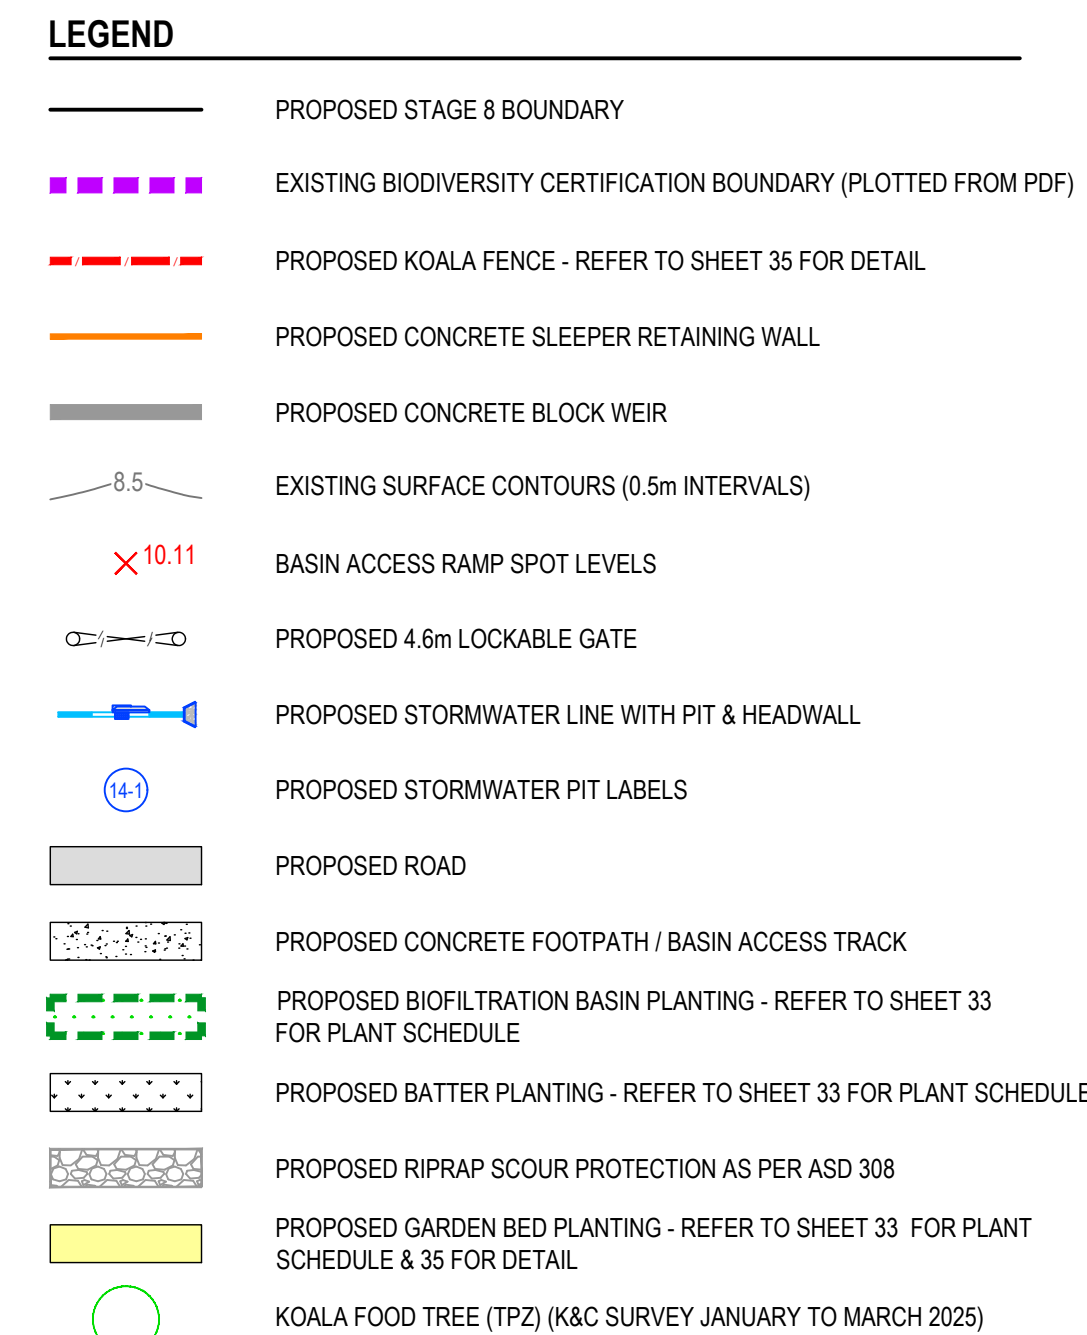


- ## NOTES
-
1. USE STANDARD JUNCTIONS WHERE CONNECTING TO PVC PIPES.
 2. SLOTTED PIPED TO BE IPLEX WPS090SL OR EQUIVALENT.
 3. REFER TO PIT SCHEDULE ON SHEET 04 FOR ALL PITS OUTSIDE OF THE BASIN
 4. REFER TO SHEET 08 FOR BASIN DETAILS.

FENCING REQUIREMENT

THE ENTIRETY OF THE BASIN IS PROPOSED TO BE FENCED WITH FAUNA EXCLUSION FENCING ADJACENT TO THE SURROUNDING ROADS. AS SUCH, NO PUBLIC ACCESS IS POSSIBLE TO THE BASIN, AND NO FURTHER RISK ASSESSMENT WAS UNDERTAKEN.

BIORETENTION BASIN TIME LINE

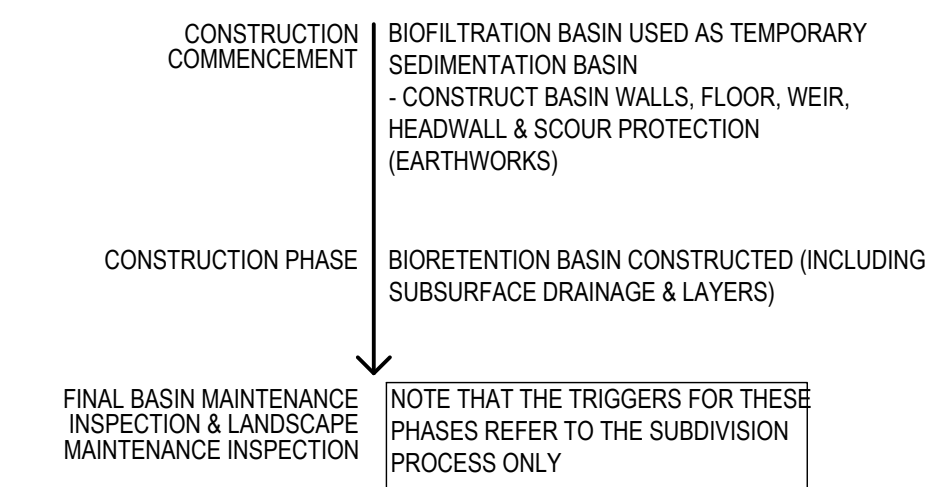

BIOFILTRATION BASIN PLANTING

AREA OF BIOFILTRATION AREA: 203m

PLANTING RATE – 6 PLANTS PER m²


FICINIA NODOSA (Fn) - 1216 PLANTS

NOTES:


1. REFER PLANTING SCHEDULE ON SHEET 33 FOR TOTAL PLANT NUMBERS, PLANT SIZES AND PLANTING HOLES.

SIGNAGE


1. SAFETY SIGNAGE TO BE SUPPLIED AND INSTALLED ON GATES AS PER ADJACENT SIGNAGE
2. GENERAL SIGNAGE TO BE INSTALLED ON ALL GATES WITH THE FOLLOWING WORDING: "THIS IS A STORMWATER DETENTION BASIN / WATER QUALITY CONTROL BASIN MAINTAINED BY PORT MACQUARIE - HASTINGS COUNCIL TO PROTECT DOWNSTREAM WATERWAYS FROM FLOODING"

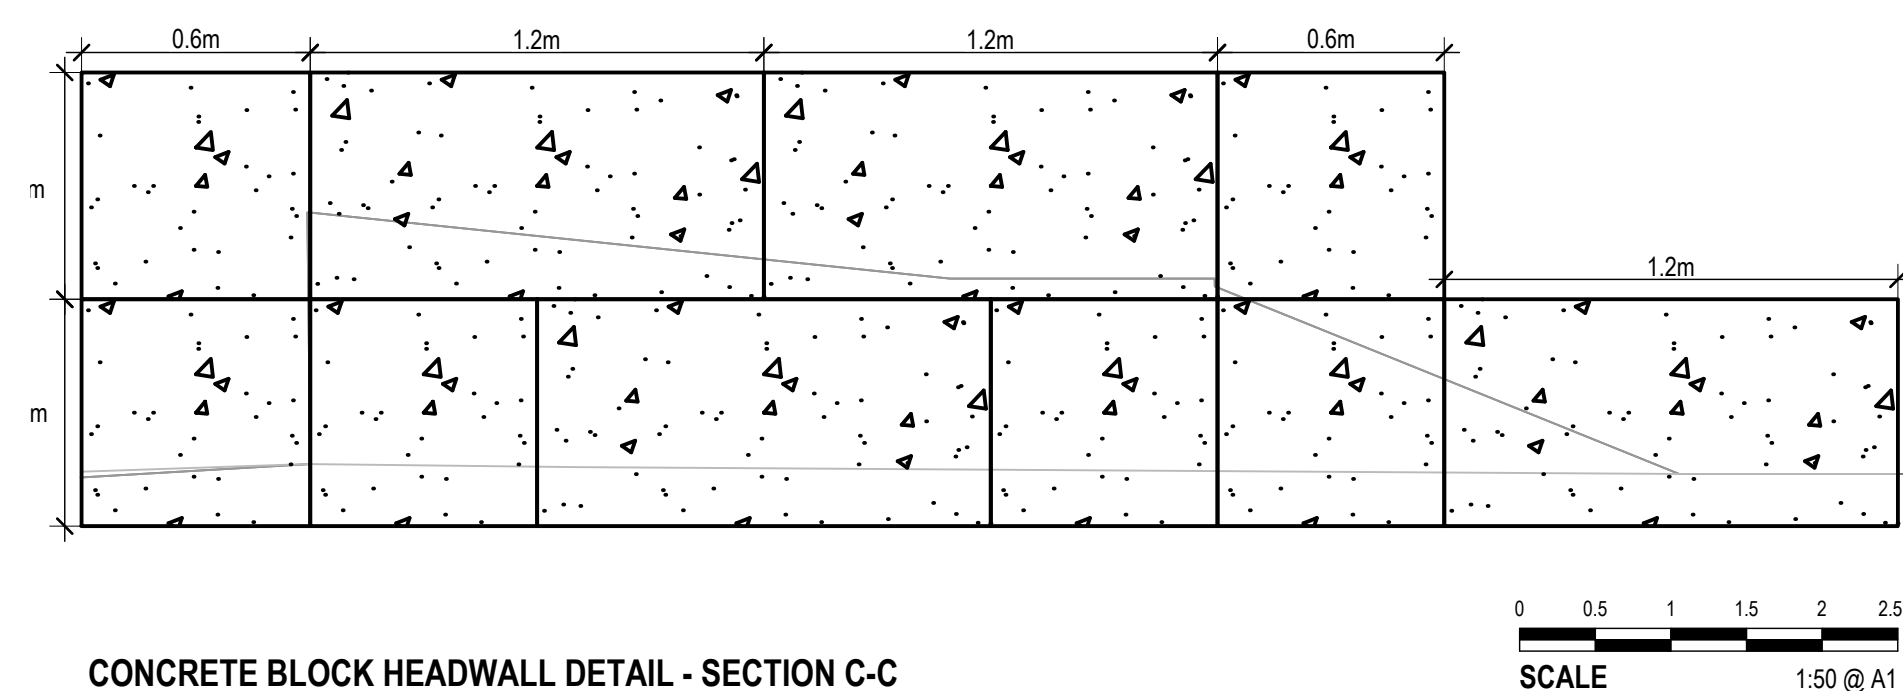

CONCRETE BLOCK HEADWALL DETAIL - SECTION C-C

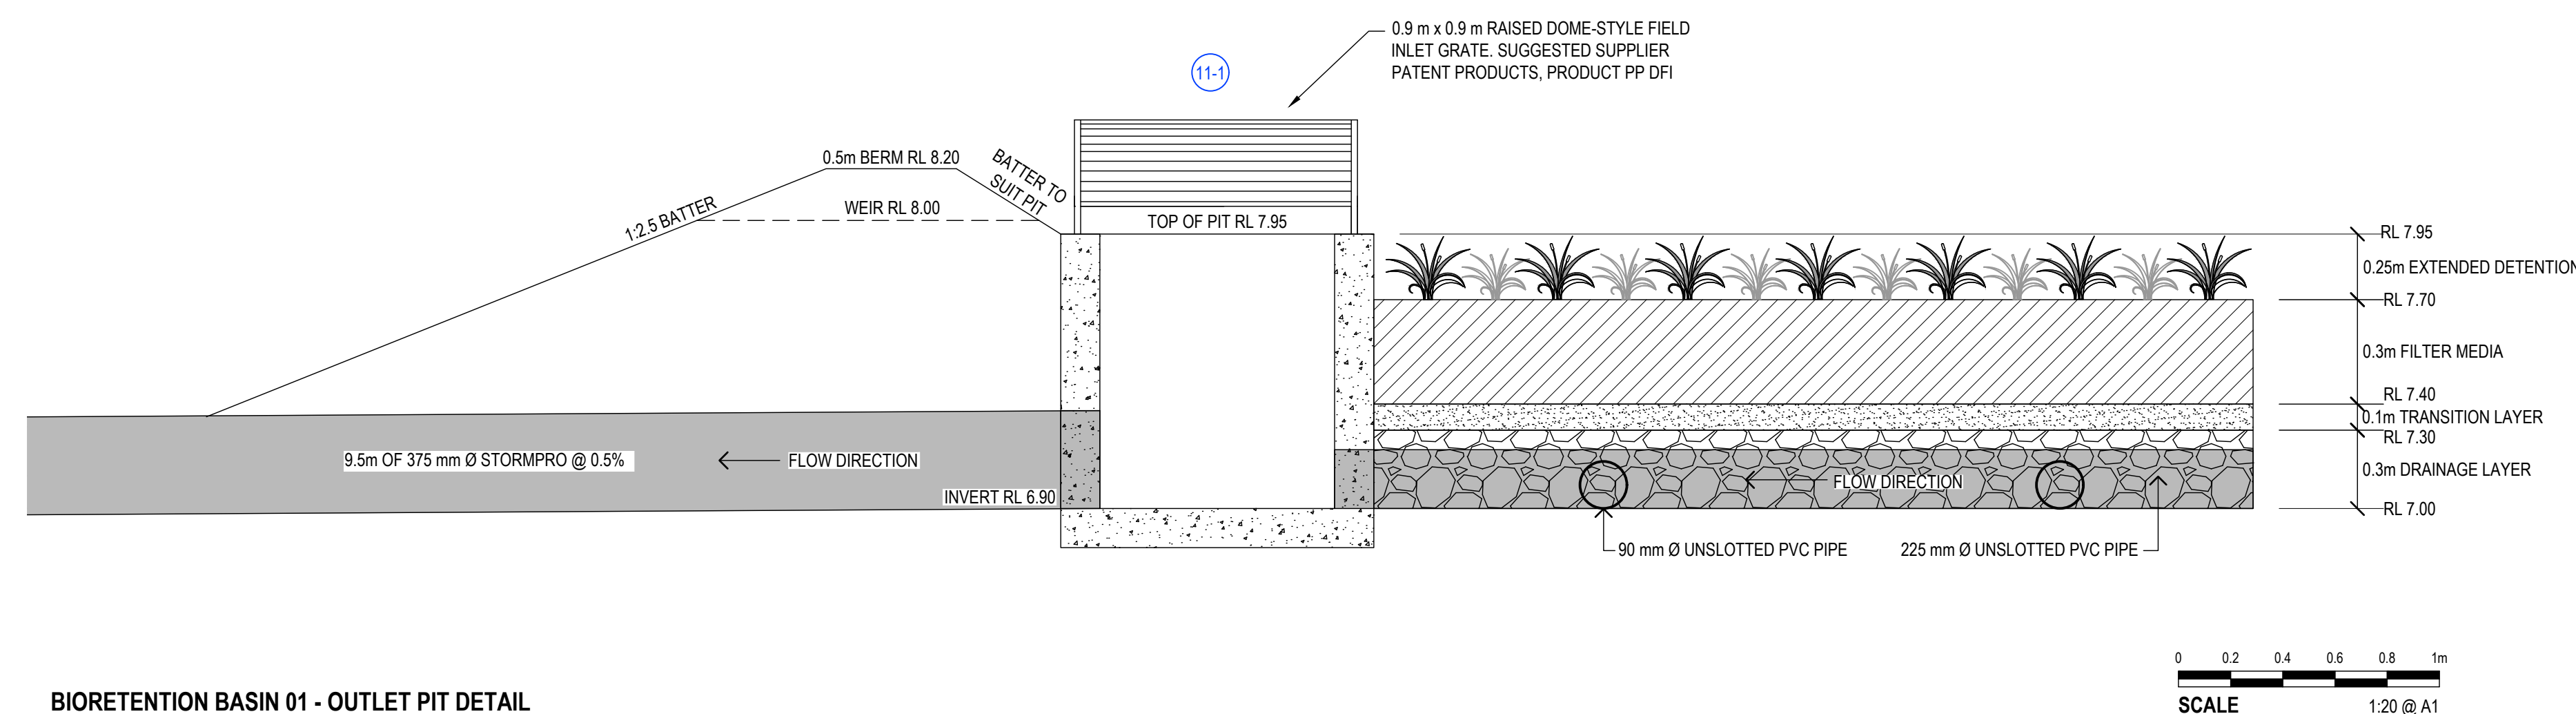

BIORETENTION BASIN 01 - OUTLET PIT DETAIL

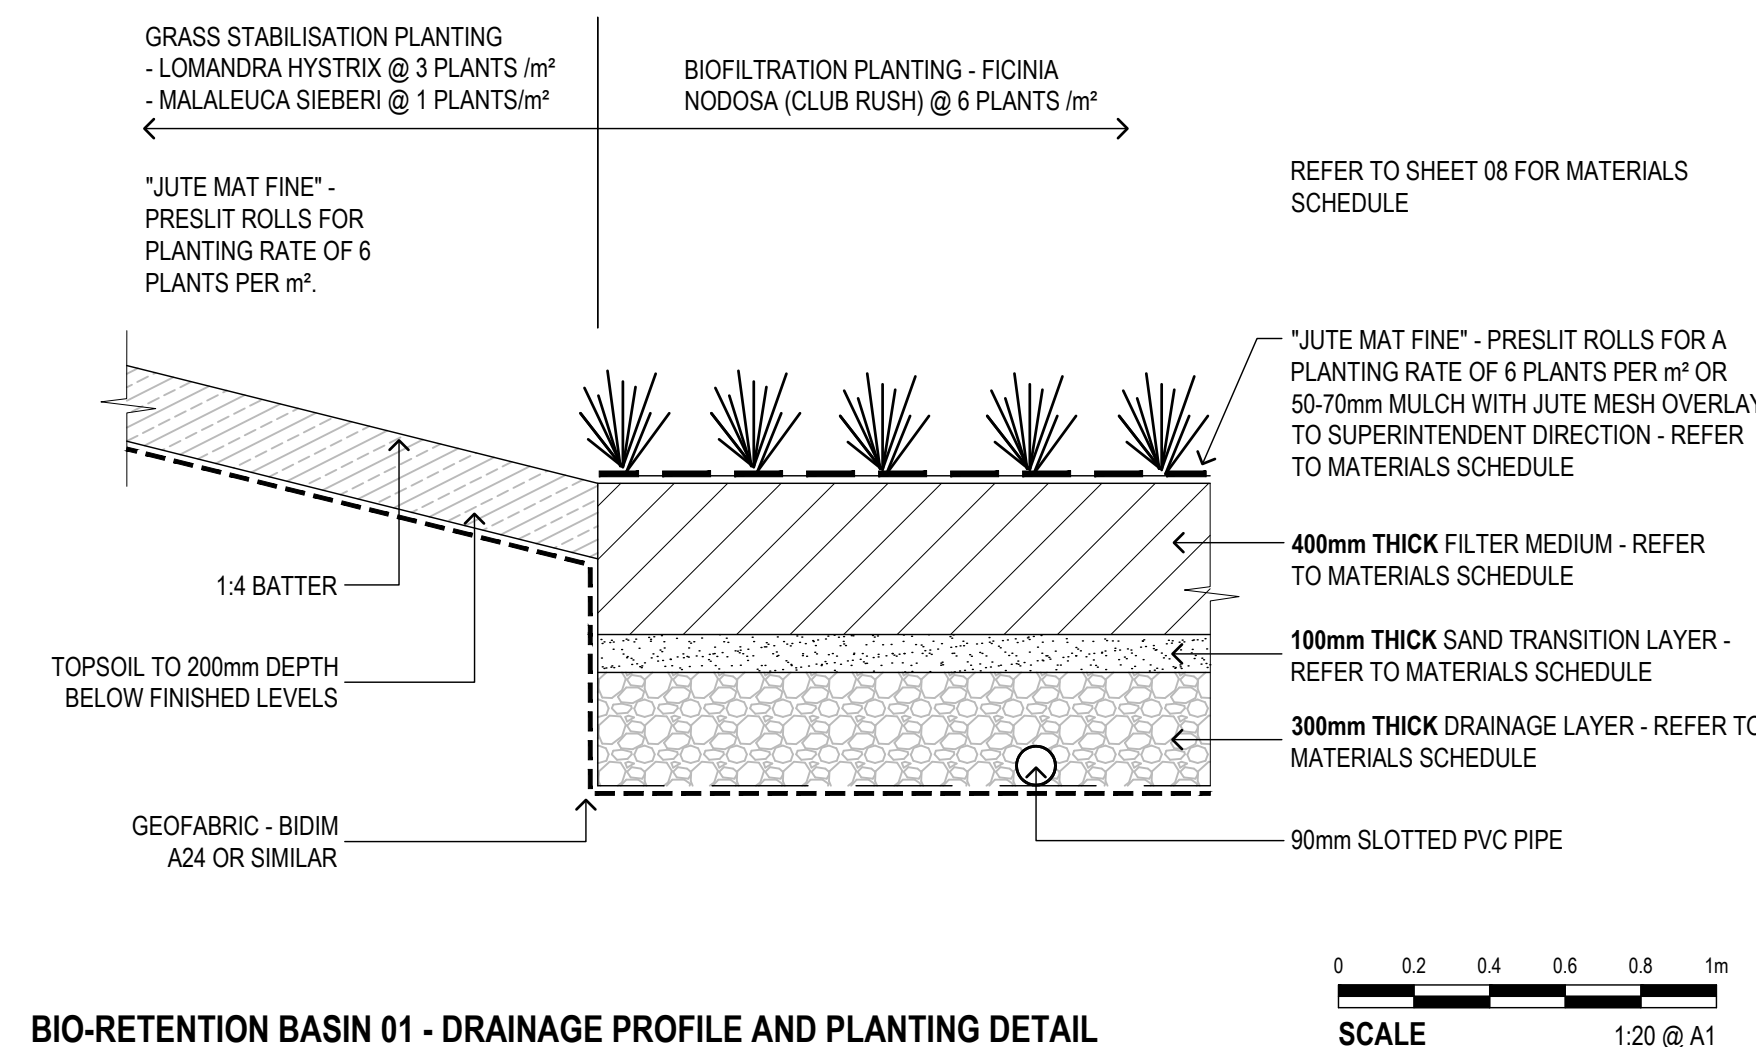

BIO-RETENTION BASIN 01 - DRAINAGE PROFILE AND PLANTING DETAIL

THIS DRAWING INCLUDES INFORMATION IN COLOUR. IF YOU HAVE A BLACK AND WHITE COPY YOU DON'T HAVE ALL THE INFORMATION. THIS NOTE IS COLOURED RED.

King & Campbell Pty Ltd
www.kingcampbell.com.au
A: PO Box 243 Port Macquarie NSW 2444
T: 02 6586 2555
F: 02 6583 4064
E: info@kingcampbell.com.au

[illegible]

DATUM

DATUM: AHD SCALE: 1:125 @ A1
(1:250 @ A3)

NOTE: DO NOT SCALE OFF DRAWINGS. USE FIGURED DIMENSIONS ONLY. REPORT ANY DISCREPANCIES TO THE AUTHOR. THIS DRAWING, BEING THE PROPERTY OF KING & CAMPBELL PTY LTD, IS PROTECTED BY COPYRIGHT AND MUST NOT BE USED, REPRODUCED OR COPIED WHOLLY, OR IN PART WITHOUT THE WRITTEN PERMISSION OF KING & CAMPBELL PTY LTD.


© King & Campbell Pty Ltd

PROJECT NO:	7197
DA NO.:	2014-114
DESIGNED BY:	JSC/BC
DRAWN BY:	JSC
CHECKED BY:	BC
DATE CREATED:	JULY 2025

DRAWING TITLE:	STORMWATER BASIN 01 PLAN
PROJECT:	THE SANCTUARY STAGE 8 LOT 300, DP 1307775 - JOHN OXLEY DRIVE, THURMSTER
CLIENT:	BIRD IN THE HAND 2 PTY LTD.

DRAWING NO:	SHEET:	REVISION:
7197 Stage 8 SWC Plan	06 OF 36	A

K&C REF: 01197 - The Sanctuary/02_Engineering/Stages 8 and 9/2-STG 8 SWC/2107_Stage 8_SWC_Plan.dwg - 41(1) BASIN/02_24 February 2026 jmcac

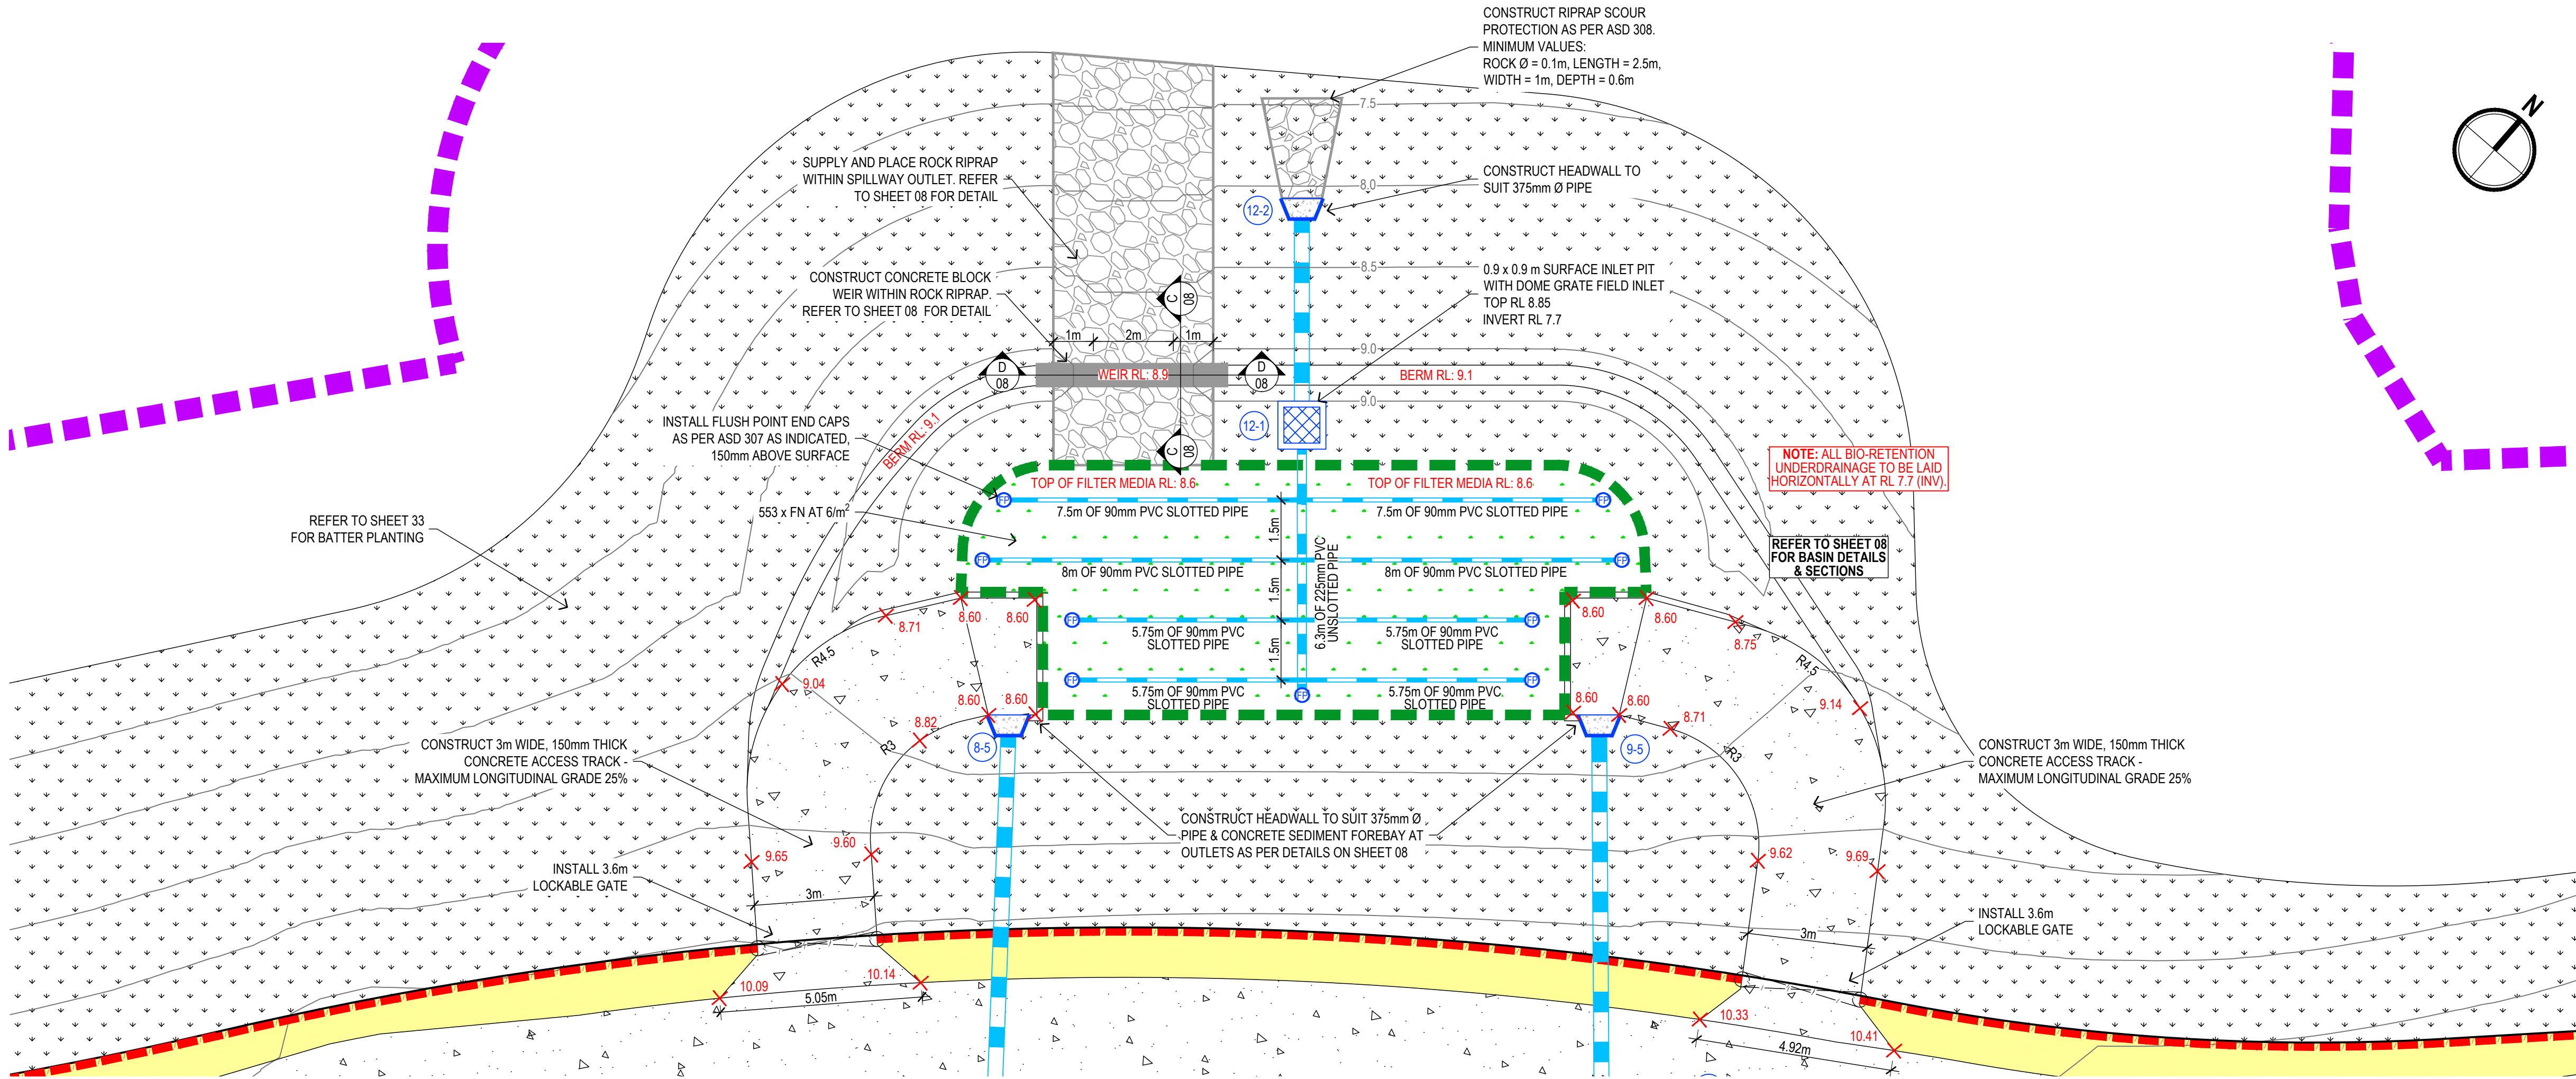

- LEGEND**
- PROPOSED STAGE 8 BOUNDARY
 - EXISTING BIODIVERSITY CERTIFICATION BOUNDARY (PLOTTED FROM PDF)
 - PROPOSED KOALA FENCE - REFER TO SHEET 35 FOR DETAIL
 - PROPOSED CONCRETE SLEEPER RETAINING WALL
 - PROPOSED CONCRETE BLOCK WEIR
 - EXISTING SURFACE CONTOURS (0.5m INTERVALS)
 - BASIN ACCESS RAMP SPOT LEVELS
 - PROPOSED 3.6m LOCKABLE GATE
 - PROPOSED STORMWATER LINE WITH PIT & HEADWALL
 - PROPOSED STORMWATER PIT LABELS
 - PROPOSED ROAD
 - PROPOSED CONCRETE FOOTPATH / BASIN ACCESS TRACK
 - PROPOSED BIOFILTRATION BASIN PLANTING - REFER TO SHEET 33 FOR PLANT SCHEDULE
 - PROPOSED BATTER PLANTING - REFER TO SHEET 33 FOR PLANT SCHEDULE
 - PROPOSED RIPRAP SCOUR PROTECTION AS PER ASD 308
 - PROPOSED GARDEN BED PLANTING - REFER TO SHEET 33 FOR PLANT SCHEDULE & 35 FOR DETAIL
 - KOALA FOOD TREE (TP2) (K&C SURVEY JANUARY TO MARCH 2025)

- NOTES**
- USE STANDARD JUNCTIONS WHERE CONNECTING TO PVC PIPES.
 - SLOTTED PIPED TO BE IPLEX WPS090SL OR EQUIVALENT.
 - REFER TO PIT SCHEDULE ON SHEET 04 FOR ALL PITS OUTSIDE OF THE BASIN.
 - REFER TO SHEET 08 FOR BASIN DETAILS.

FENCING REQUIREMENT

THE ENTIRETY OF THE BASIN IS PROPOSED TO BE FENCED WITH FAUNA EXCLUSION FENCING ADJACENT TO THE SURROUNDING ROADS. AS SUCH, NO PUBLIC ACCESS IS POSSIBLE TO THE BASIN. AND NO FURTHER RISK ASSESSMENT WAS UNDERTAKEN.

BIOFILTRATION BASIN PLANTING

AREA OF BIOFILTRATION AREA: 93m²


PLANTING RATE - 6 PLANTS PER m²

FICINIA NODOSA (Fn) - 553 PLANTS

NOTES:


- REFER PLANTING SCHEDULE ON SHEET 33 FOR TOTAL PLANT NUMBERS, PLANT SIZES AND PLANTING HOLES.

BIORETENTION BASIN TIME LINE

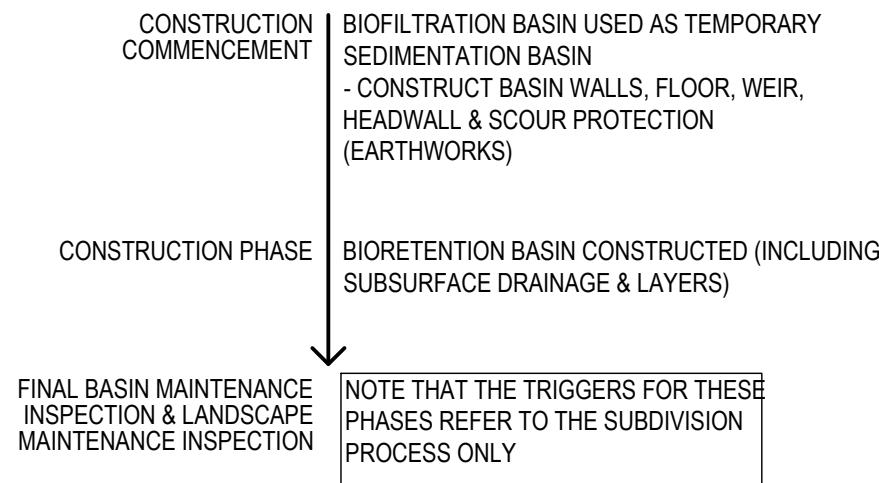


SIGNAGE

- SAFETY SIGNAGE TO BE SUPPLIED AND INSTALLED ON GATES AS PER ADJACENT SIGNAGE
- GENERAL SIGNAGE TO BE INSTALLED ON ALL GATES WITH THE FOLLOWING WORDING: "THIS IS A STORMWATER DETENTION BASIN / WATER QUALITY CONTROL BASIN MAINTAINED BY PORT MACQUARIE - HASTINGS COUNCIL TO PROTECT DOWNSTREAM WATERWAYS FROM FLOODING"

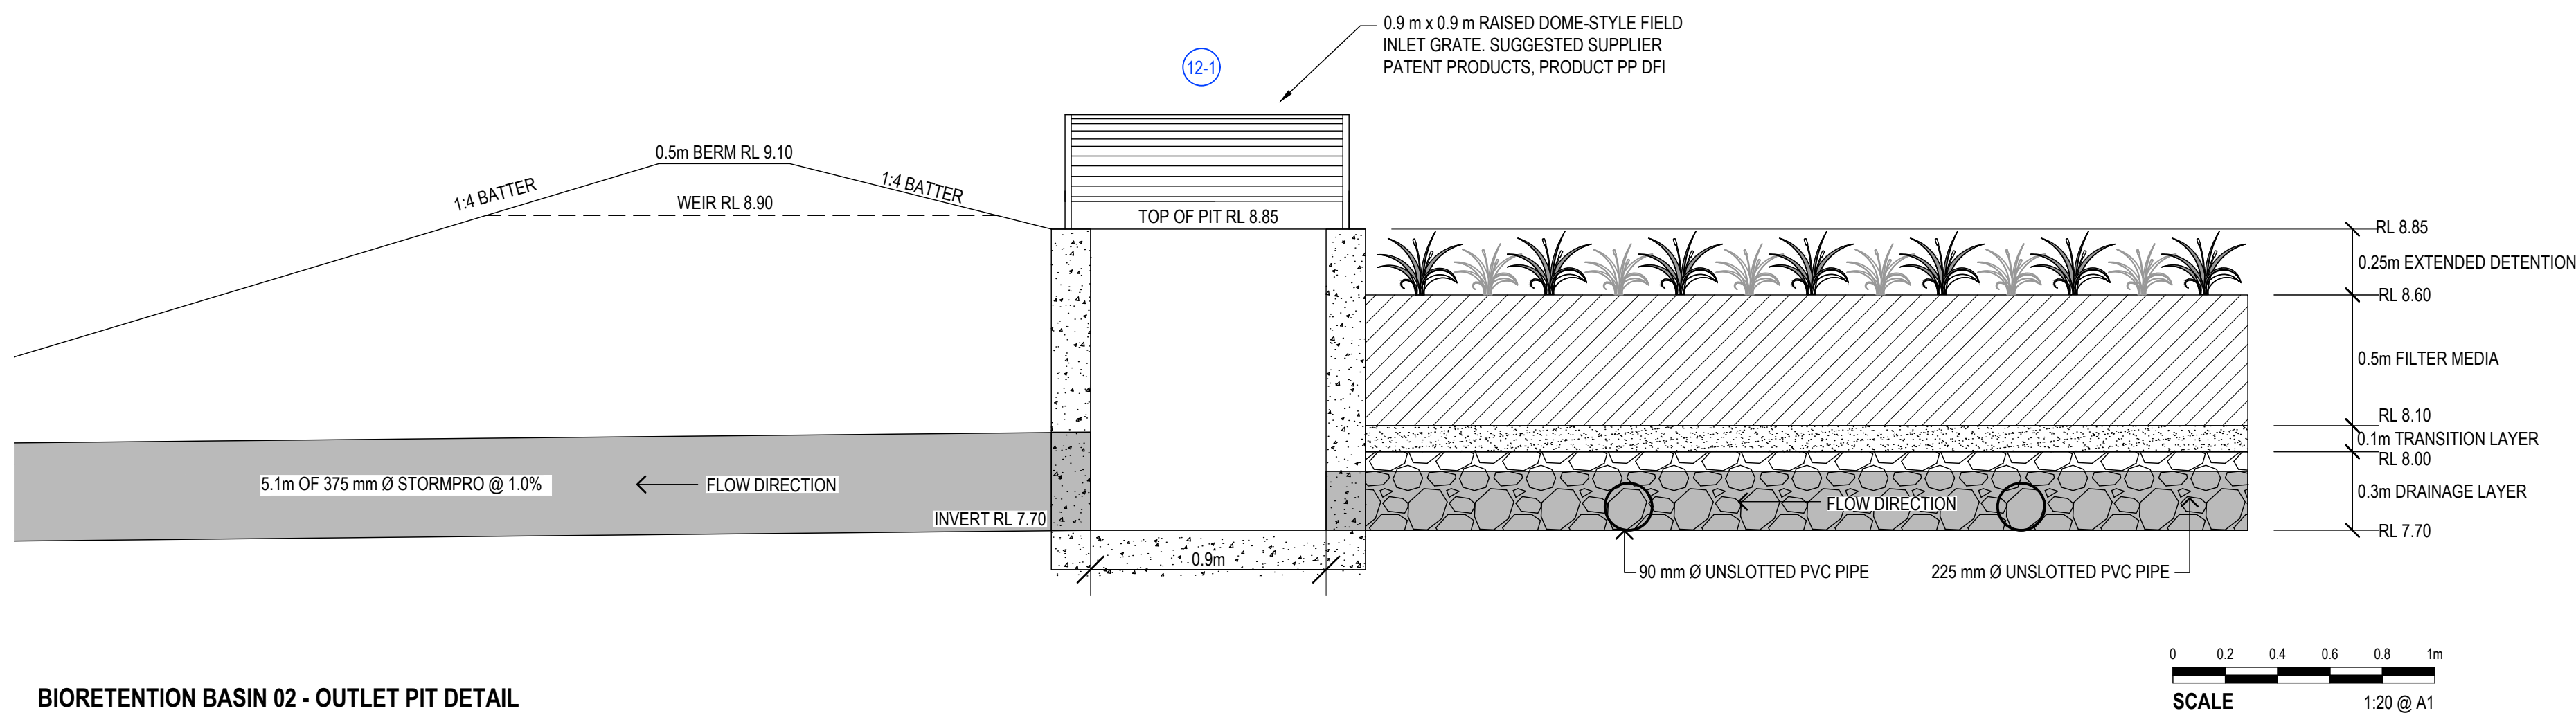

BIORETENTION BASIN 02 - OUTLET PIT DETAIL

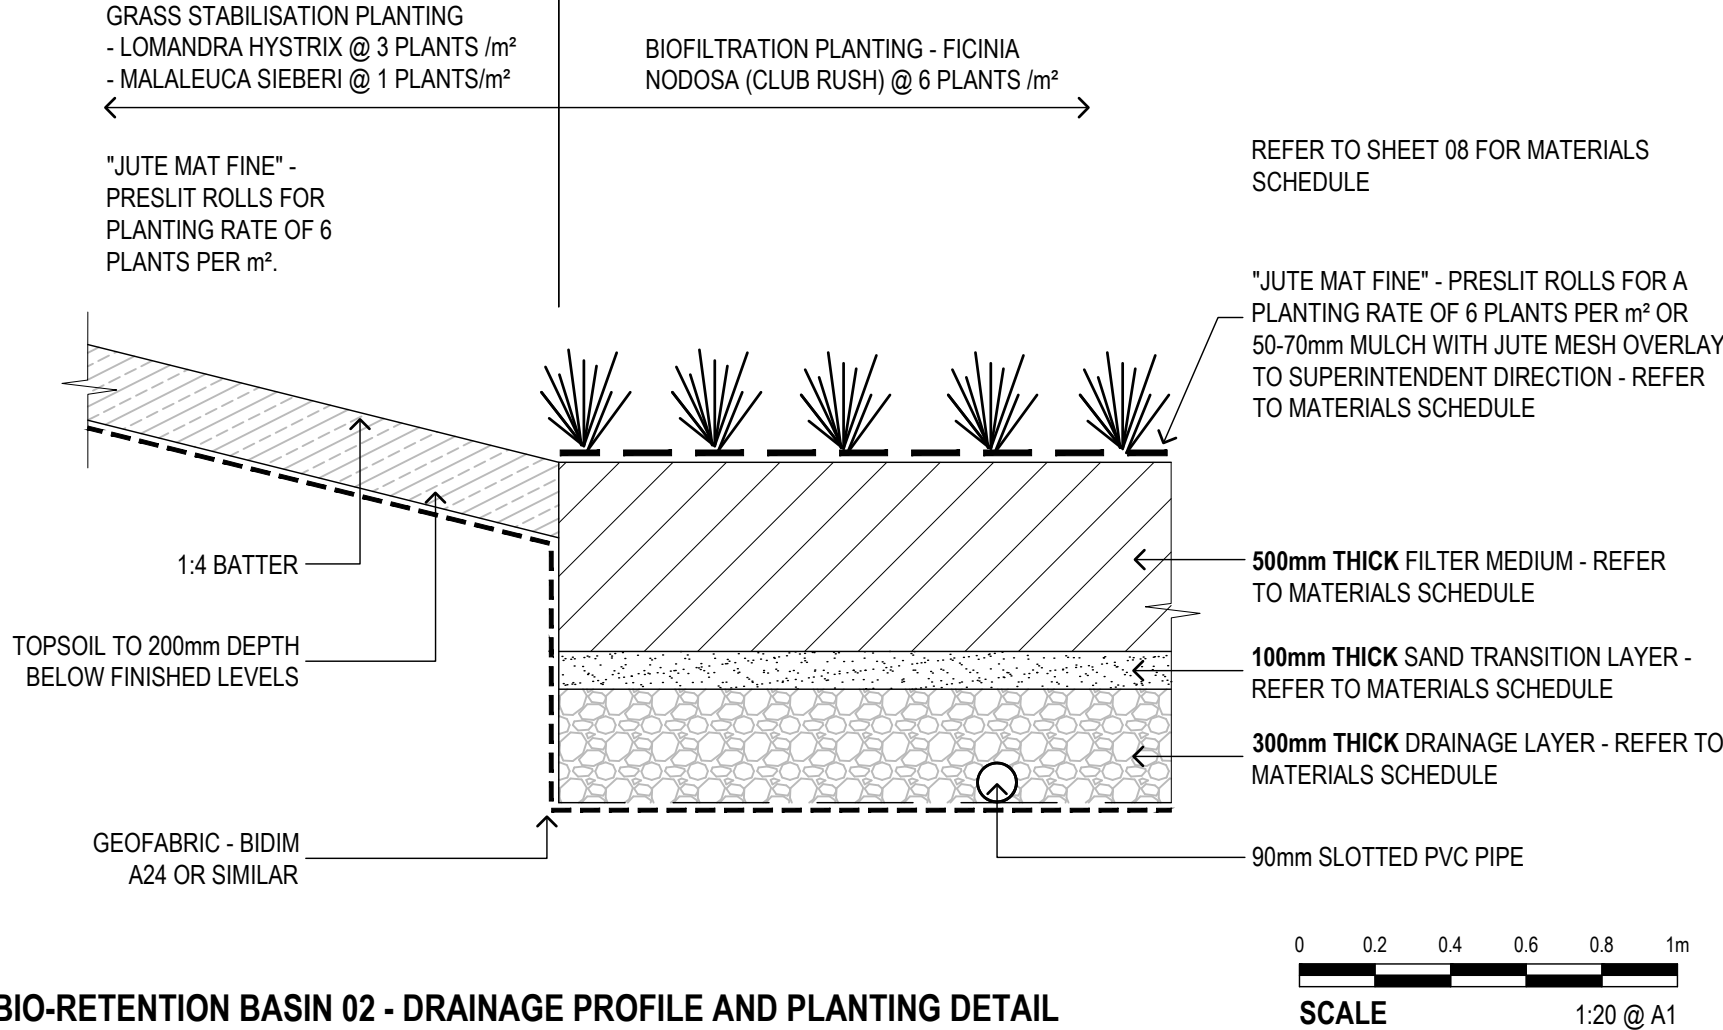

BIO-RETENTION BASIN 02 - DRAINAGE PROFILE AND PLANTING DETAIL

KING + CAMPBELL

King & Campbell Pty Ltd
www.kingcampbell.com.au
A: PO Box 243 Port Macquarie NSW 2444
T: 02 6586 2555
F: 02 6583 4064
E: info@kingcampbell.com.au

REV.	DATE	DESCRIPTION	BY
A	31.10.2025	ISSUED FOR APPROVAL	JSC

DATUM: AHD

SCALE: 1:100 @ A1
1:200 @ A3

NOTE: DO NOT SCALE OFF DRAWINGS. USE FIGURED DIMENSIONS ONLY. REPORT ANY DISCREPANCIES TO THE AUTHOR. THIS DRAWING, BEING THE PROPERTY OF KING & CAMPBELL PTY LTD, IS PROTECTED BY COPYRIGHT AND MUST NOT BE USED, REPRODUCED OR COPIED WHOLLY, OR IN PART WITHOUT THE WRITTEN PERMISSION OF KING & CAMPBELL PTY LTD.







© King & Campbell Pty Ltd

PROJECT NO:	7197	DRAWING TITLE:	STORMWATER BASIN 02 PLAN
DA NO.:	2014-114	PROJECT:	THE SANCTUARY STAGE 8 LOT 300, DP 1307775 - JOHN OXLEY DRIVE, THURMSTER
DESIGNED BY:	JSC/BC	CLIENT:	BIRD IN THE HAND 2 PTY LTD.
DRAWN BY:	JSC	DRAWING NO:	7197_Stage 8_SWC_Plan
CHECKED BY:	BC	SHEET:	07 OF 36
DATE CREATED:	JULY 2025	REVISION:	A

NOT TO BE USED FOR CONSTRUCTION UNLESS SUBDIVISION WORKS CERTIFICATE ISSUED FOR THE WORKS


THIS DRAWING INCLUDES INFORMATION IN COLOUR. IF YOU HAVE A BLACK AND WHITE COPY YOU DON'T HAVE ALL THE INFORMATION. THIS NOTE IS COLOURED RED.

A1

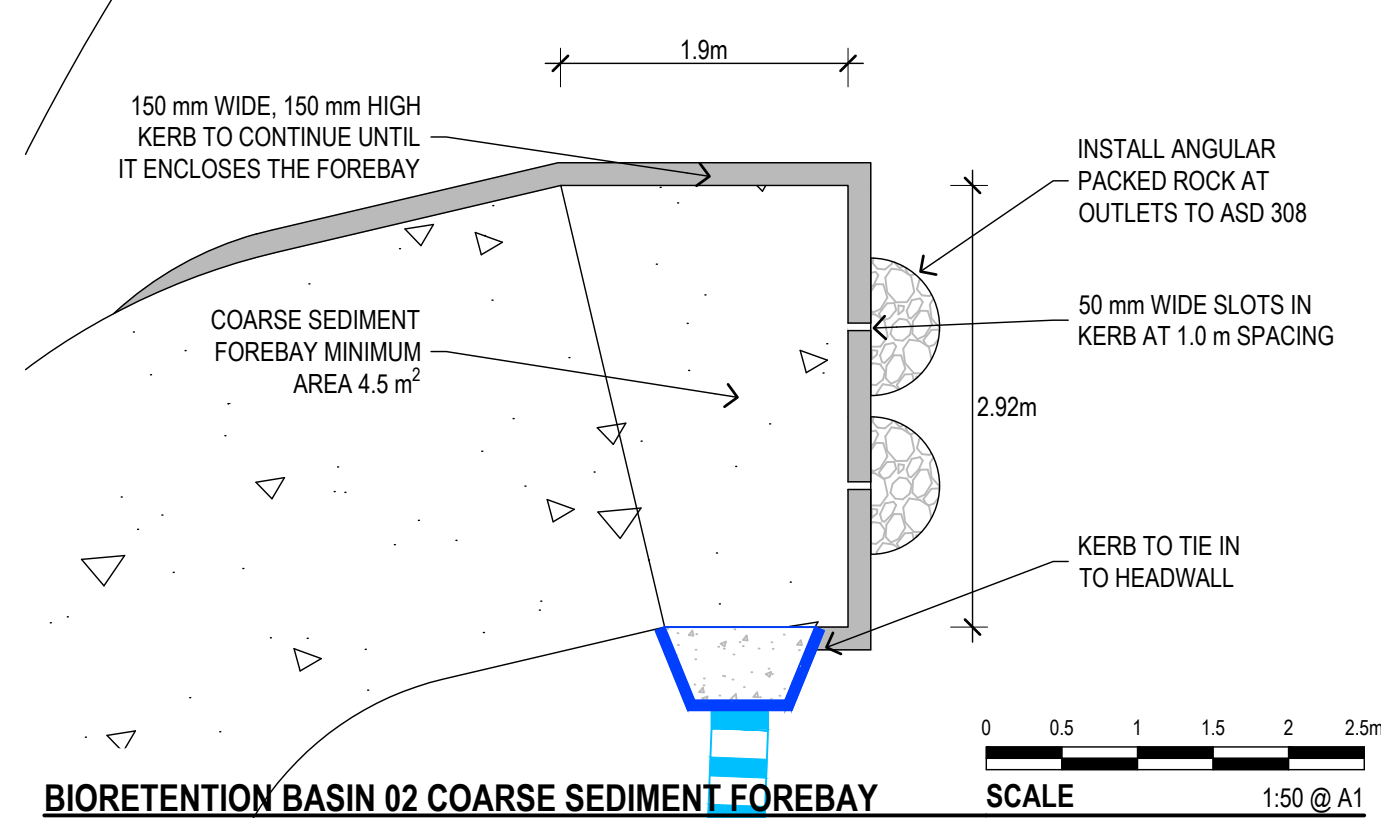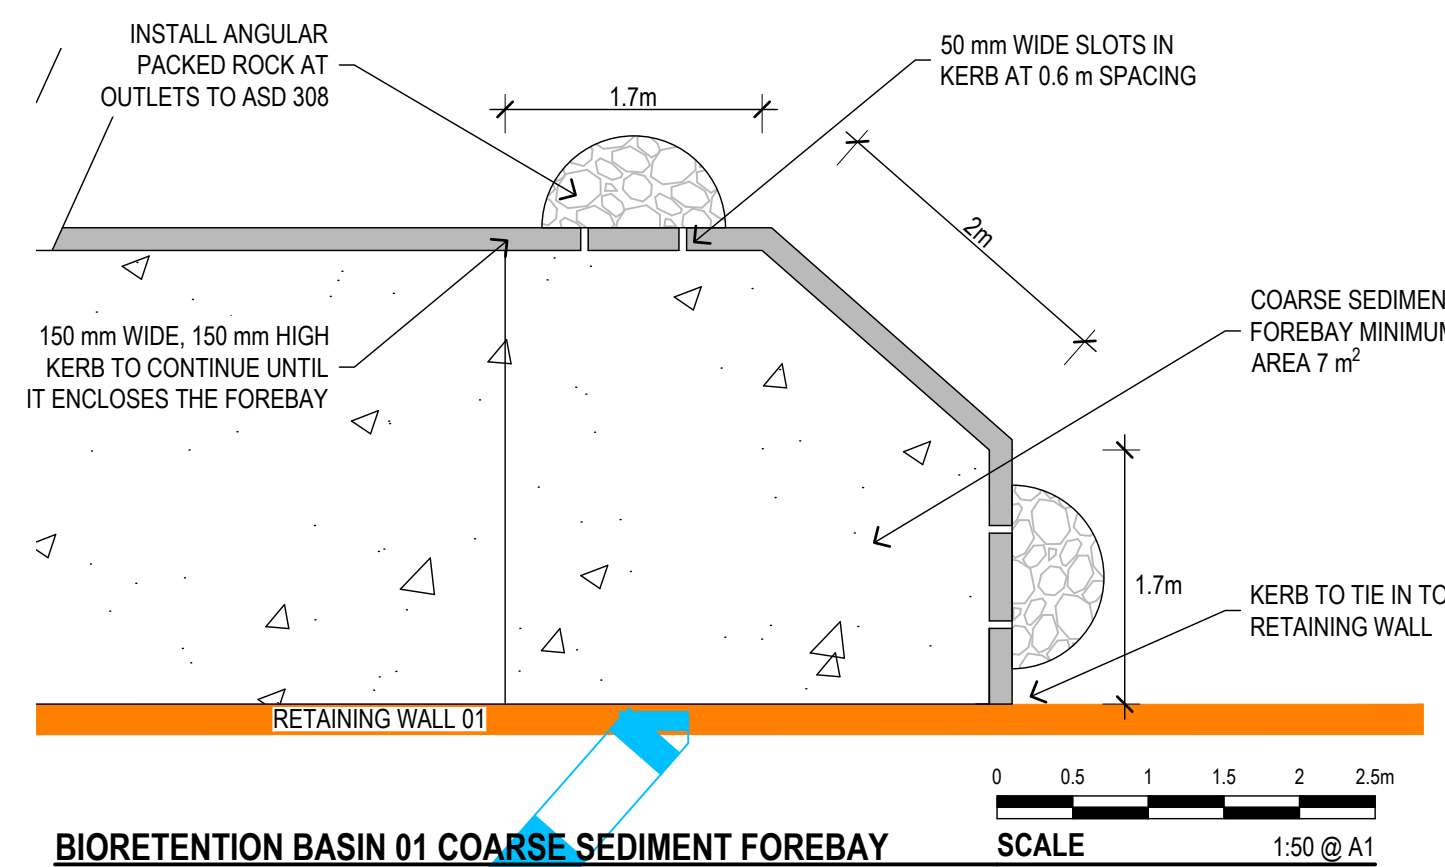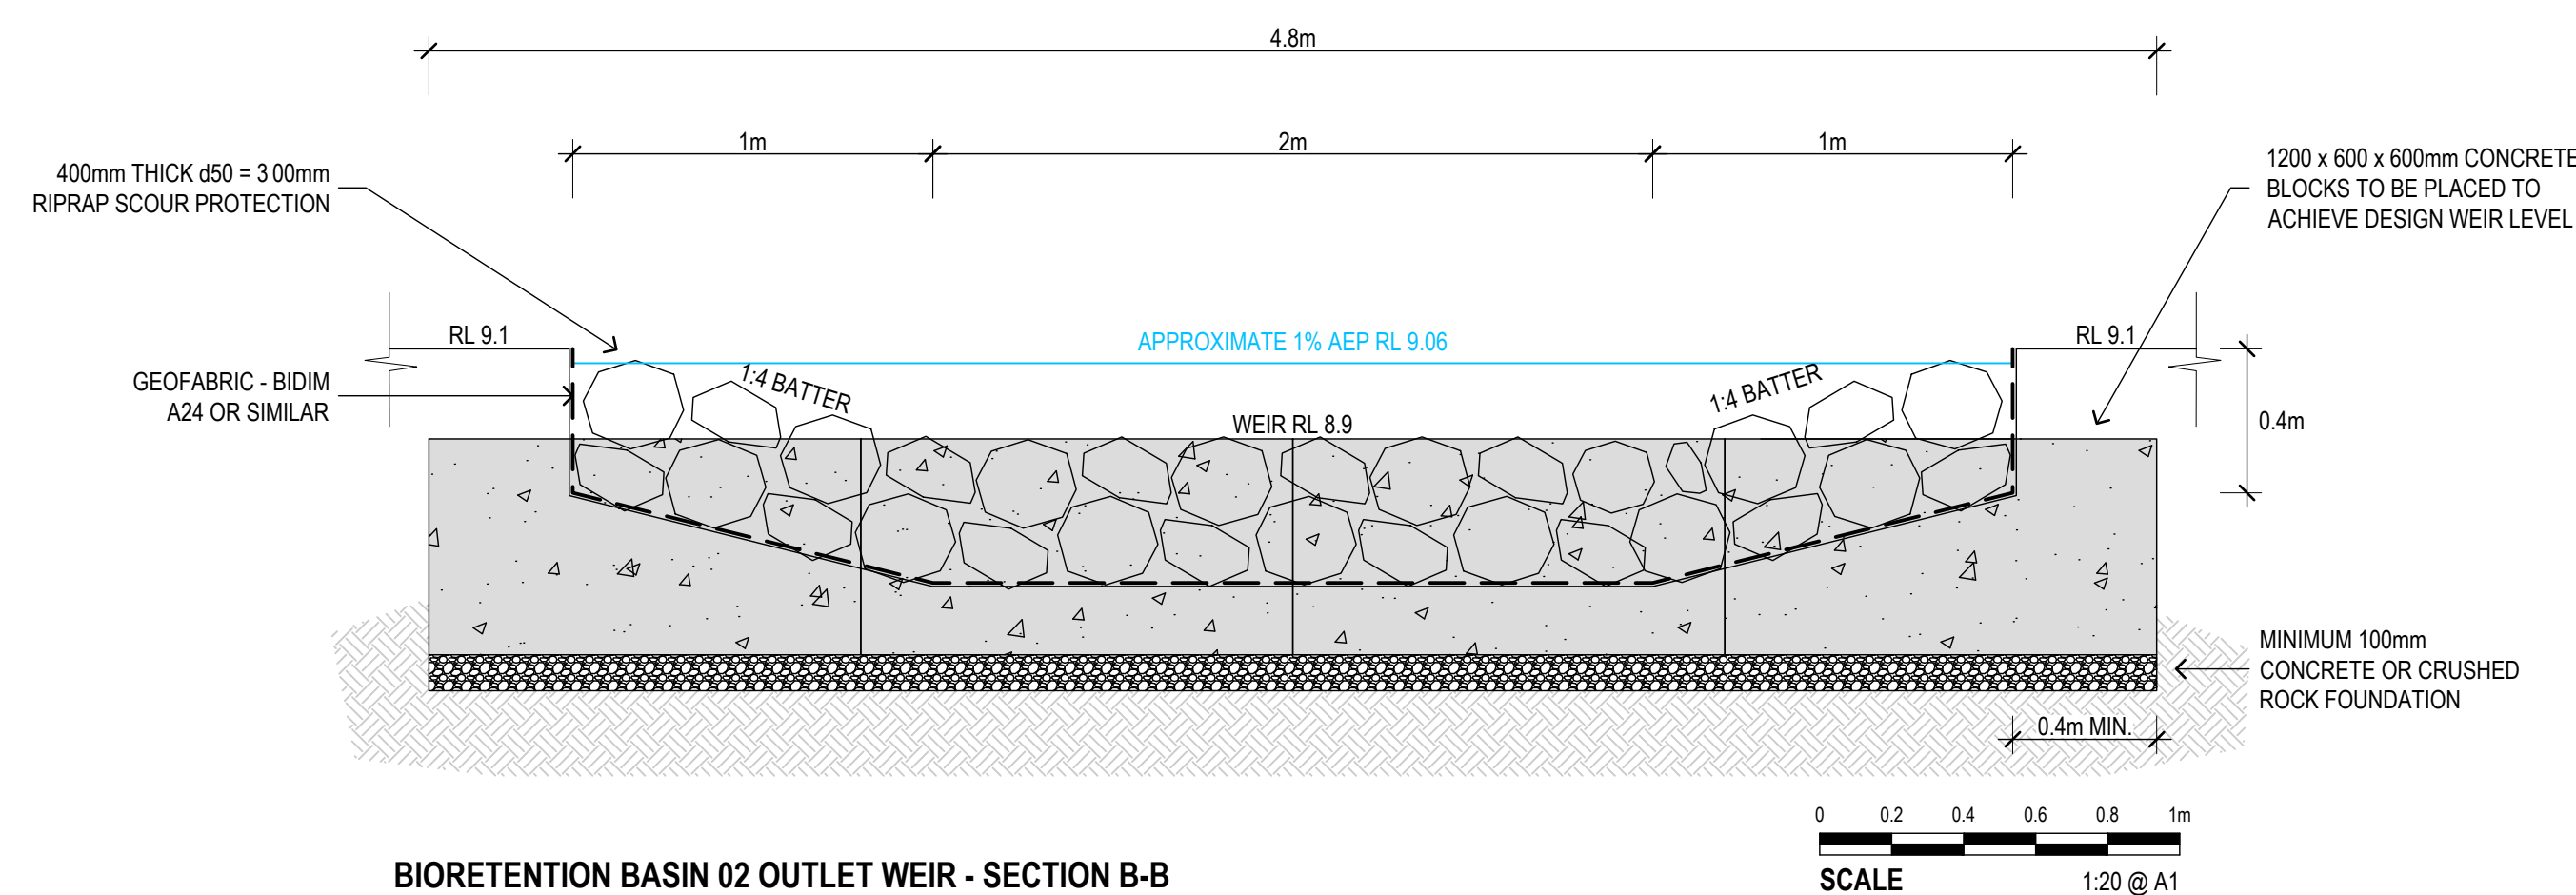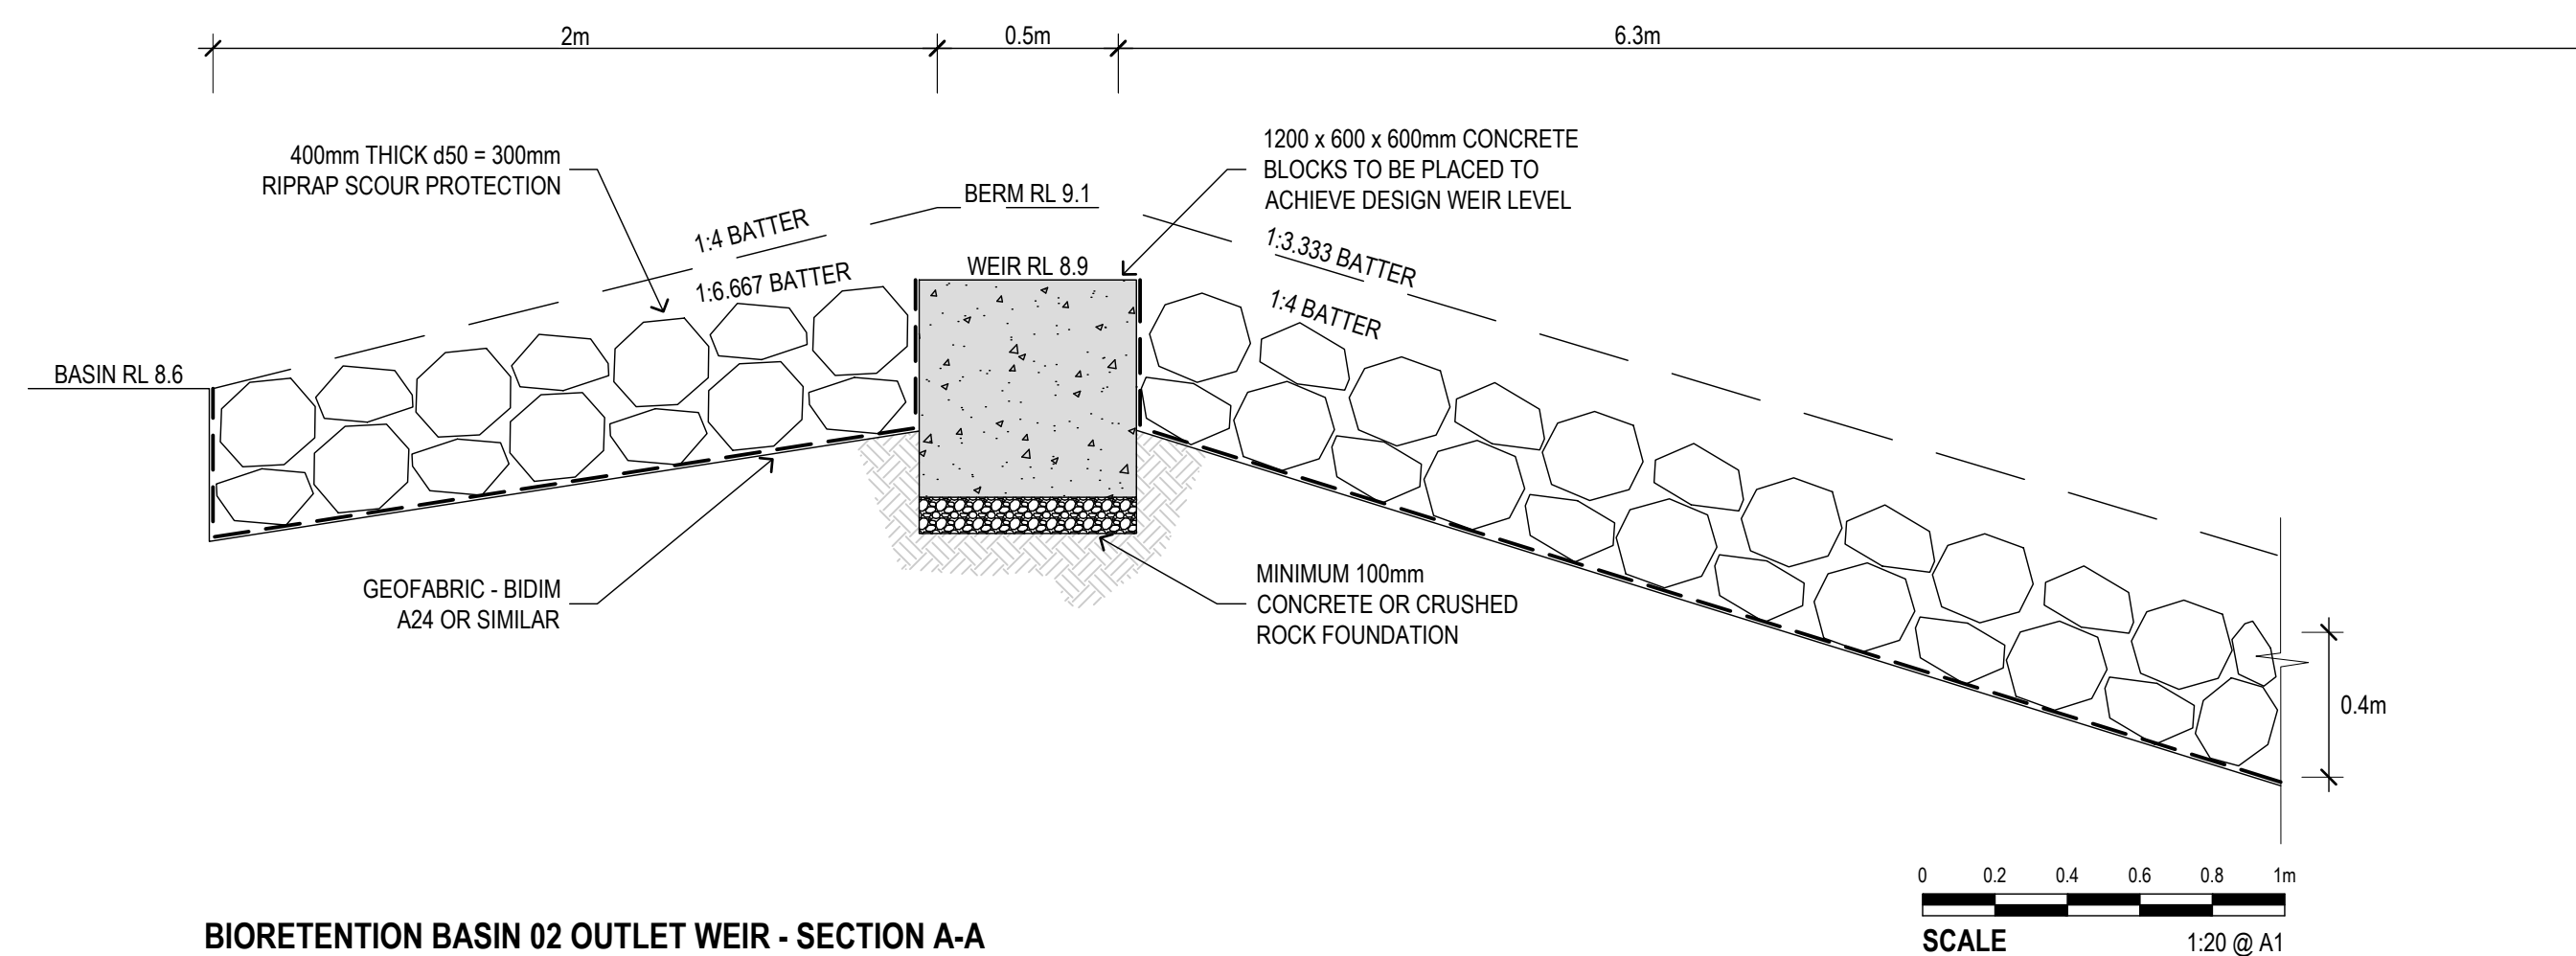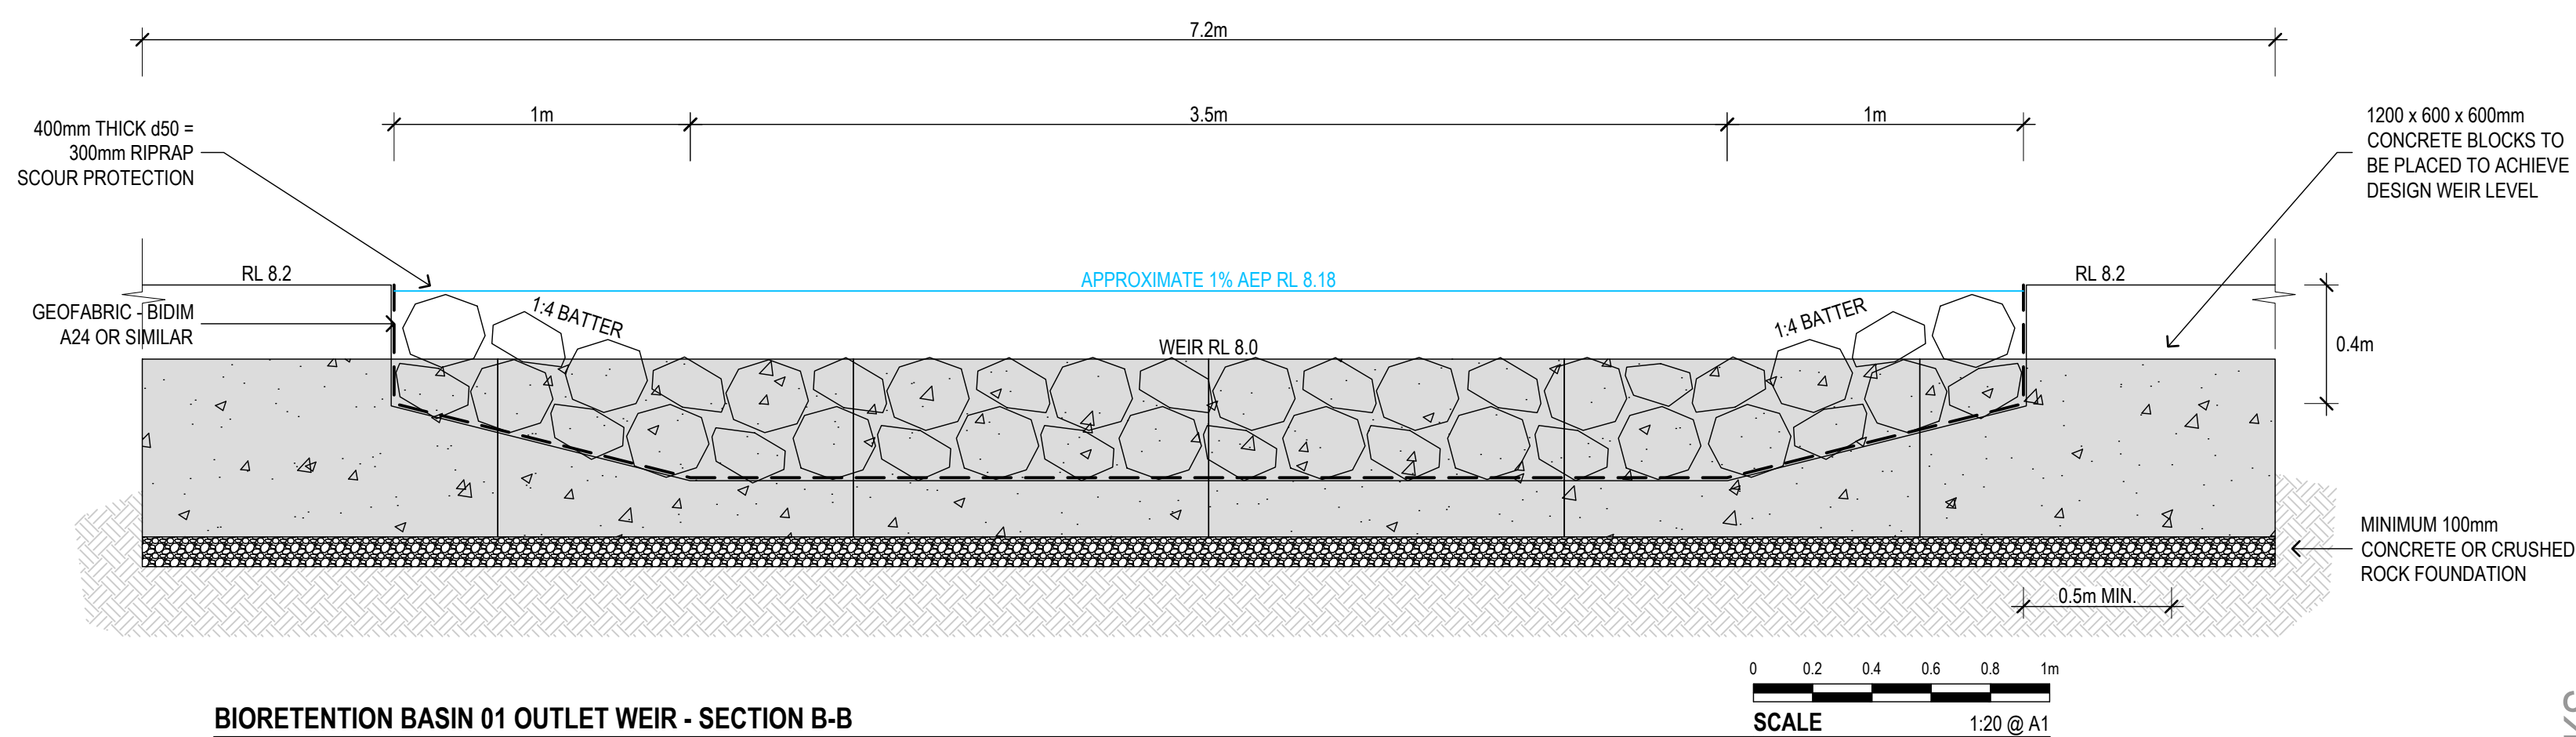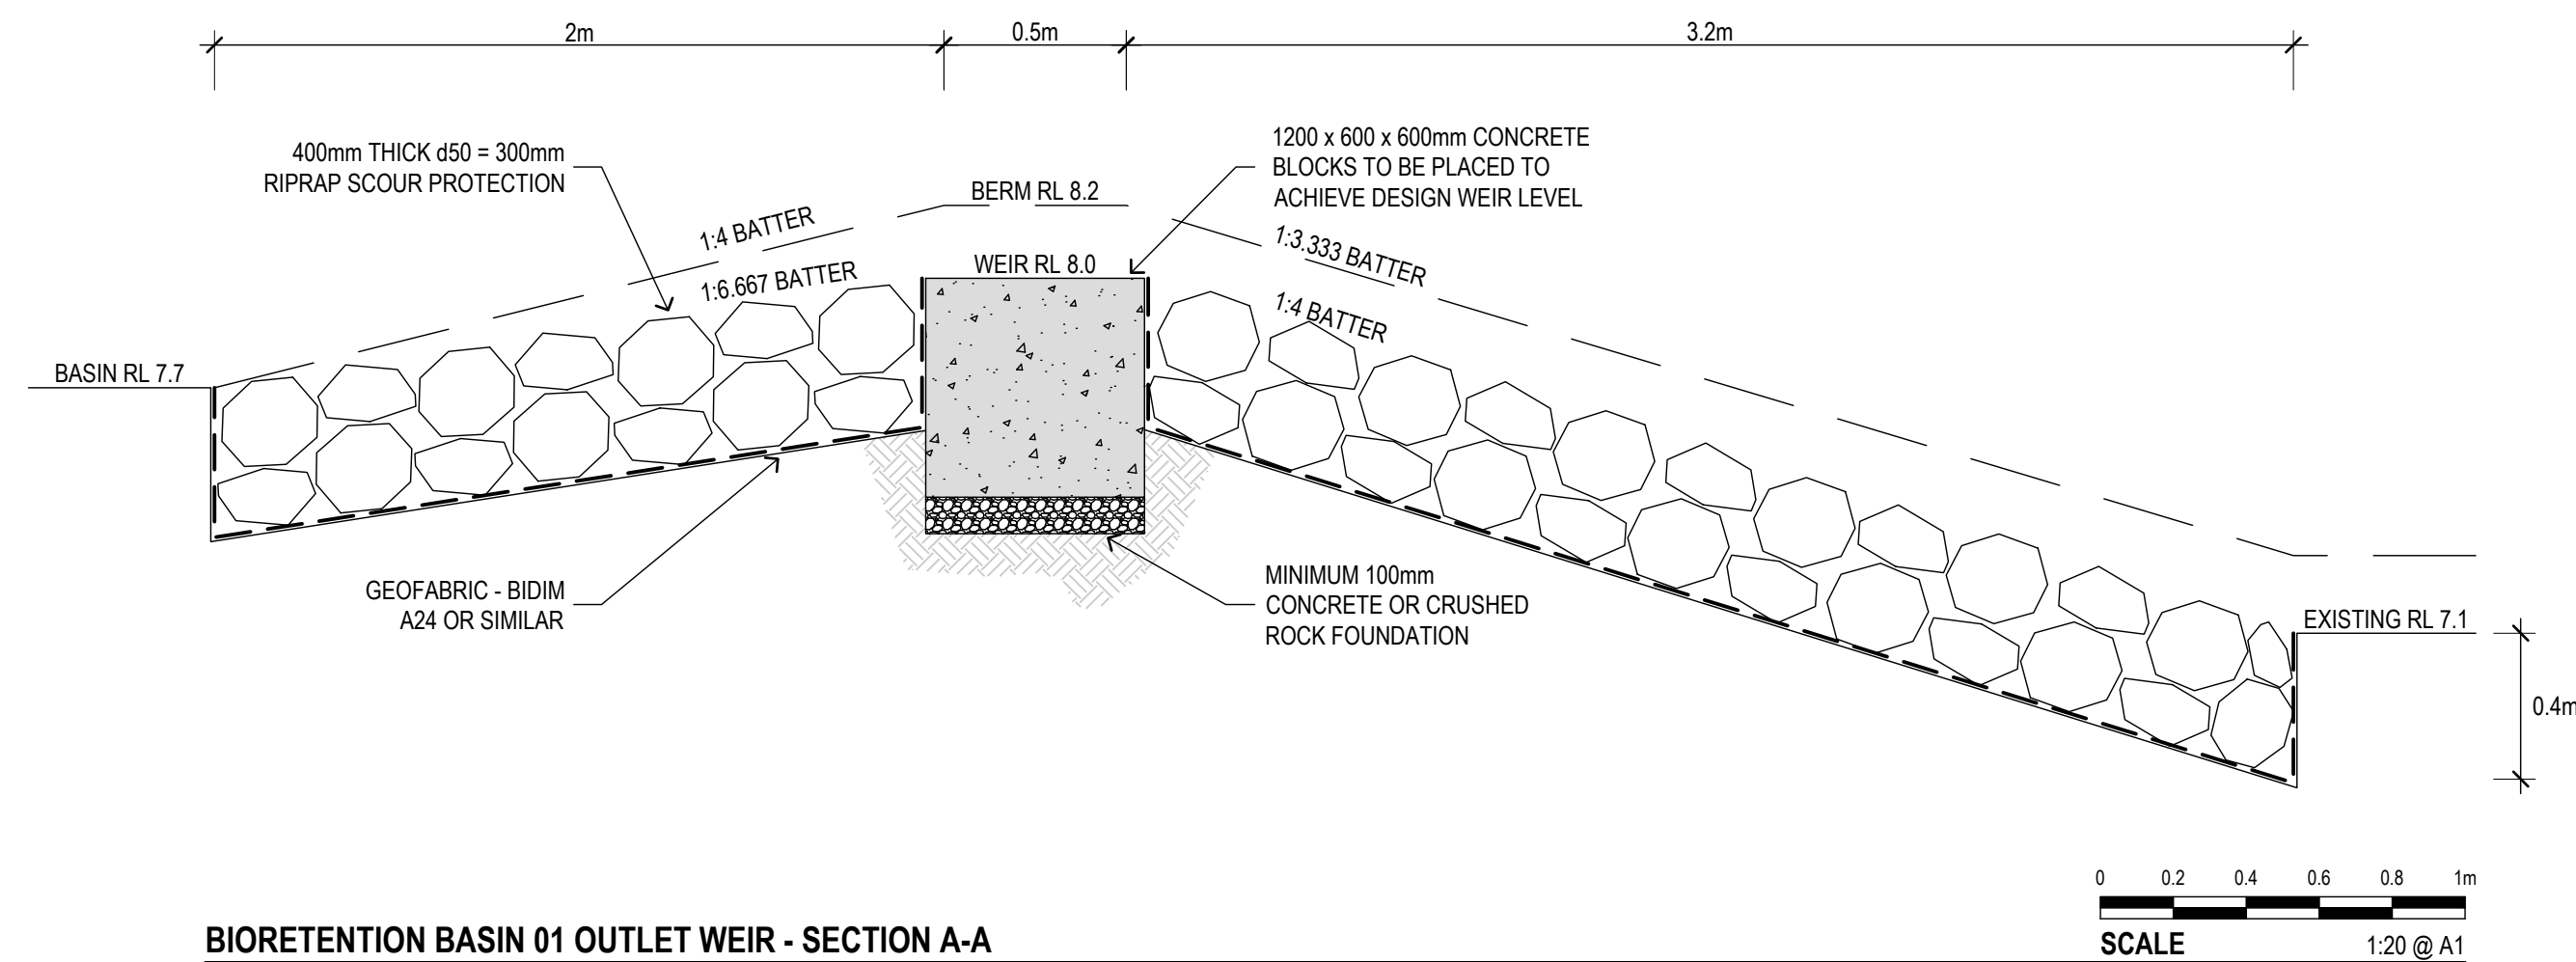

BIORETENTION MATERIALS SCHEDULE

ITEM	SPECIFICATION	SUPPLIER
MAXIJUTE FOR BIORETENTION BASIN	MAXIJUTE 'FINE'. PRESPLIT 6 HOLES/m²	TREEMAX PH. 03 9574 8600
JUTE MESH FOR BIORETENTION BASIN	JUTE MESH TO BE PLACED TO PREVENT FLOATATION OF MULCH	TREEMAX PH. 03 9574 8600
MULCH FOR BIO-RETENTION BASIN	SUGAR CANE MULCH OR EQUIVALENT (50-75mm THICKNESS) TO PROVIDE WEED SUPPRESSION AND RETAIN SOIL MOISTURE	FROM APPROVED SUPPLIER
FILTER MEDIUM FOR BIORETENTION BASIN	LOAMY SAND IN ACCORDANCE WITH GUIDELINES FOR SOIL FILTER MEDIA IN BIORETENTION SYSTEMS (FAWB JUNE 2009) 200mm/hr INFILTRATION RATE. NOTE: ORTHOPHOSPHATE CONTENT <35mg/kg. CONTRACTOR TO ARRANGE FOR TESTING OF MEDIA TO FAWB GUIDELINES PRIOR TO PLACEMENT AT A RATE OF 1 SAMPLE PER 500m² OR PART THEREOF. www.monash.edu.au/fawb/publications/index.html	FROM APPROVED SUPPLIER
TRANSITION LAYER FOR BIORETENTION BASIN	CLEAN WELL GRADED SAND < 2% FINES D15 (TRANSITION LAYER) < 5 X D85 (FILTER MEDIA) D15 (TRANSITION LAYER) = 5 - 20 X D15 (FILTER MEDIA) D50 (TRANSITION LAYER) < 25 X D50 (FILTER MEDIA) D60 (TRANSITION LAYER) < 20 X D10 (DRAINAGE LAYER)	FROM APPROVED SUPPLIER
DRAINAGE LAYER	CLEAN FINE GRAVEL (EG. WASHED SCREENINGS) - D15 (DRAINAGE LAYER) < 5 X D85 (TRANSITION LAYER)	FROM APPROVED SUPPLIER

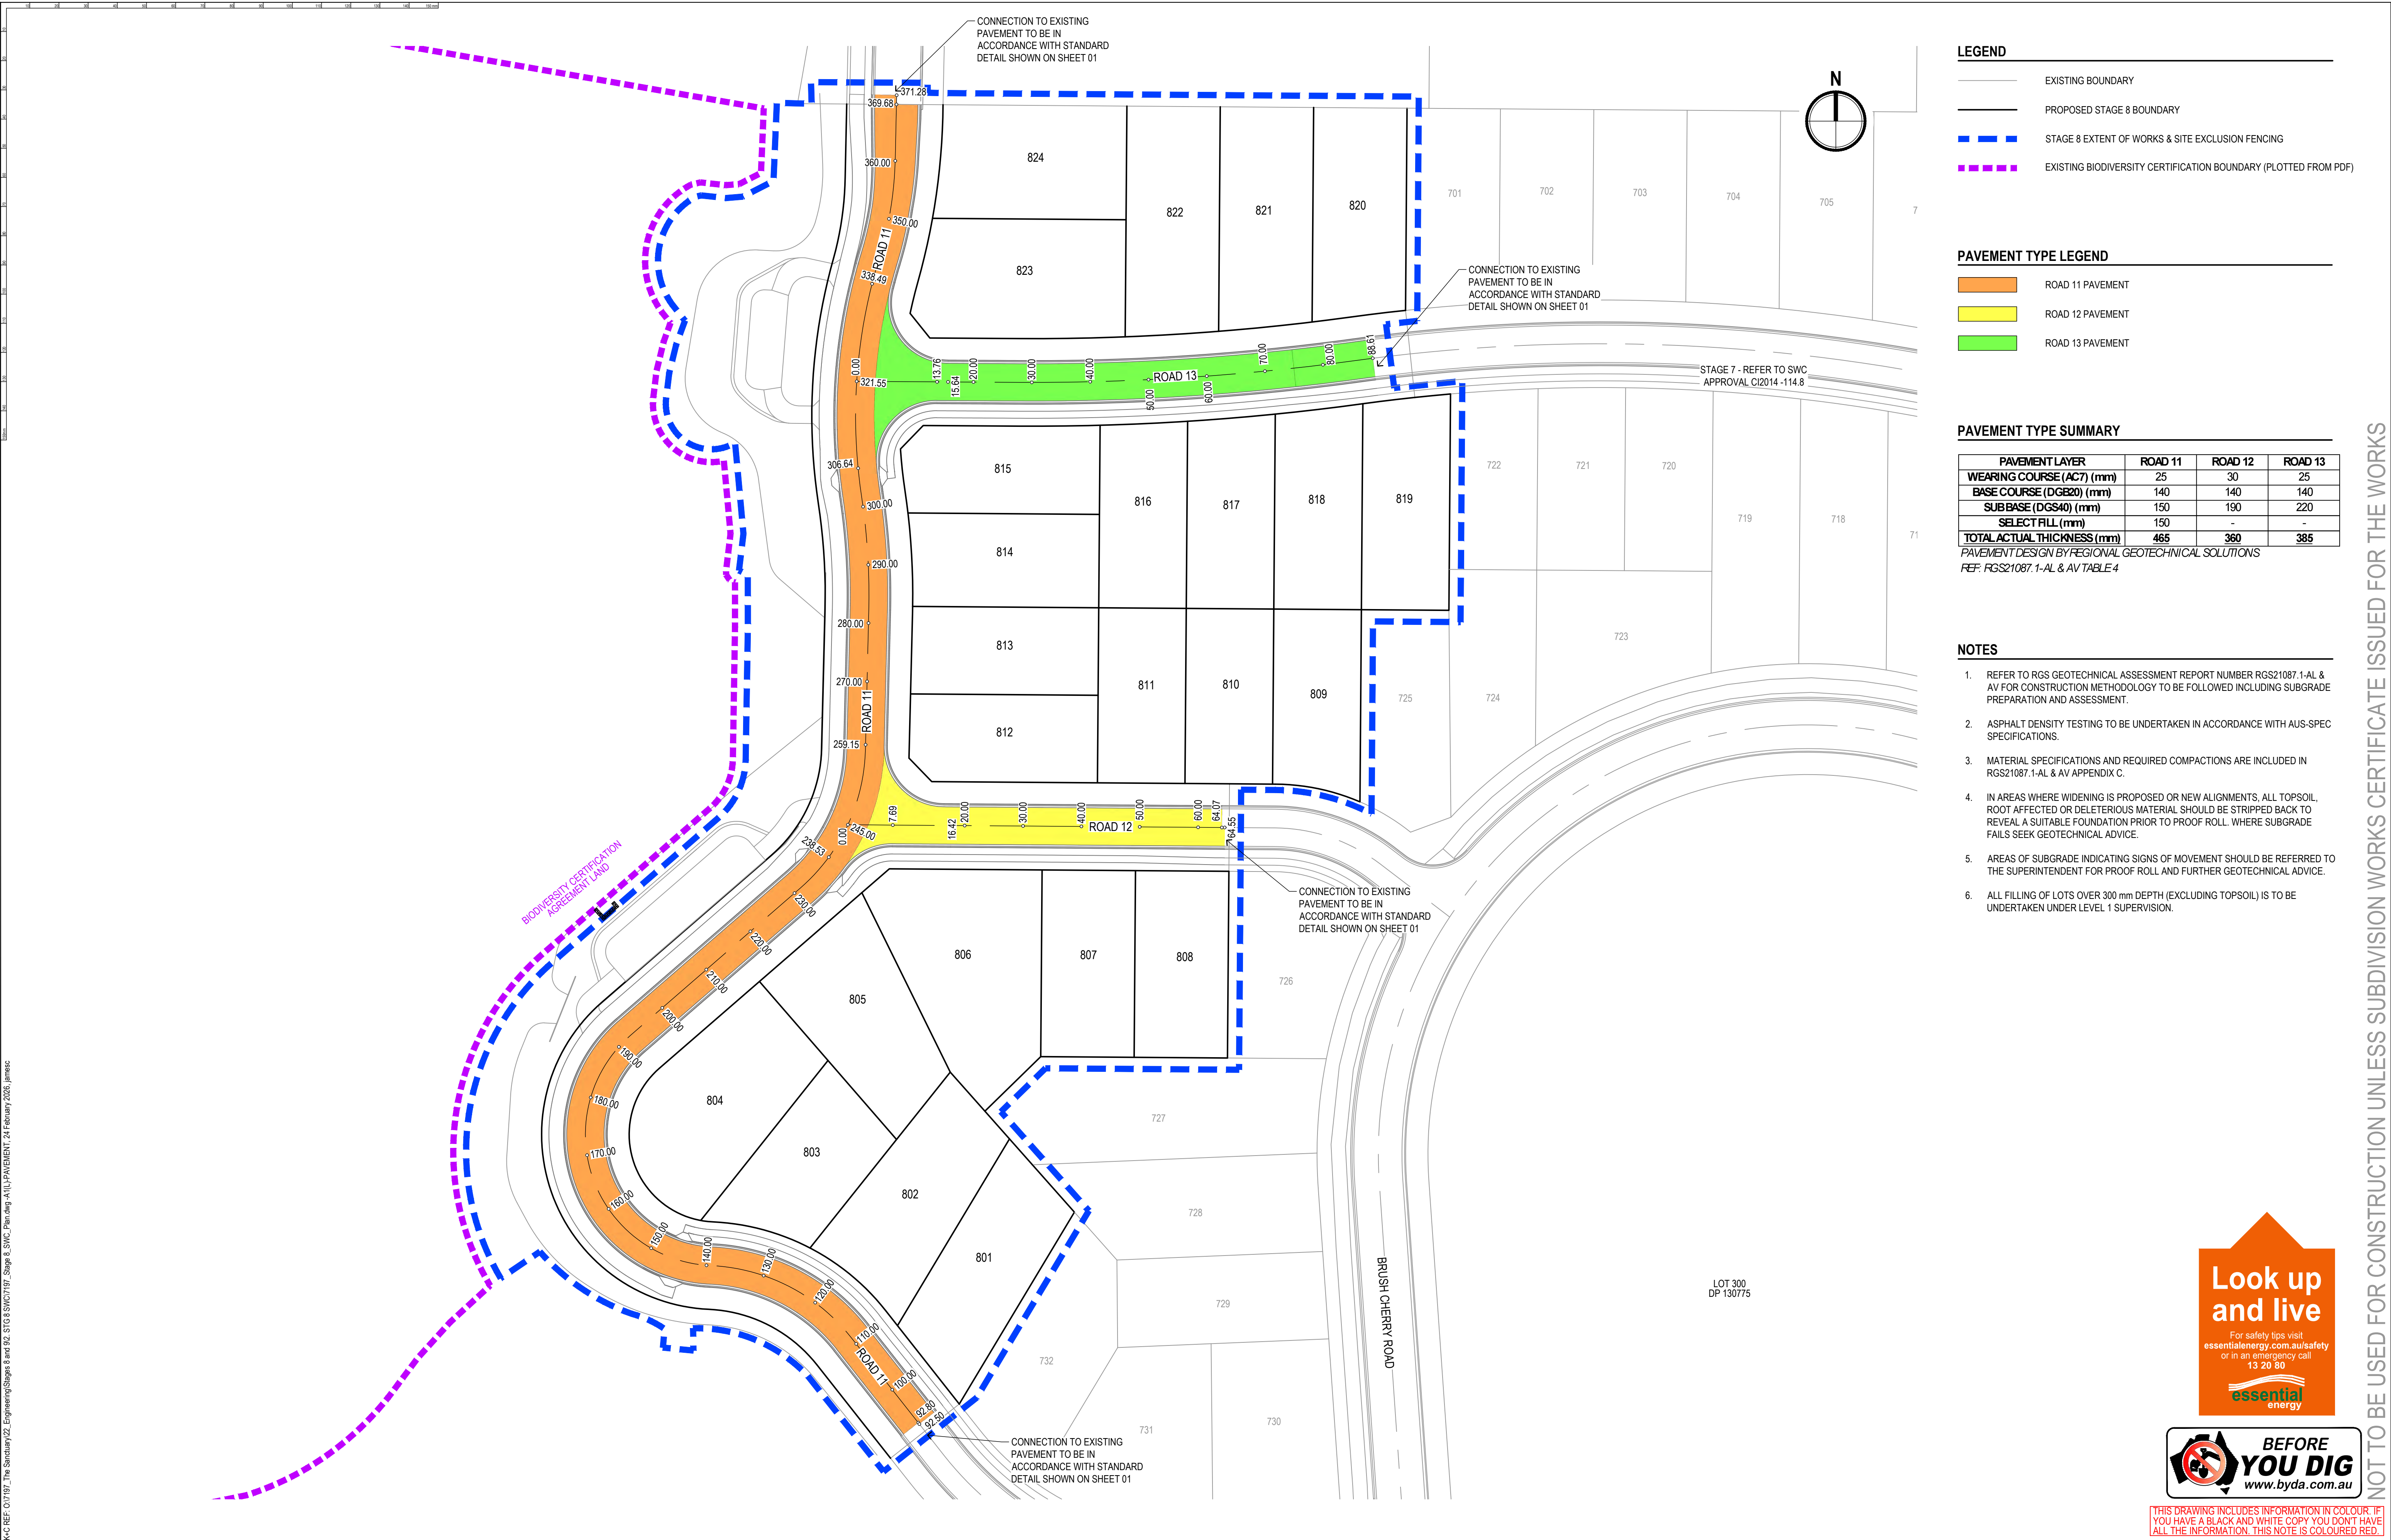

K:\C-REF-017197_The Sanctuary\02_Engineering\Stages 8 and 9\2 STG 8 SWC\2107_Stage 8_SWC_Plan.dwg 4/11/PAVEMENT 24 February 2025 janes

REV.	DATE	DESCRIPTION	BY
A	31.10.2025	ISSUED FOR APPROVAL	JSC

PROJECT NO:	7197	DRAWING TITLE:	PAVEMENT PLAN
DA NO.:	2014-114	PROJECT:	THE SANCTUARY STAGE 8 LOT 300, DP 1307775 - JOHN OXLEY DRIVE, THURMSTER
DESIGNED BY:	JSC/BC	CLIENT:	BIRD IN THE HAND 2 PTY LTD.
DRAWN BY:	JSC	DRAWING NO:	7197_Stage 8_SWC_Plan
CHECKED BY:	BC	SHEET:	10 OF 36
DATE CREATED:	JULY 2025	REVISION:	A

NOT TO BE USED FOR CONSTRUCTION UNLESS SUBDIVISION WORKS CERTIFICATE ISSUED FOR THE WORKS

Look up
and live

For safety tips visit
essentialenergy.com.au/safety
or in an emergency call
13 20 80

essential
energy




THIS DRAWING INCLUDES INFORMATION IN COLOUR. IF YOU HAVE A BLACK AND WHITE COPY YOU DON'T HAVE ALL THE INFORMATION. THIS NOTE IS COLOURED RED.


K:\C-REF-01787_The Sanctuary\02_Engineering\Stages 8 and 9\2-STG8-SWC\2107_Stage 8_SWC_Sections.dwg A:\U-RO-LS\1_24 February 2026_jenenc

K&C REF: 01787



CONNECTION TO EXISTING PAVEMENT
TO BE IN ACCORDANCE WITH
STANDARD DETAIL ON SHEET 01

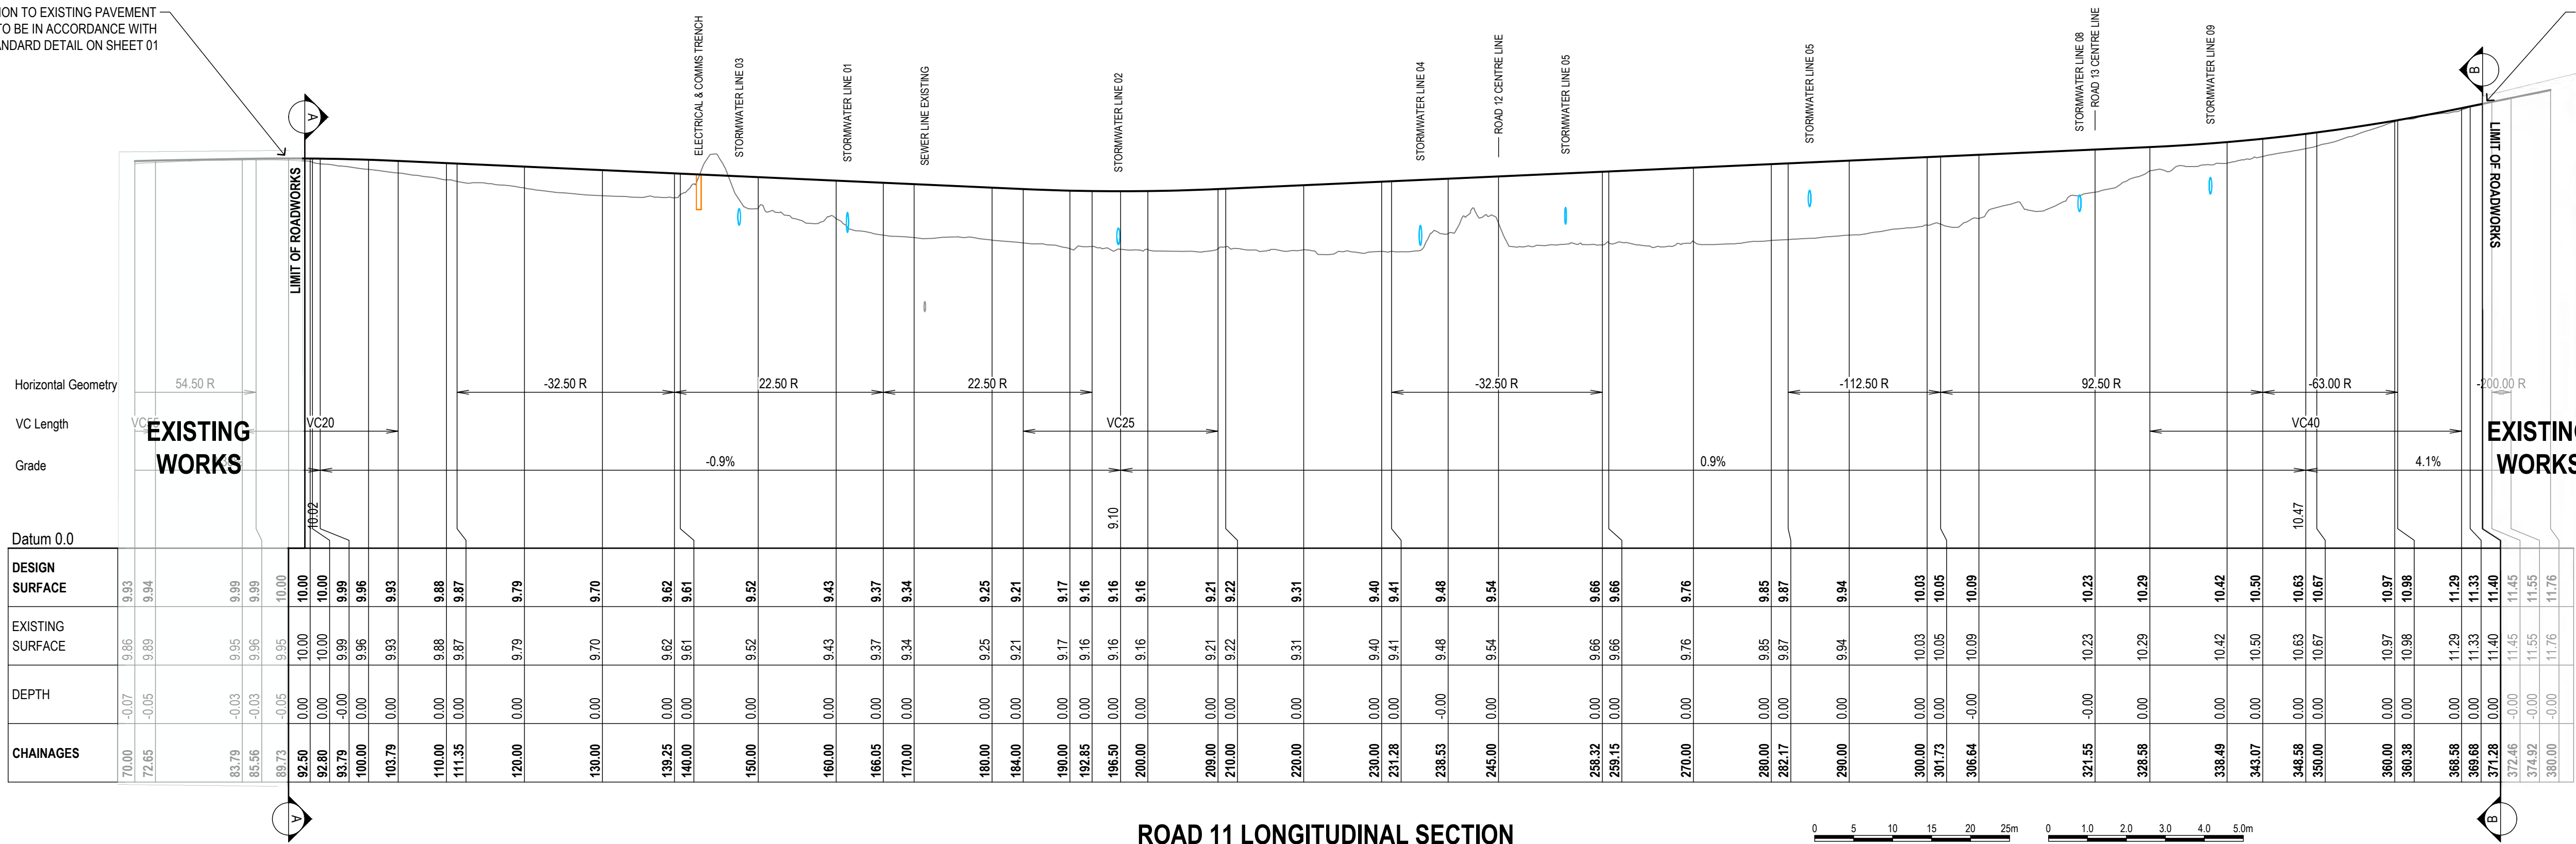



ROAD 11 LONGITUDINAL SECTION



ROAD 11 TYPICAL CROSS SECTION (CH 90.97 TO 144.2)

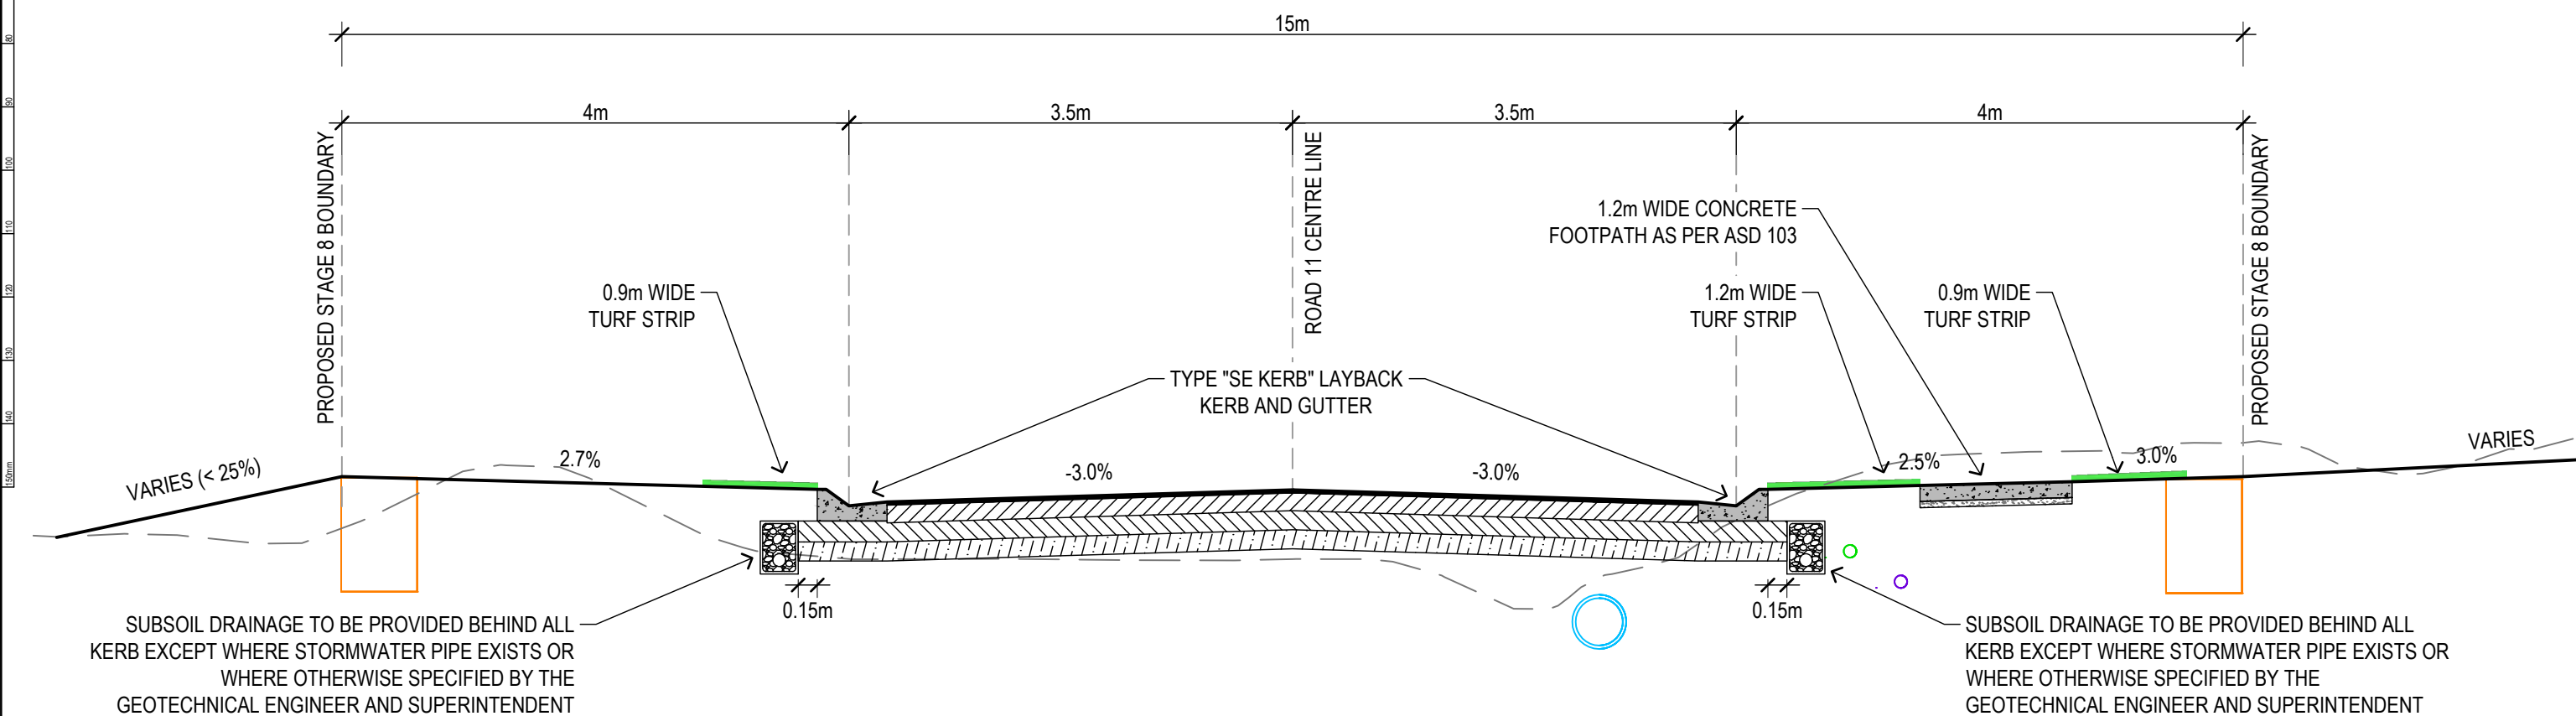

ROAD 11 TYPICAL CROSS SECTION (CH 144.2 TO 371.28)

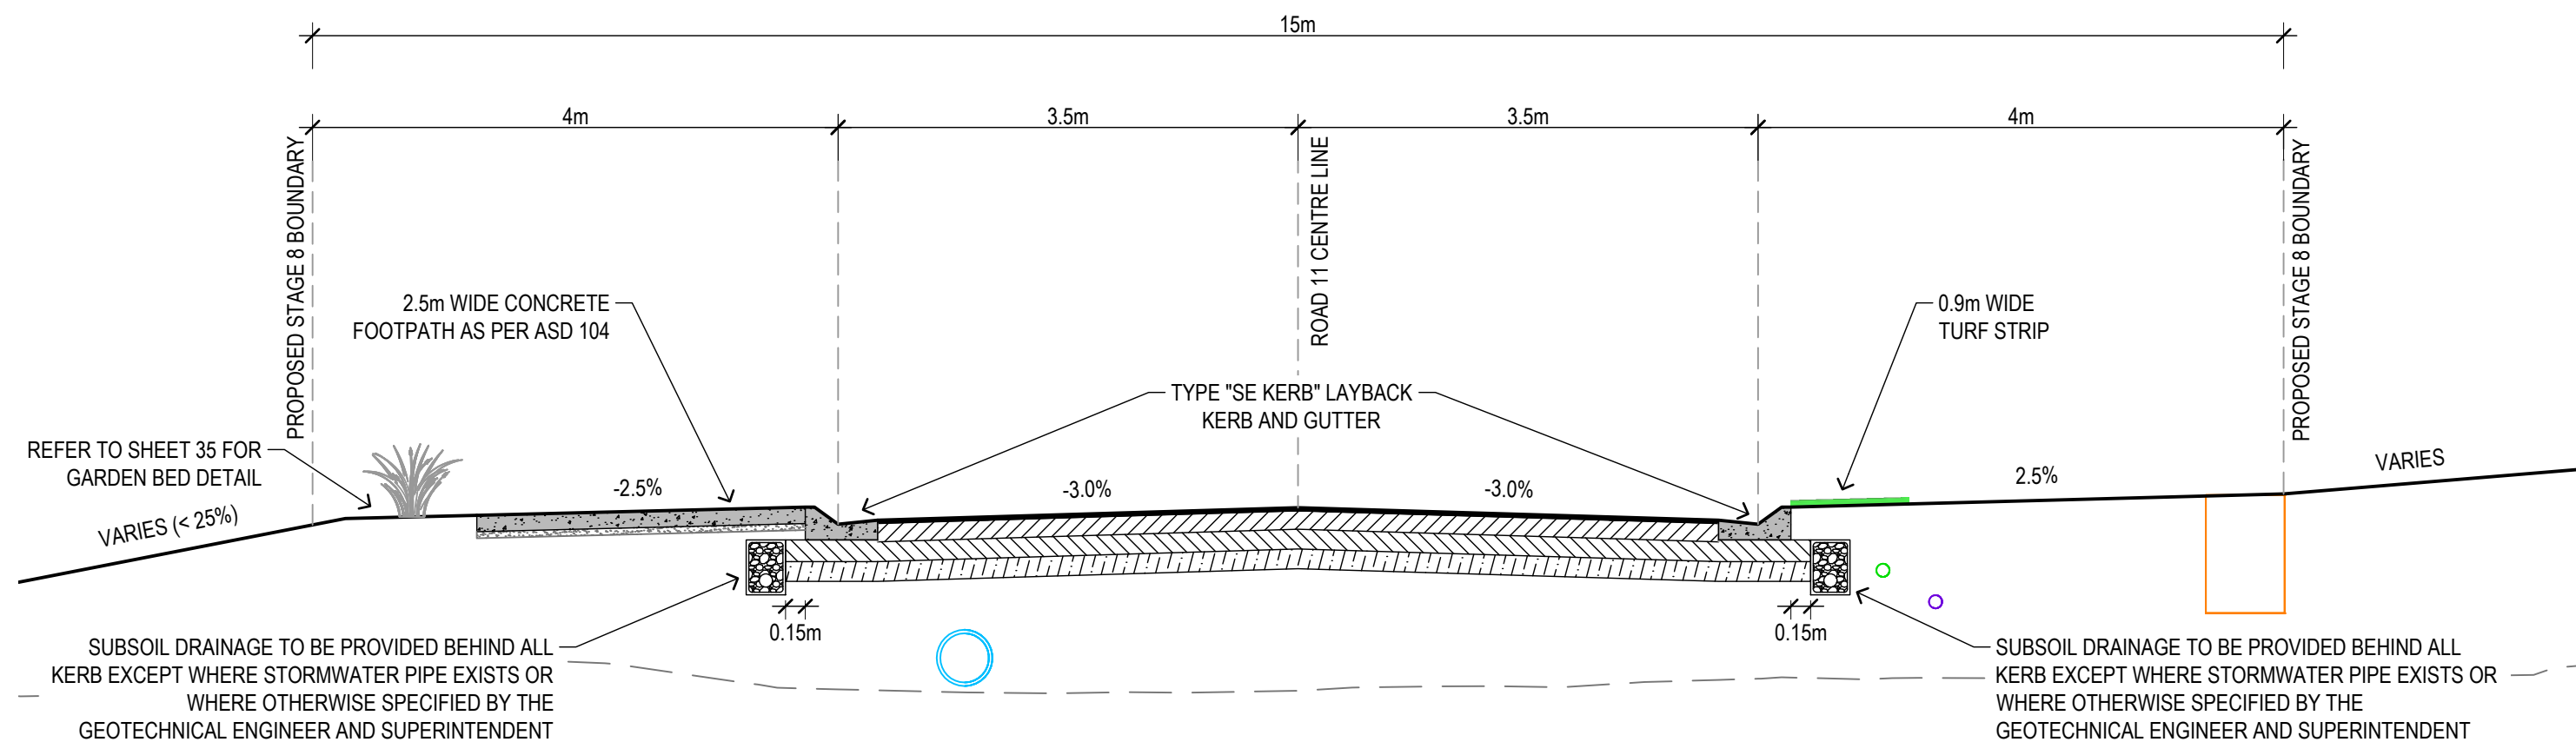

ROAD 11

WEARING COURSE: 25 mm ASPHALTIC CONCRETE (UNDERLAIN BY 7 mm PRIMER SEAL)

BASE: 140 mm DGS20

SUBBASE: 150 mm DGS40

SUBGRADE: 150 mm CONSOLIDATED DEPTH SELECT FILL CBR > 15

PAVEMENT TO BE IN ACCORDANCE WITH REGIONAL GEOTECHNICAL SOLUTIONS REPORT RGS21087.1-AL & AV FOR FURTHER DETAILS.

PAVEMENT TO BE VERIFIED FOLLOWING STRIPPING TO SUBGRADE LEVEL AND ASSESSMENT BY GEOTECHNICAL ENGINEER.

REV.	DATE	DESCRIPTION	
A	31.10.2025	ISSUED FOR APPROVAL	JSC


DATUM: AHD

SCALE: AS SHOWN @ A1


NOTE: DO NOT SCALE OFF DRAWINGS. USE FIGURED DIMENSIONS ONLY. REPORT ANY DISCREPANCIES TO THE AUTHOR. THIS DRAWING, BEING THE PROPERTY OF KING & CAMPBELL PTY LTD, IS PROTECTED BY COPYRIGHT AND MUST NOT BE USED, REPRODUCED OR COPIED WHOLLY, OR IN PART WITHOUT THE WRITTEN PERMISSION OF KING & CAMPBELL PTY LTD. © King & Campbell Pty Ltd

PROJECT NO:	7197	DRAWING TITLE:	ROAD 11 LONGITUDINAL SECTION & TYPICAL SECTIONS
DA NO.:	2014-114	PROJECT:	THE SANCTUARY STAGE 8 LOT 300, DP 1307775 - JOHN OXLEY DRIVE, THRUMSTER
DESIGNED BY:	JSC/BC	CLIENT:	BIRD IN THE HAND 2 PTY LTD.
DRAWN BY:	JSC	DRAWING NO:	7197_Stage 8_SWC_Sections
CHECKED BY:	BC	SHEET:	11 OF 36
DATE CREATED:	JULY 2025	REVISION:	A


K:\C-REF-017197_The Sanctuary\02_Engineering\Stages 8 and 9\2-STG 8 SWC\2107_Stage 8_SWC_Sections.dwg - A1(1)-RD-XS 01, 24 February 2026, jenos

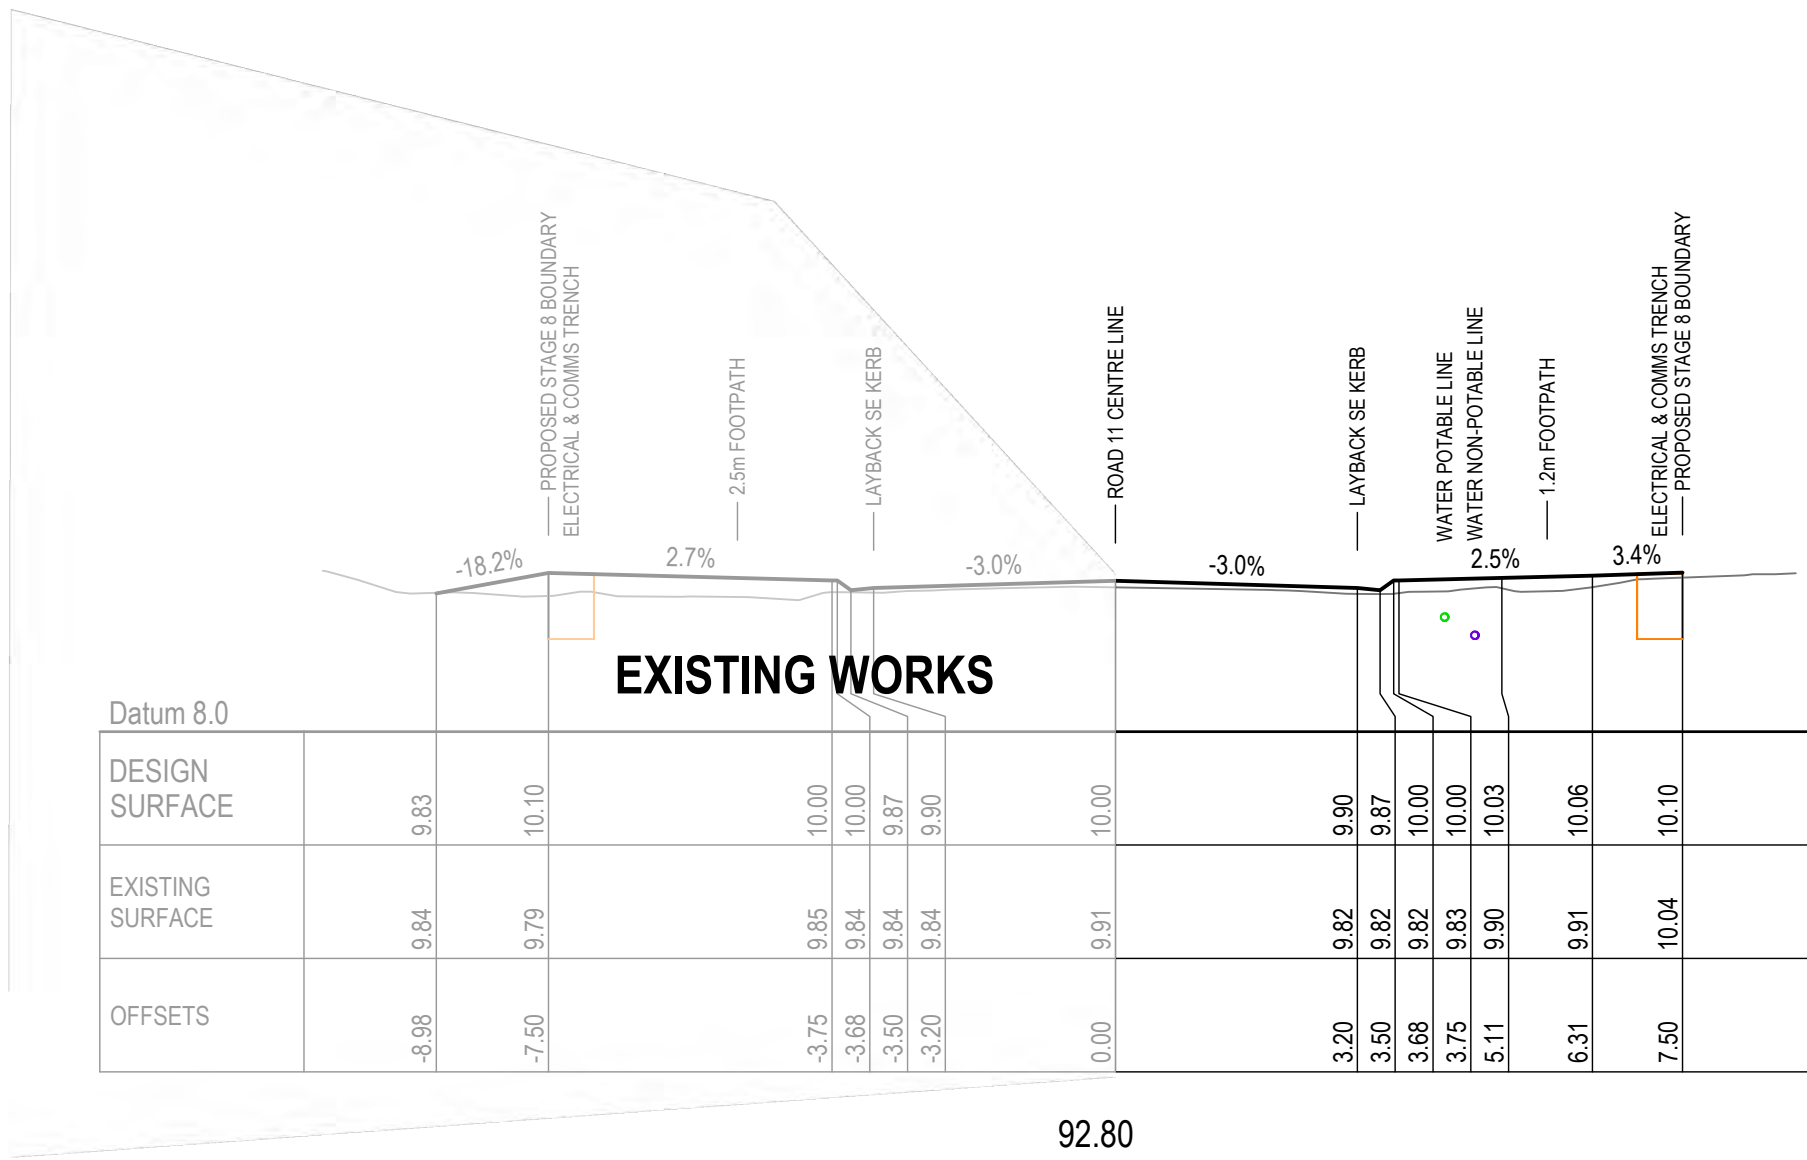


92.80

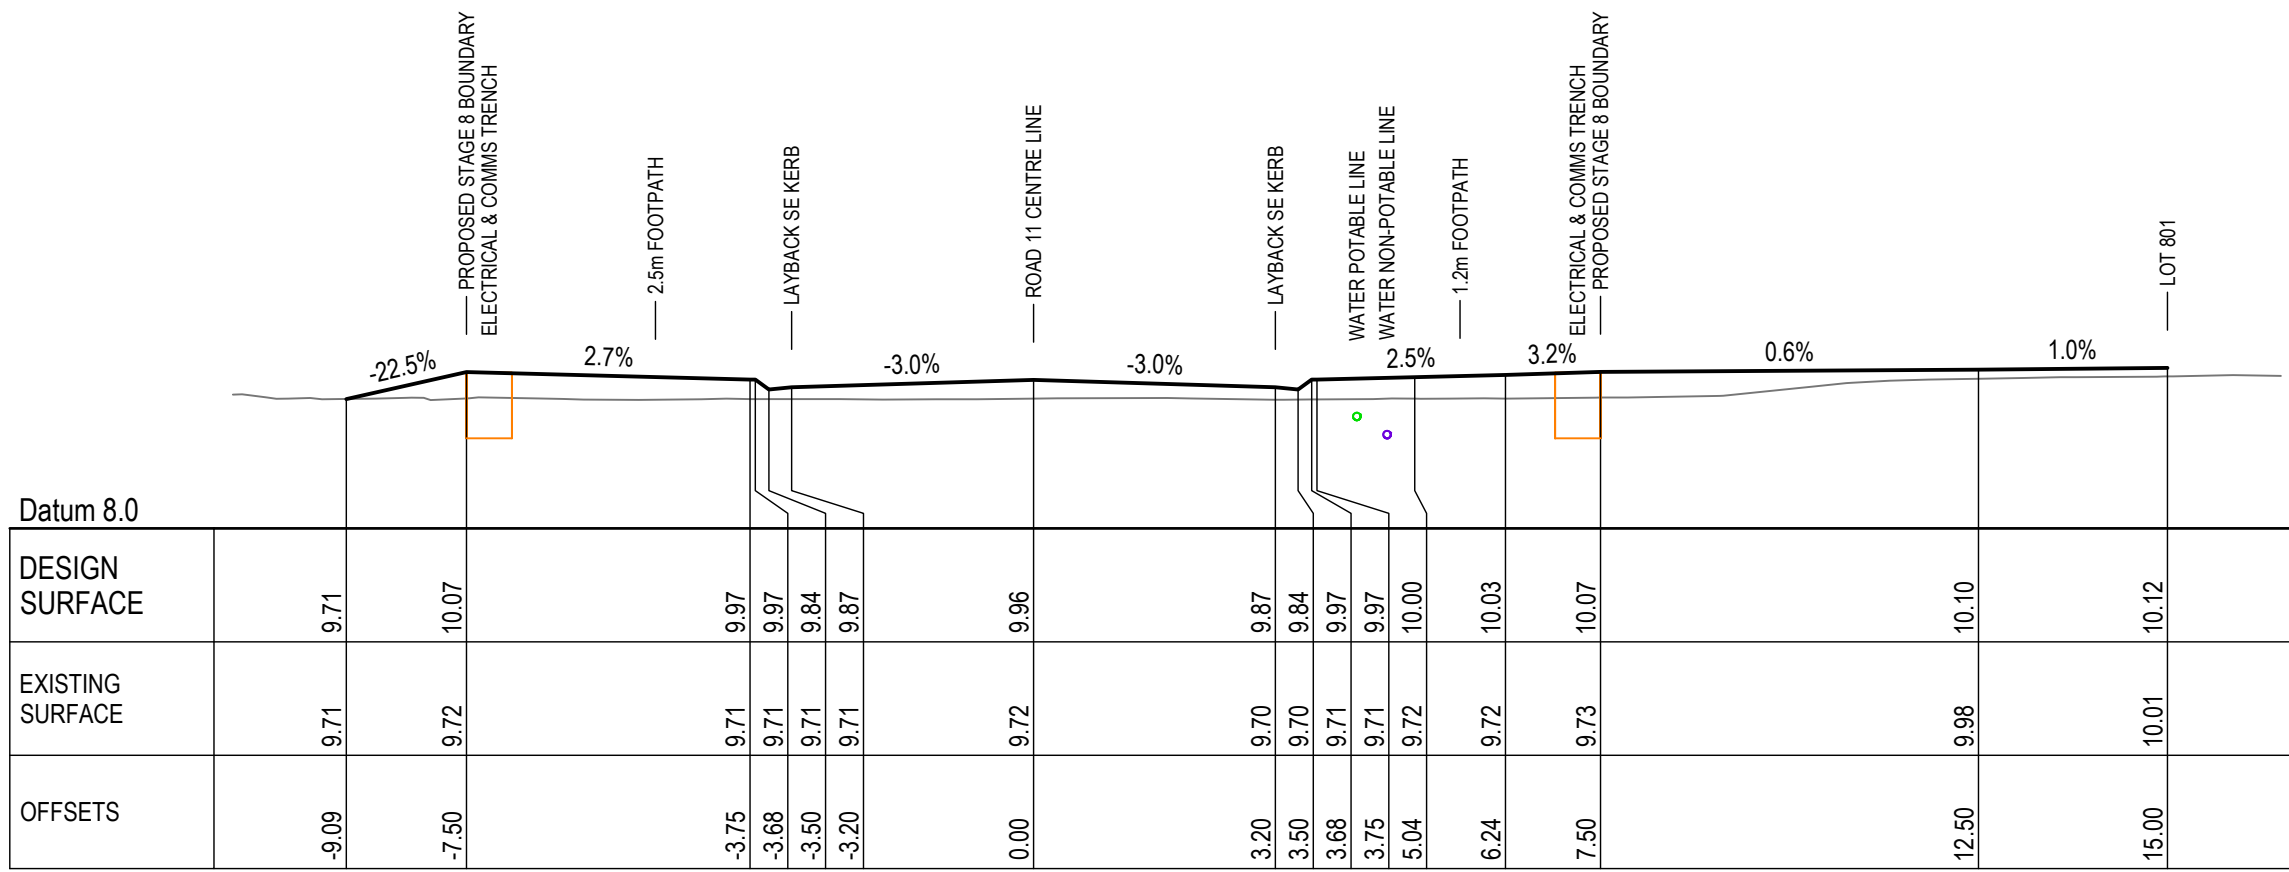


100.00

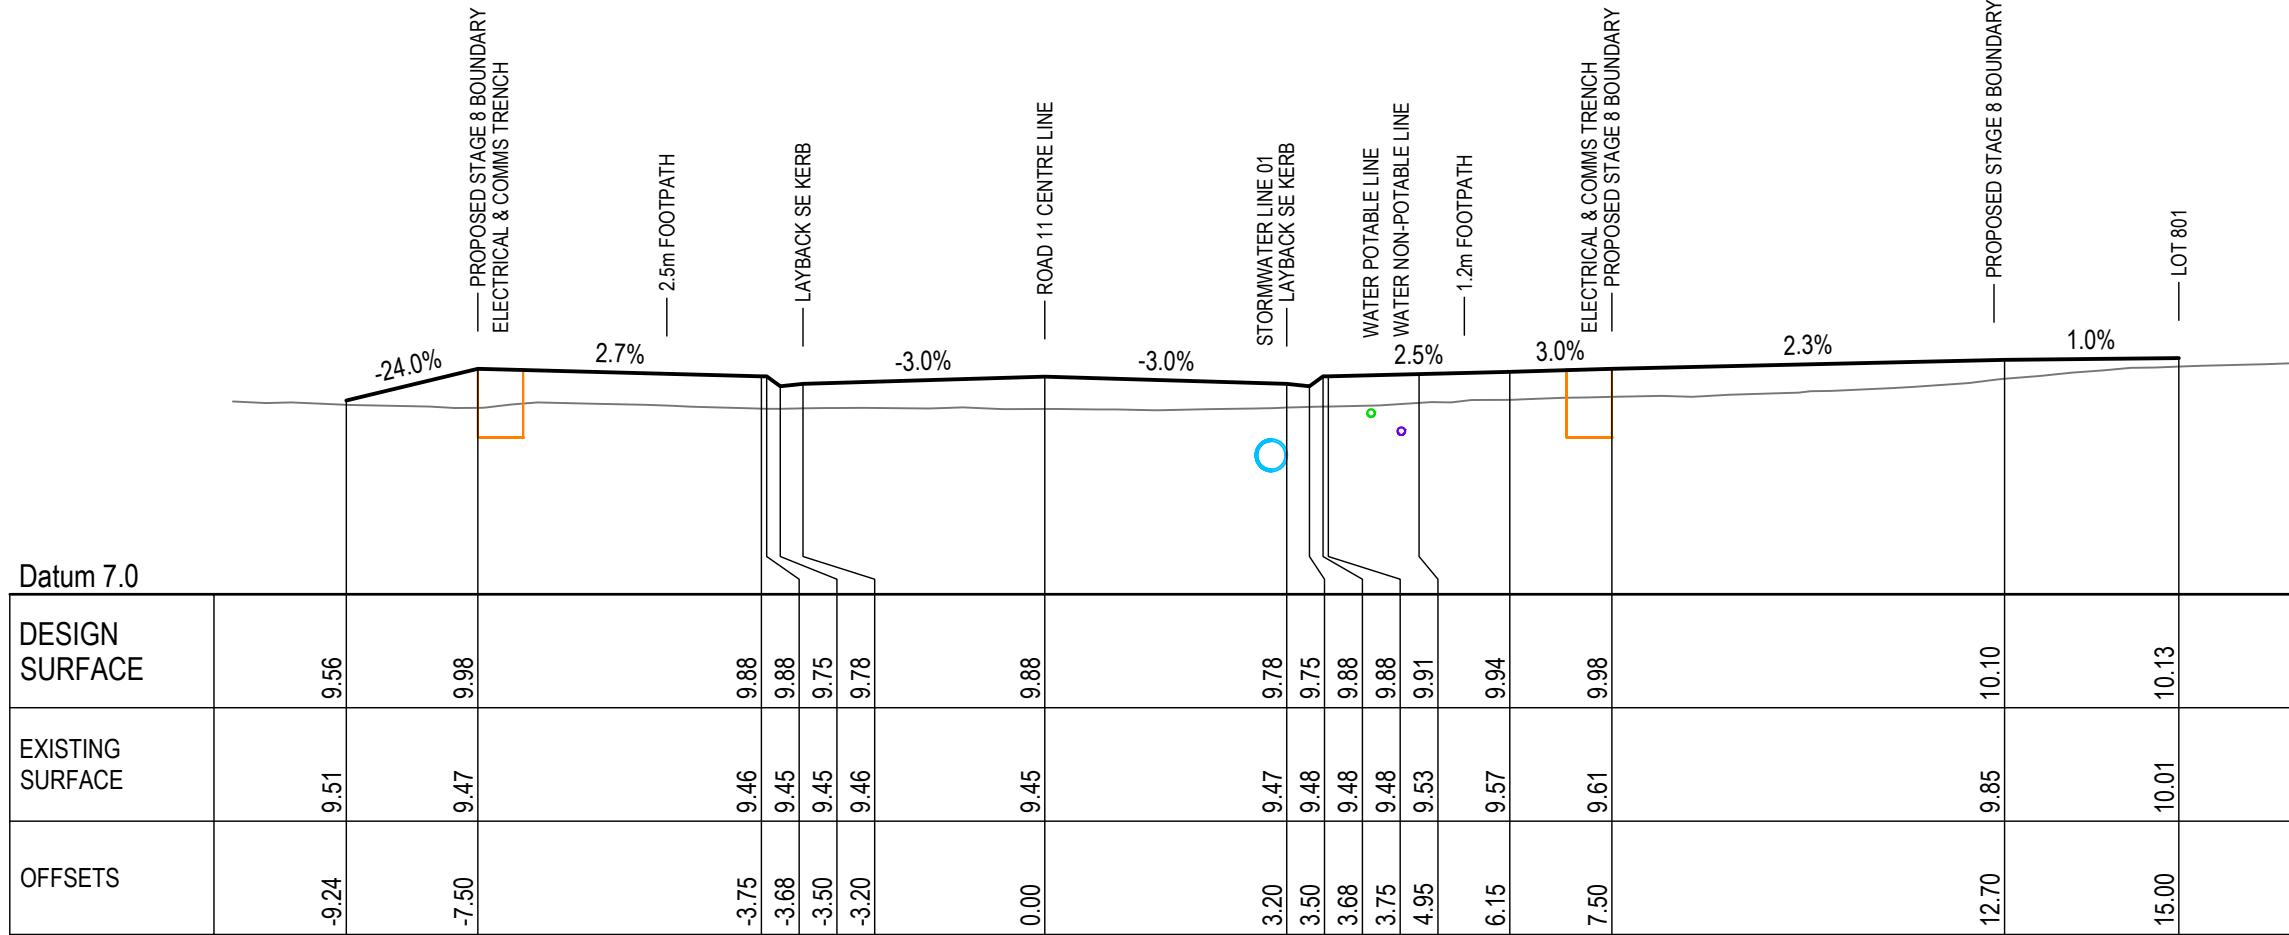


110.00

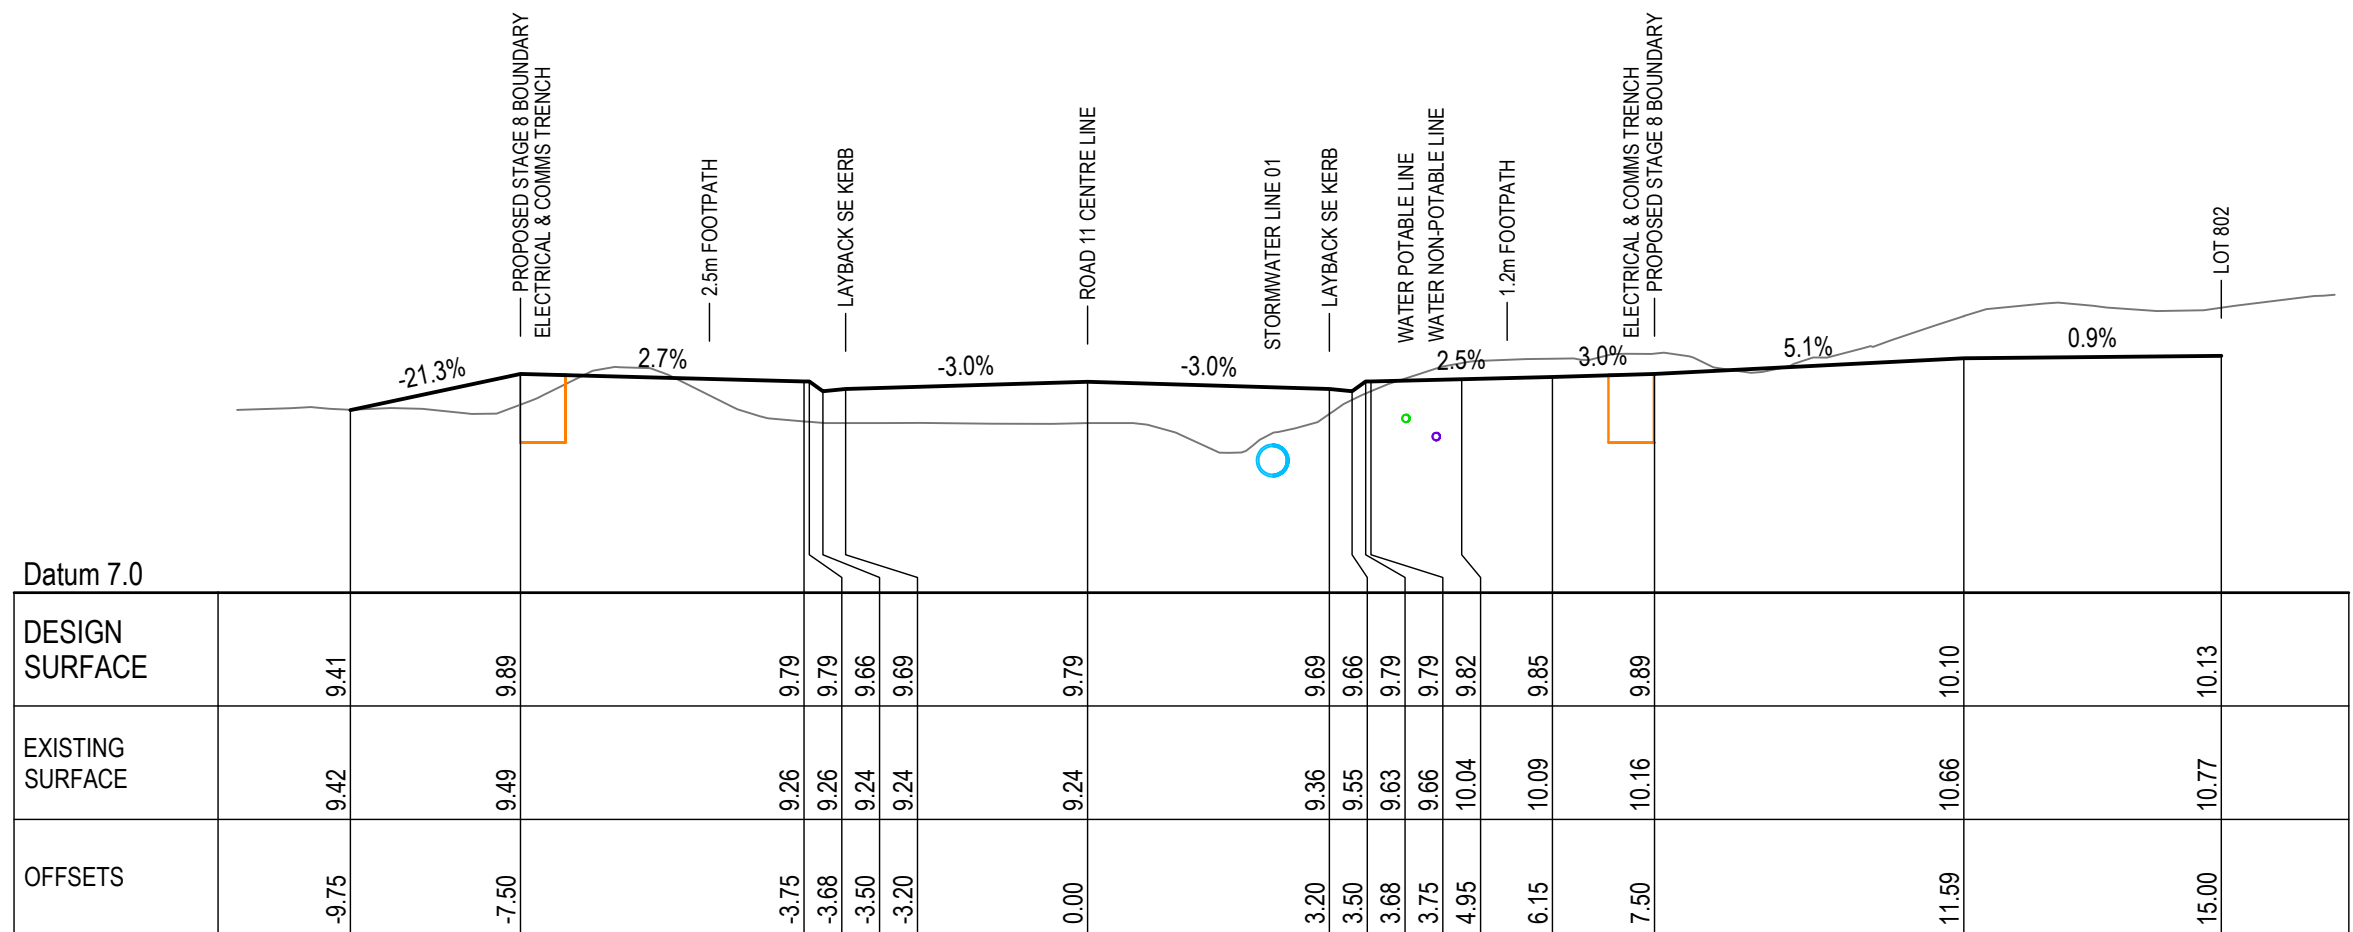

120.00

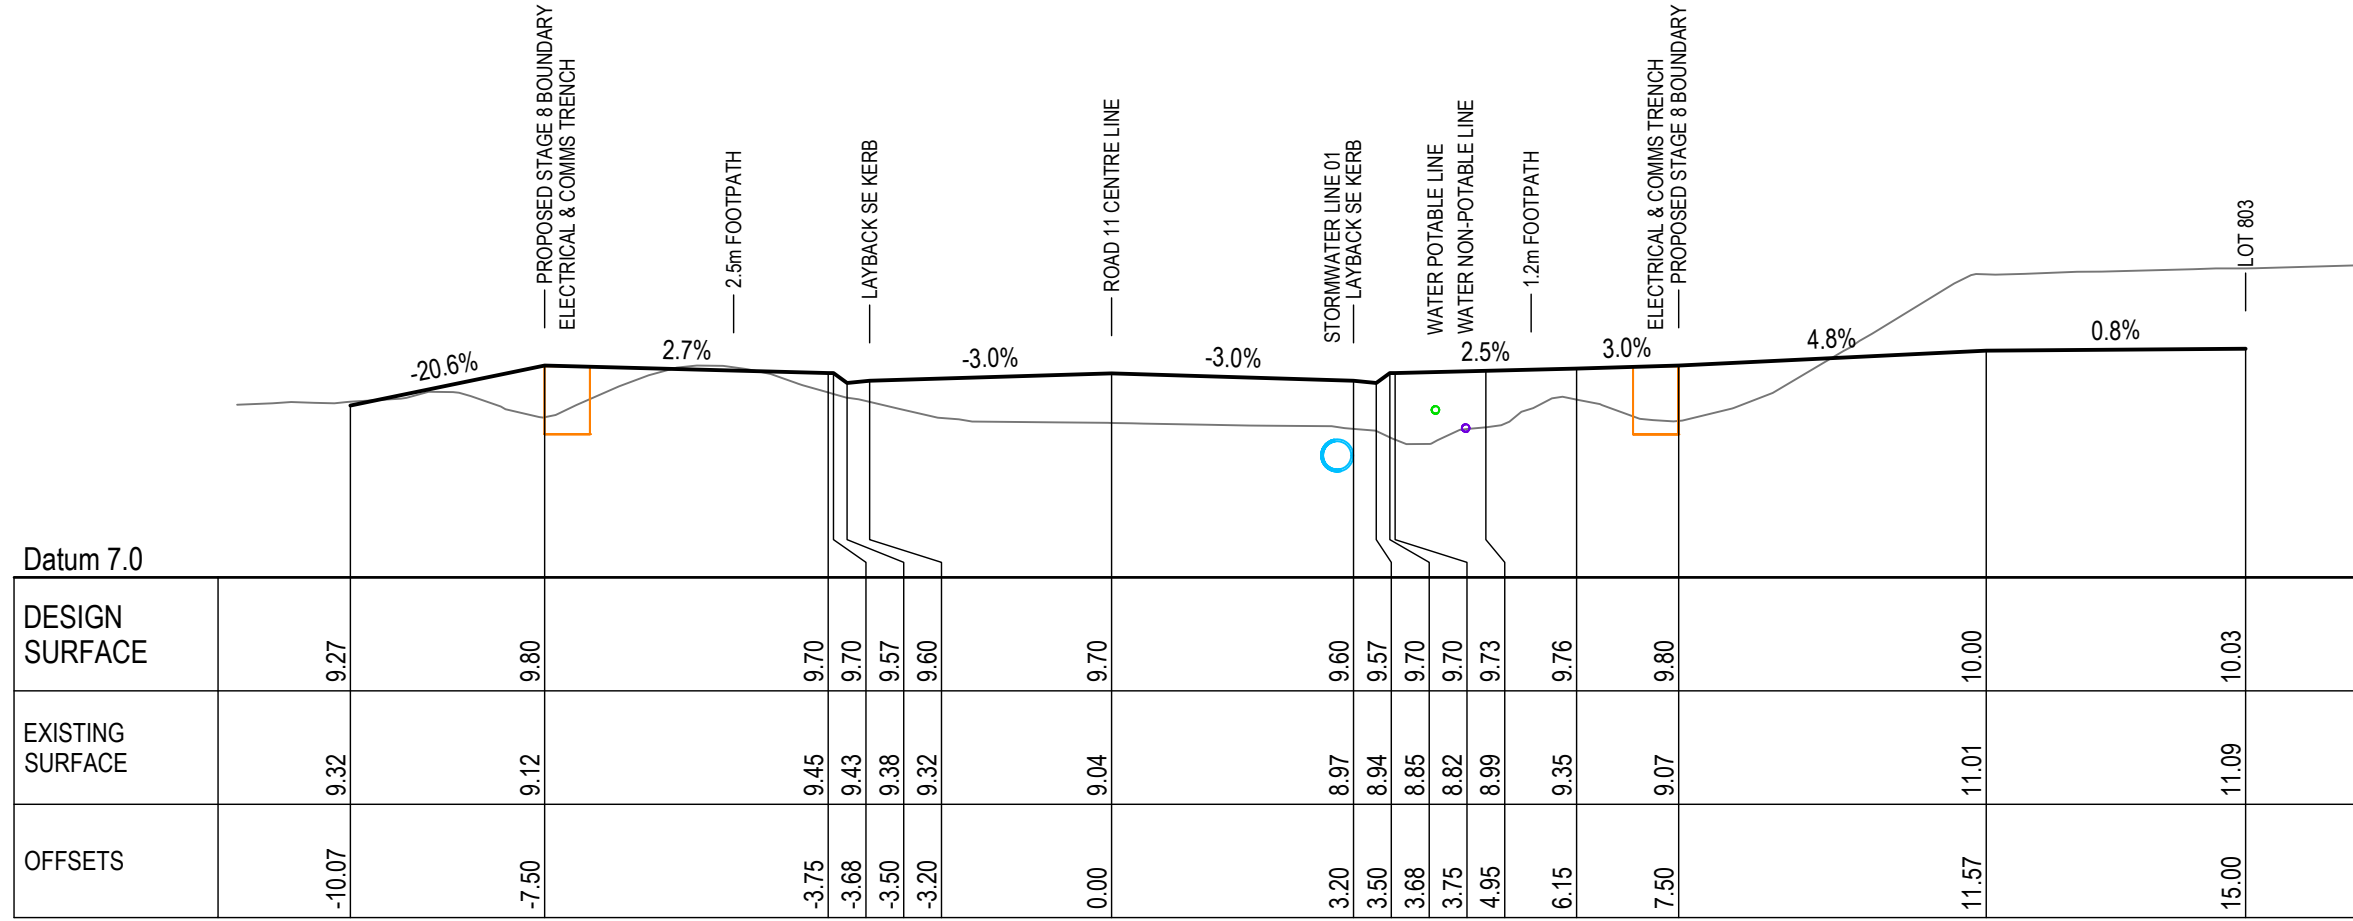

130.00

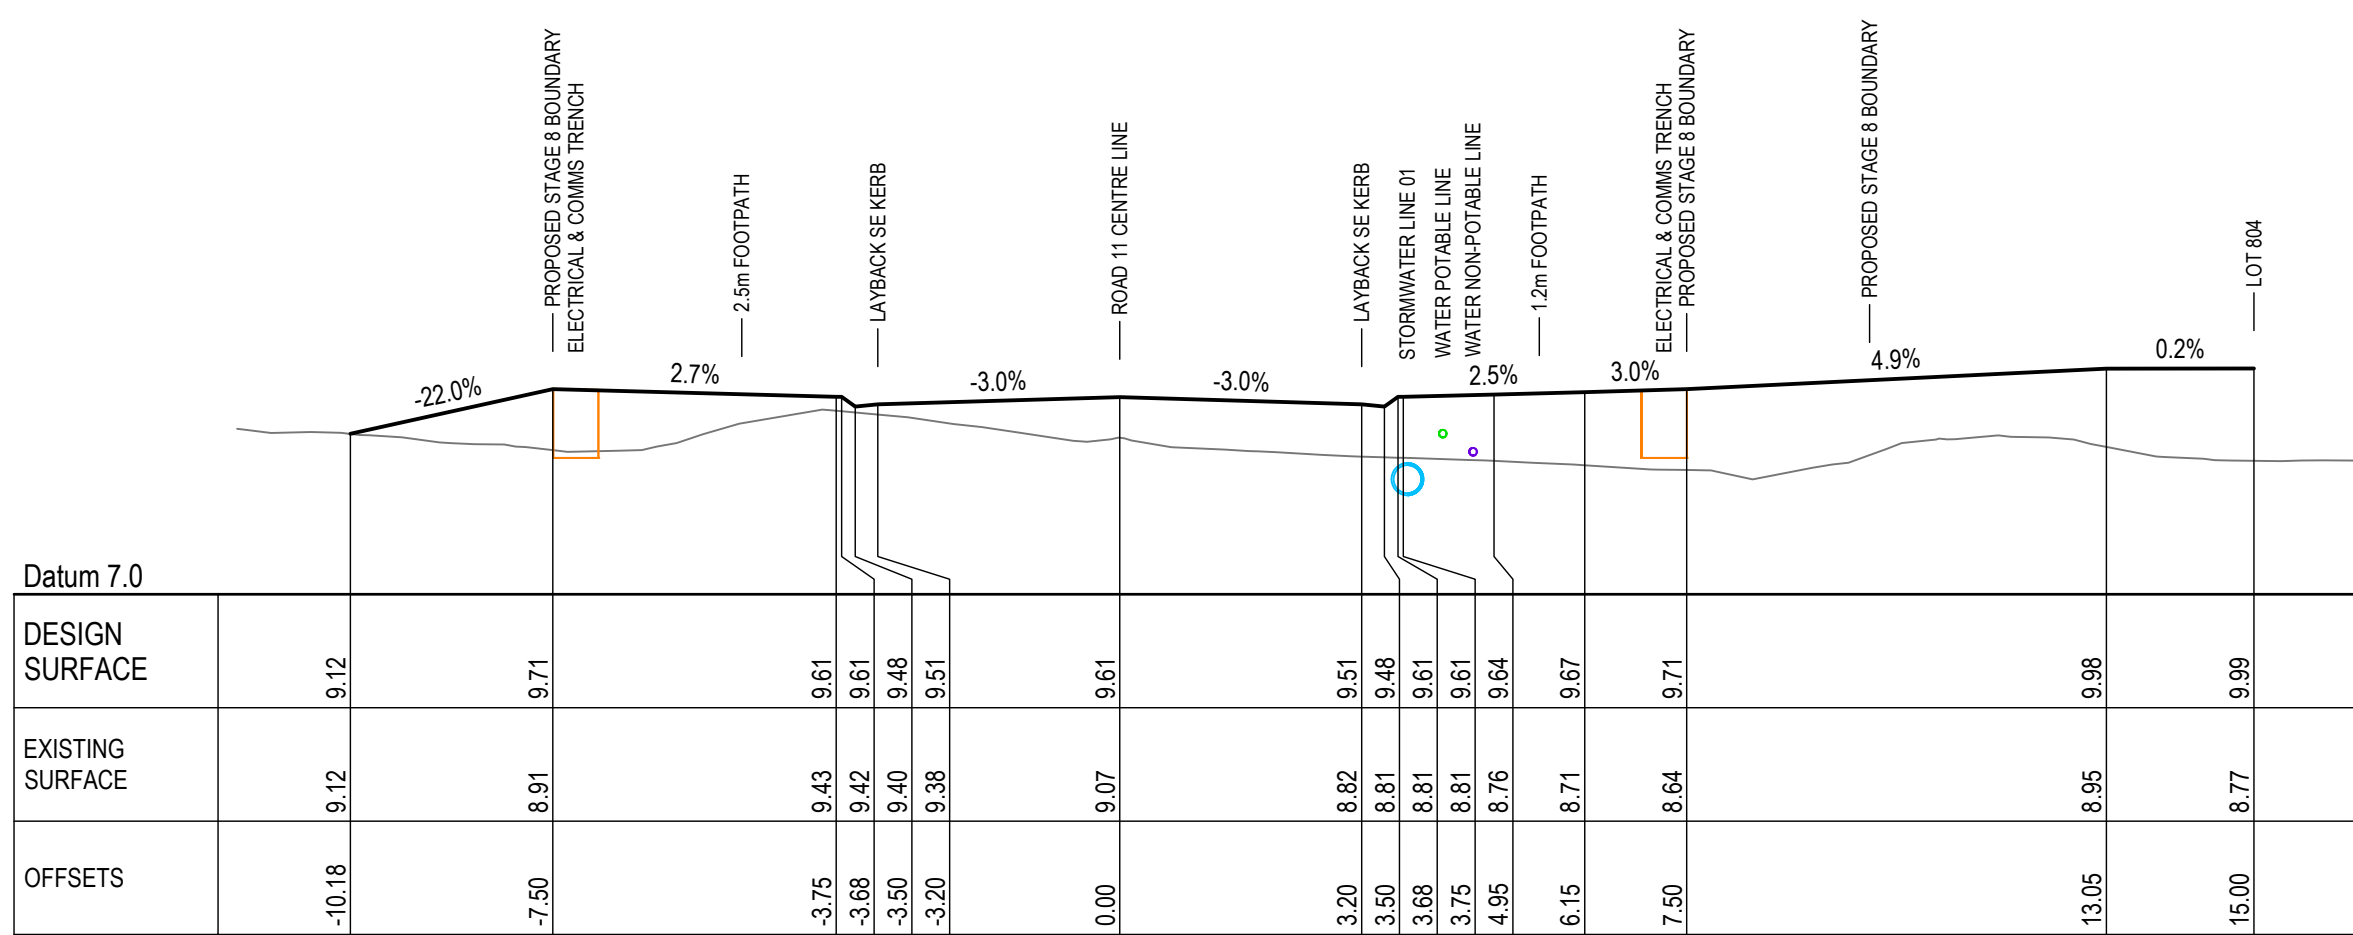

140.00

REV.	DATE	DESCRIPTION	
A	31.10.2025	ISSUED FOR APPROVAL	JSC

DATUM: AHD SCALE: AS SHOWN @ A1

NOTE: DO NOT SCALE OFF DRAWINGS. USE FIGURED DIMENSIONS ONLY. REPORT ANY DISCREPANCIES TO THE AUTHOR. THIS DRAWING BEING THE PROPERTY OF KING & CAMPBELL PTY LTD, IS PROTECTED BY COPYRIGHT AND MUST NOT BE USED, REPRODUCED OR COPIED WHOLLY, OR IN PART WITHOUT THE WRITTEN PERMISSION OF KING & CAMPBELL PTY LTD.
© King & Campbell Pty Ltd








PROJECT NO:	7197	DRAWING TITLE:	ROAD 11 CROSS SECTIONS CH 92.50 TO 140.00
DA NO.:	2014-114	PROJECT:	THE SANCTUARY STAGE 8 LOT 300, DP 1307775 - JOHN OXLEY DRIVE, THURMSTER
DESIGNED BY:	JSC/BC	CLIENT:	BIRD IN THE HAND 2 PTY LTD.
DRAWN BY:	JSC	DRAWING NO:	7197_Stage 8_SWC_Sections
CHECKED BY:	BC	SHEET:	12 OF 36
DATE CREATED:	JULY 2025	REVISION:	A

K:\C-REF-01797-The Sanctuary\02_Engineering\Stages 8 and 9\2-STG 8 SWC\2107_Stage 8_SWC_Sections.dwg - A1(1)-RD-02_24 February 2026_jenae

REV.	DATE	DESCRIPTION	
A	31.10.2025	ISSUED FOR APPROVAL	JSC

DATUM:	AHD	SCALE:	AS SHOWN @ A1
NOTE: DO NOT SCALE OFF DRAWINGS. USE FIGURED DIMENSIONS ONLY. REPORT ANY DISCREPANCIES TO THE AUTHOR. THIS DRAWING BEING THE PROPERTY OF KING & CAMPBELL PTY LTD, IS PROTECTED BY COPYRIGHT AND MUST NOT BE USED, REPRODUCED OR COPIED WHOLLY, OR IN PART WITHOUT THE WRITTEN PERMISSION OF KING & CAMPBELL PTY LTD. © King & Campbell Pty Ltd			

PROJECT NO:	7197	DRAWING TITLE:	ROAD 11 CROSS SECTIONS CH 150.00 TO 200.00			
DA NO.:	2014-114	DESIGNED BY:	JSC/BC	PROJECT:	THE SANCTUARY STAGE 8 LOT 300, DP 1307775 - JOHN OXLEY DRIVE, THURMSTER	
DRAWN BY:	JSC	CHECKED BY:	BC	CLIENT:	BIRD IN THE HAND 2 PTY LTD.	
DATE CREATED:	JULY 2025				DRAWING NO:	7197_Stage 8_SWC_Sections
					SHEET:	13 OF 36
					REVISION:	A

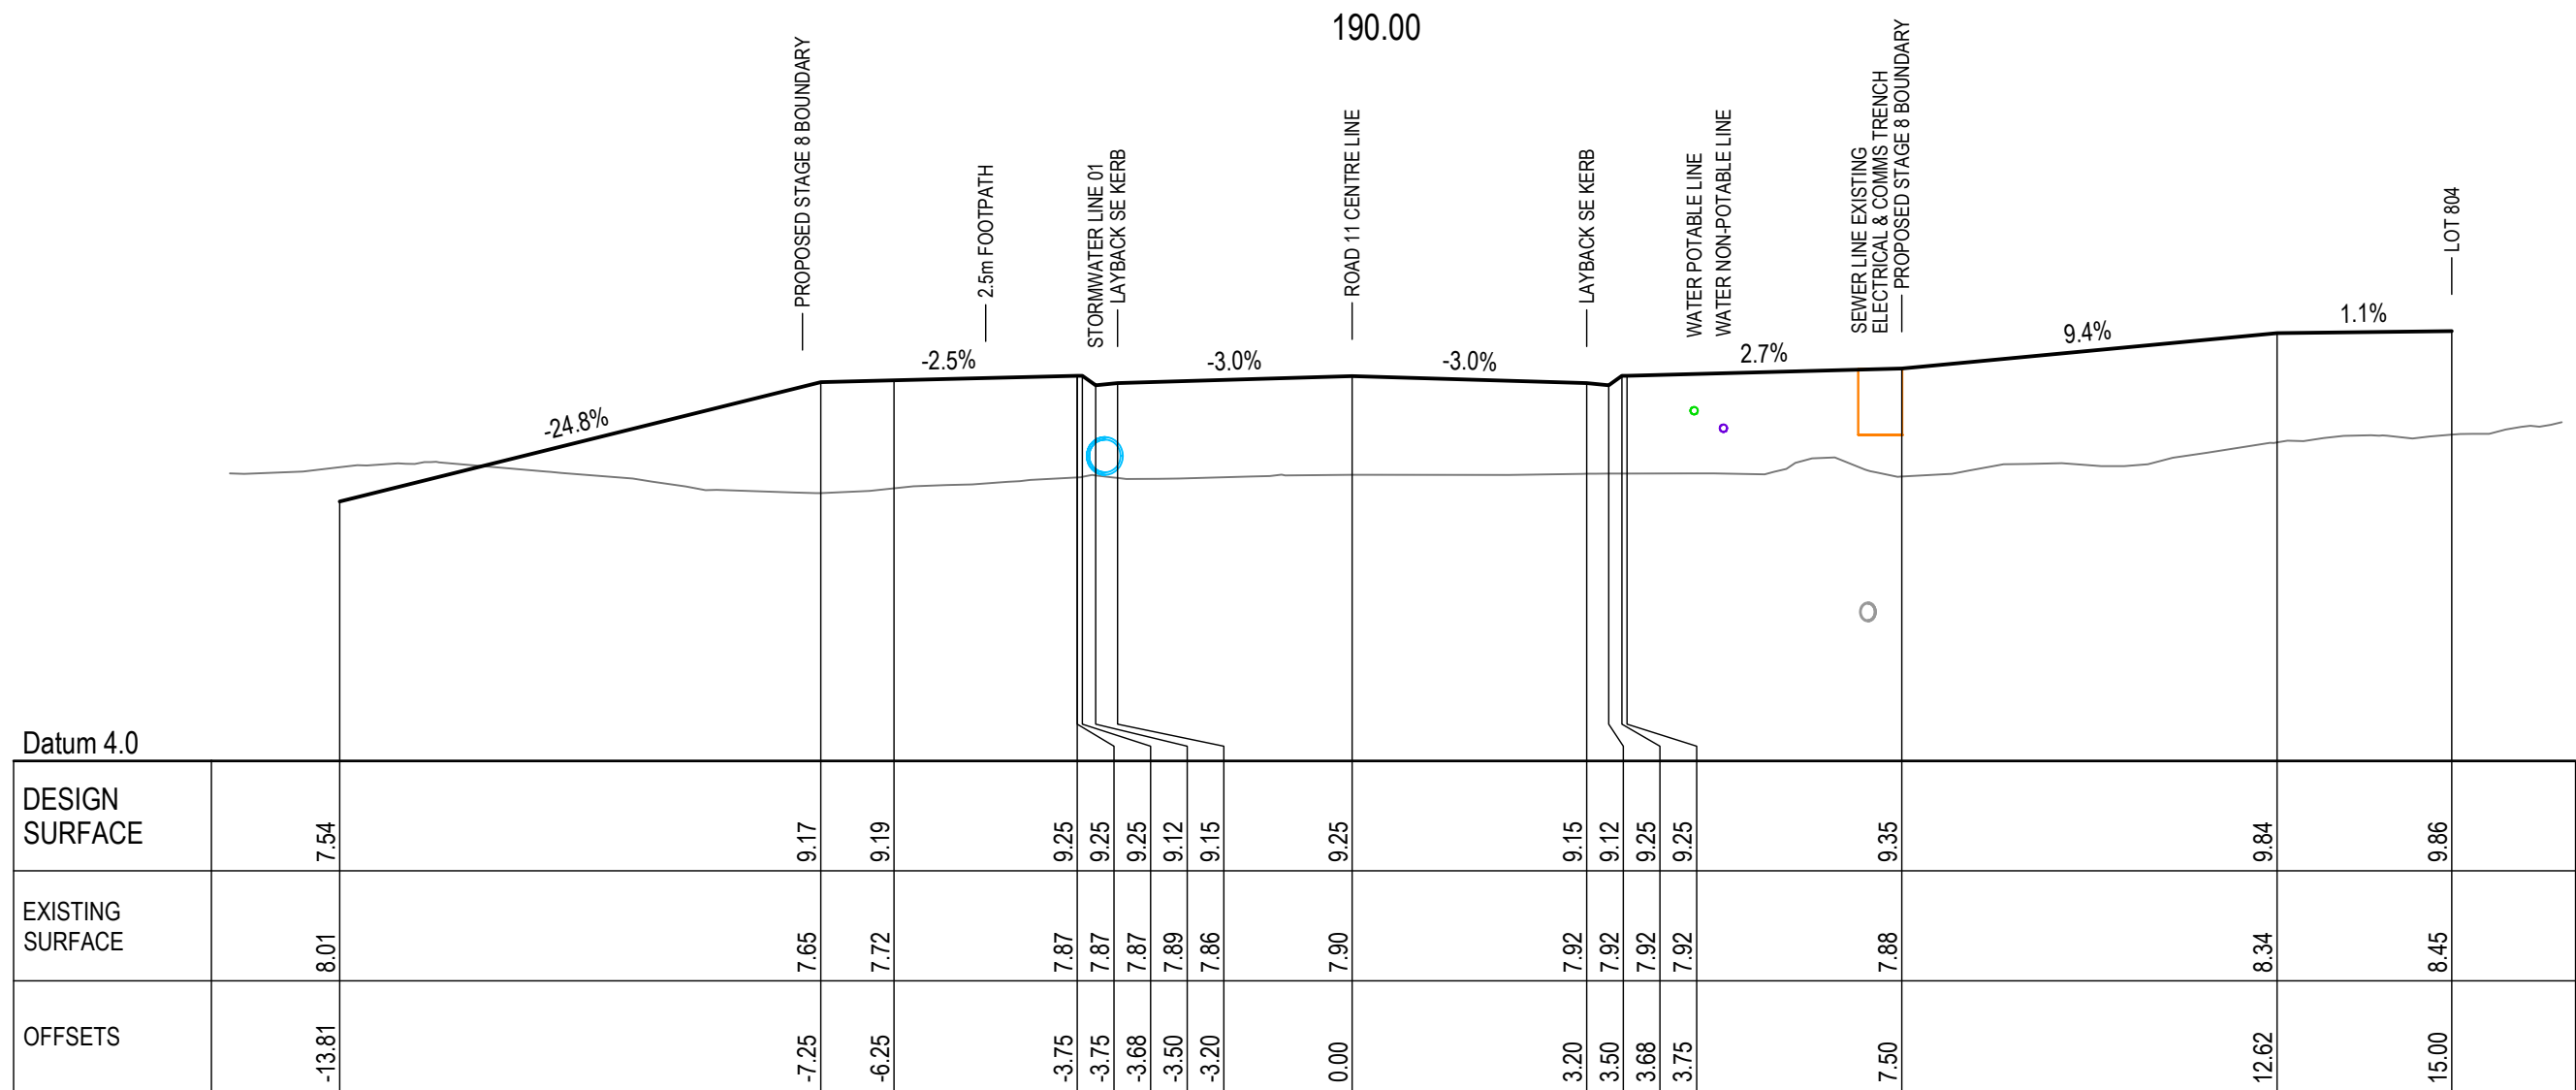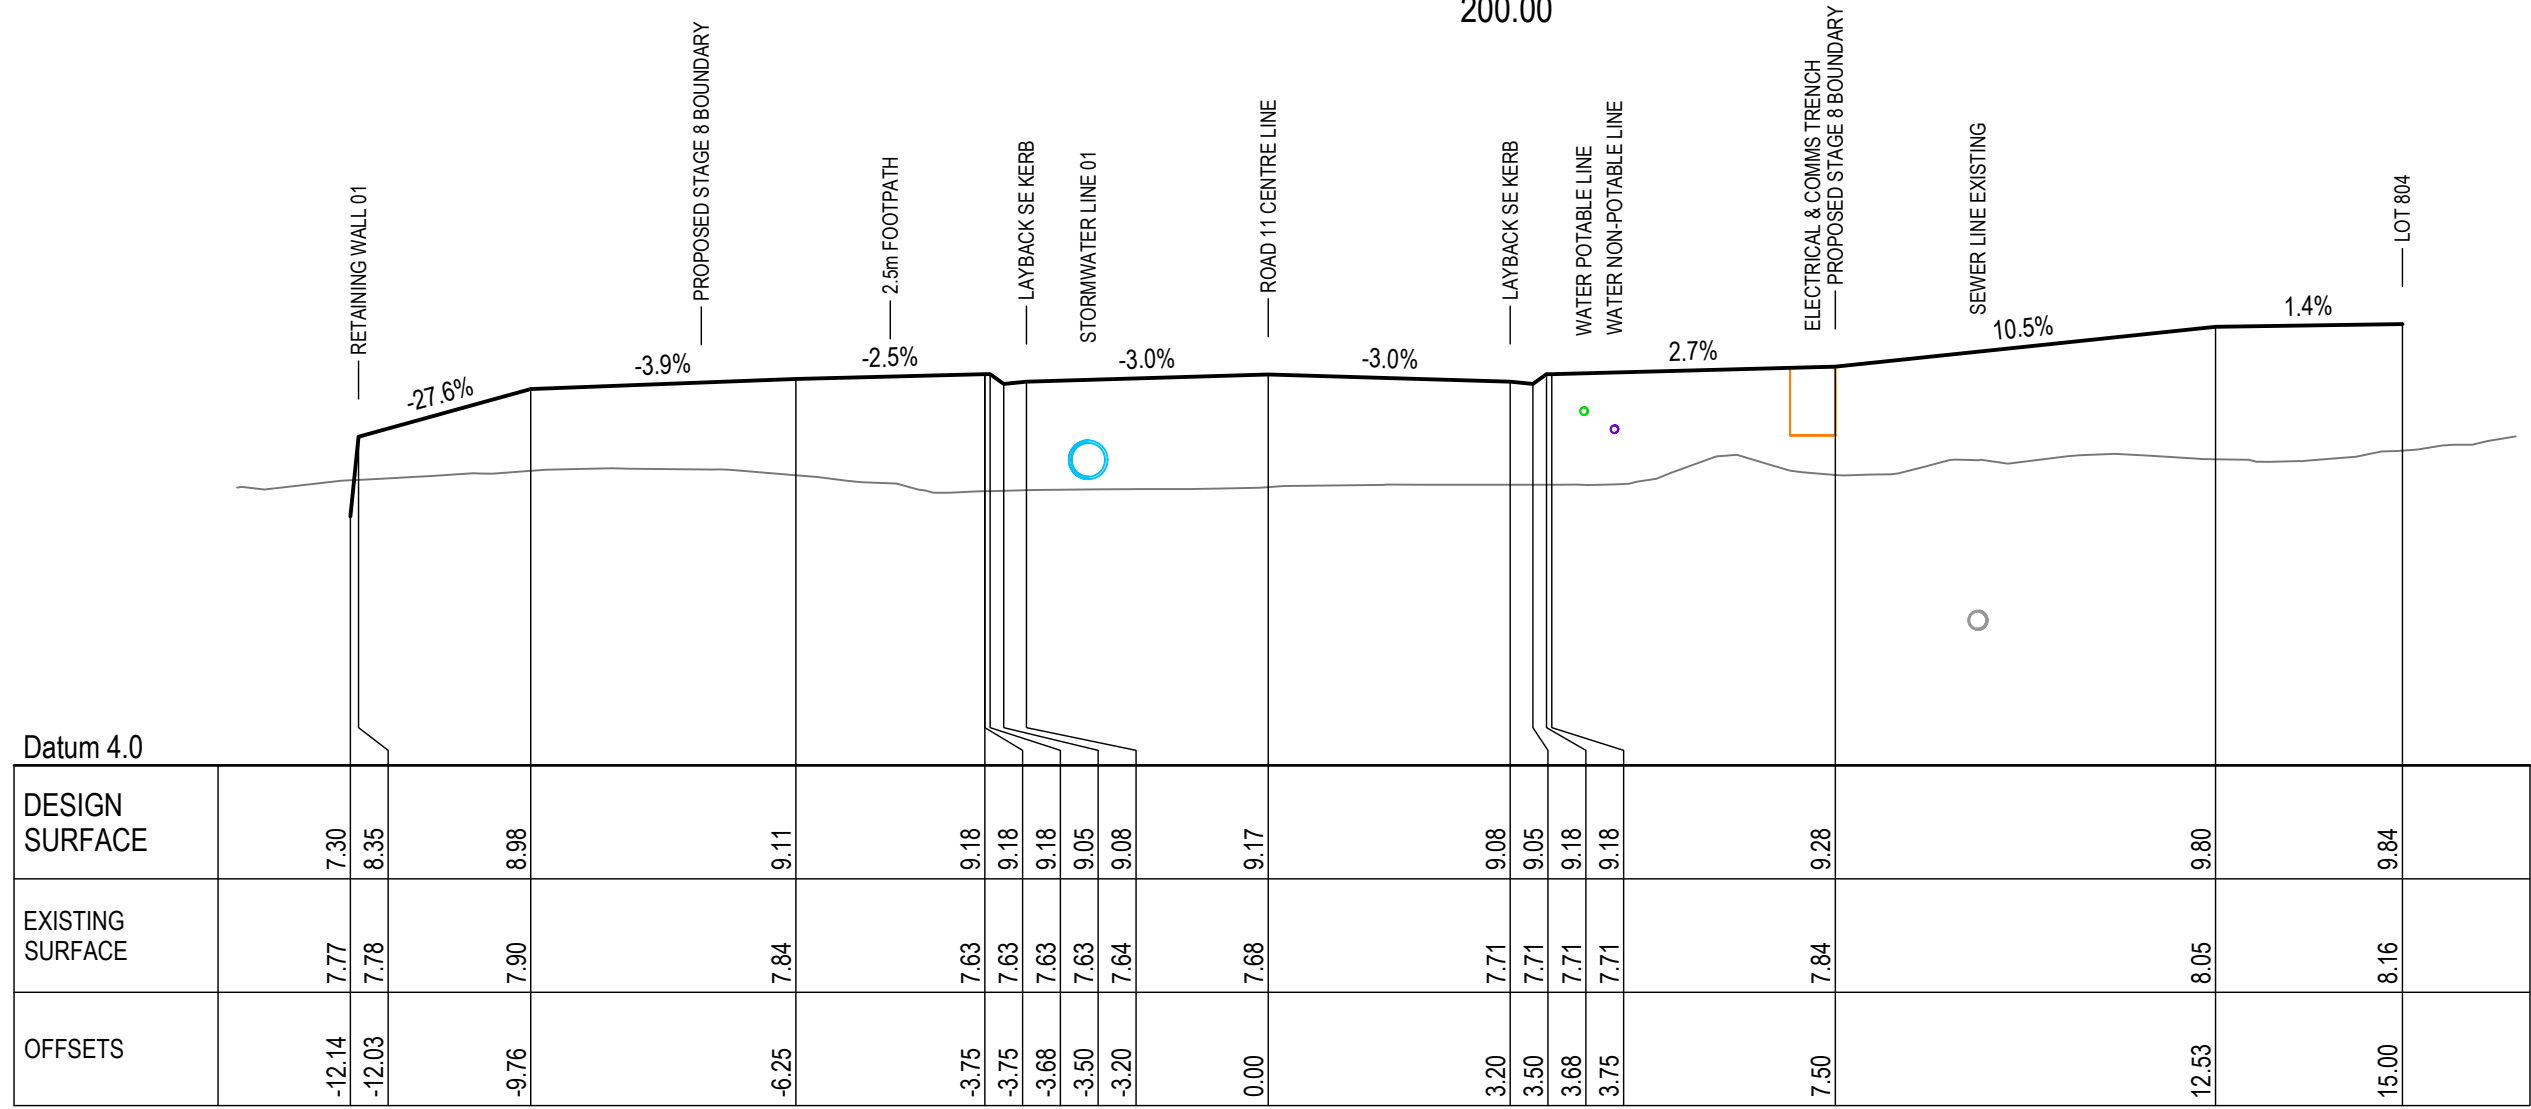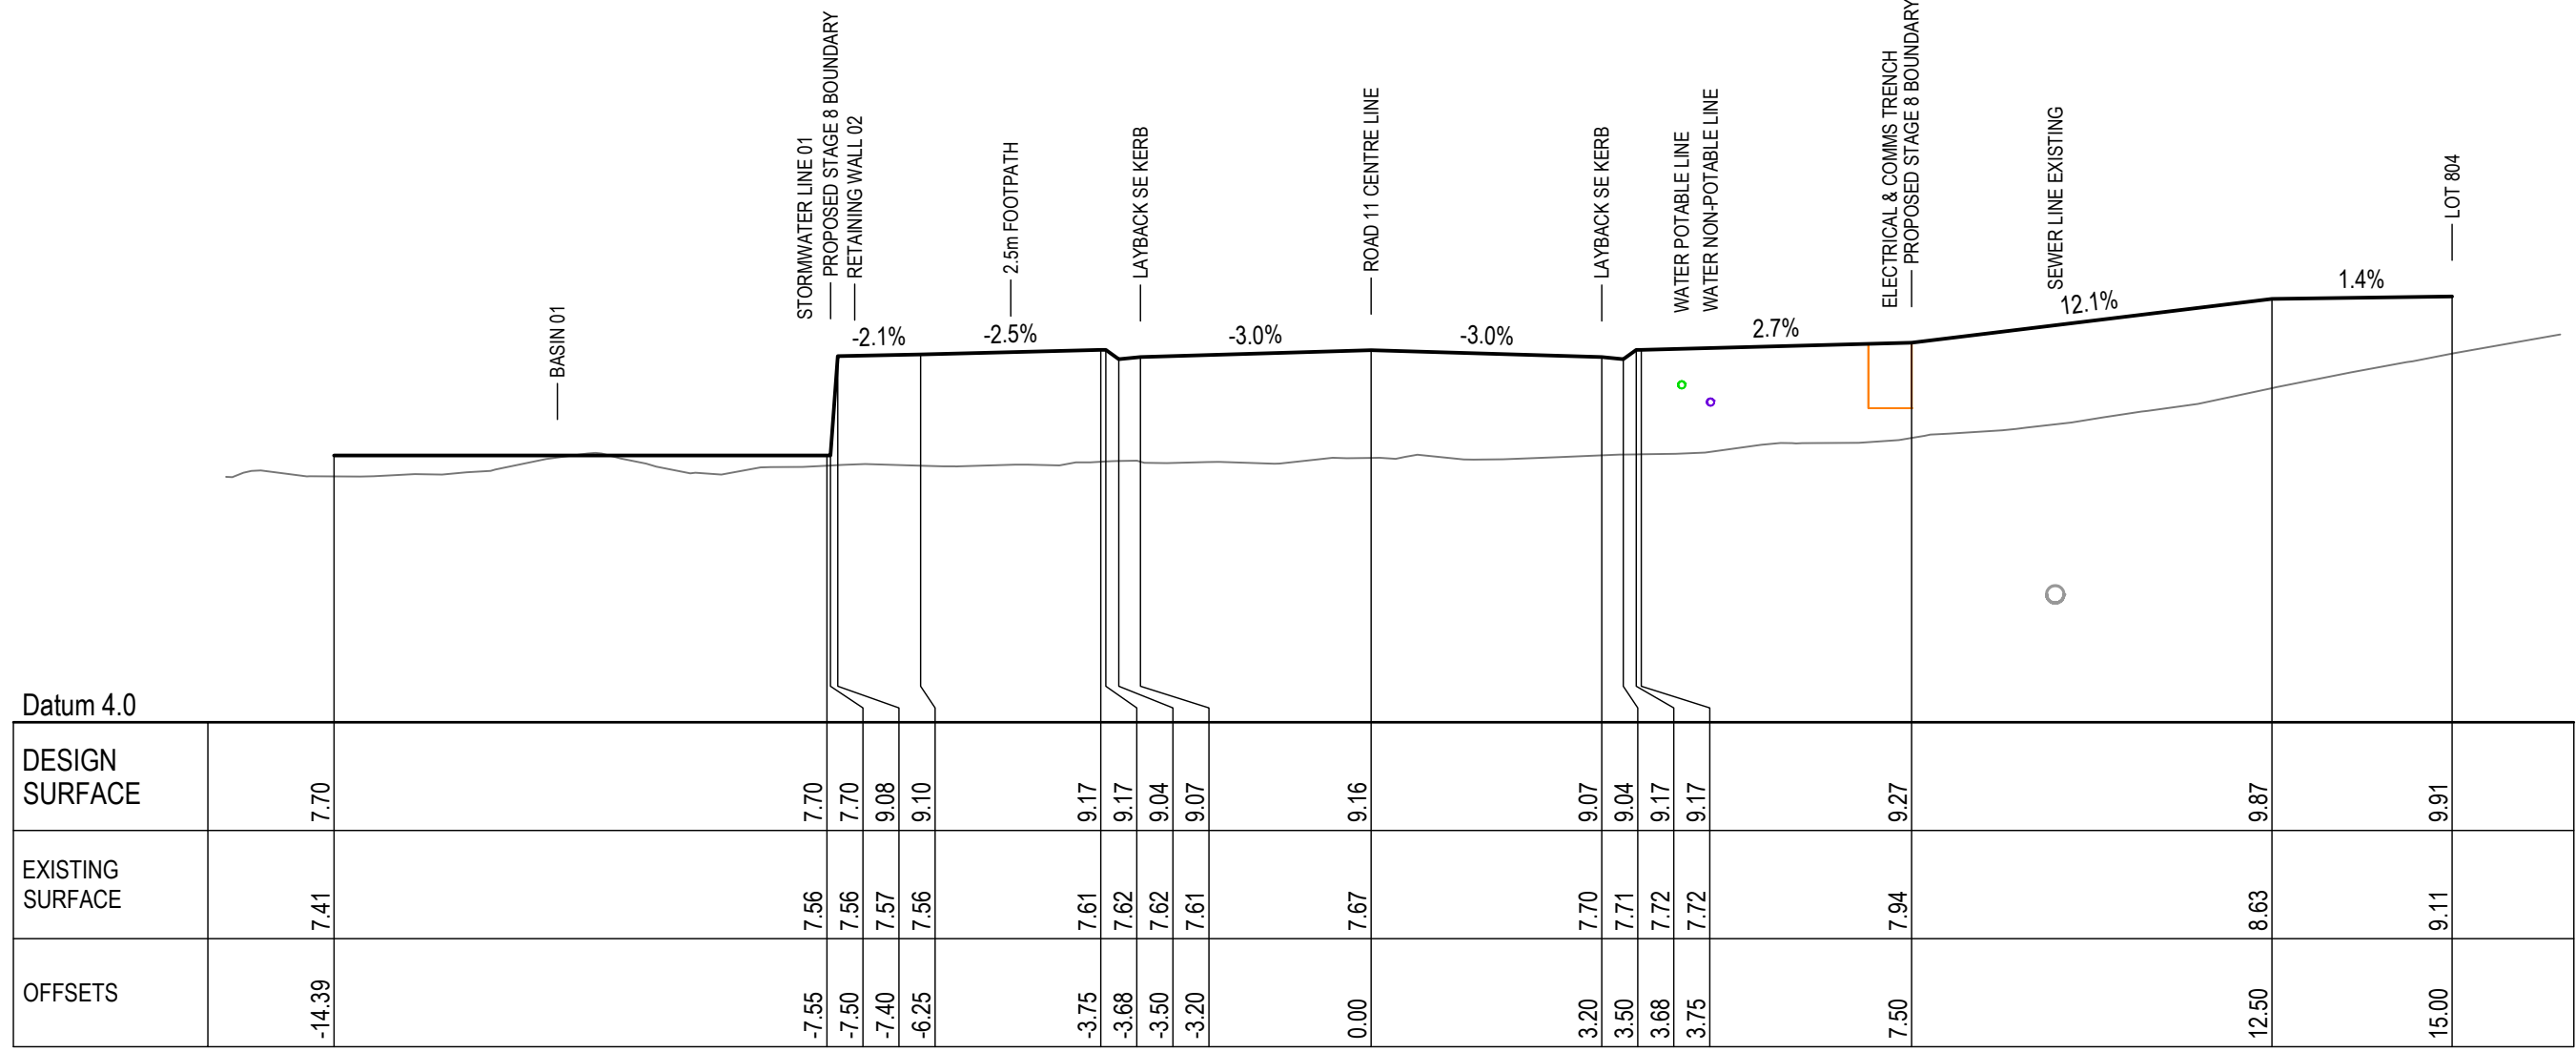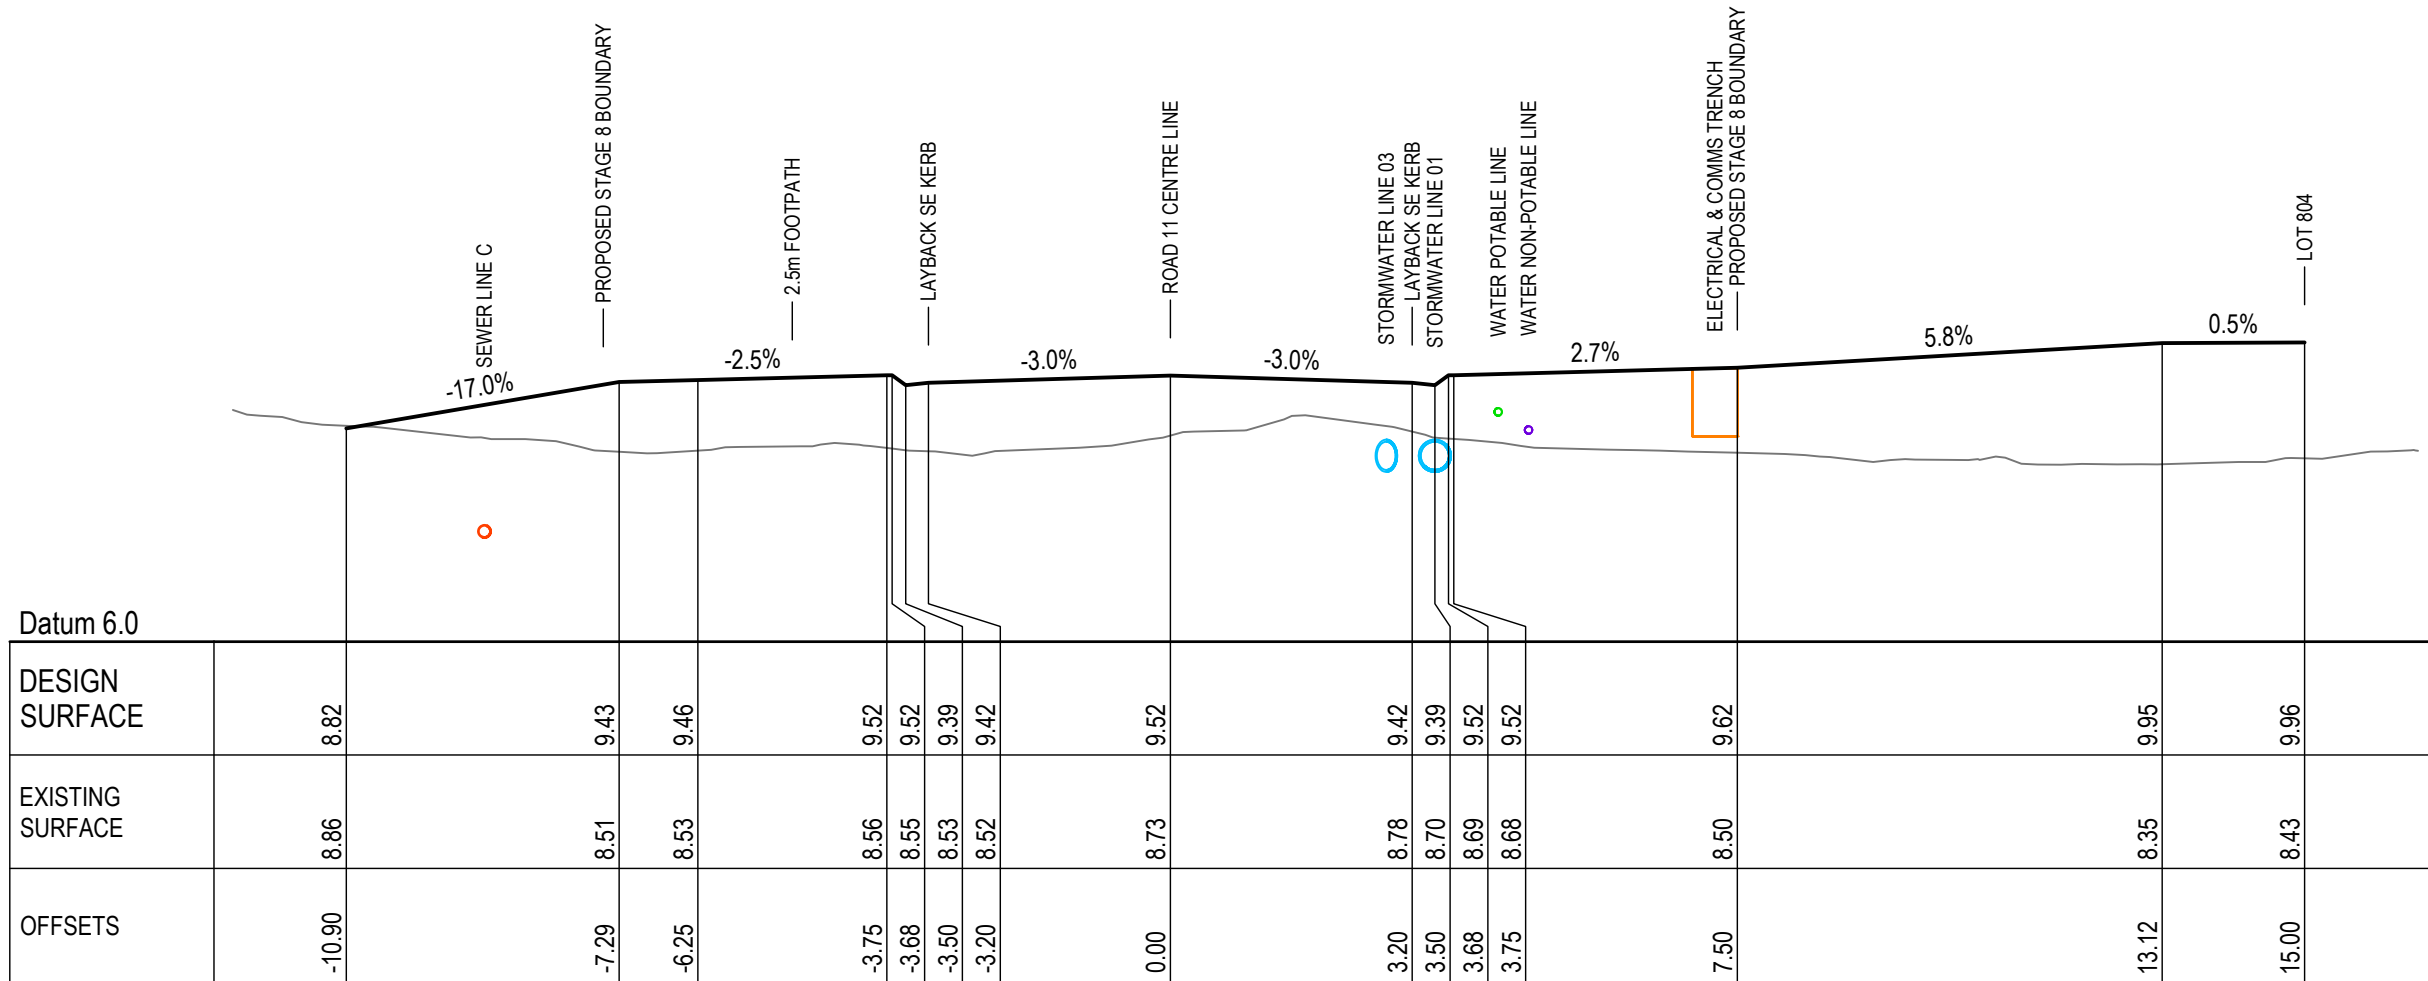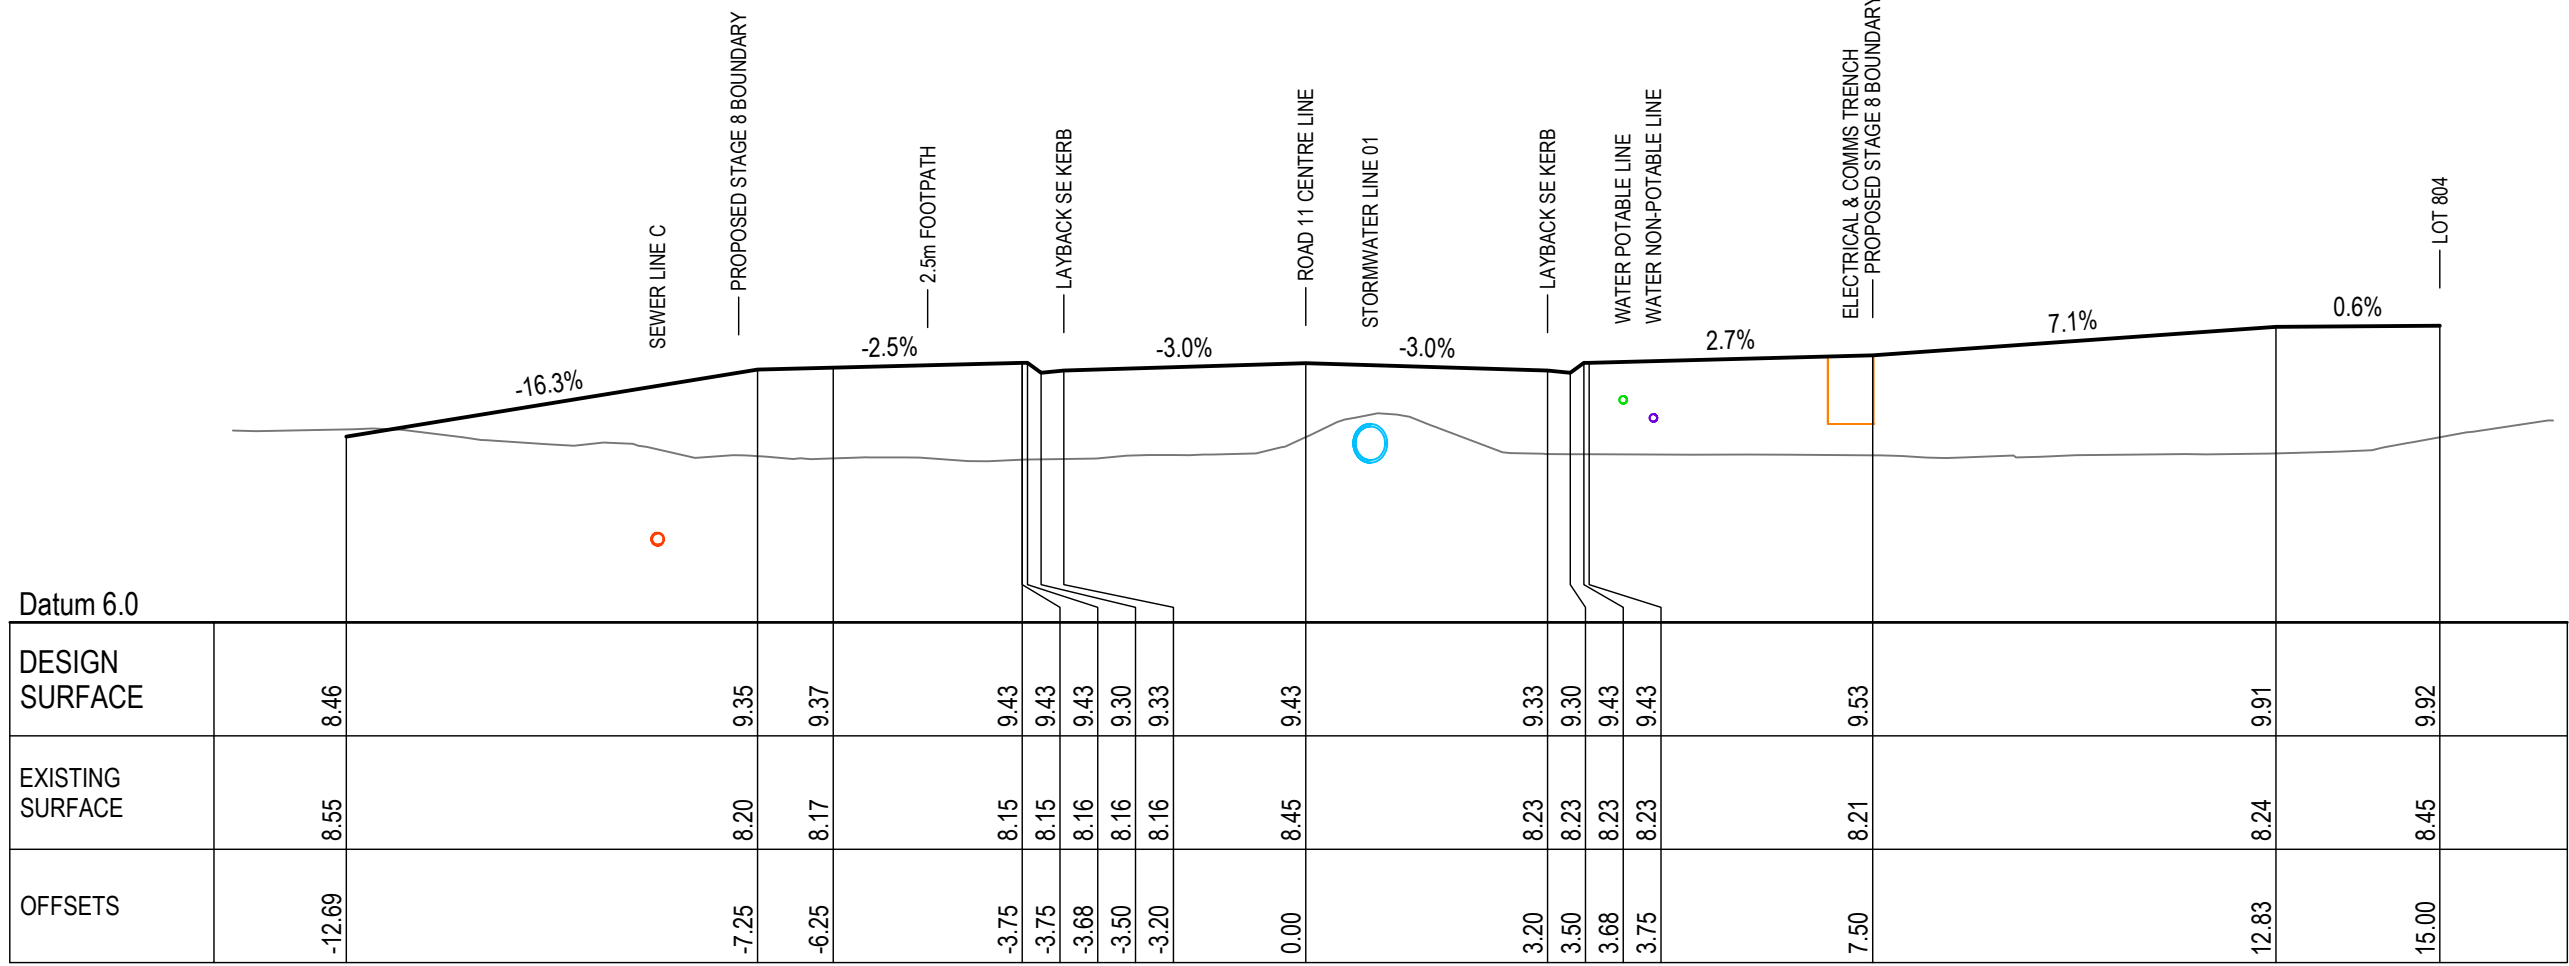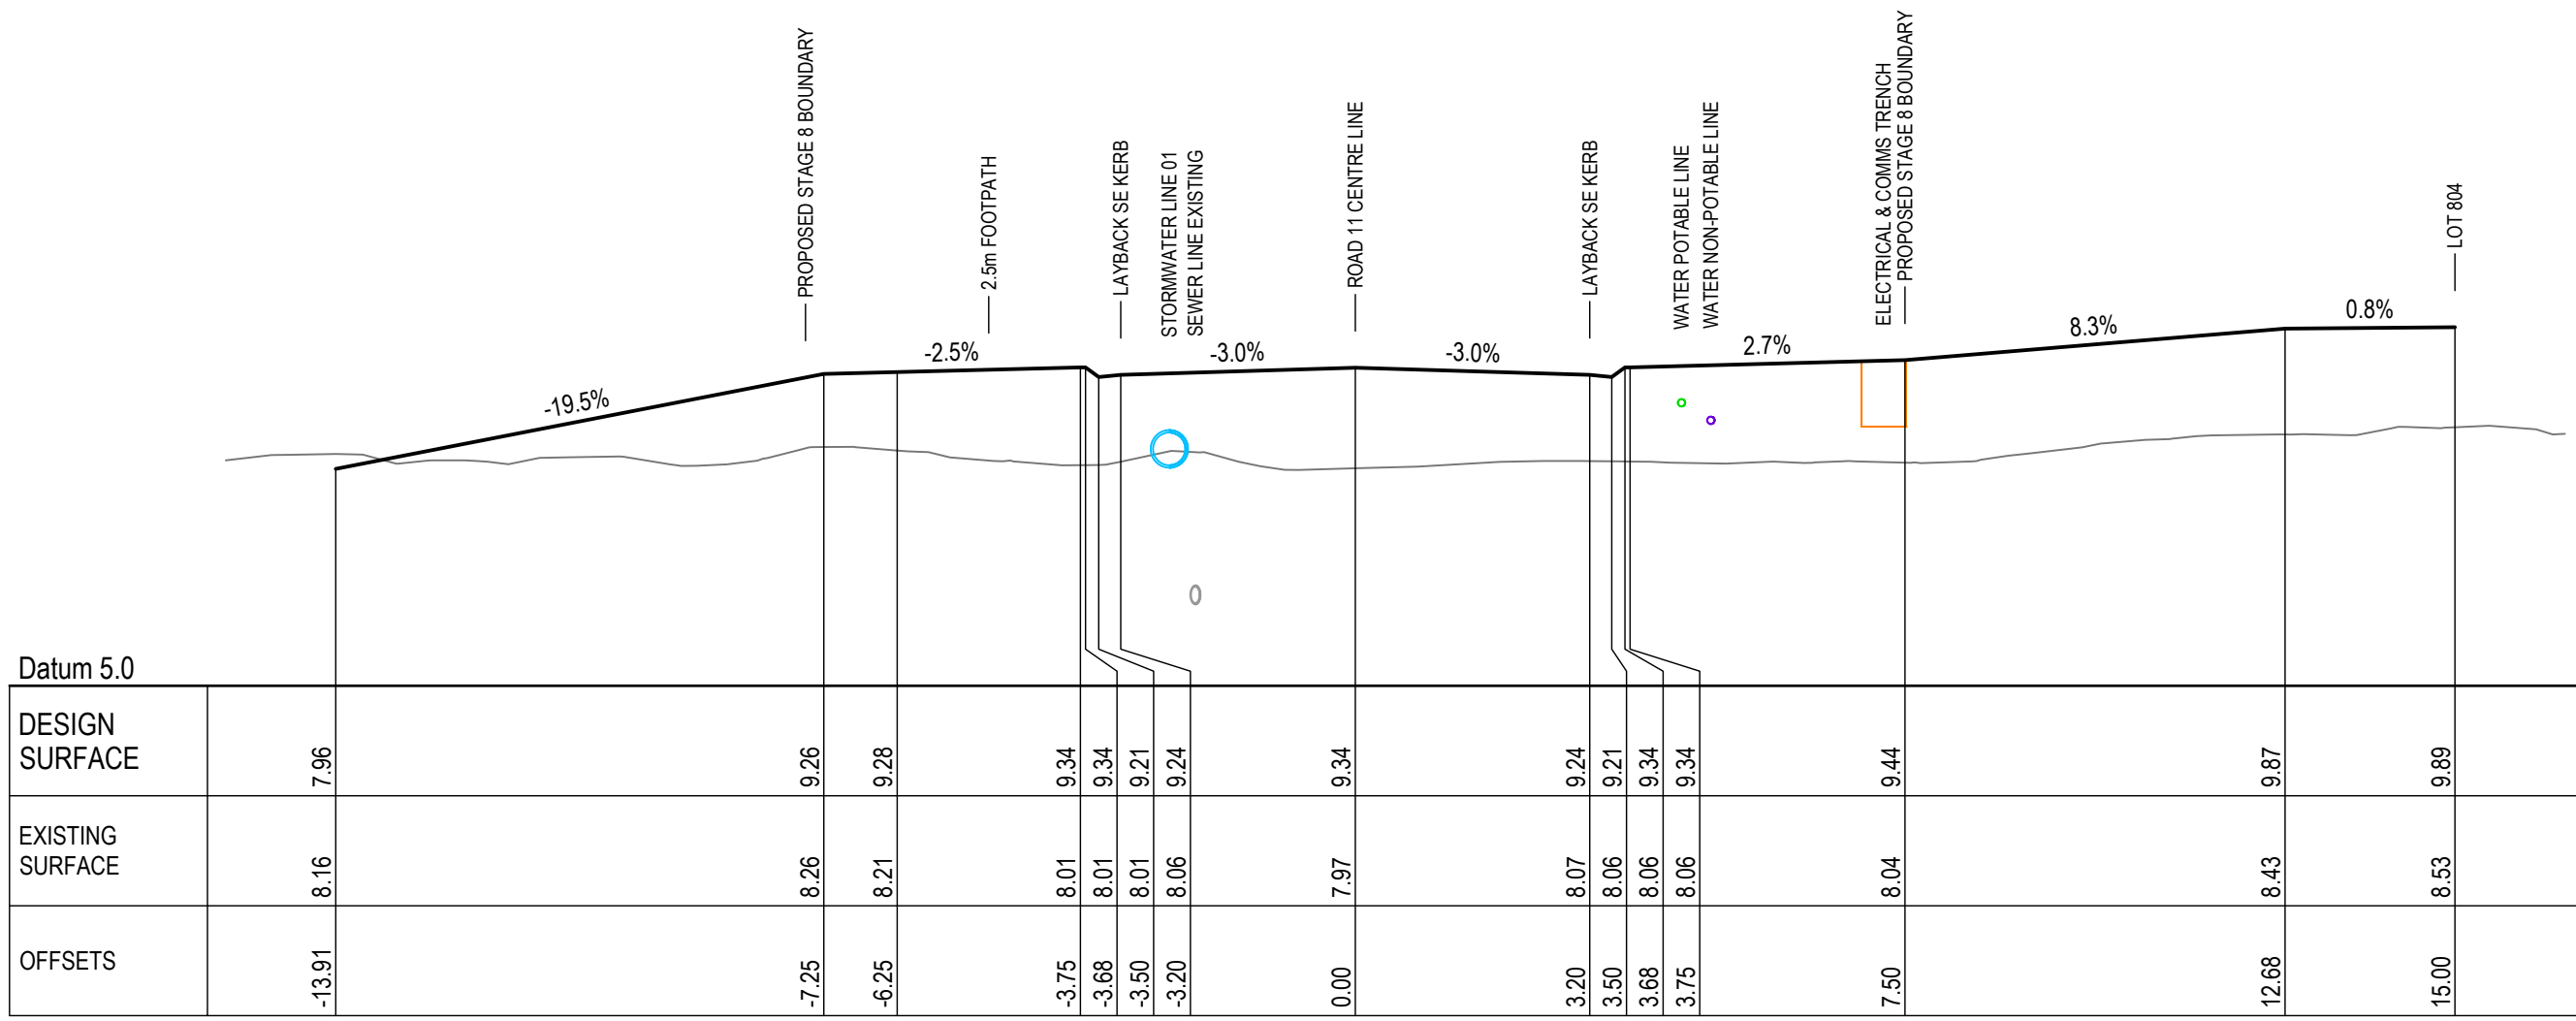








M:\C-REF-01797_The Sanctuary\02_Engineering\Stages 8 and 9\2_SWG Sections.dwg - A1(1)-RD XS 03, 24 February 2026, jenos

REV.	DATE	DESCRIPTION	
A	31.10.2025	ISSUED FOR APPROVAL	JSC


DATUM: AHD SCALE: AS SHOWN @ A1

NOTE: DO NOT SCALE OFF DRAWINGS. USE FIGURED DIMENSIONS ONLY. REPORT ANY DISCREPANCIES TO THE AUTHOR. THIS DRAWING BEING THE PROPERTY OF KING & CAMPBELL PTY LTD, IS PROTECTED BY COPYRIGHT AND MUST NOT BE USED, REPRODUCED OR COPIED WHOLLY, OR IN PART WITHOUT THE WRITTEN PERMISSION OF KING & CAMPBELL PTY LTD.
© King & Campbell Pty Ltd


PROJECT NO:	7197	DRAWING TITLE:	ROAD 11 CROSS SECTIONS CH 210.00 TO 259.15			
DA NO.:	2014-114					
DESIGNED BY:	JSC/BC	PROJECT:	THE SANCTUARY STAGE 8 LOT 300, DP 1307775 - JOHN OXLEY DRIVE, THURMSTER			
DRAWN BY:	JSC					
CHECKED BY:	BC	CLIENT:	BIRD IN THE HAND 2 PTY LTD.			
DATE CREATED:	JULY 2025					
		DRAWING NO:	7197_Stage 8_SWC_Sections	SHEET:	14 OF 36	REVISION:
						A

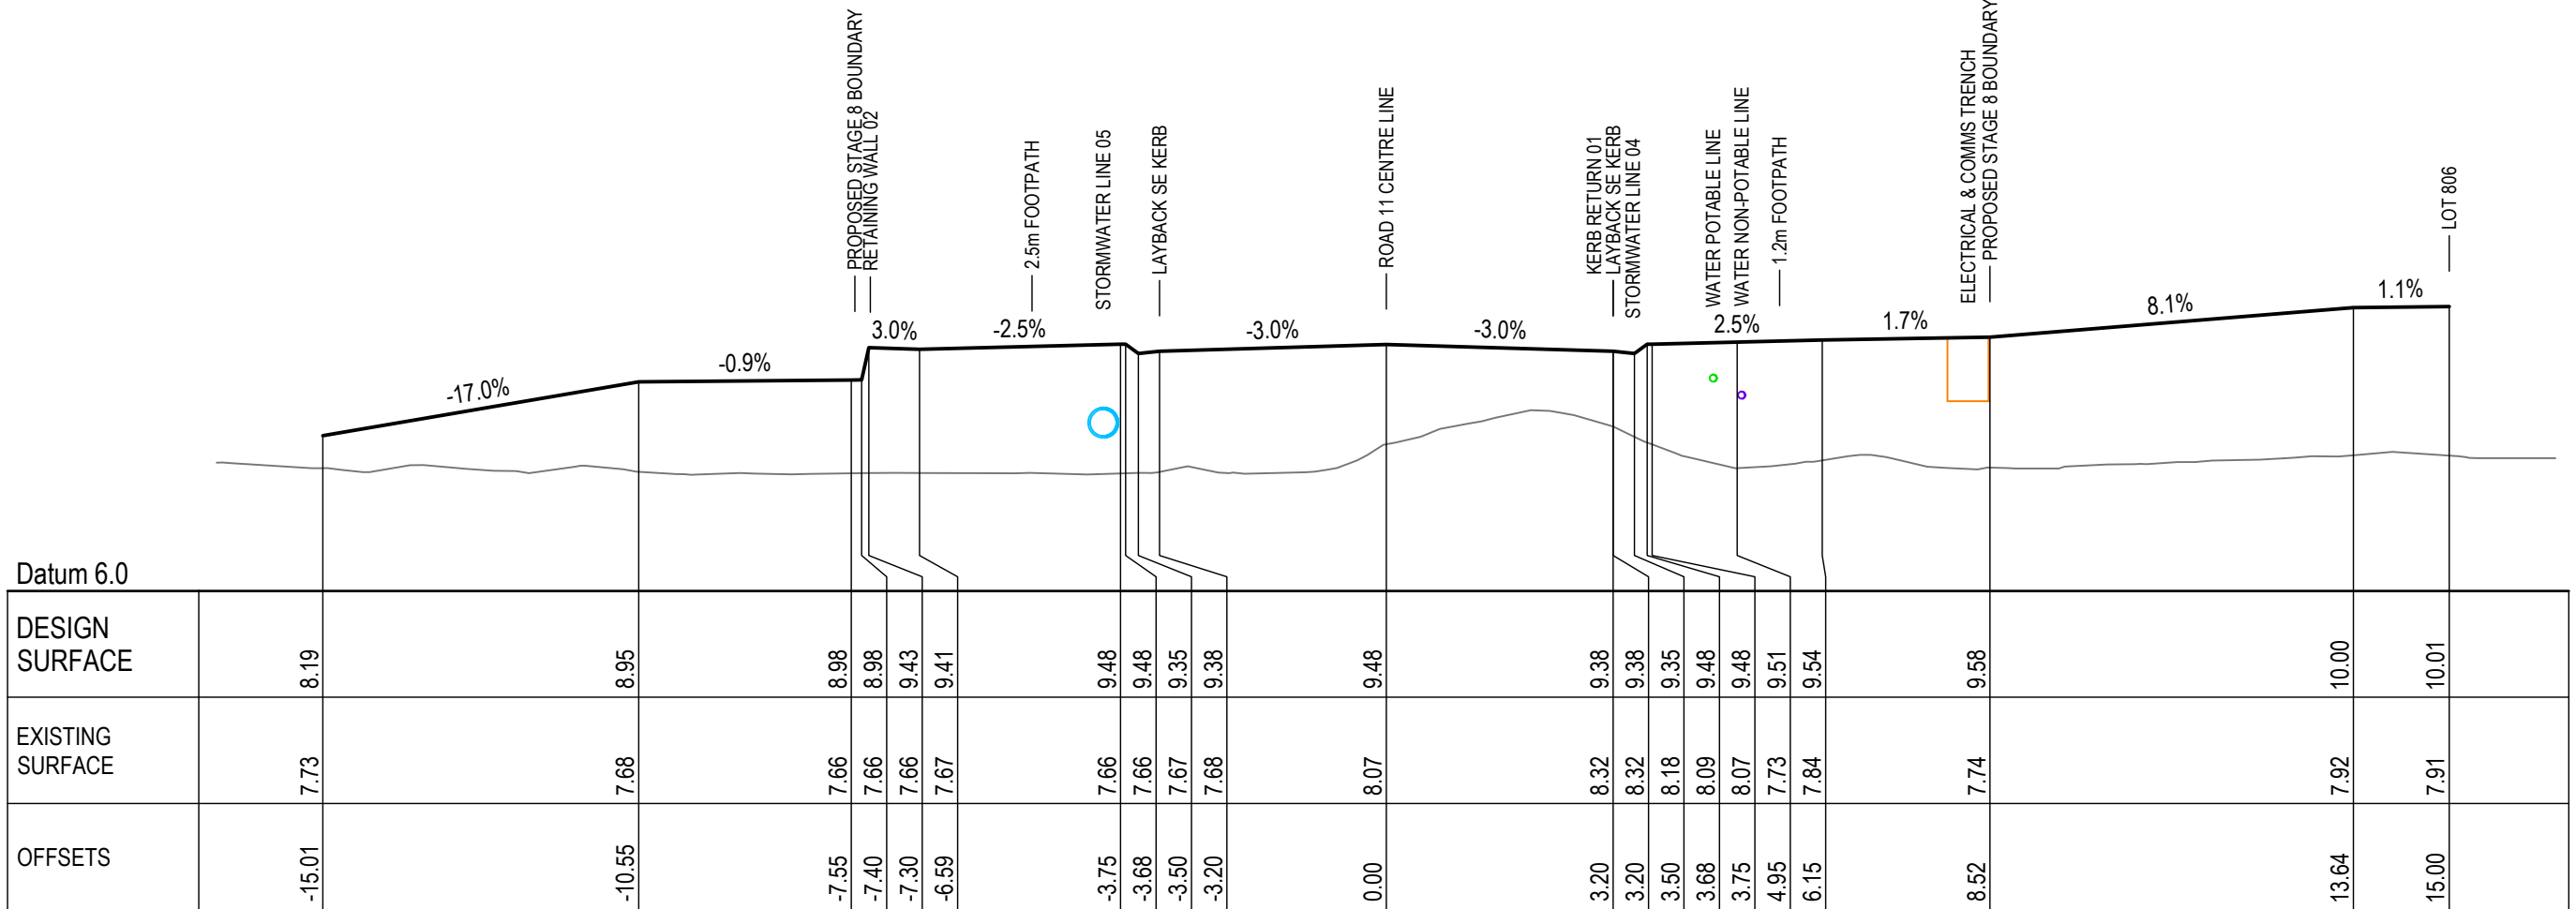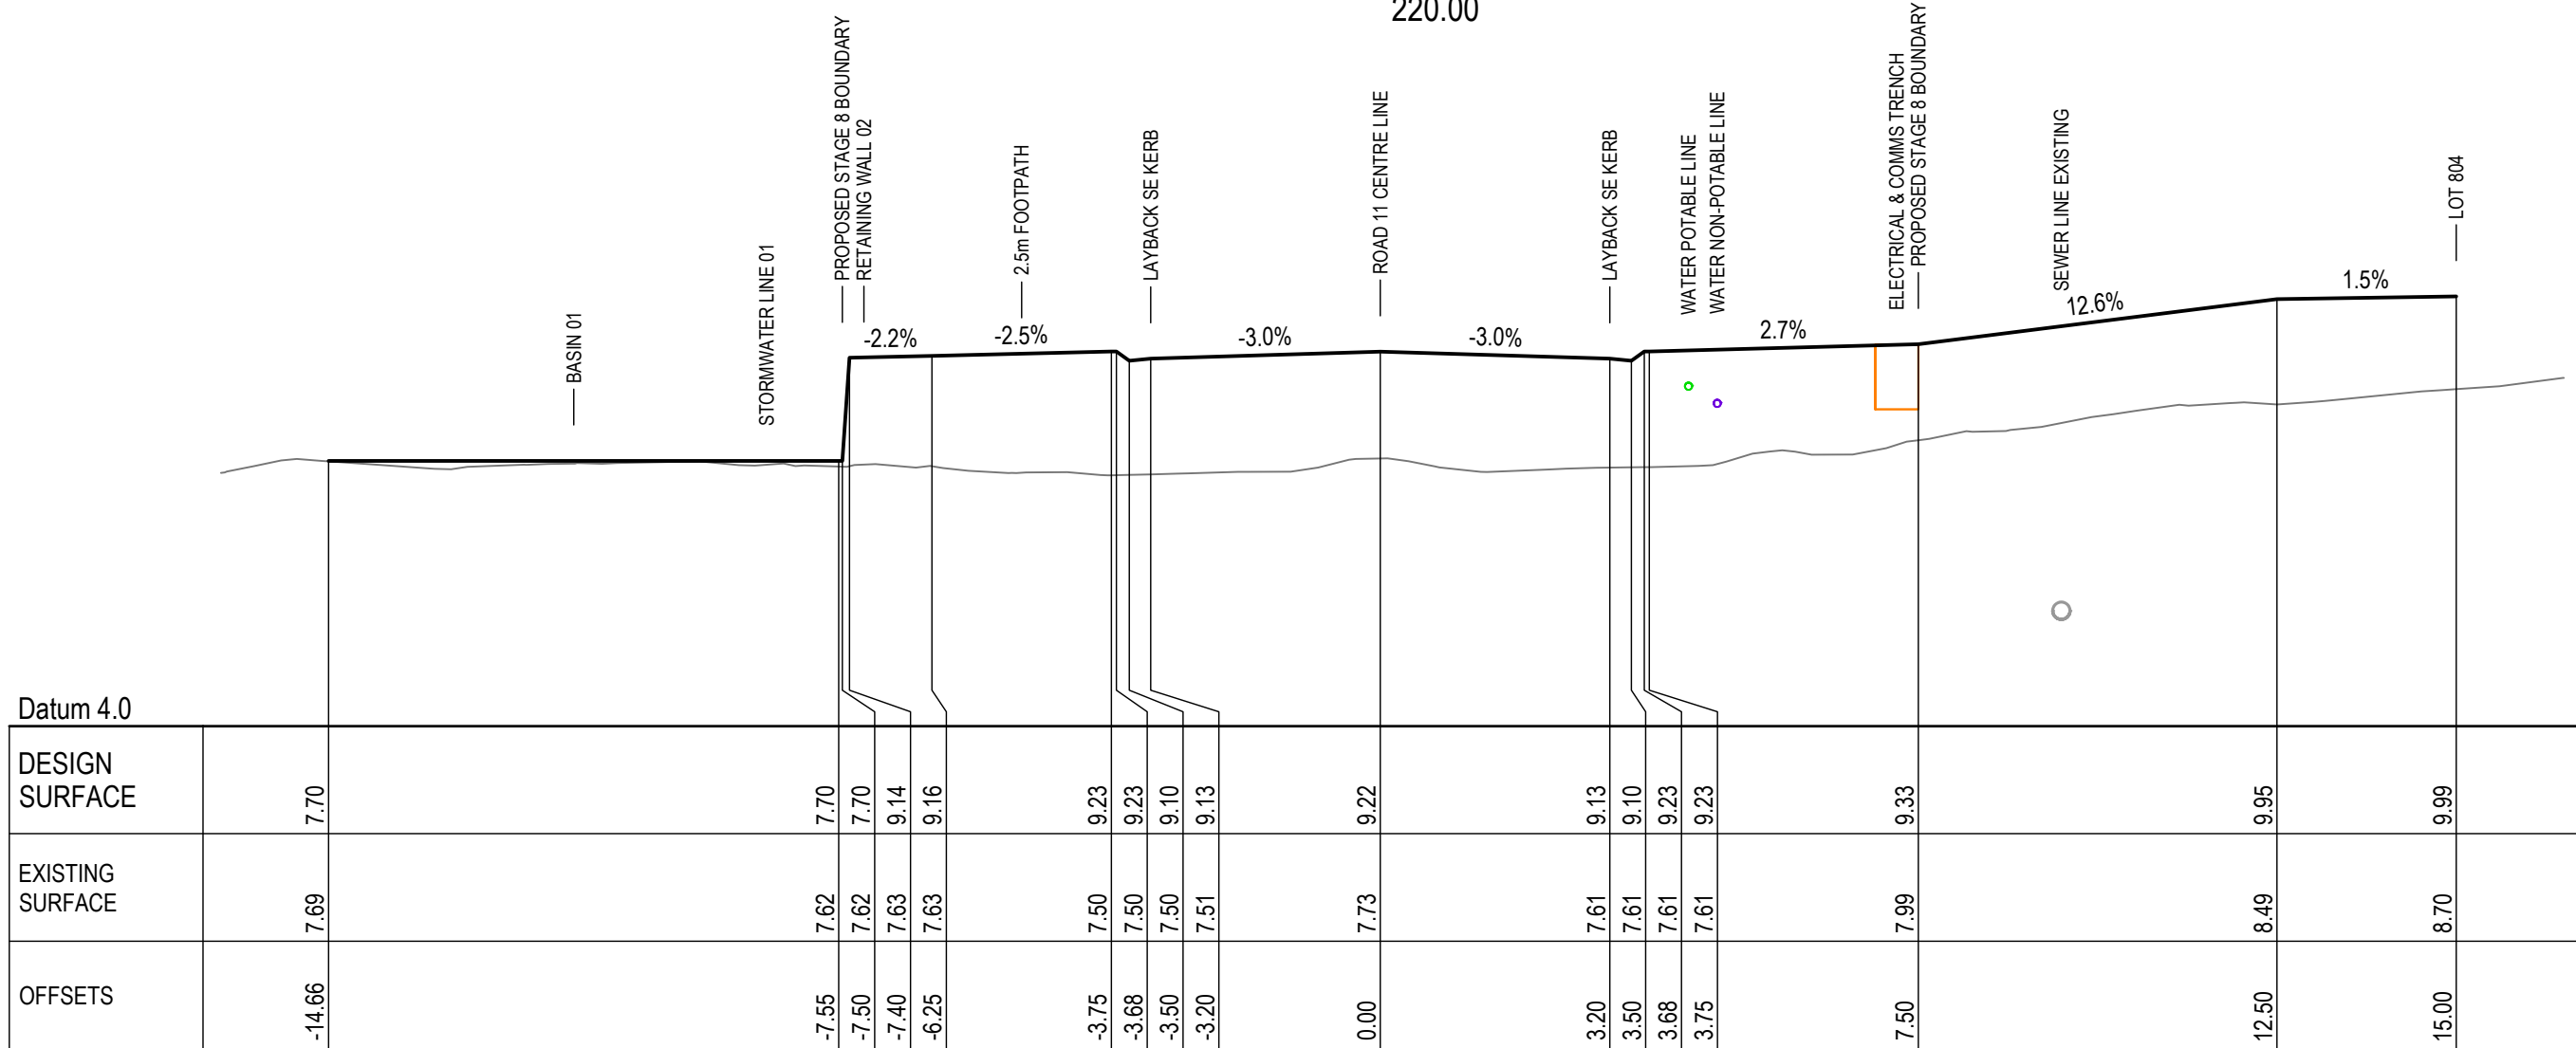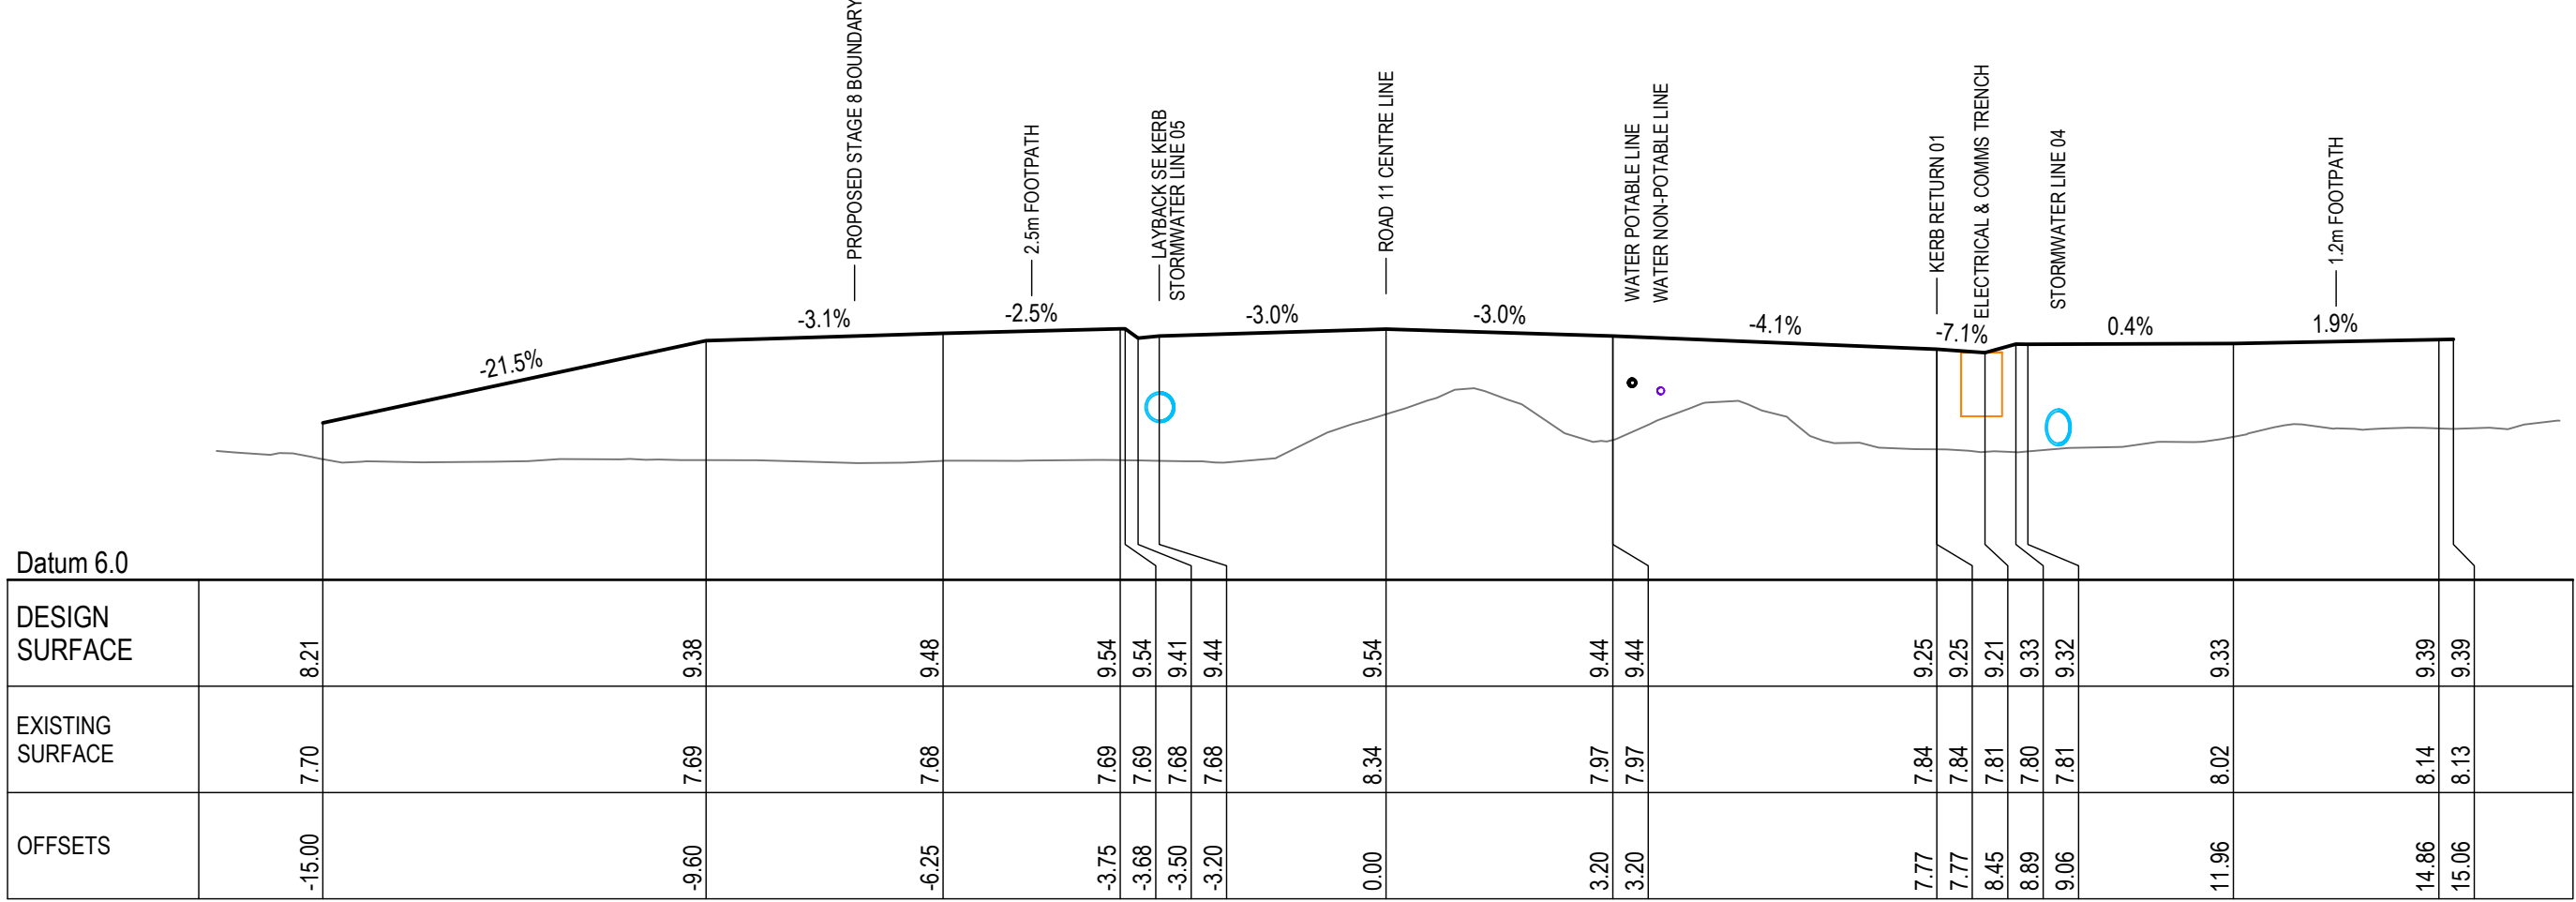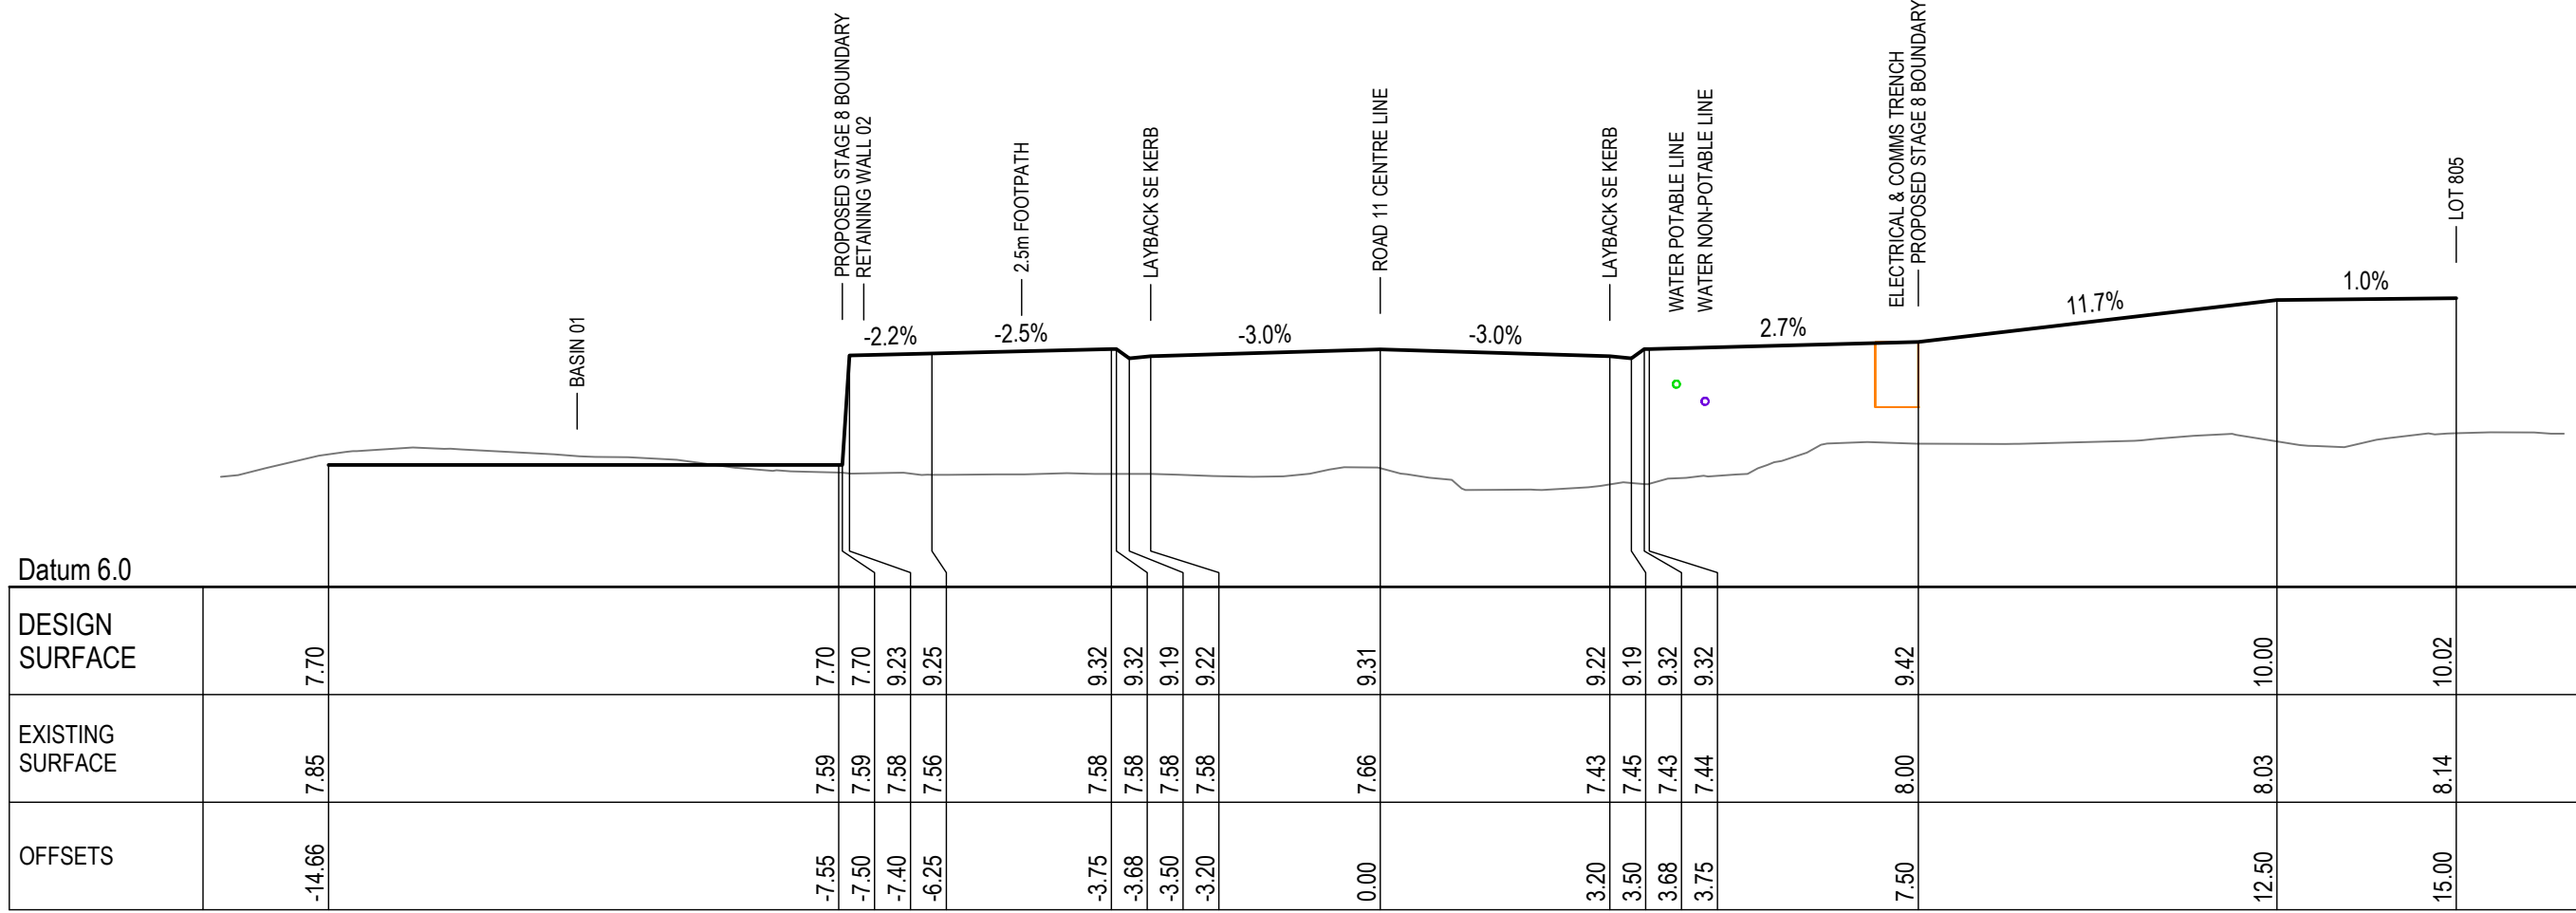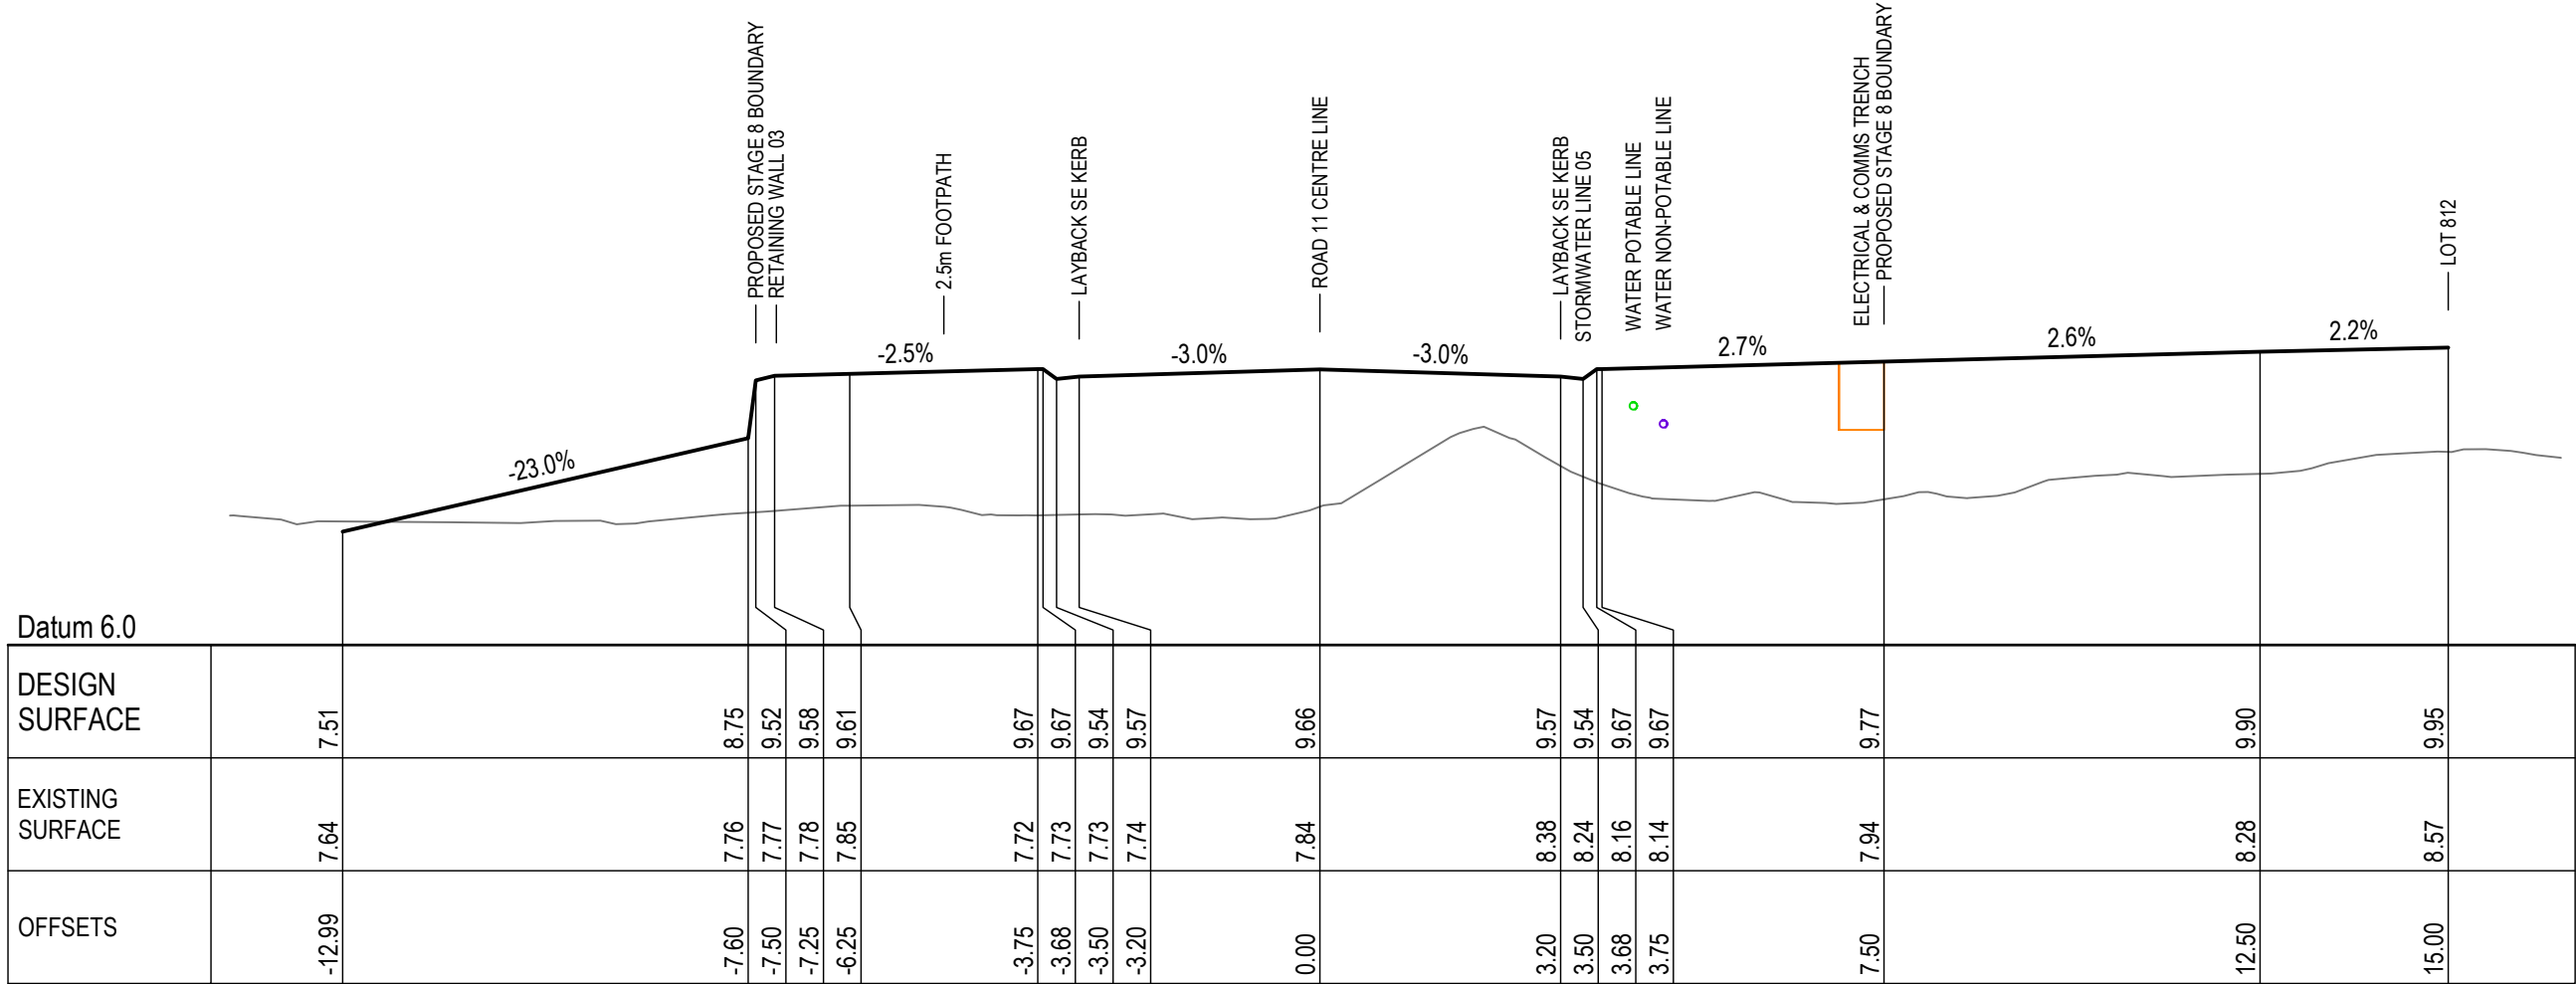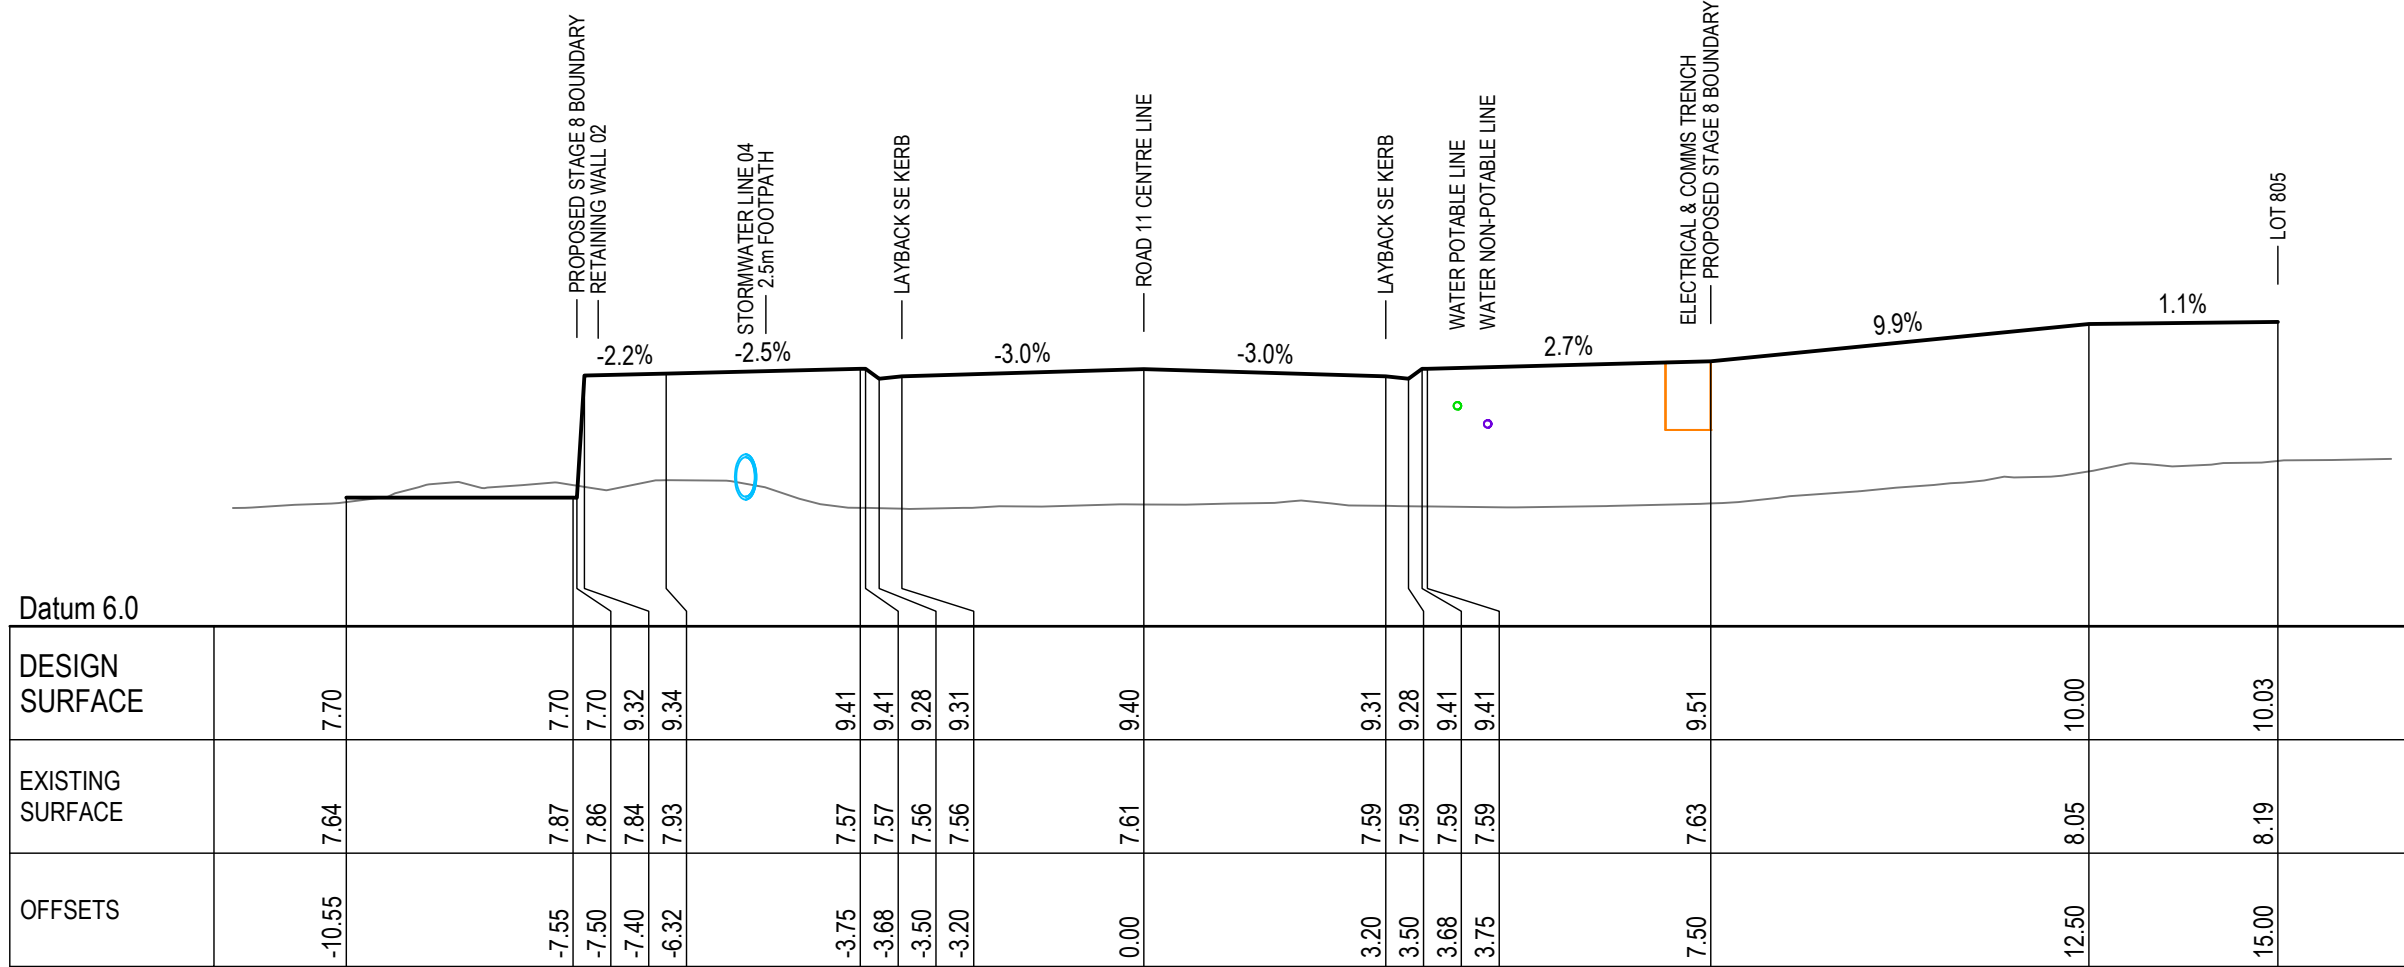


K:\C-REF-017197_The Sanctuary\02_Engineering\Stages 8 and 9\2_SWG Sections.dwg - A1(1)-RD_XS.DWG, 24 February 2026, jenssc

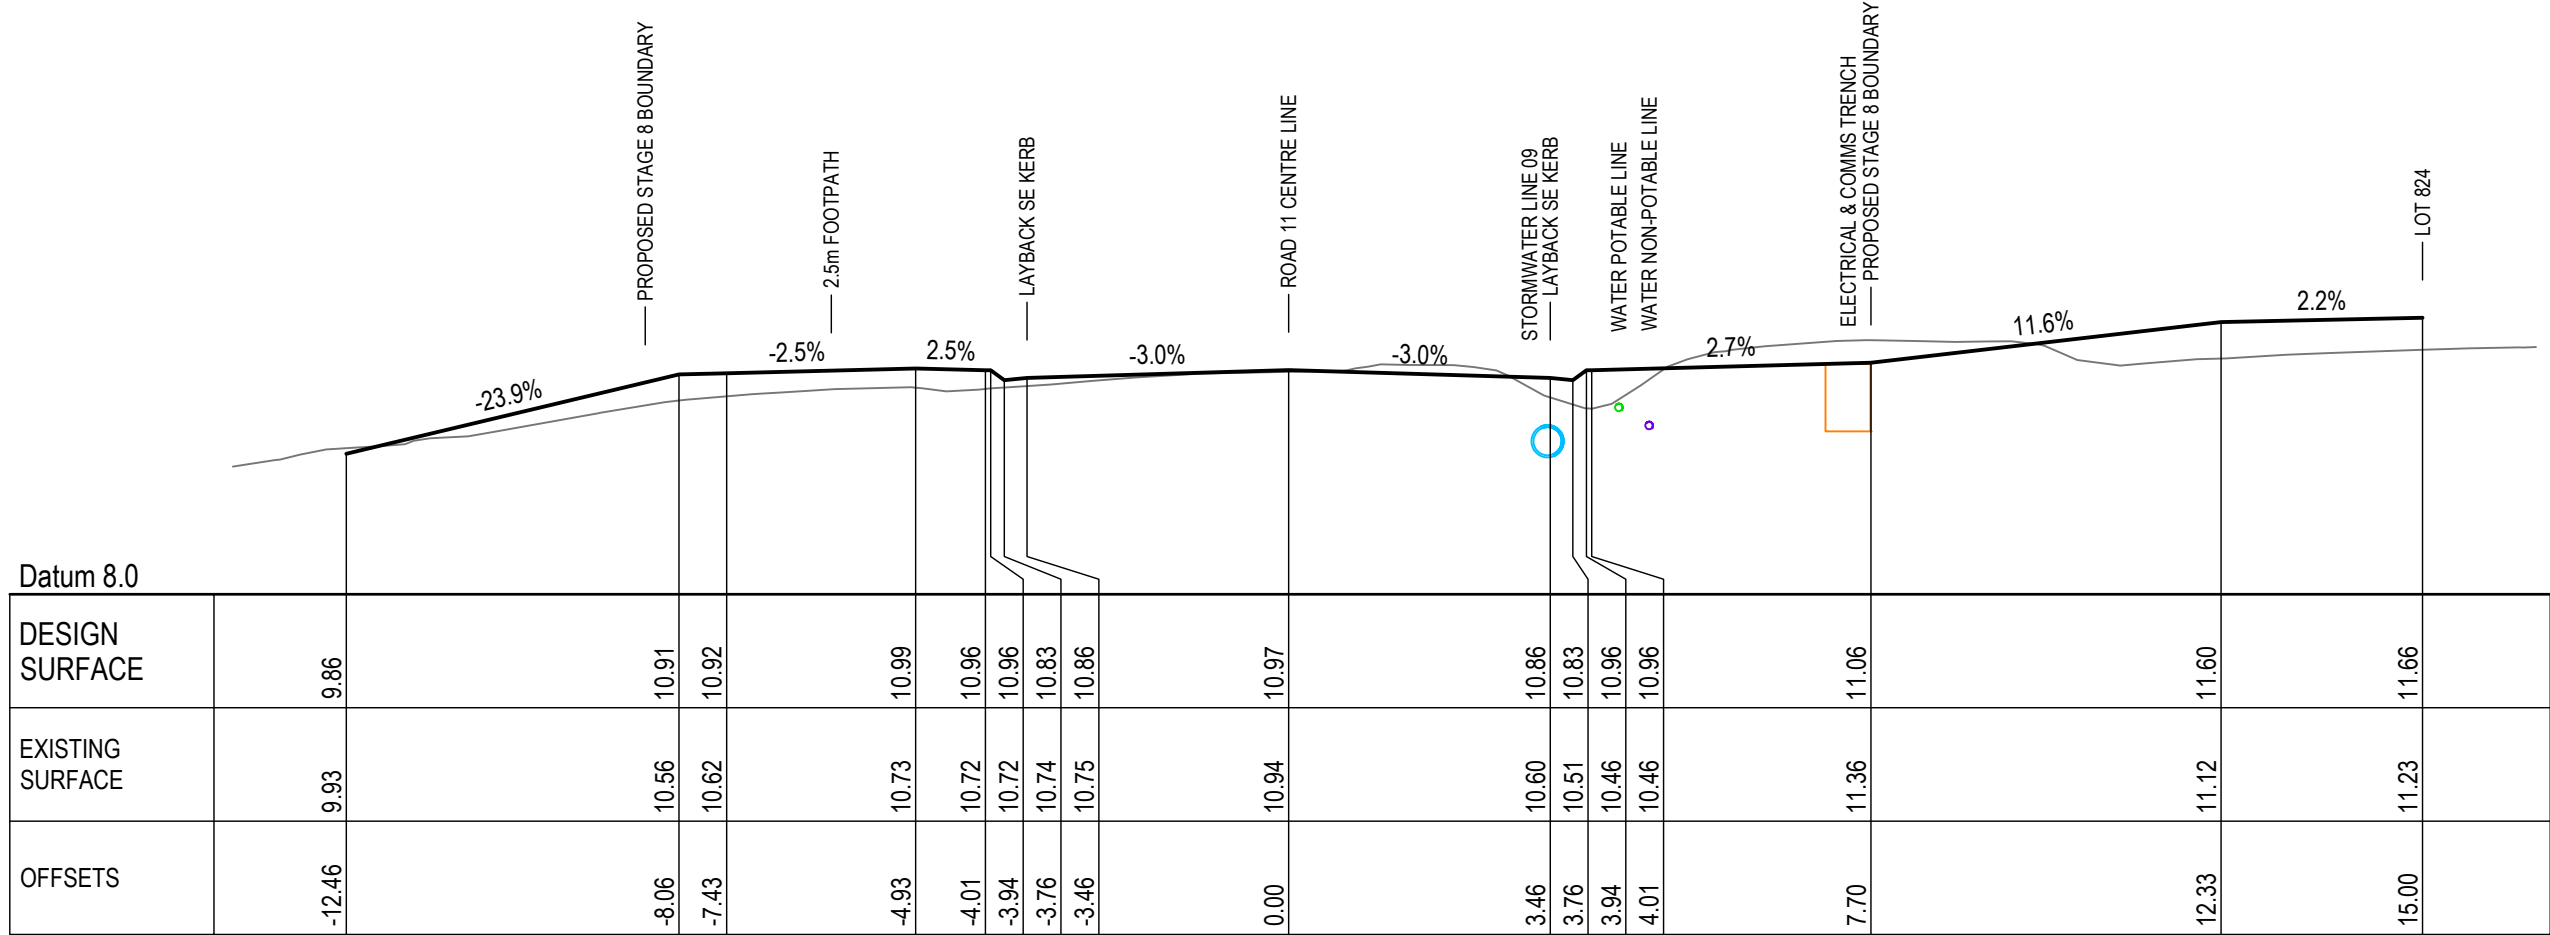

360.00

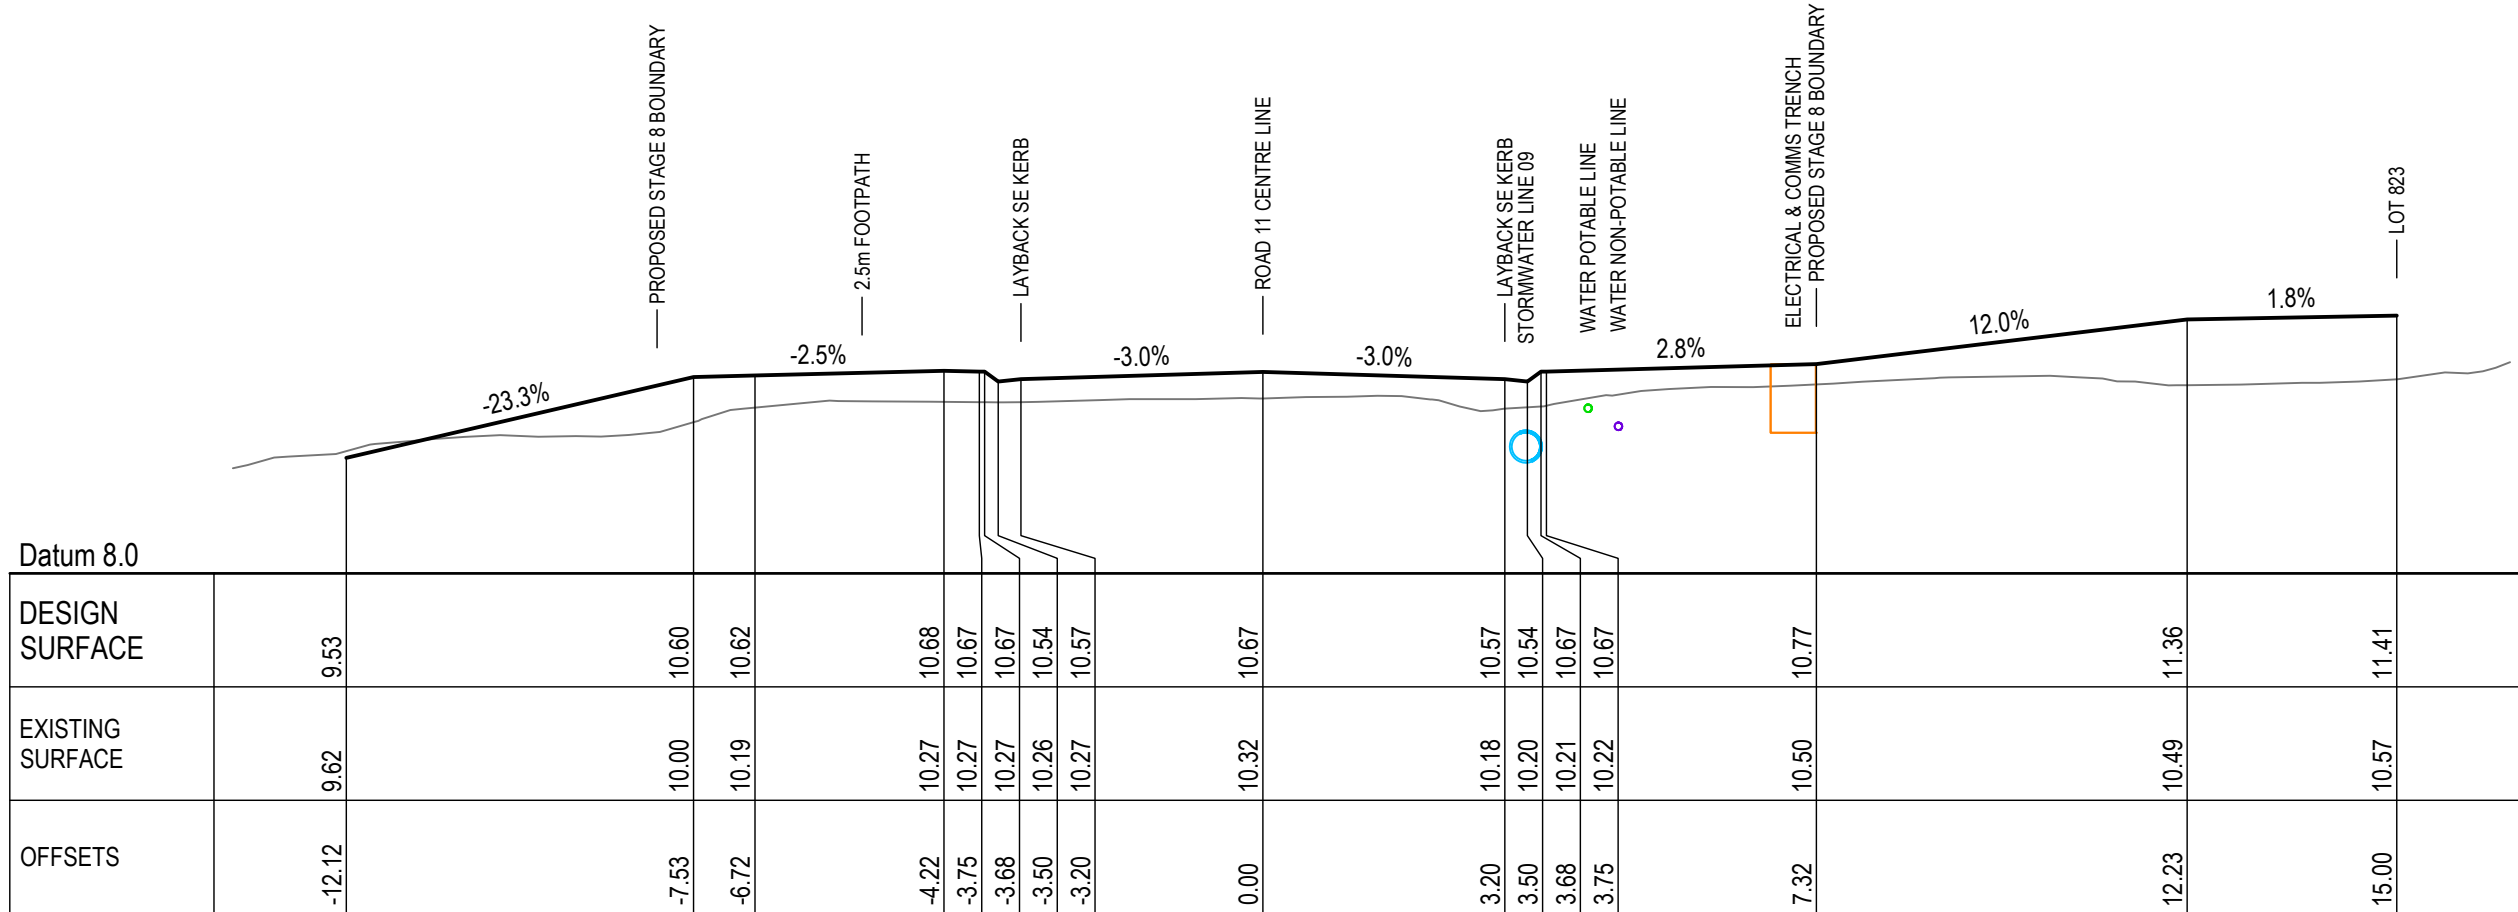


350.00

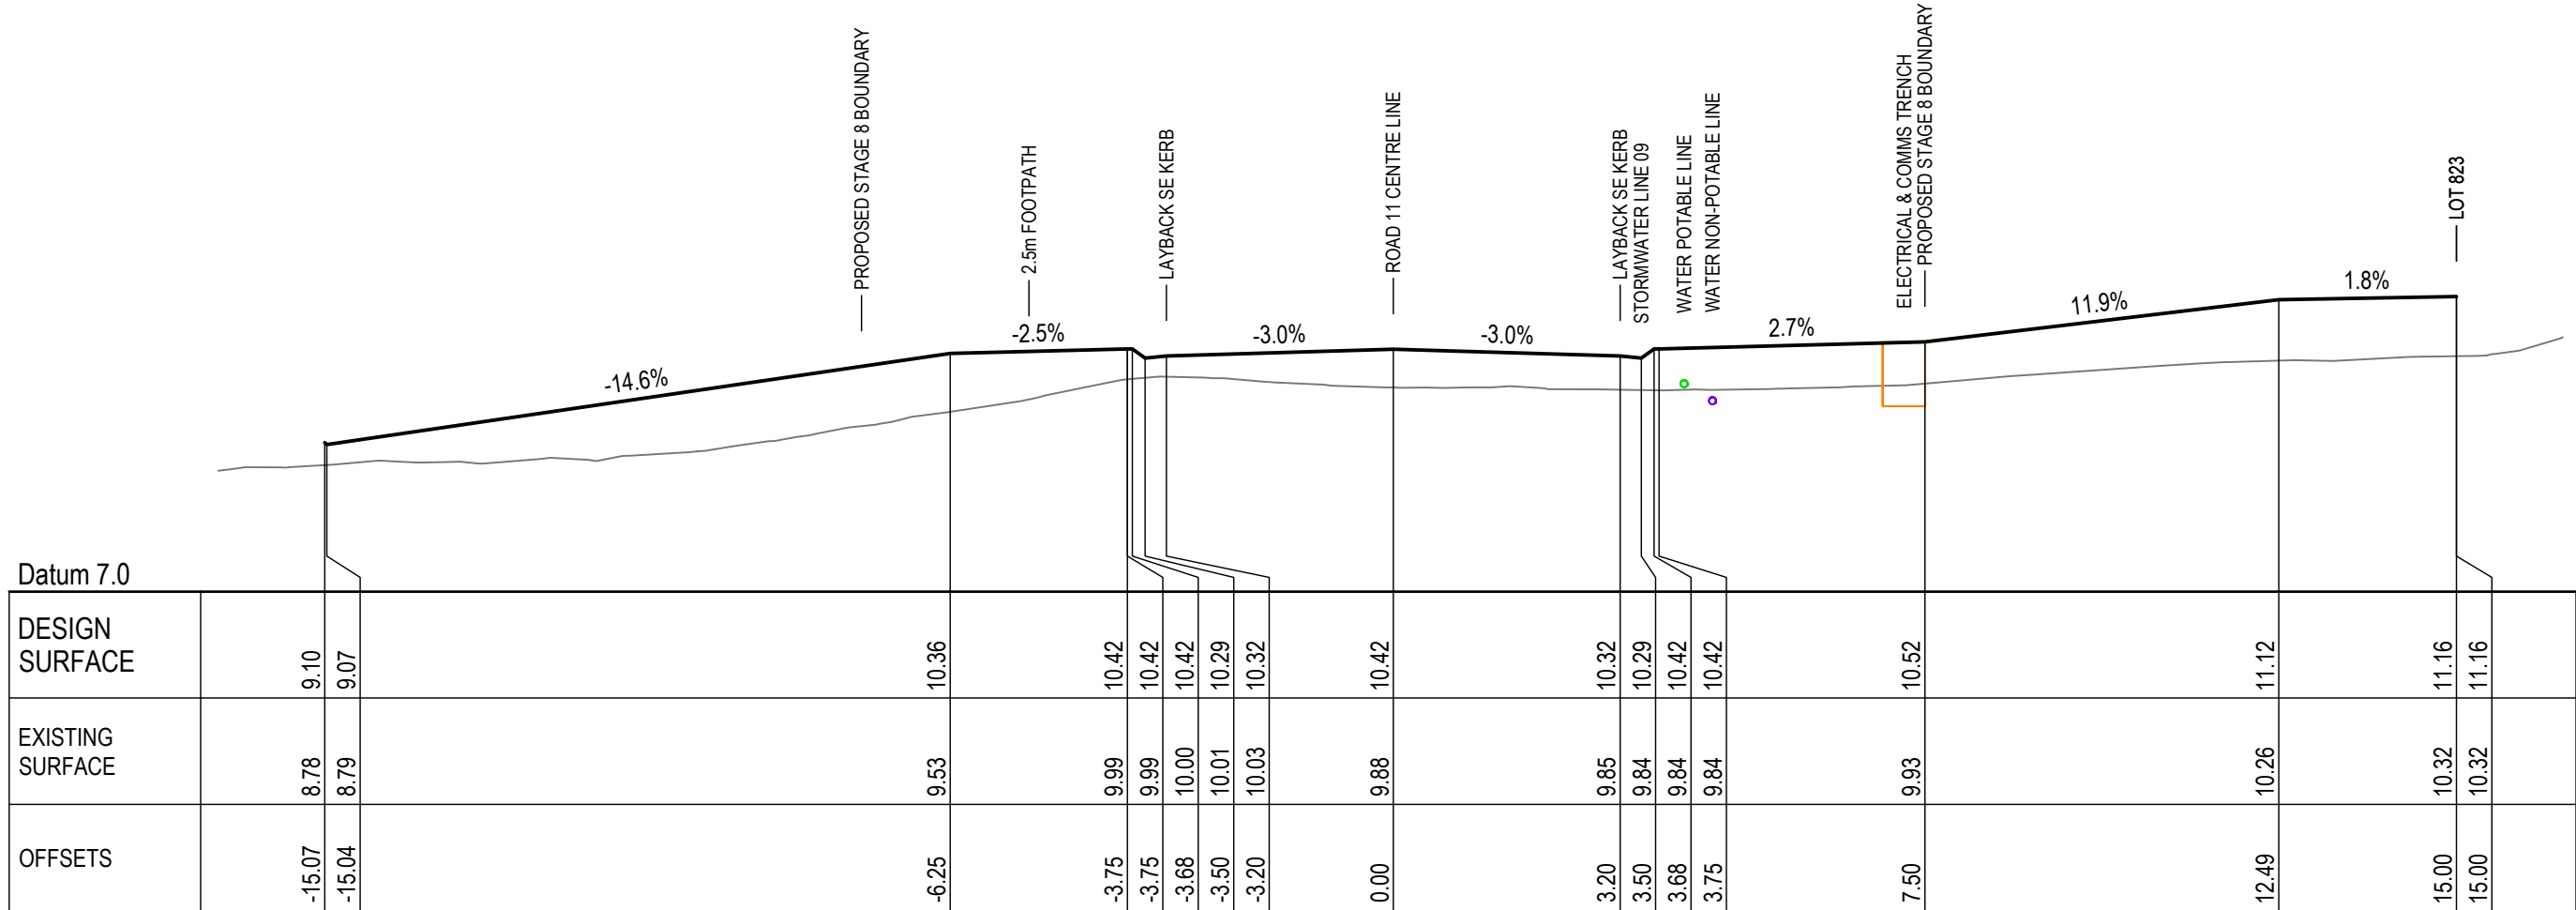


338.49

0 1.0 2.0 3.0 4.0 5.0m
HORIZONTAL SCALE 1:100 @ A1

0 1.0 2.0 3.0 4.0 5.0m
VERTICAL SCALE 1:100 @ A1

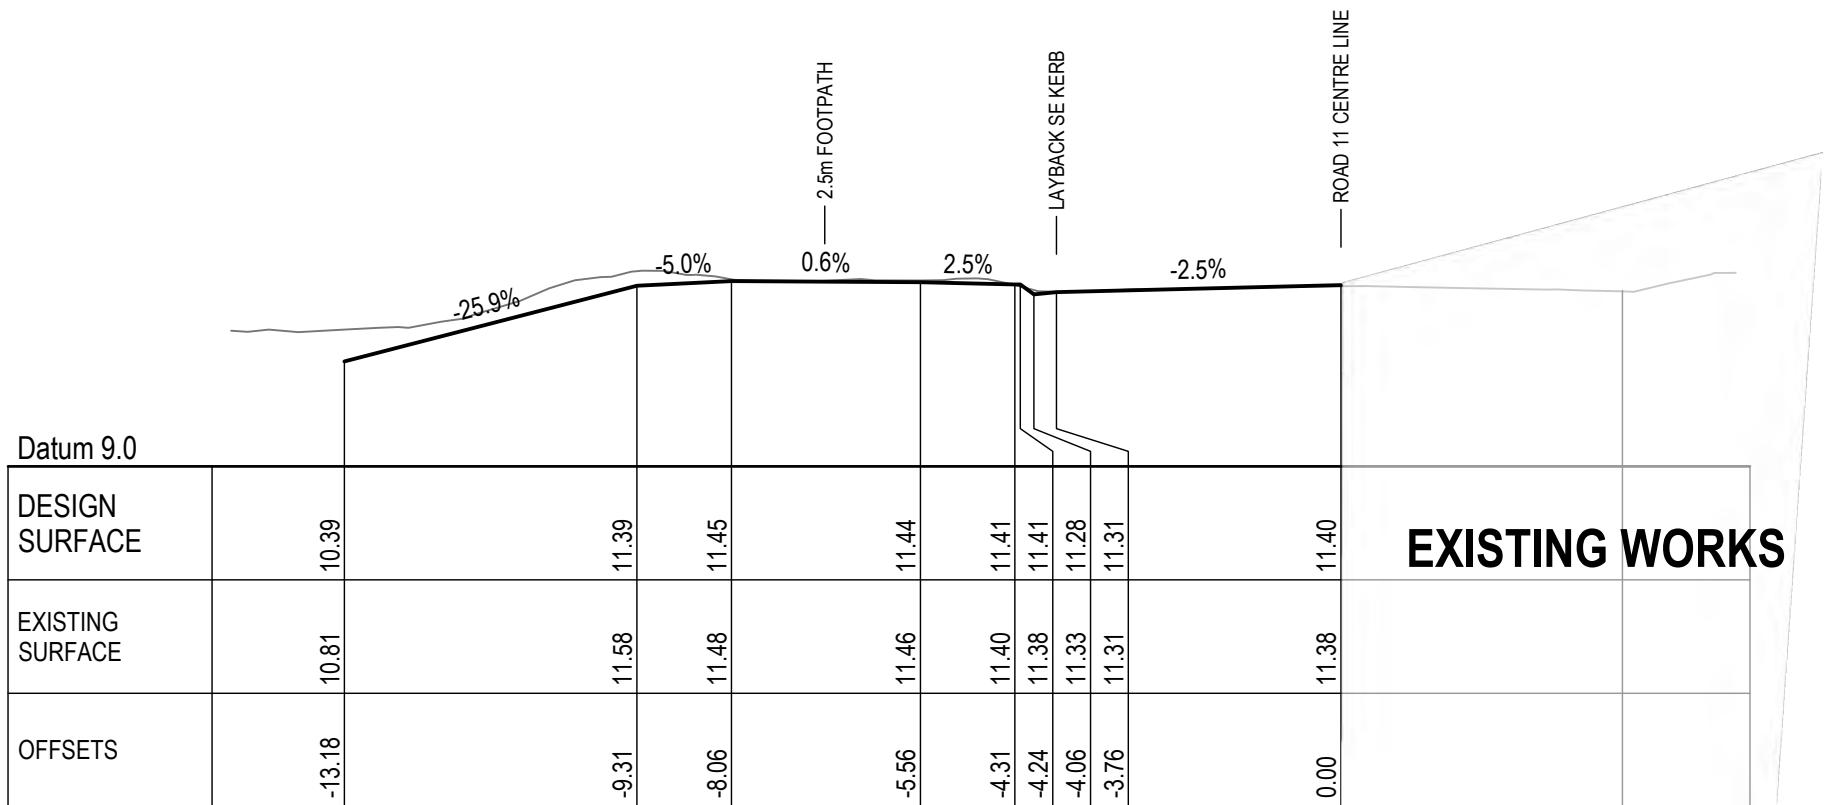

371.28

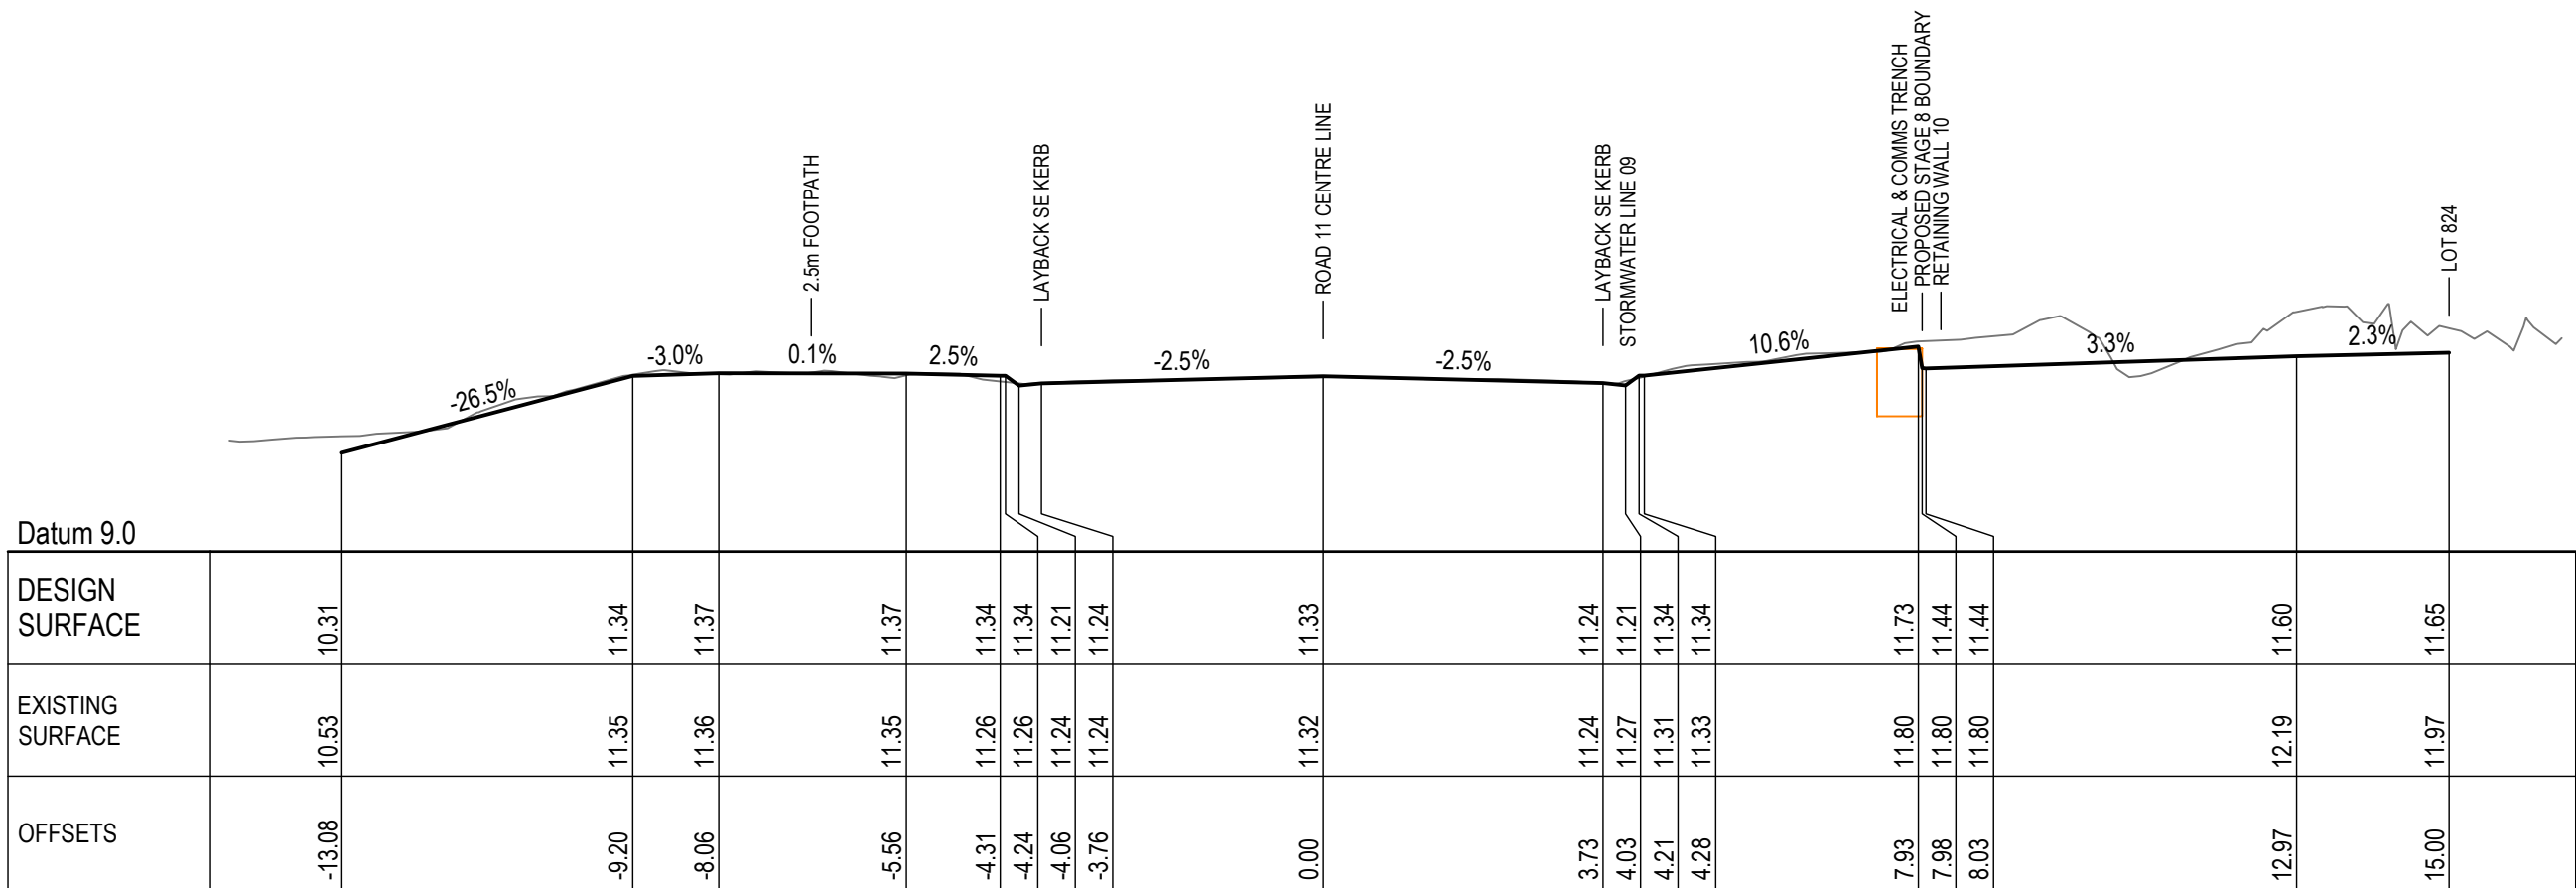

369.68

KING + CAMPBELL

King & Campbell Pty Ltd
www.kingscampbell.com.au
A: PO Box 243 Port Macquarie NSW 2444
T: 02 6586 2555
F: 02 6583 4064
E: info@kingcampbell.com.au

REV.	DATE	DESCRIPTION	
A	31.10.2025	ISSUED FOR APPROVAL	JSC

DATUM: AHD SCALE: AS SHOWN @ A1


NOTE: DO NOT SCALE OFF DRAWINGS. USE FIGURED DIMENSIONS ONLY. REPORT ANY DISCREPANCIES TO THE AUTHOR. THIS DRAWING BEING THE PROPERTY OF KING & CAMPBELL PTY LTD, IS PROTECTED BY COPYRIGHT AND MUST NOT BE USED, REPRODUCED OR COPIED WHOLLY, OR IN PART WITHOUT THE WRITTEN PERMISSION OF KING & CAMPBELL PTY LTD. © King & Campbell Pty Ltd

PROJECT NO:	7197	DRAWING TITLE:	ROAD 11 CROSS SECTIONS CH 338.49 TO 371.28
DA NO.:	2014-114		
DESIGNED BY:	JSC/BC	PROJECT:	THE SANCTUARY STAGE 8 LOT 300, DP 1307775 - JOHN OXLEY DRIVE, THURMSTER
DRAWN BY:	JSC		
CHECKED BY:	BC	CLIENT:	BIRD IN THE HAND 2 PTY LTD.
DATE CREATED:	JULY 2025		
		DRAWING NO:	7197_Stage 8_SWC_Sections
		SHEET:	16 OF 36
		REVISION:	A



NOT TO BE USED FOR CONSTRUCTION UNLESS SUBDIVISION WORKS CERTIFICATE ISSUED FOR THE WORKS

A1

M:\C-REF-01797_The Sanctuary\02_Engineering\Stages 8 and 9\2_SWC\SWC2107_Stage 8_SWC_Sections.dwg - A1(1)-RD.LS(1). 24 February 2025, jpsc

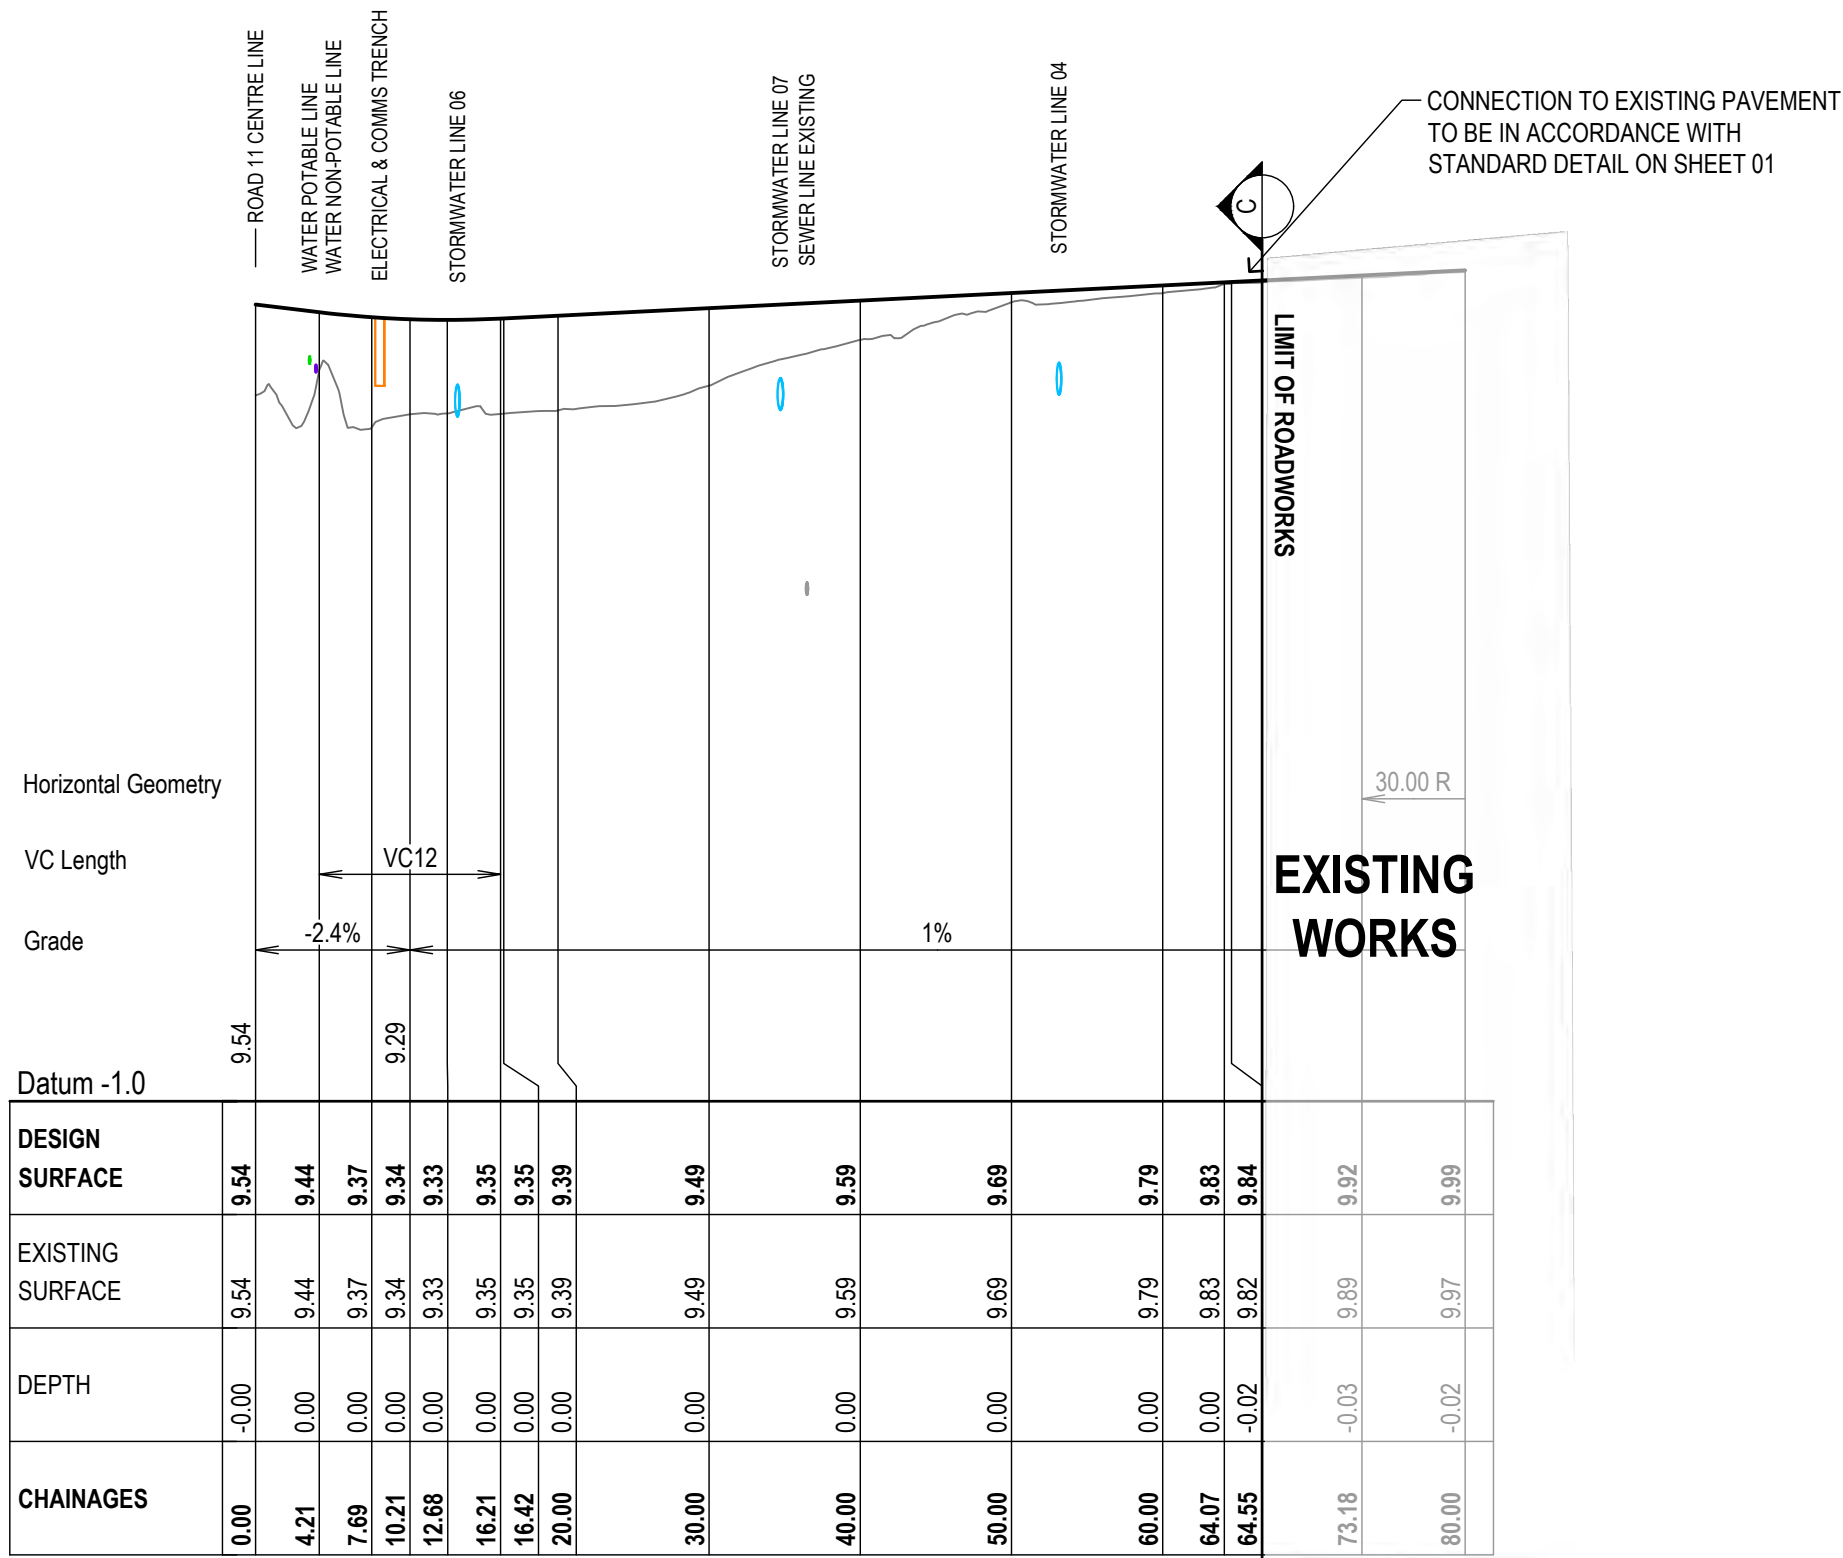

ROAD 12 LONGITUDINAL SECTION

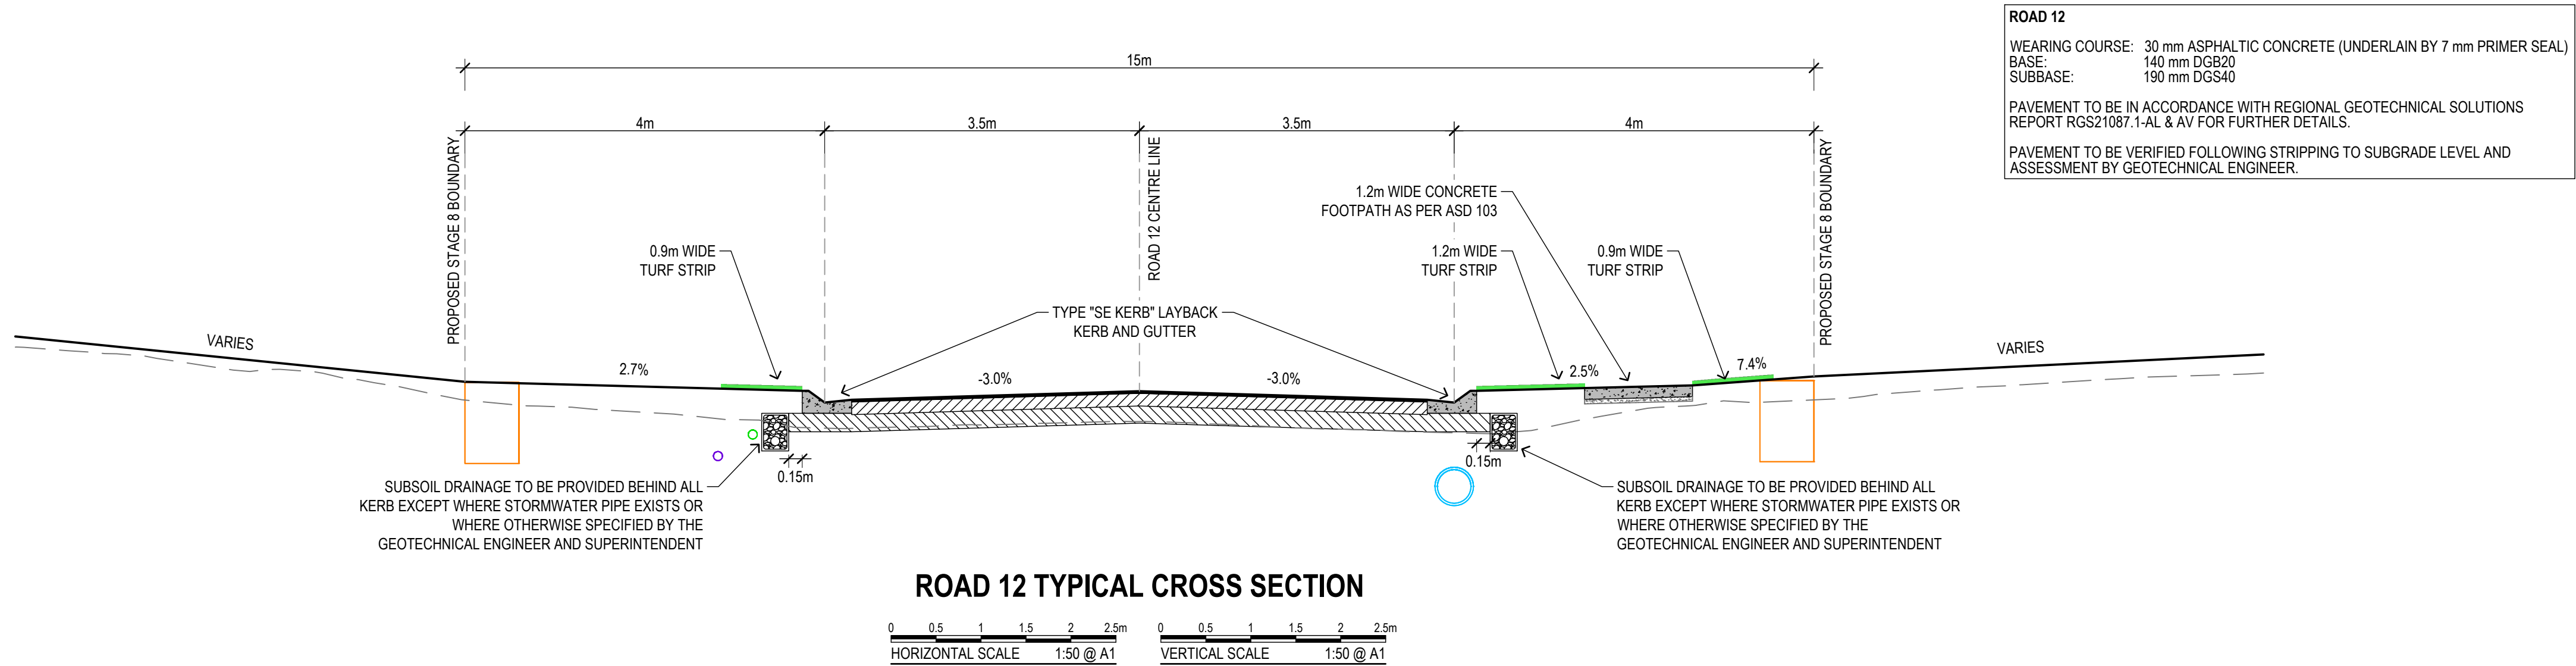

REV.	DATE	DESCRIPTION	
A	31.10.2025	ISSUED FOR APPROVAL	JSC

DATUM:	AHD	SCALE:	AS SHOWN @ A1
NOTE: DO NOT SCALE OFF DRAWINGS. USE FIGURED DIMENSIONS ONLY. REPORT ANY DISCREPANCIES TO THE AUTHOR. THIS DRAWING BEING THE PROPERTY OF KING & CAMPBELL PTY LTD, IS PROTECTED BY COPYRIGHT AND MUST NOT BE USED, REPRODUCED OR COPIED WHOLLY, OR IN PART WITHOUT THE WRITTEN PERMISSION OF KING & CAMPBELL PTY LTD. © King & Campbell Pty Ltd			







PROJECT NO:	7197	DRAWING TITLE:	ROAD 12 LONGITUDINAL SECTION & TYPICAL SECTION				A1
DA NO.:	2014-114						
DESIGNED BY:	JSC/BC	PROJECT:	THE SANCTUARY STAGE 8 LOT 300, DP 1307775 - JOHN OXLEY DRIVE, THURMSTER				
DRAWN BY:	JSC						
CHECKED BY:	BC	CLIENT:	BIRD IN THE HAND 2 PTY LTD.				
DATE CREATED:	JULY 2025						
		DRAWING NO:		SHEET:	REVISION:		
		7197_Stage 8_SWC_Sections		17 OF 36	A		

M:\C-REF-01797_The Sanctuary\02_Engineering\Stages 8 and 9\2_SWG8 SWG2107_Stage 8_SWC_Sections.dwg - A1(1)-RD_XS 06_24 February 2026_jenacs


REV.	DATE	DESCRIPTION	
A	31.10.2025	ISSUED FOR APPROVAL	JSC

DATUM:	AHD	SCALE:	AS SHOWN @ A1
NOTE: DO NOT SCALE OFF DRAWINGS. USE FIGURED DIMENSIONS ONLY. REPORT ANY DISCREPANCIES TO THE AUTHOR. THIS DRAWING BEING THE PROPERTY OF KING & CAMPBELL PTY LTD, IS PROTECTED BY COPYRIGHT AND MUST NOT BE USED, REPRODUCED OR COPIED WHOLLY, OR IN PART WITHOUT THE WRITTEN PERMISSION OF KING & CAMPBELL PTY LTD. © King & Campbell Pty Ltd			

PROJECT NO:	7197	DRAWING TITLE:	ROAD 12 CROSS SECTIONS CH 7.69 TO 60.00				A1
DA NO.:	2014-114						
DESIGNED BY:	JSC/BC	PROJECT:	THE SANCTUARY STAGE 8 LOT 300, DP 1307775 - JOHN OXLEY DRIVE, THURMSTER				
DRAWN BY:	JSC						
CHECKED BY:	BC						
DATE CREATED:	JULY 2025						
		CLIENT:	BIRD IN THE HAND 2 PTY LTD.		DRAWING NO:	SHEET:	REVISION:
					7197_Stage 8_SWC_Sections	18 OF 36	A

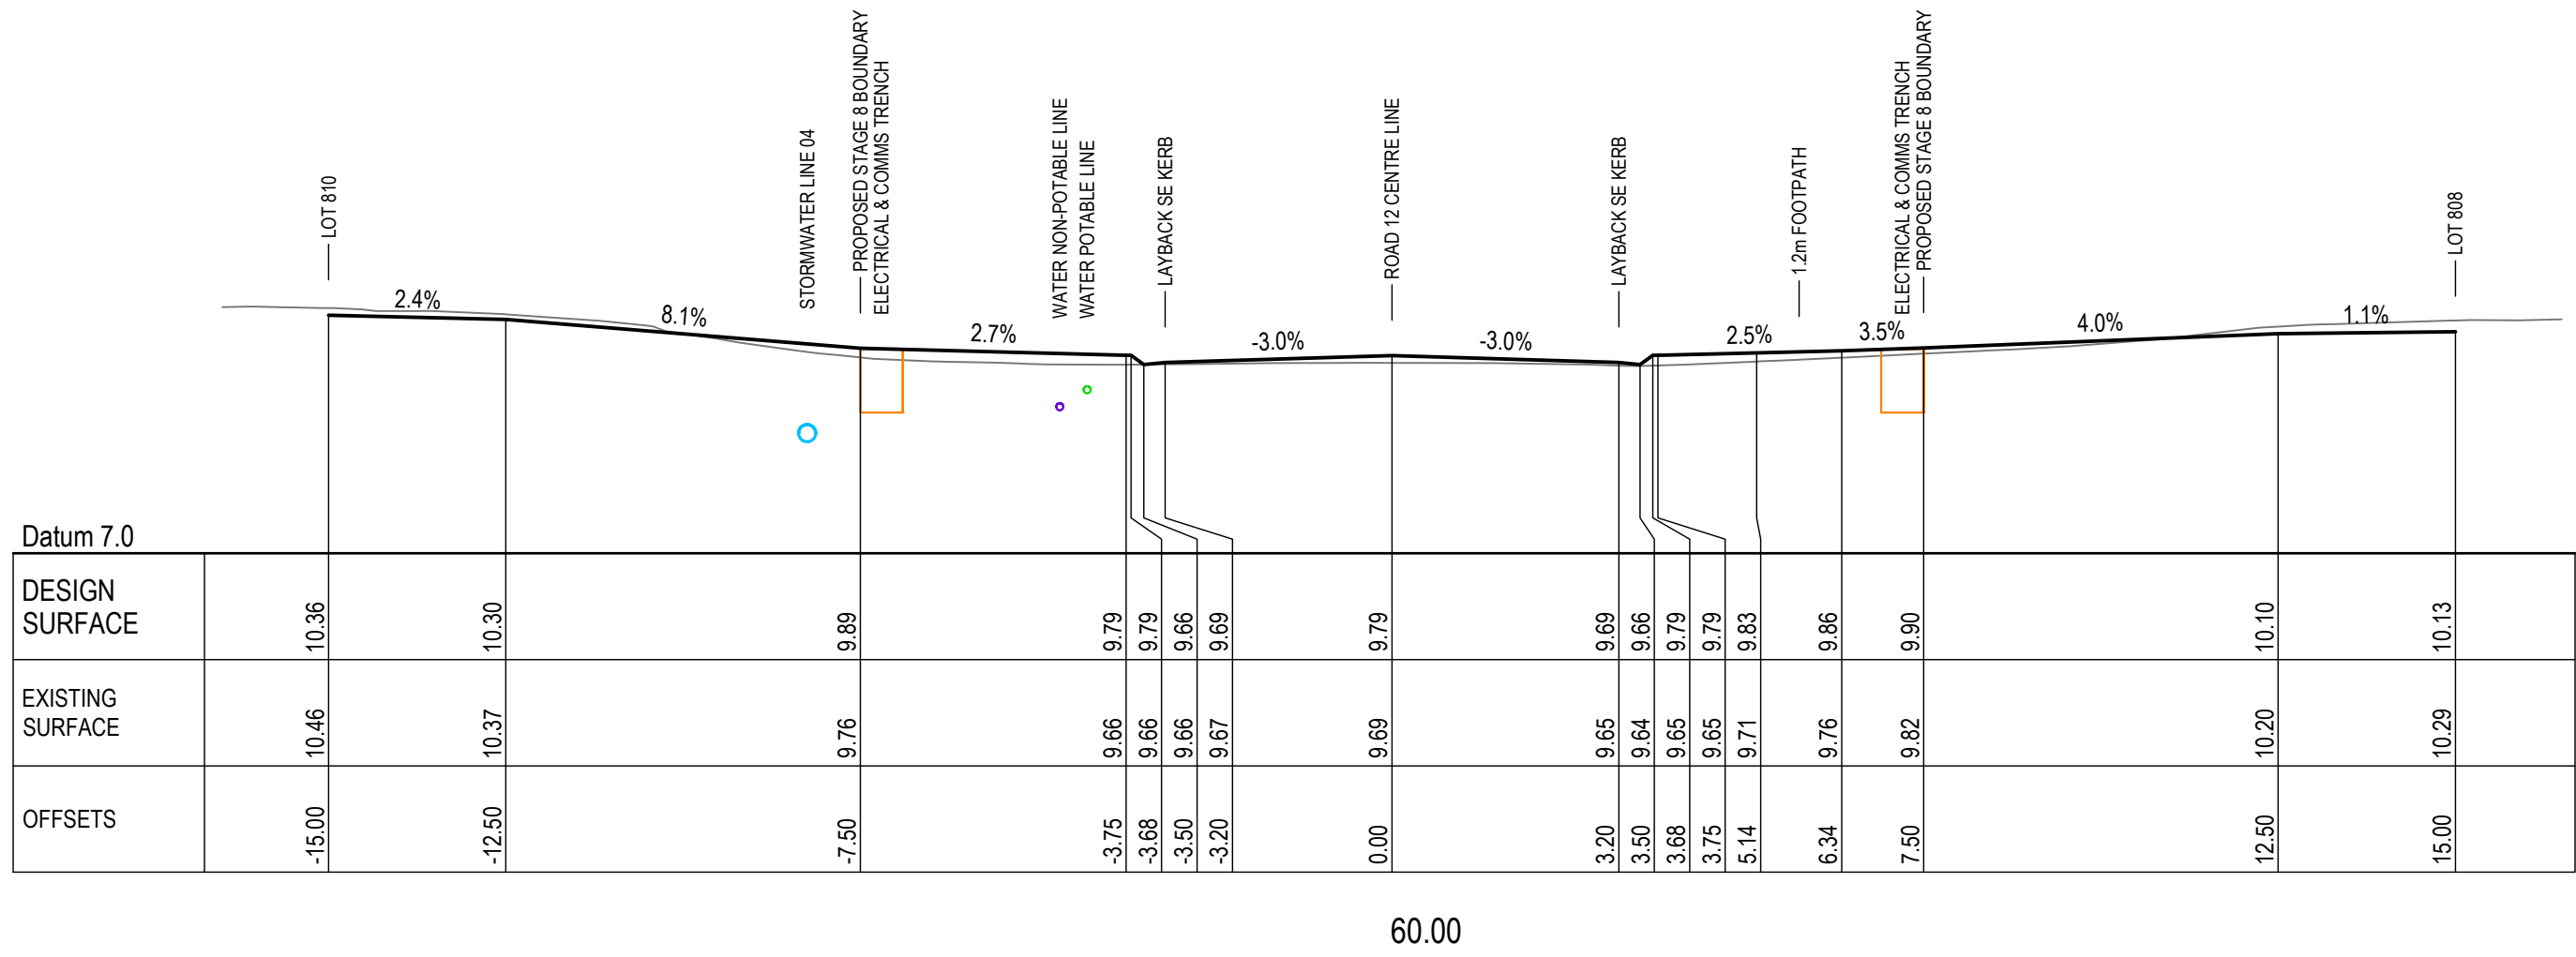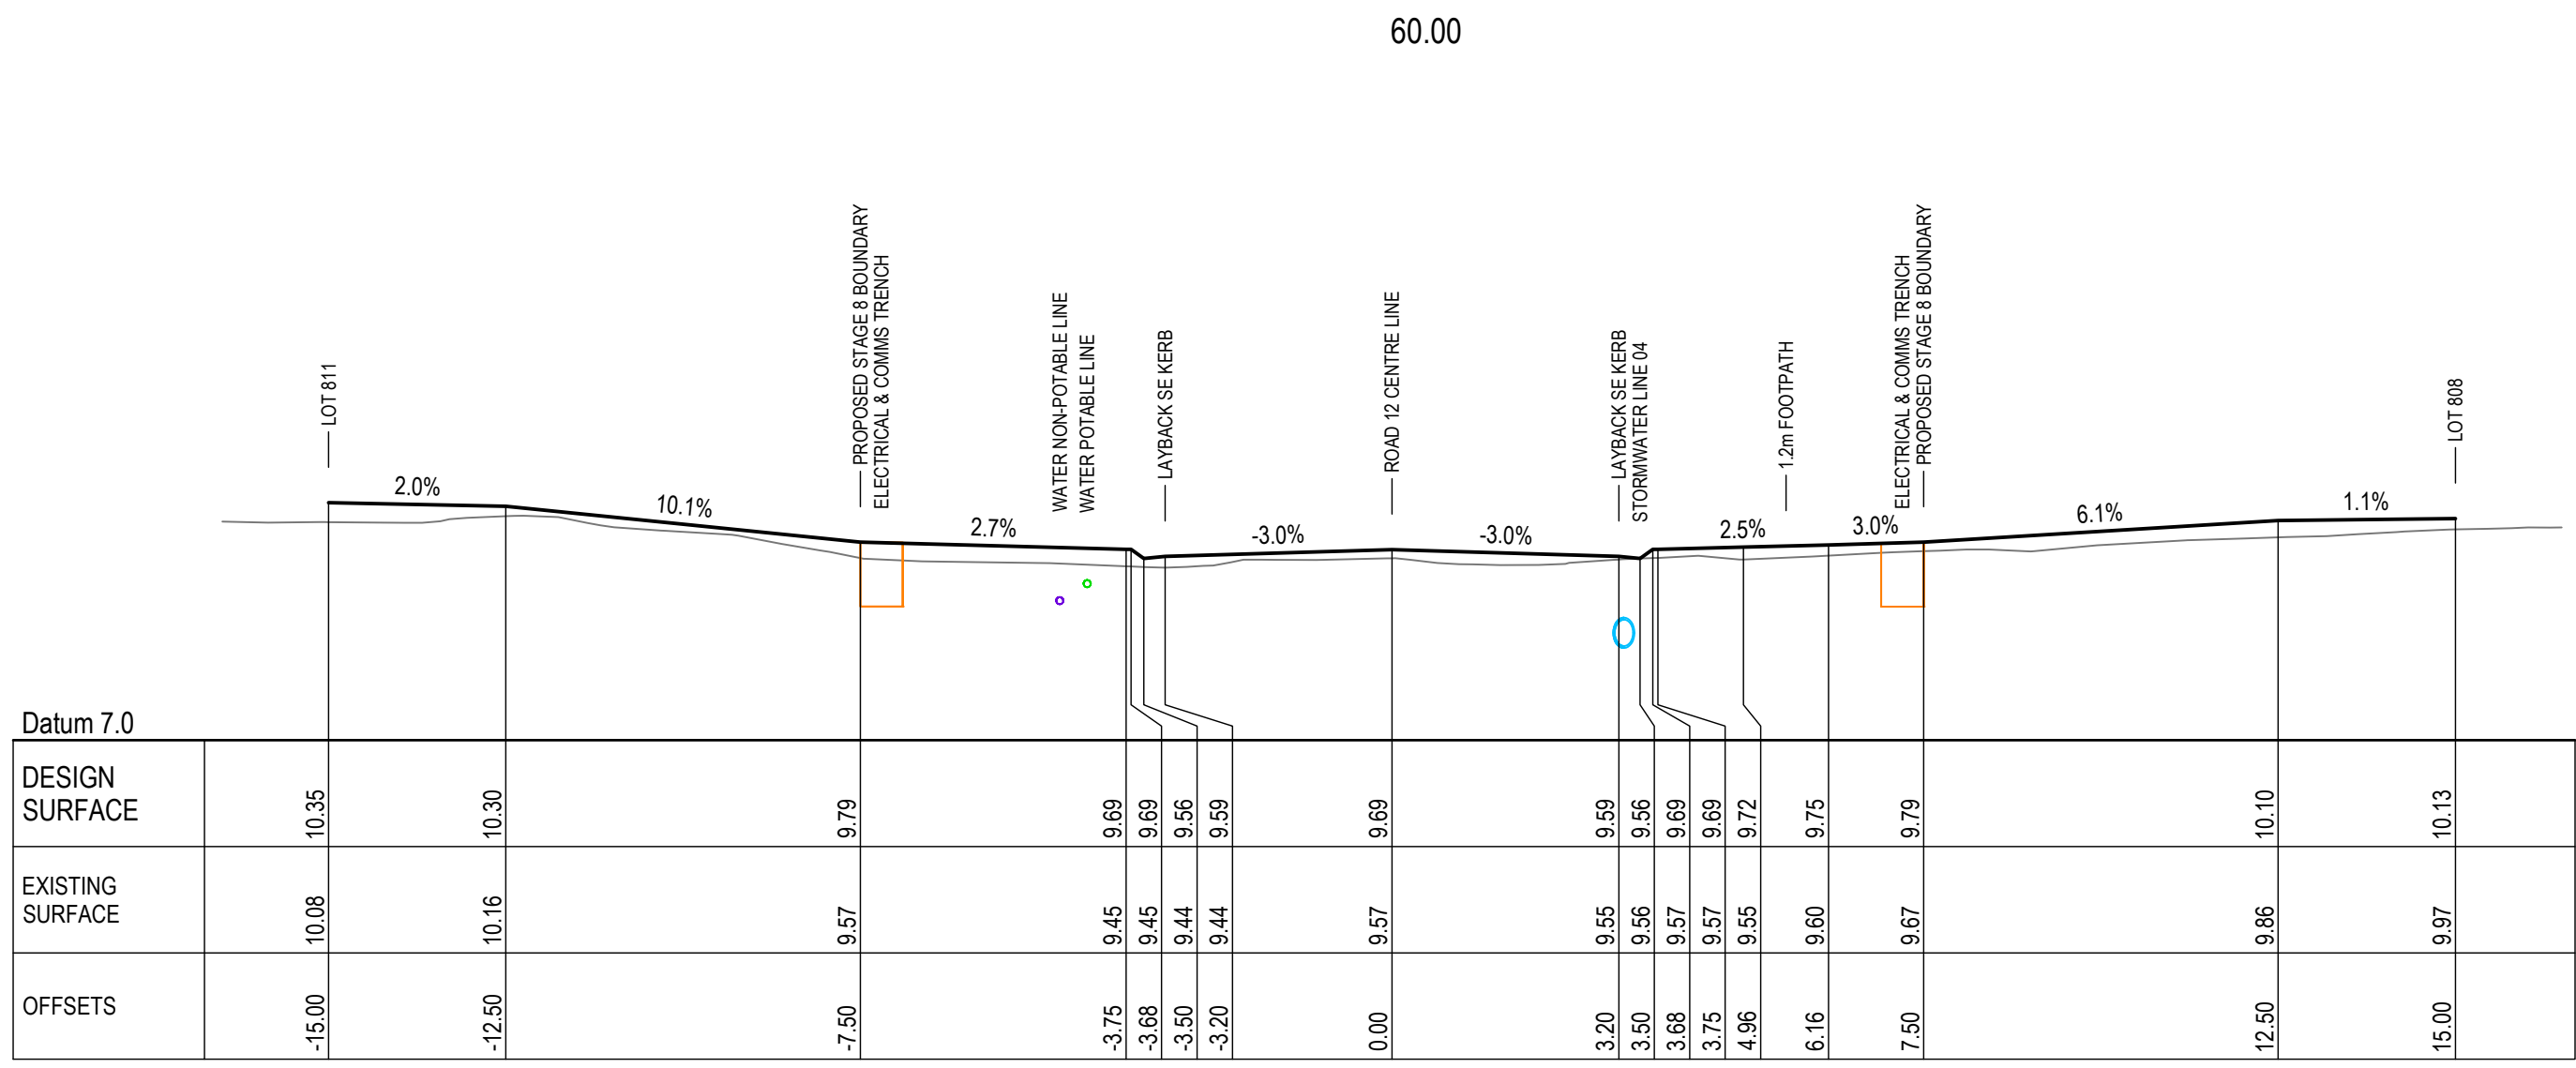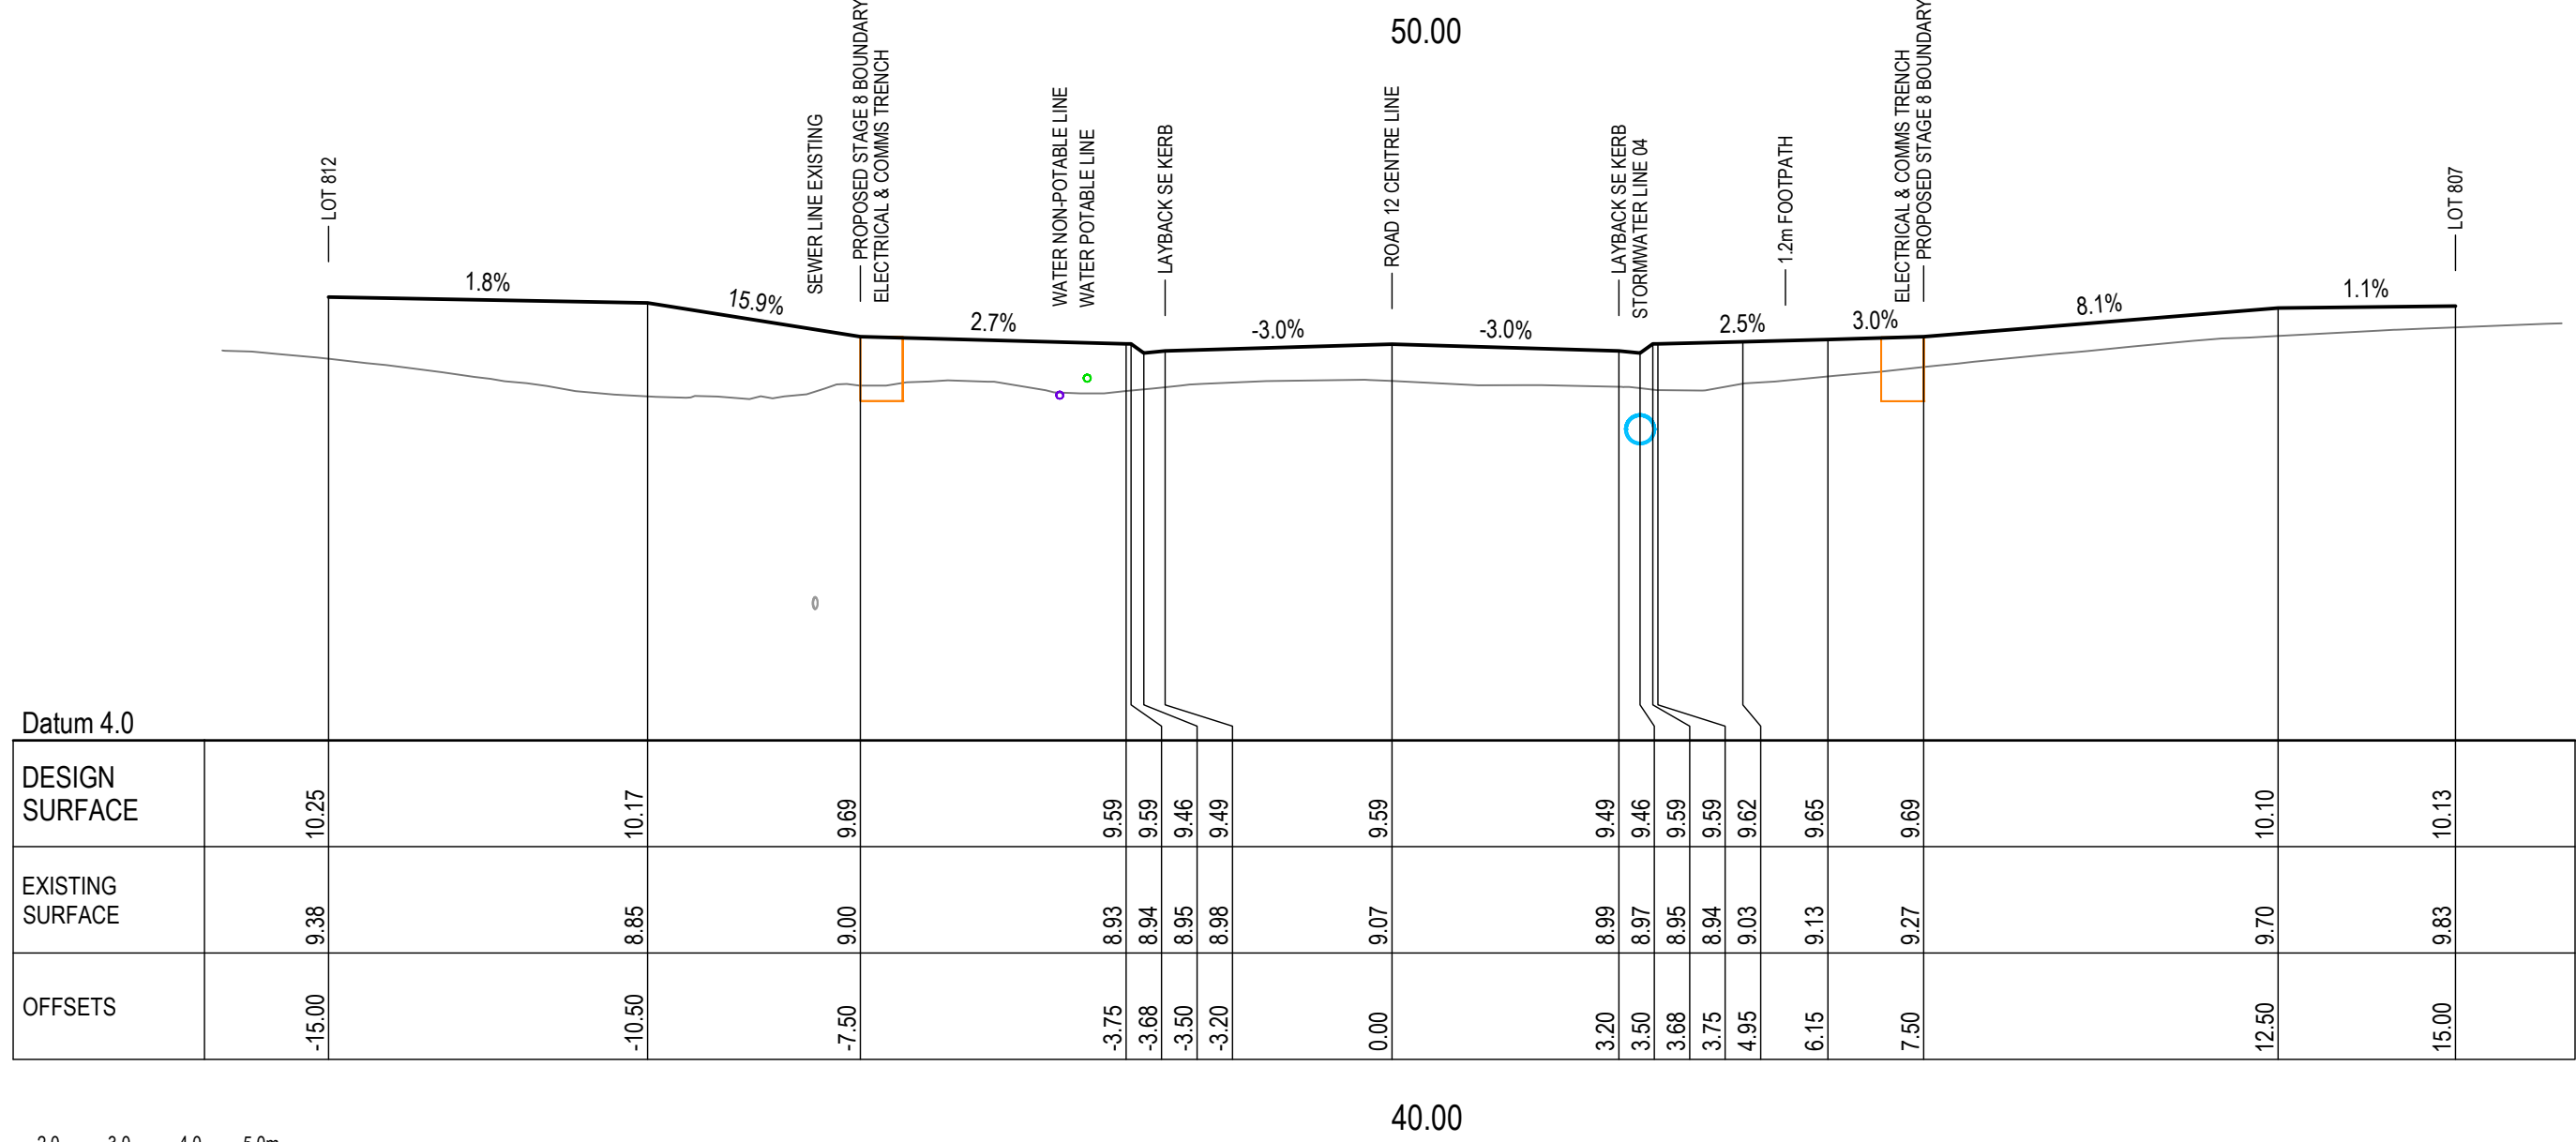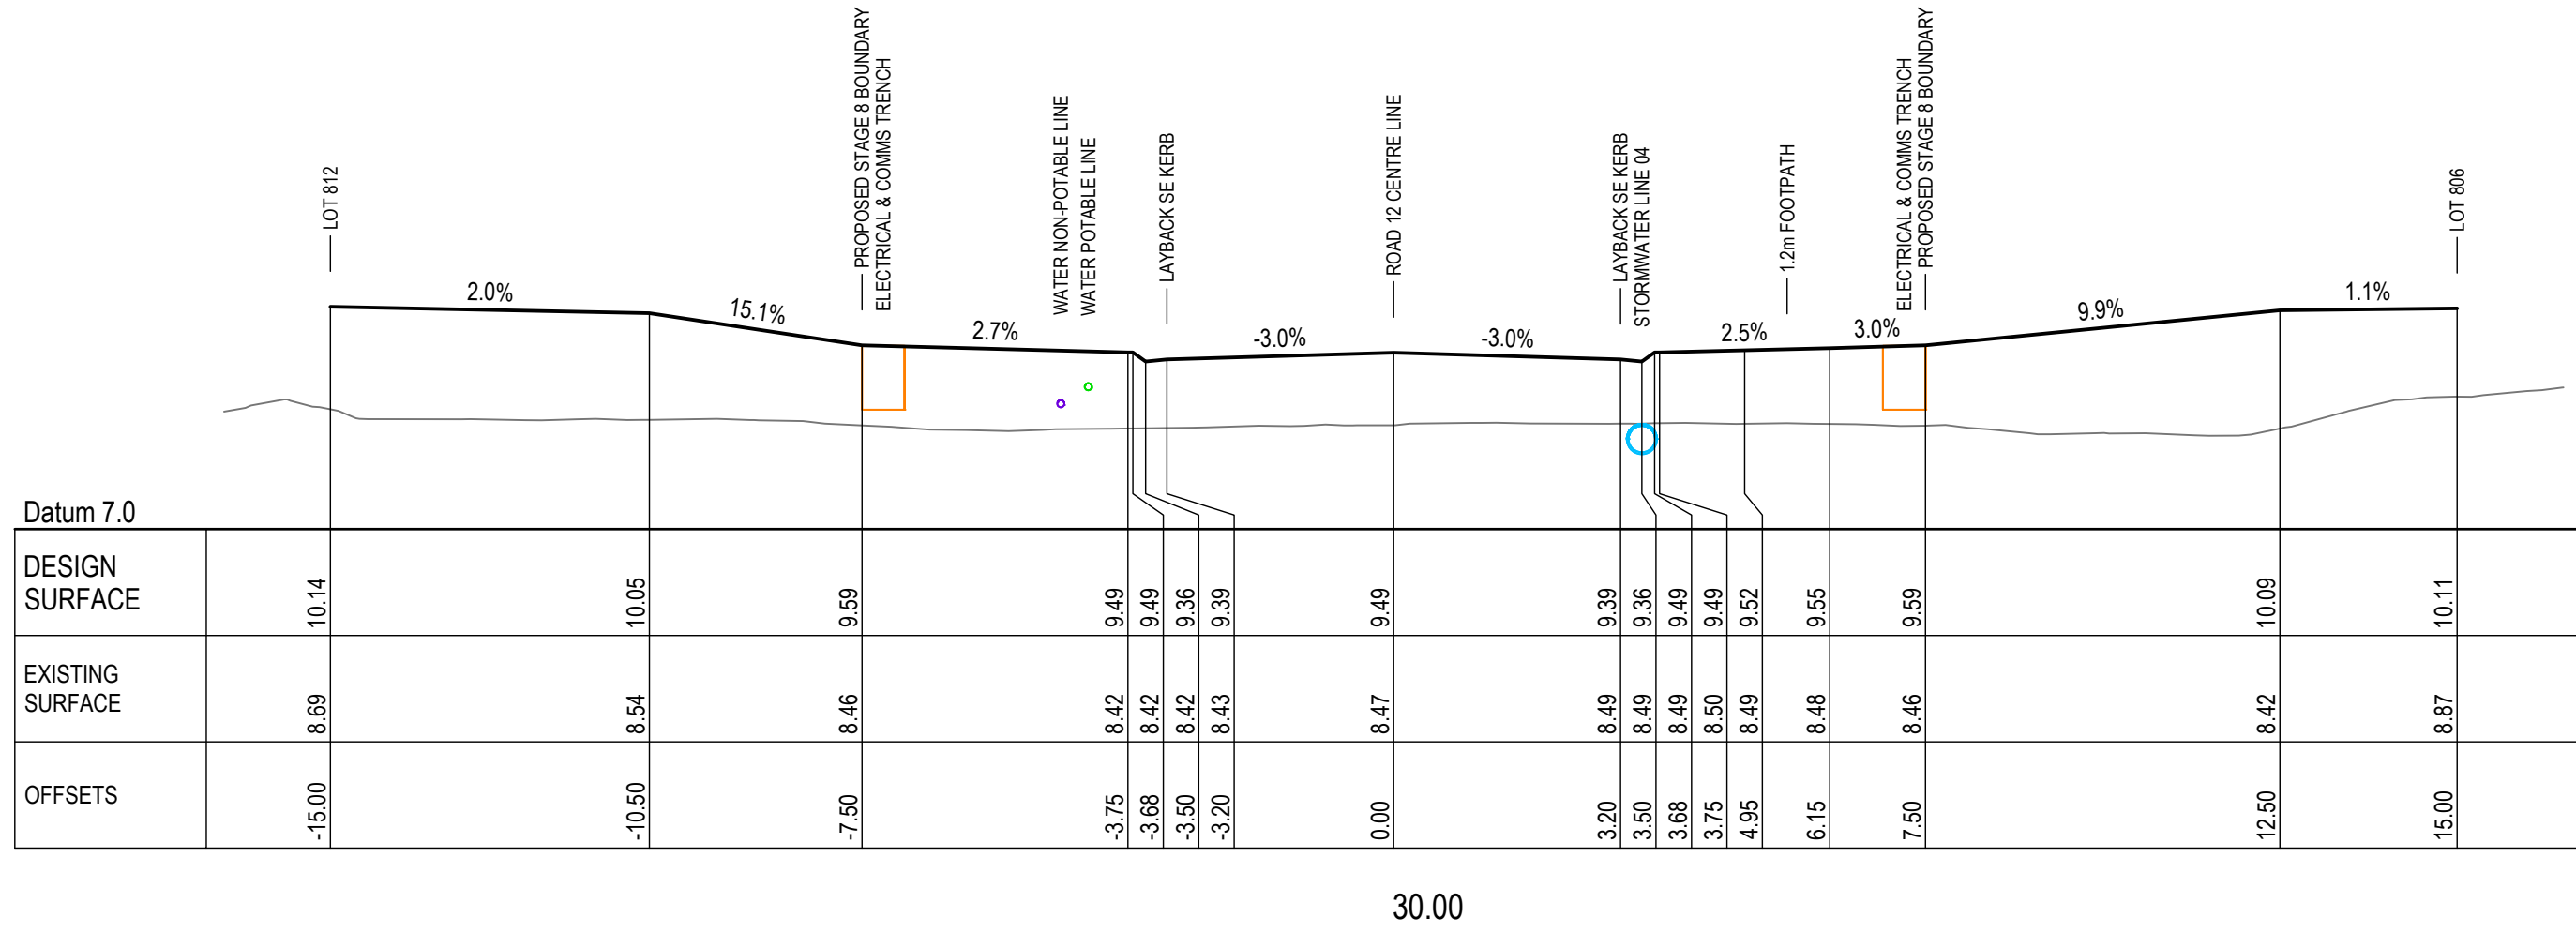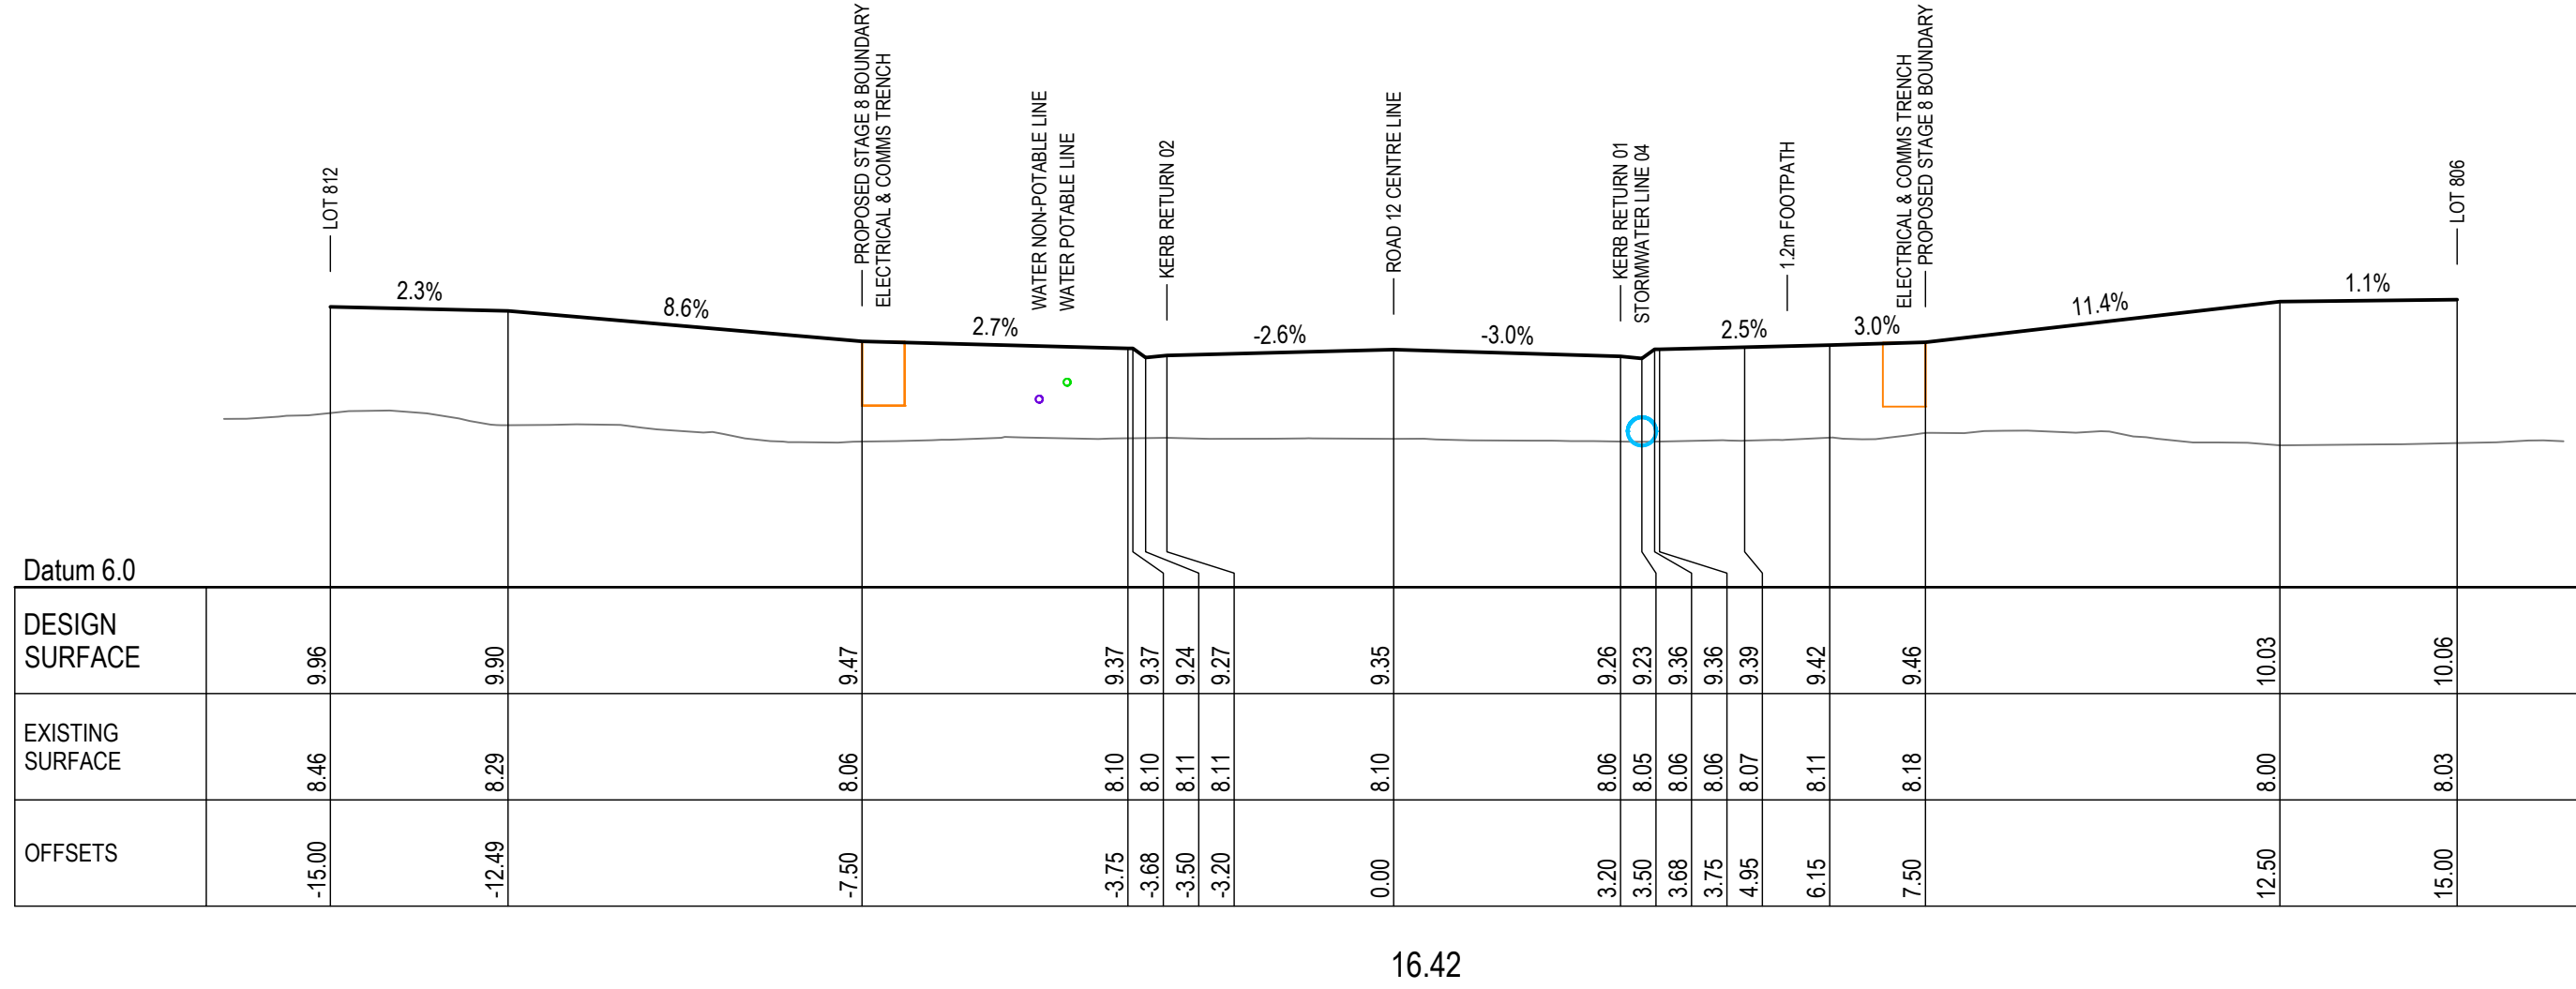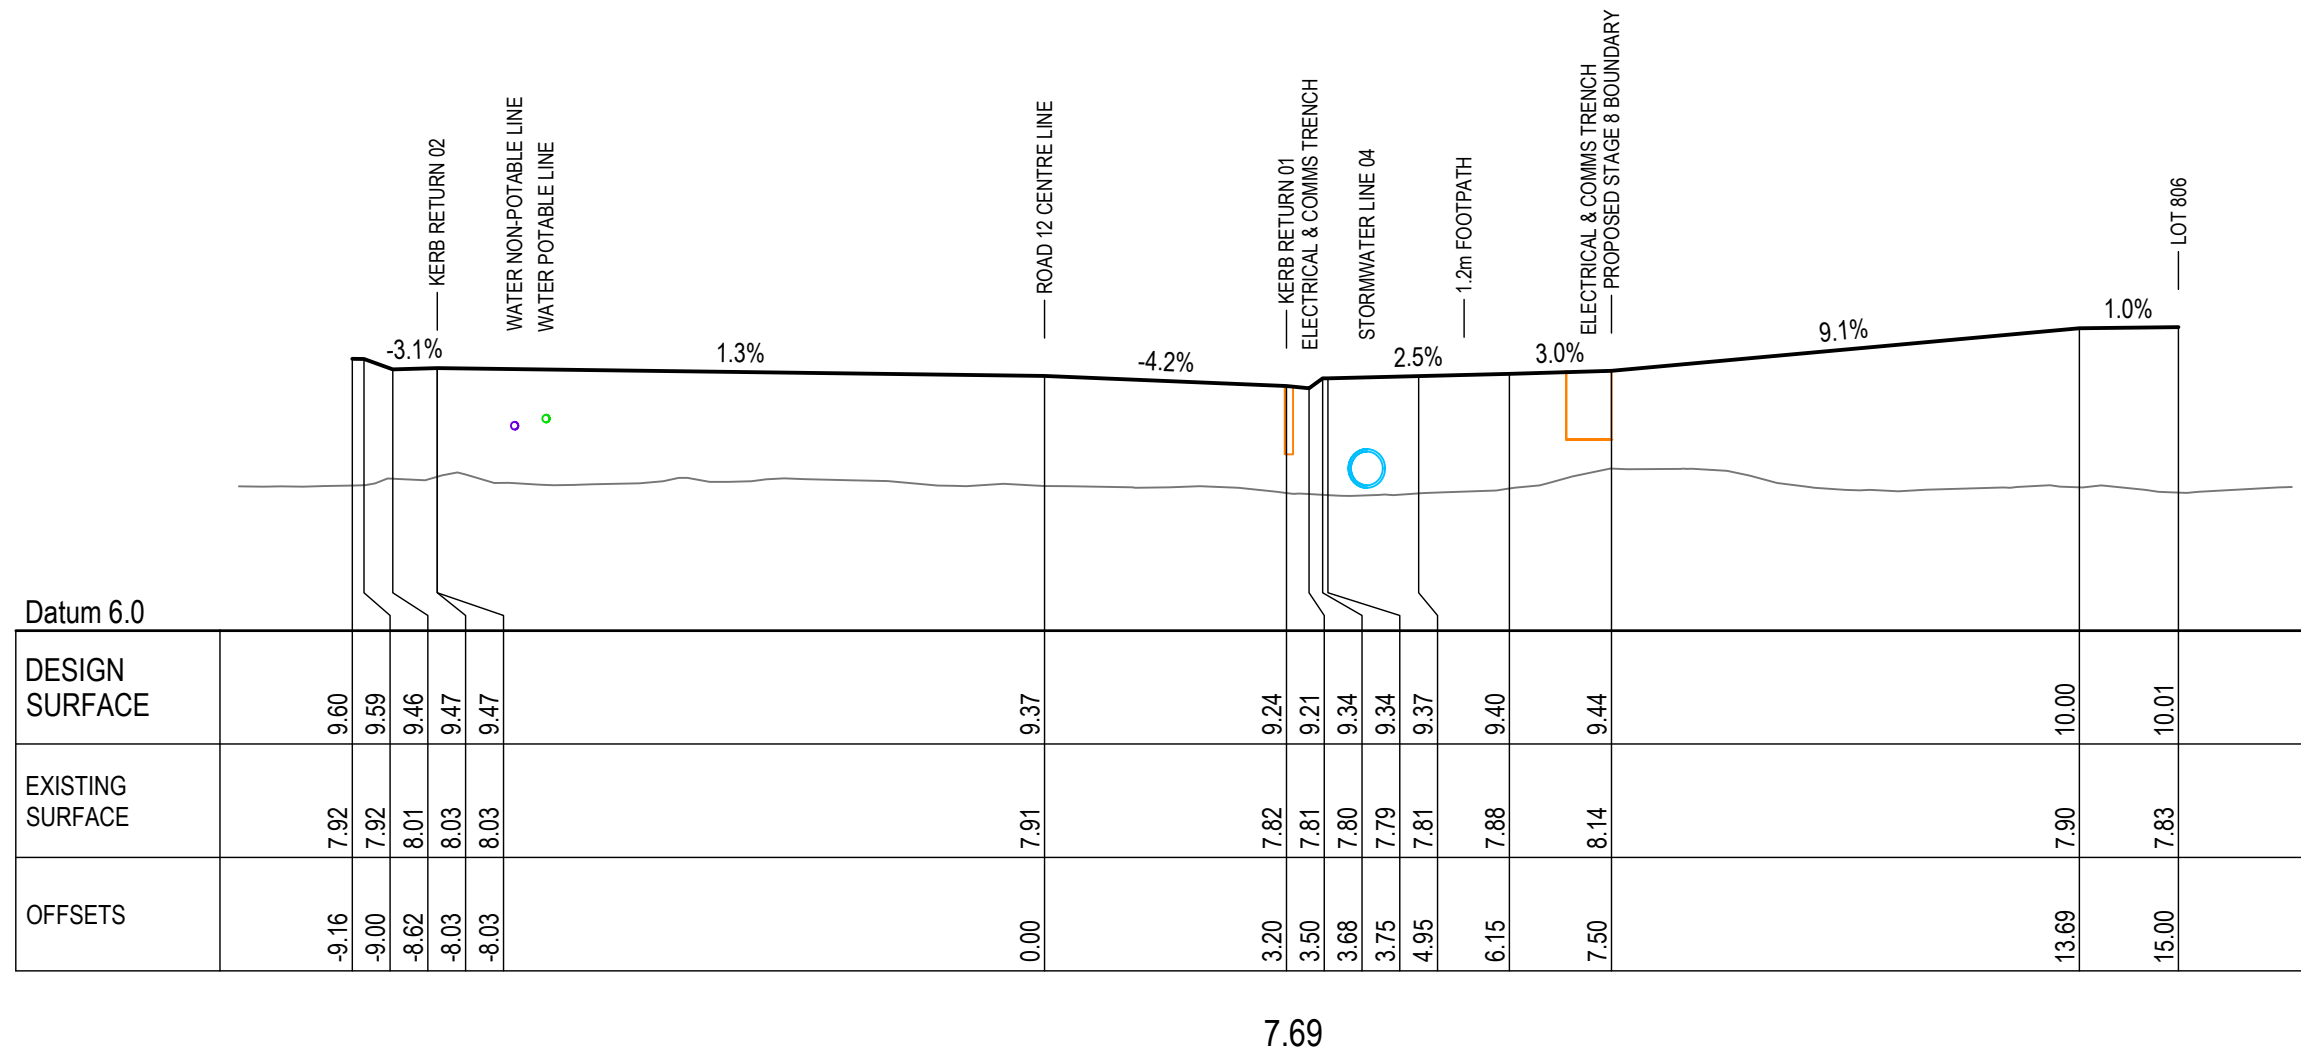

K:\C-REF-017197_The Sanctuary\02_Engineering\Stages 8 and 9\2_SWG\SWG17197_Stage 8_SWC_Sections.dwg - A1(1)-RD.XS 07_24 February 2026_jenae

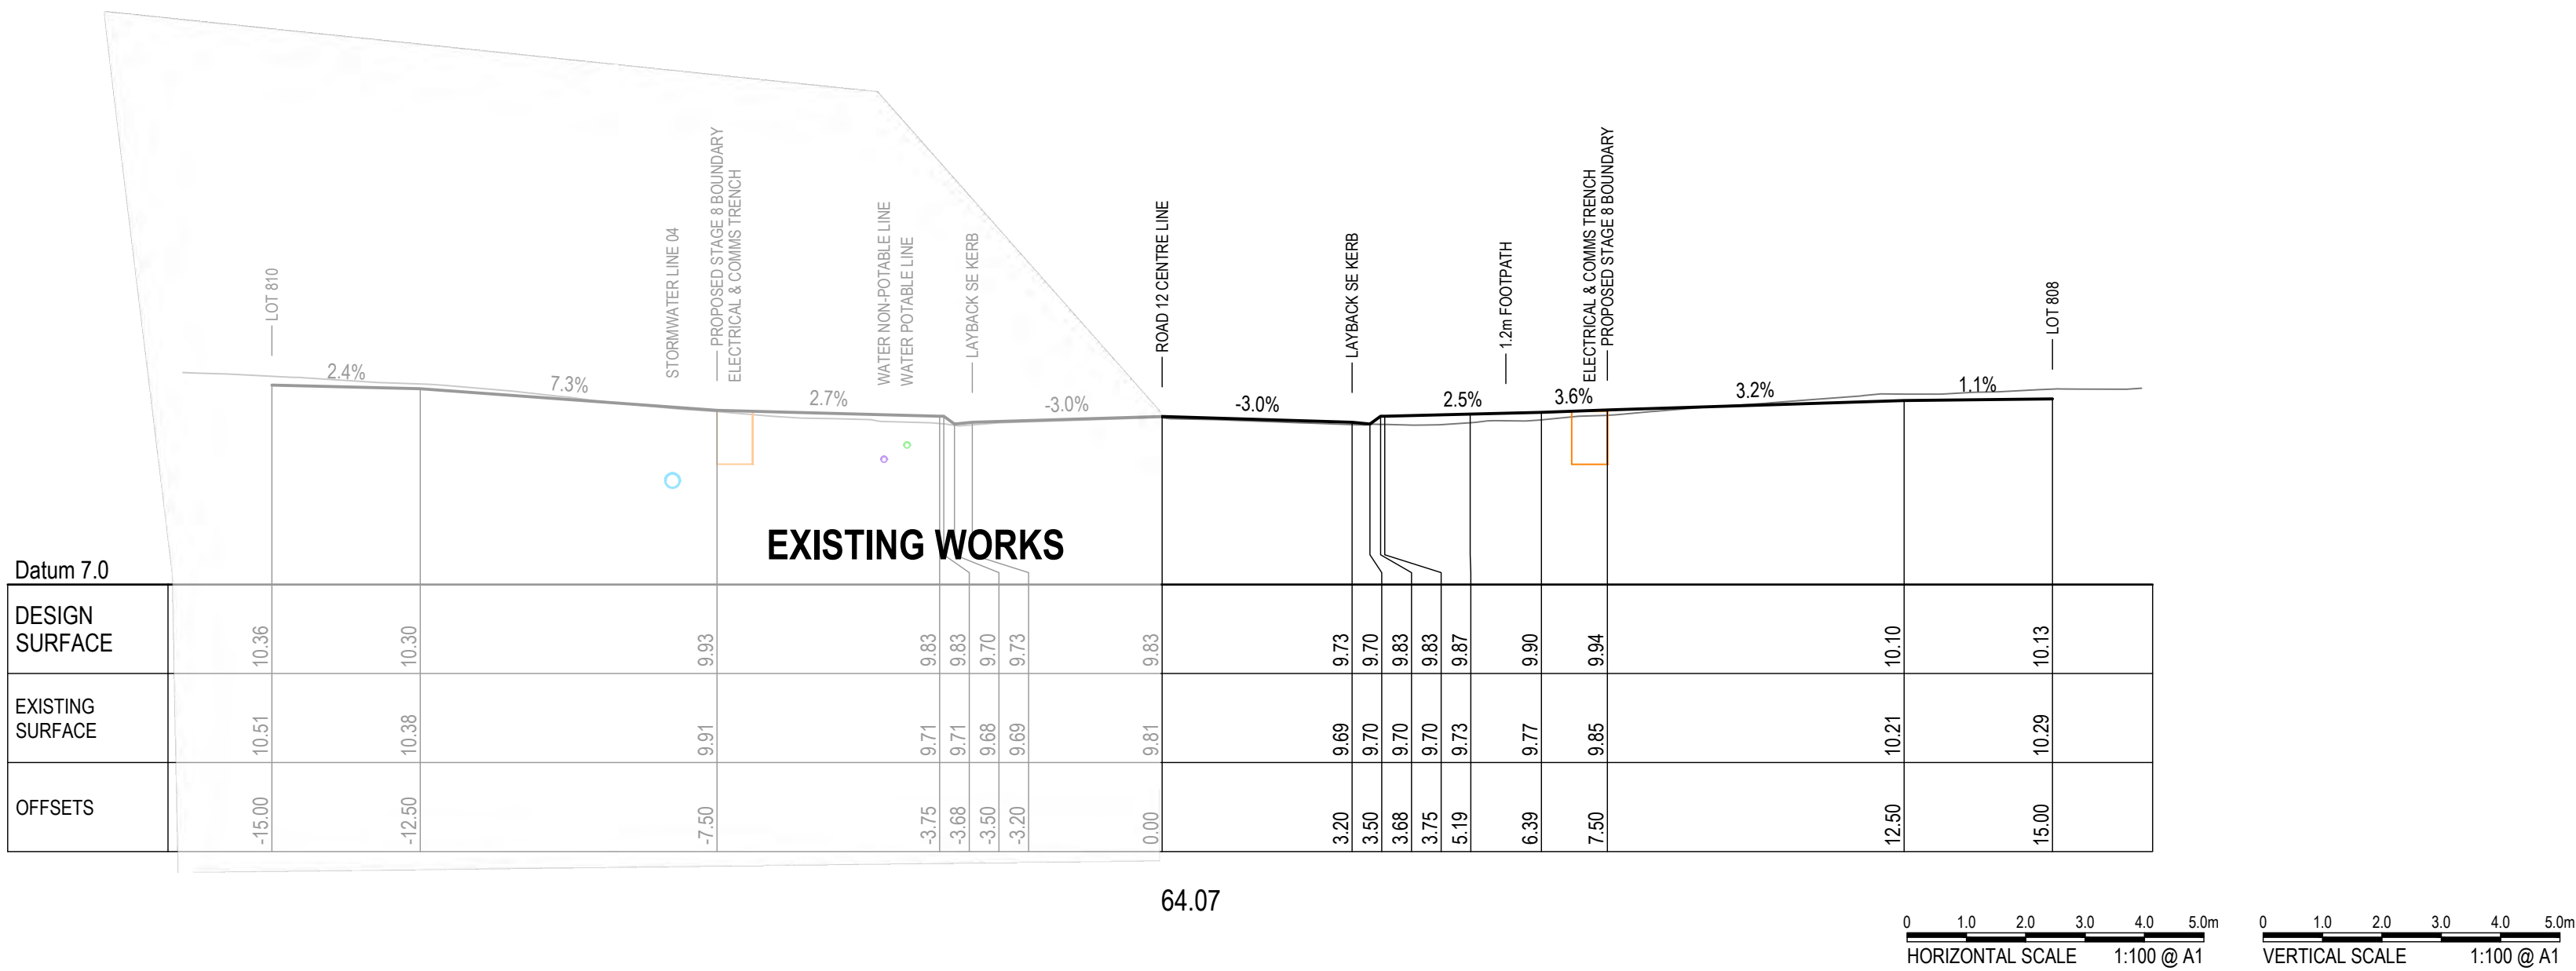

KING + CAMPBELL


King & Campbell Pty Ltd
www.kingcampbell.com.au
A: PO Box 243 Port Macquarie NSW 2444
T: 02 6586 2555
F: 02 6583 4064
E: info@kingcampbell.com.au

REV.	DATE	DESCRIPTION	
A	31.10.2025	ISSUED FOR APPROVAL	JSC

DATUM: AHD SCALE: AS SHOWN @ A1


NOTE: DO NOT SCALE OFF DRAWINGS. USE FIGURED DIMENSIONS ONLY. REPORT ANY DISCREPANCIES TO THE AUTHOR. THIS DRAWING BEING THE PROPERTY OF KING & CAMPBELL PTY LTD, IS PROTECTED BY COPYRIGHT AND MUST NOT BE USED, REPRODUCED OR COPIED WHOLLY, OR IN PART, WITHOUT THE WRITTEN PERMISSION OF KING & CAMPBELL PTY LTD. © King & Campbell Pty Ltd

PROJECT NO:	7197	DRAWING TITLE:	ROAD 12 CROSS SECTIONS CH 64.55
DA NO.:	2014-114	PROJECT:	THE SANCTUARY STAGE 8 LOT 300, DP 1307775 - JOHN OXLEY DRIVE, THURMSTER
DESIGNED BY:	JSC/BC	CLIENT:	BIRD IN THE HAND 2 PTY LTD.
DRAWN BY:	JSC	DRAWING NO:	7197_Stage 8_SWC_Sections
CHECKED BY:	BC	SHEET:	19 OF 36
DATE CREATED:	JULY 2025	REVISION:	A

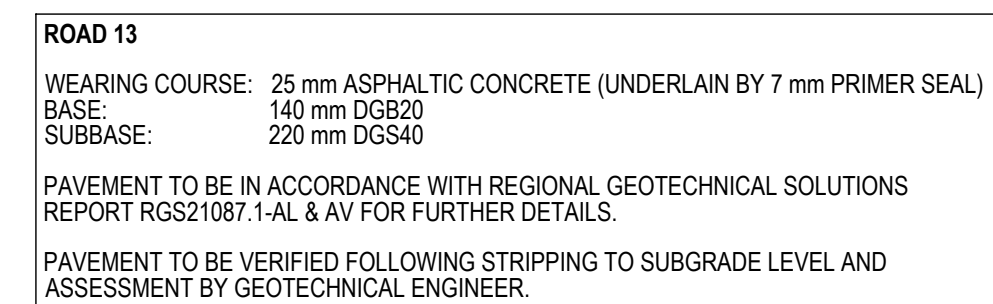

0 0.5 1 1.5 2 2.5m
HORIZONTAL SCALE 1:50 @ A1

0 0.5 1 1.5 2 2.5m
VERTICAL SCALE 1:50 @ A1



A1







M:\C-REF_017197_The Sanctuary\02_Engineering\Stages 8 and 9\2_SWG Sections.dwg - A1(1)-RD_XS 06_24 February 2026_jenae

REV.	DATE	DESCRIPTION	
A	31.10.2025	ISSUED FOR APPROVAL	JSC

DATUM: AHD
SCALE: AS SHOWN @ A1

NOTE: DO NOT SCALE OFF DRAWINGS. USE FIGURED DIMENSIONS ONLY. REPORT ANY DISCREPANCIES TO THE AUTHOR. THIS DRAWING BEING THE PROPERTY OF KING & CAMPBELL PTY LTD, IS PROTECTED BY COPYRIGHT AND MUST NOT BE USED, REPRODUCED OR COPIED WHOLLY, OR IN PART WITHOUT THE WRITTEN PERMISSION OF KING & CAMPBELL PTY LTD.
© King & Campbell Pty Ltd

PROJECT NO:	7197	DRAWING TITLE:	ROAD 13 CROSS SECTIONS CH 13.76 TO 60.00	A1
DA NO.:	2014-114			
DESIGNED BY:	JSC/BC	PROJECT:	THE SANCTUARY STAGE 8 LOT 300, DP 1307775 - JOHN OXLEY DRIVE, THURMSTER	
DRAWN BY:	JSC			
CHECKED BY:	BC	CLIENT:	BIRD IN THE HAND 2 PTY LTD.	
DATE CREATED:	JULY 2025			
		DRAWING NO:	7197_Stage 8_SWC_Sections	
		SHEET:	21 OF 36	
		REVISION:	A	

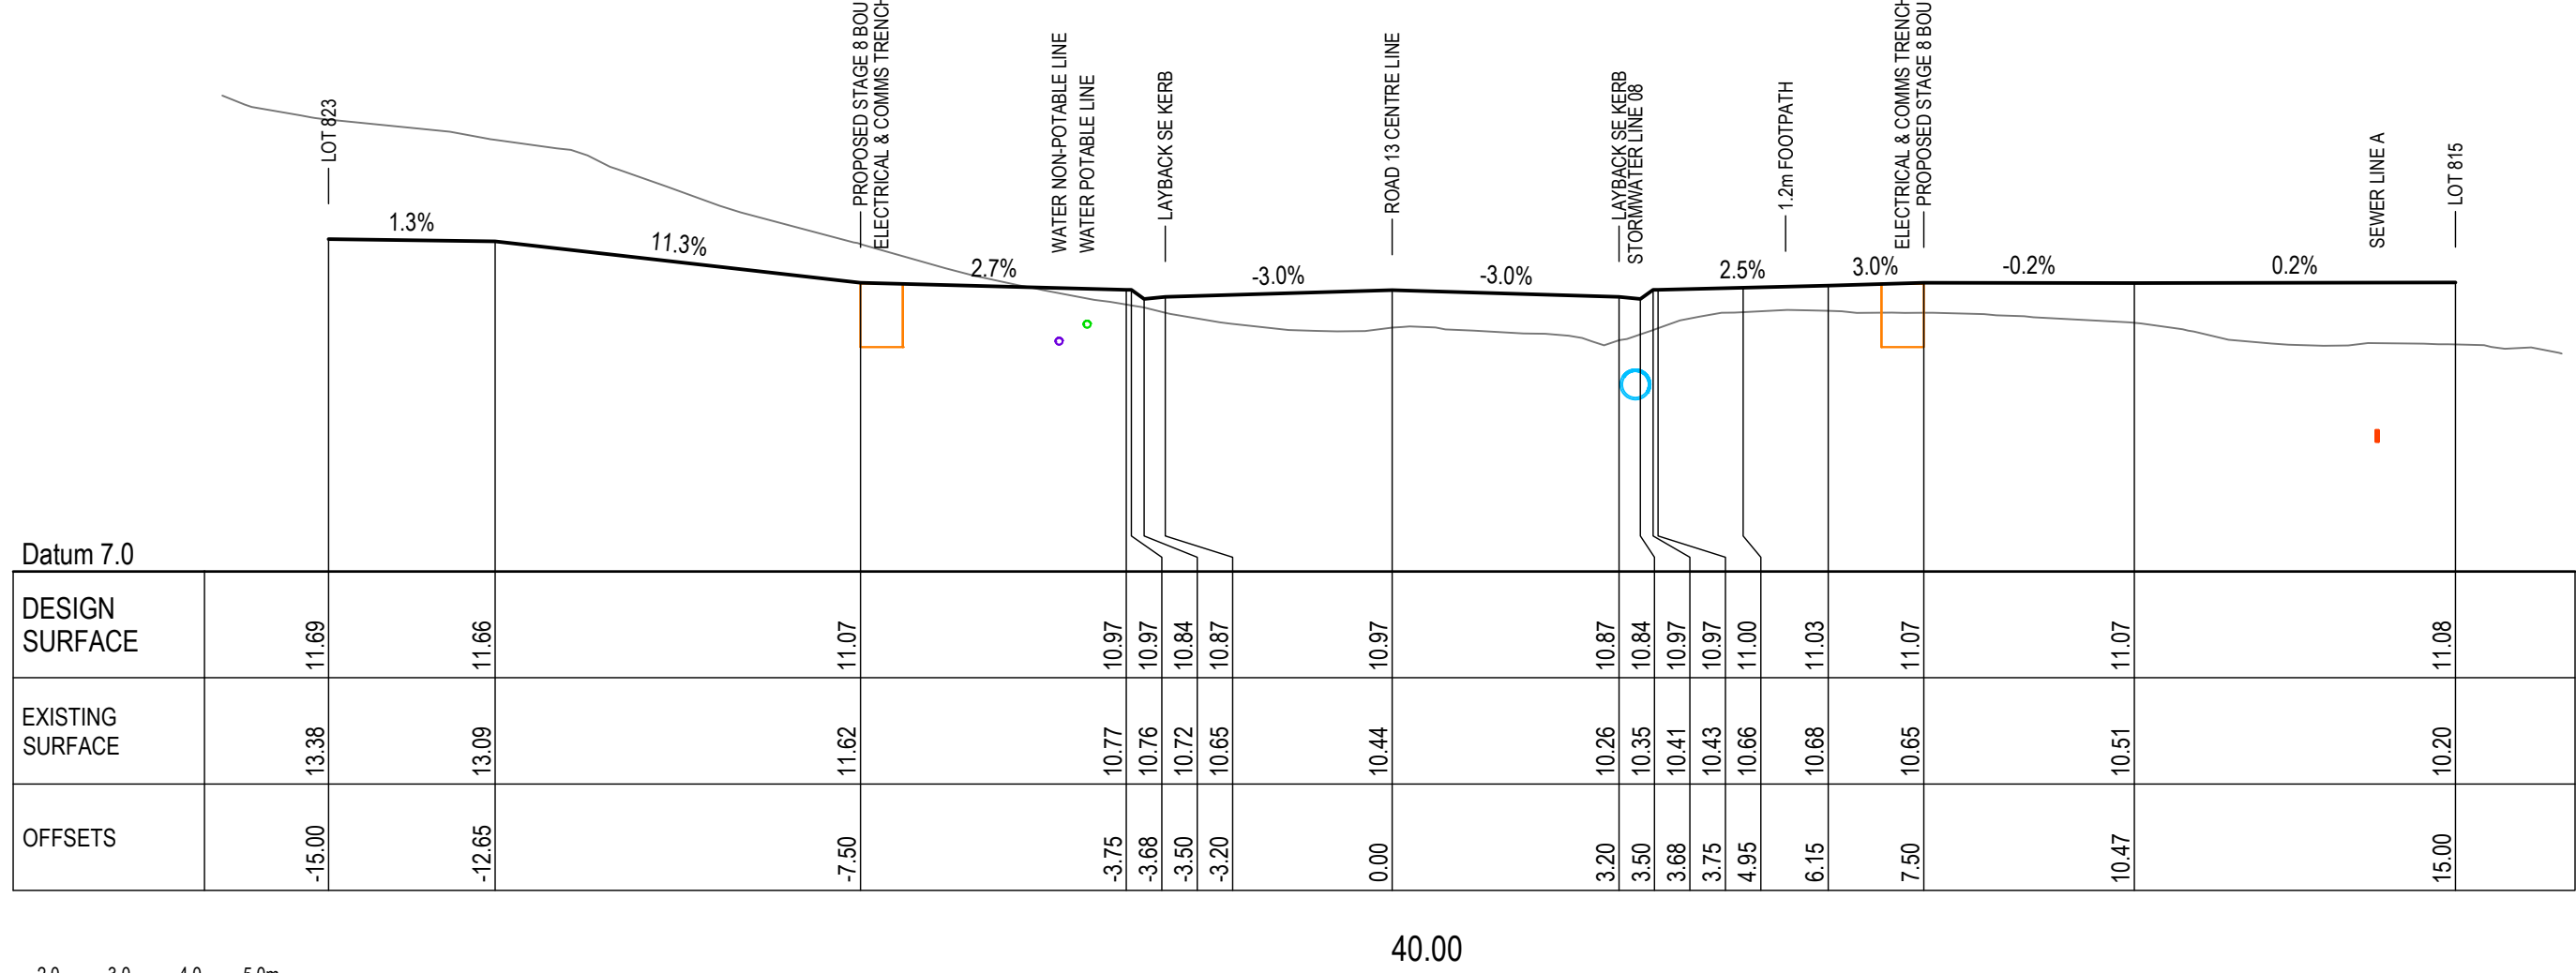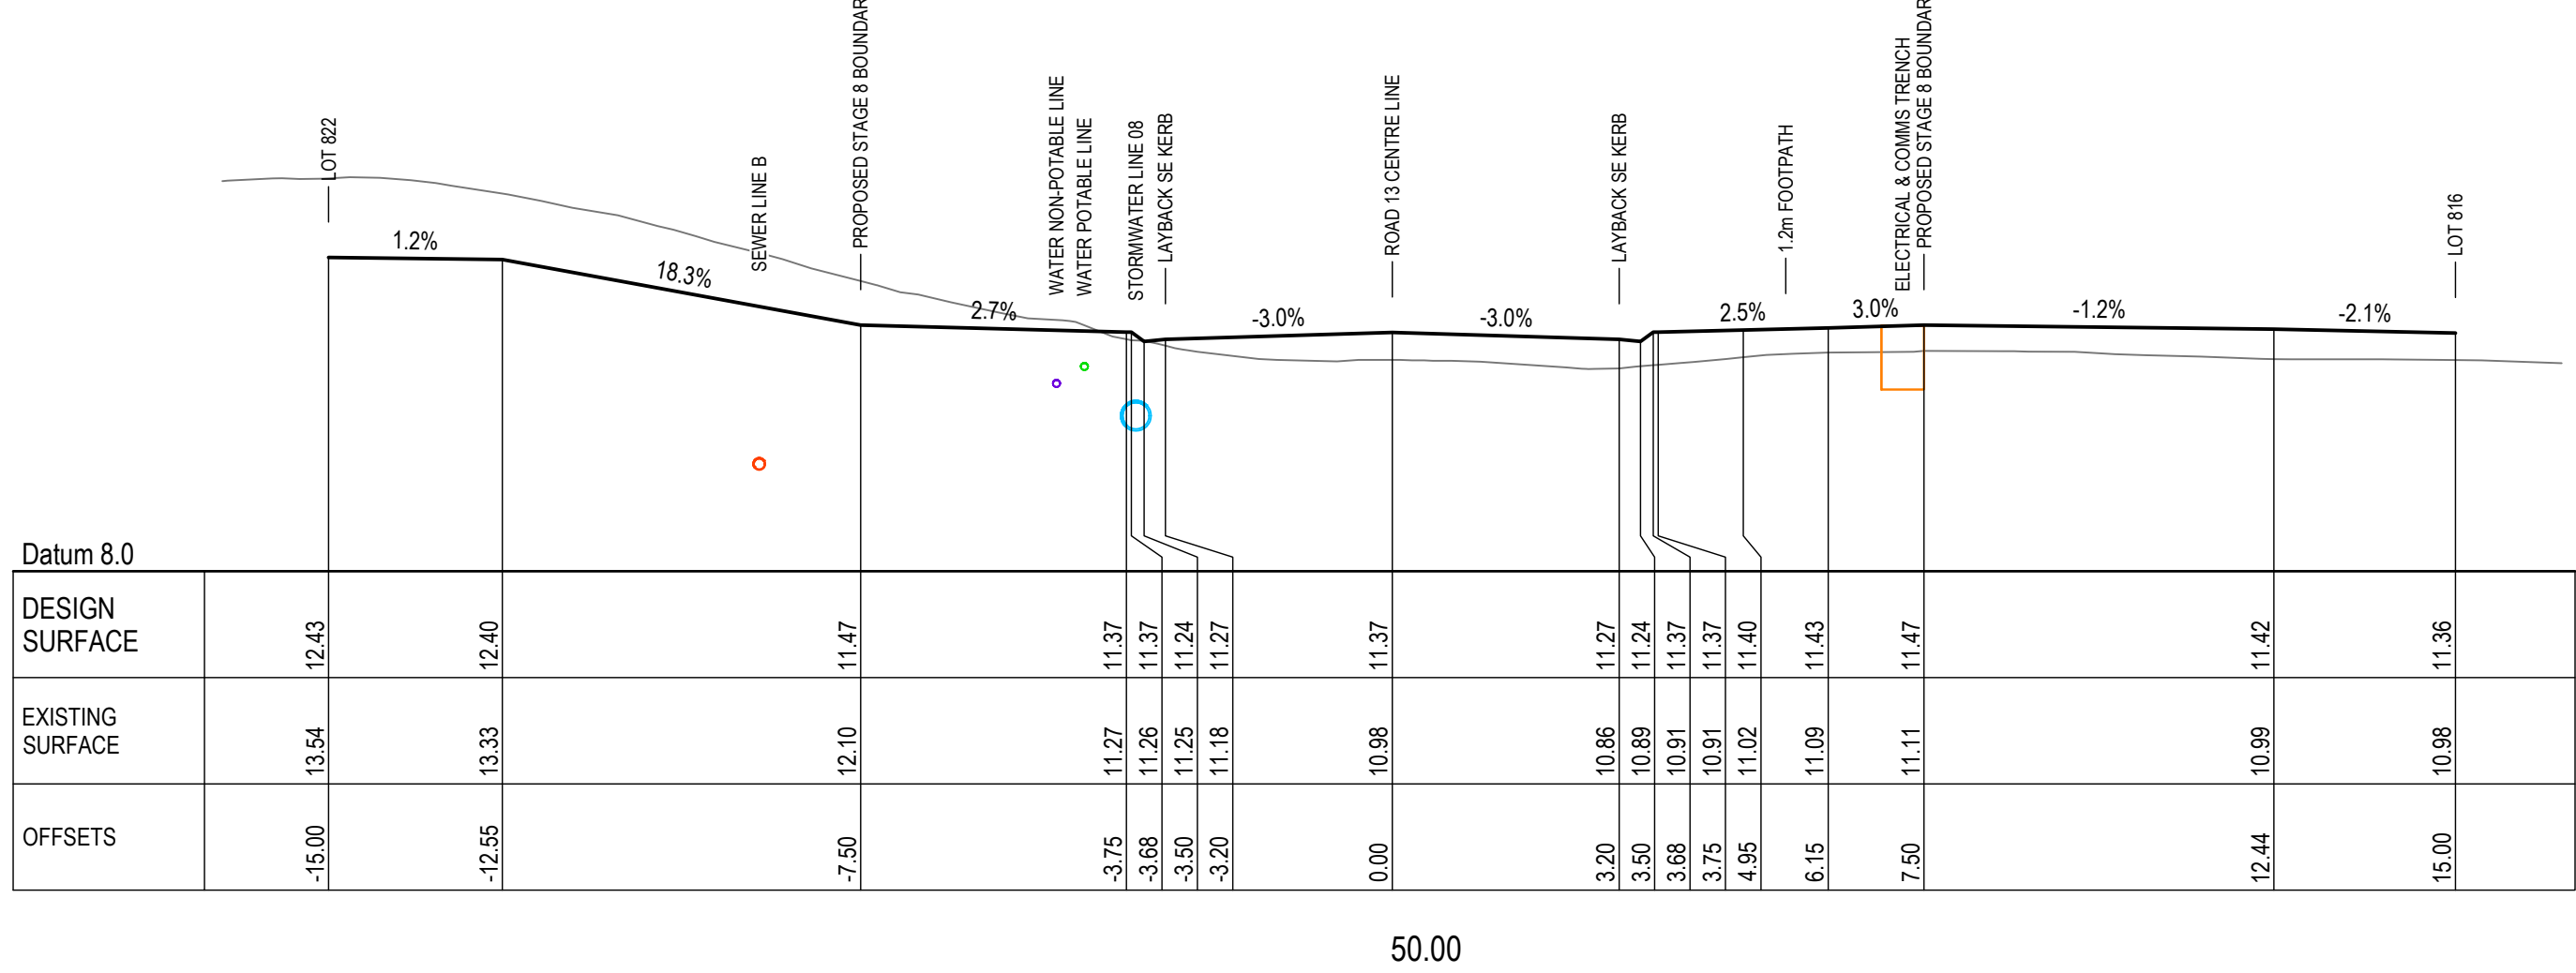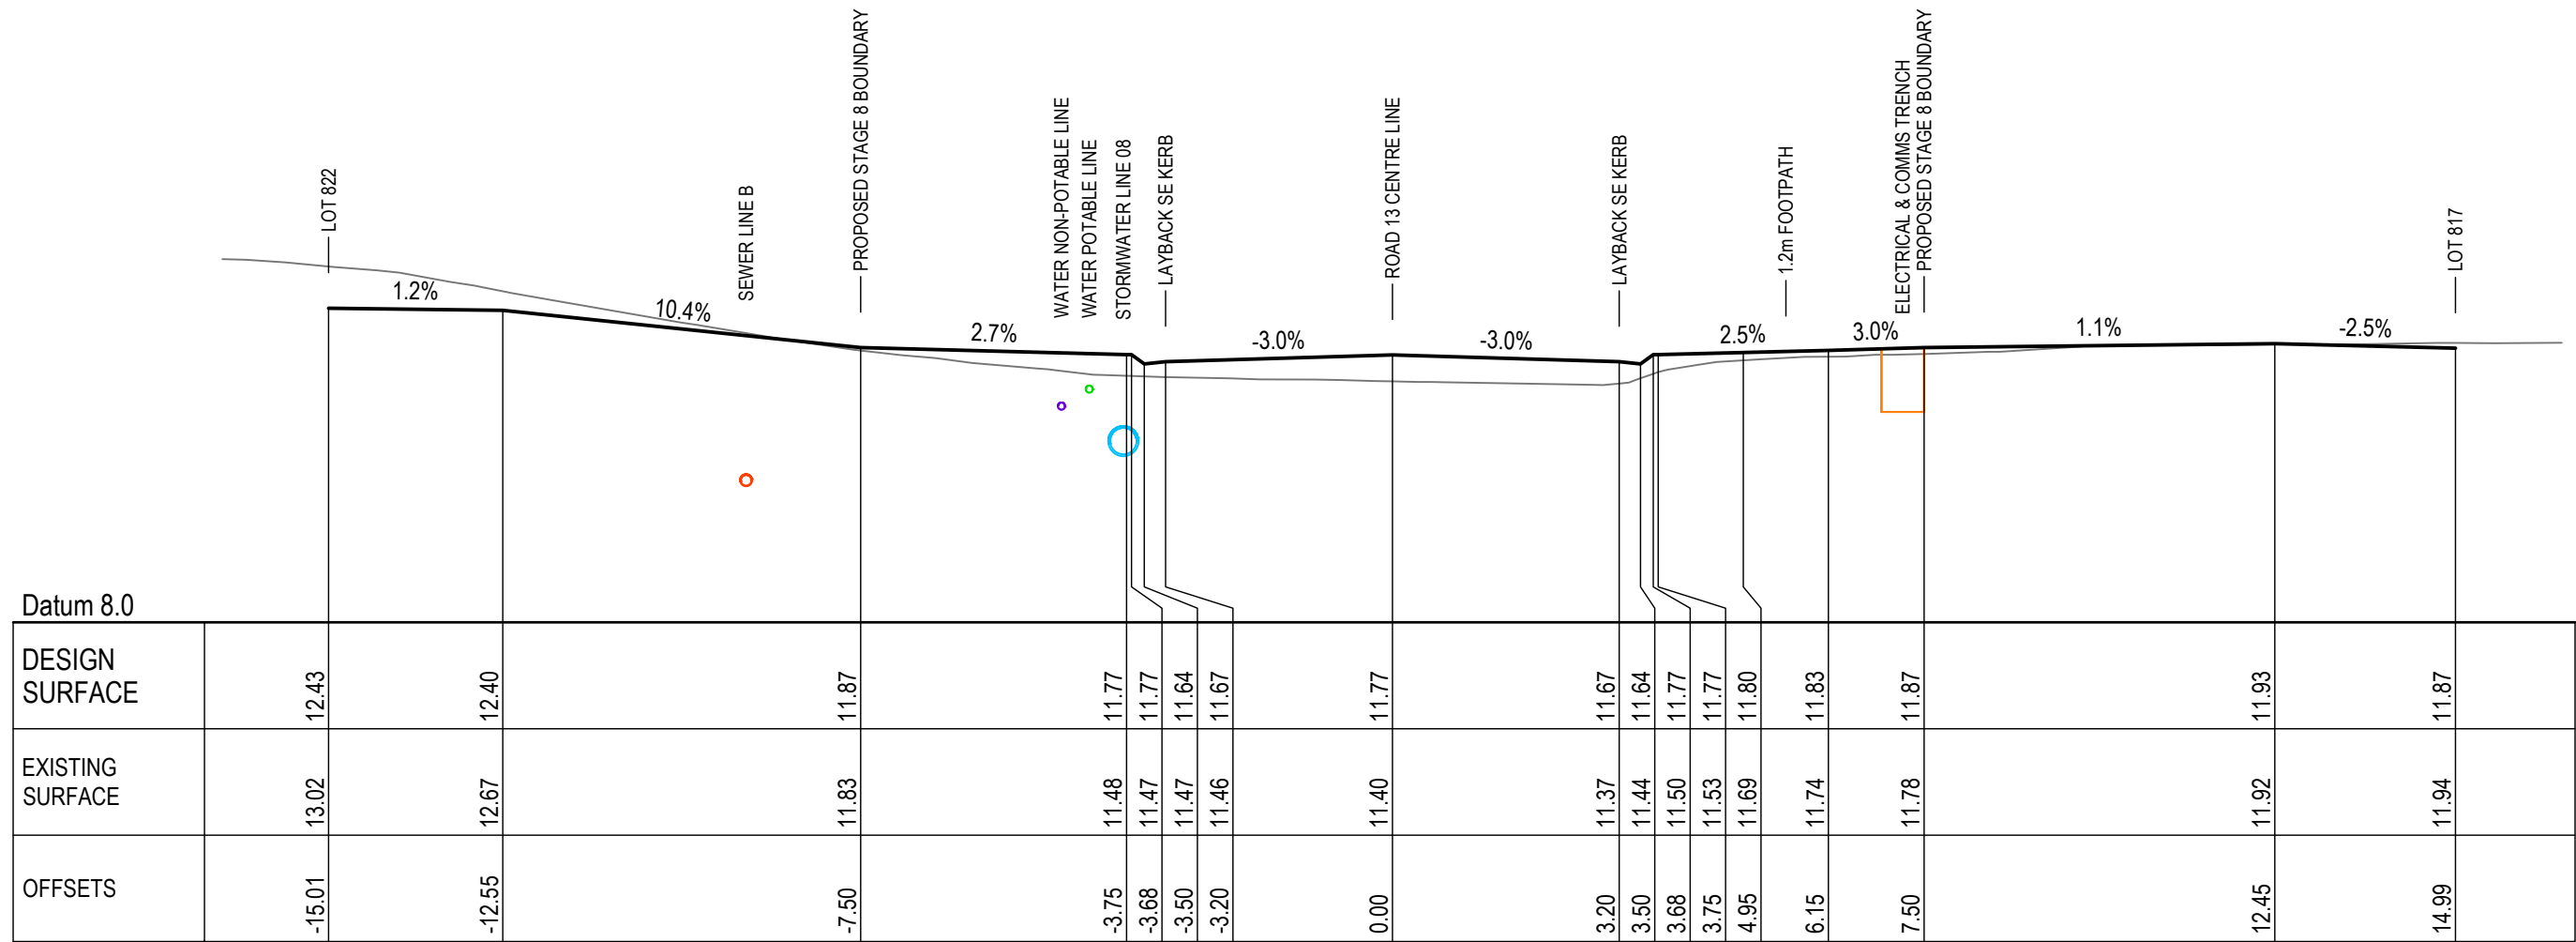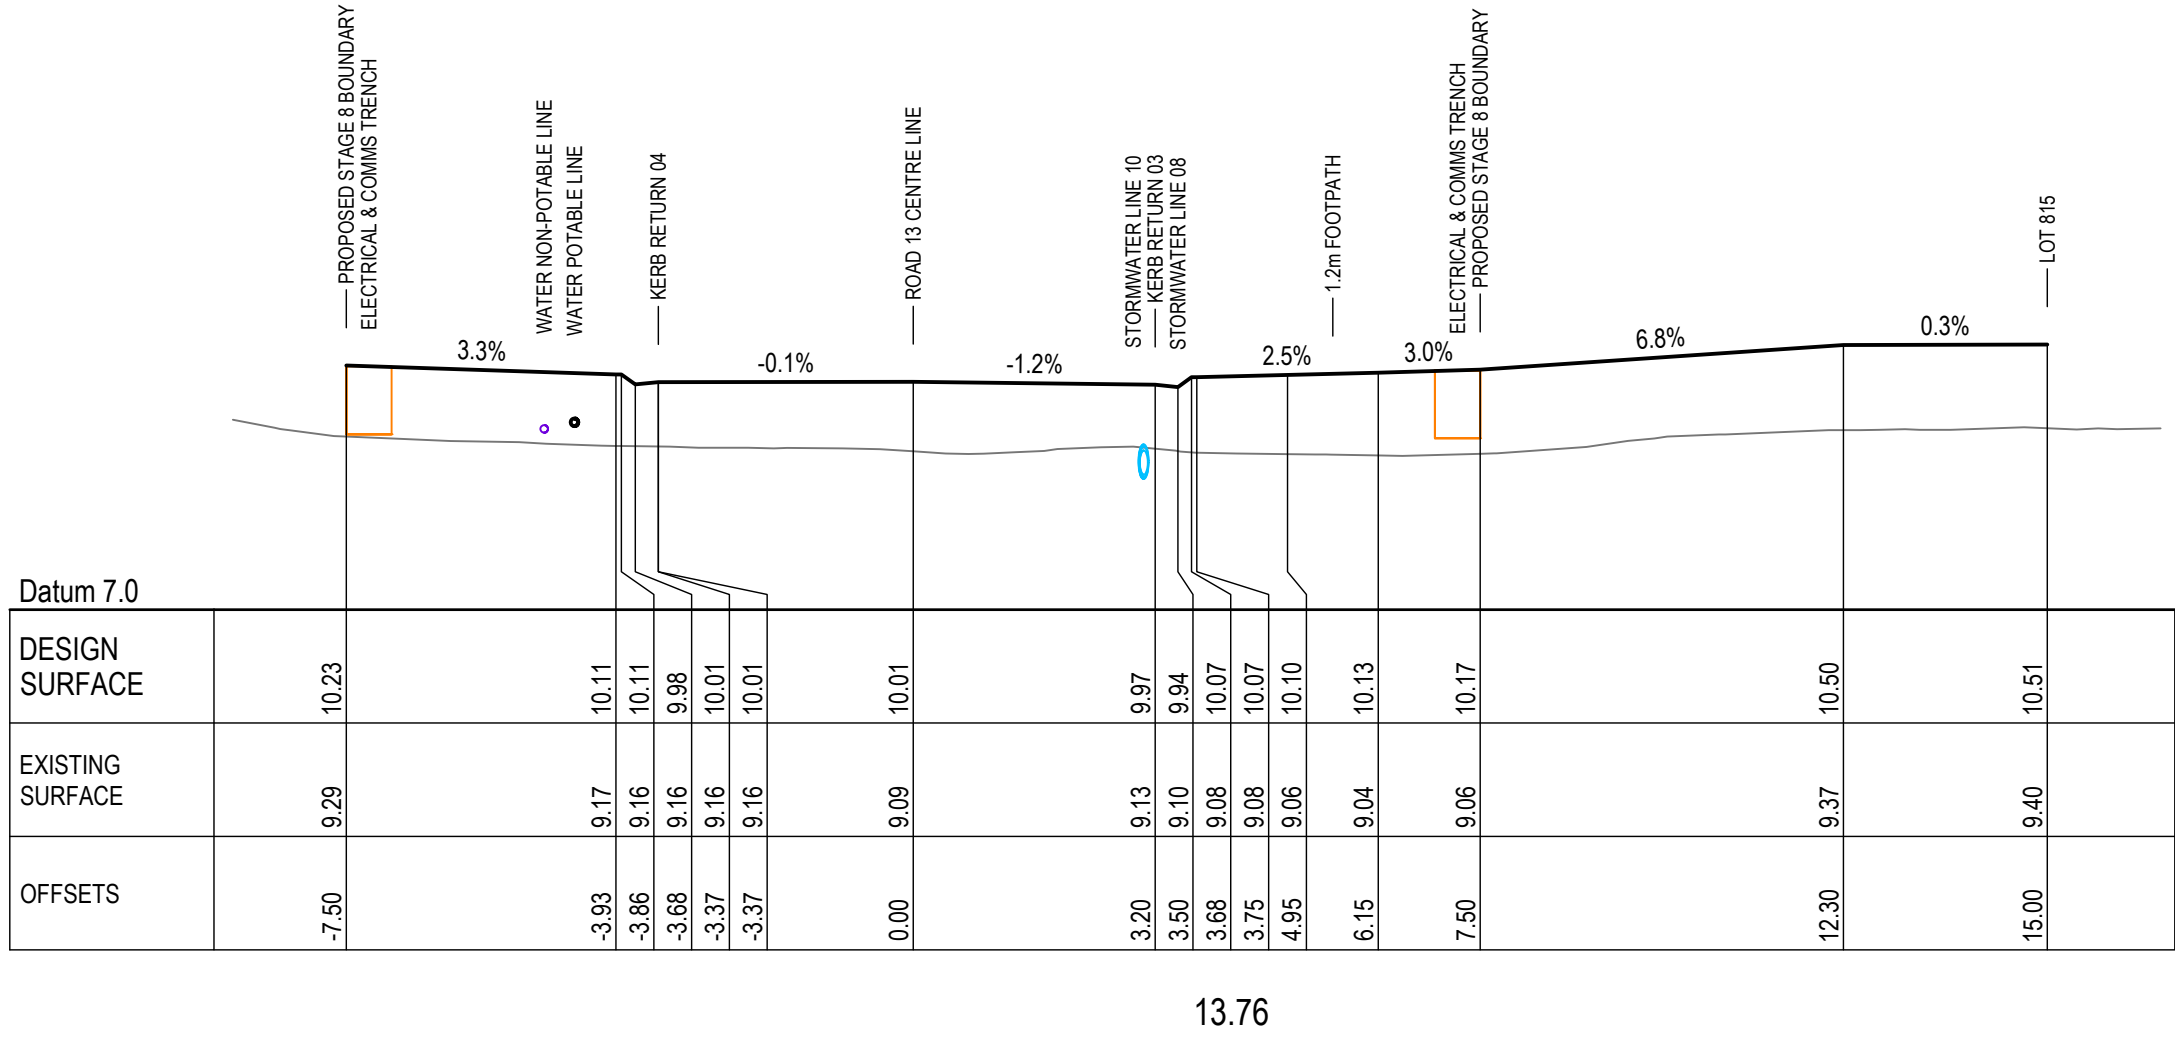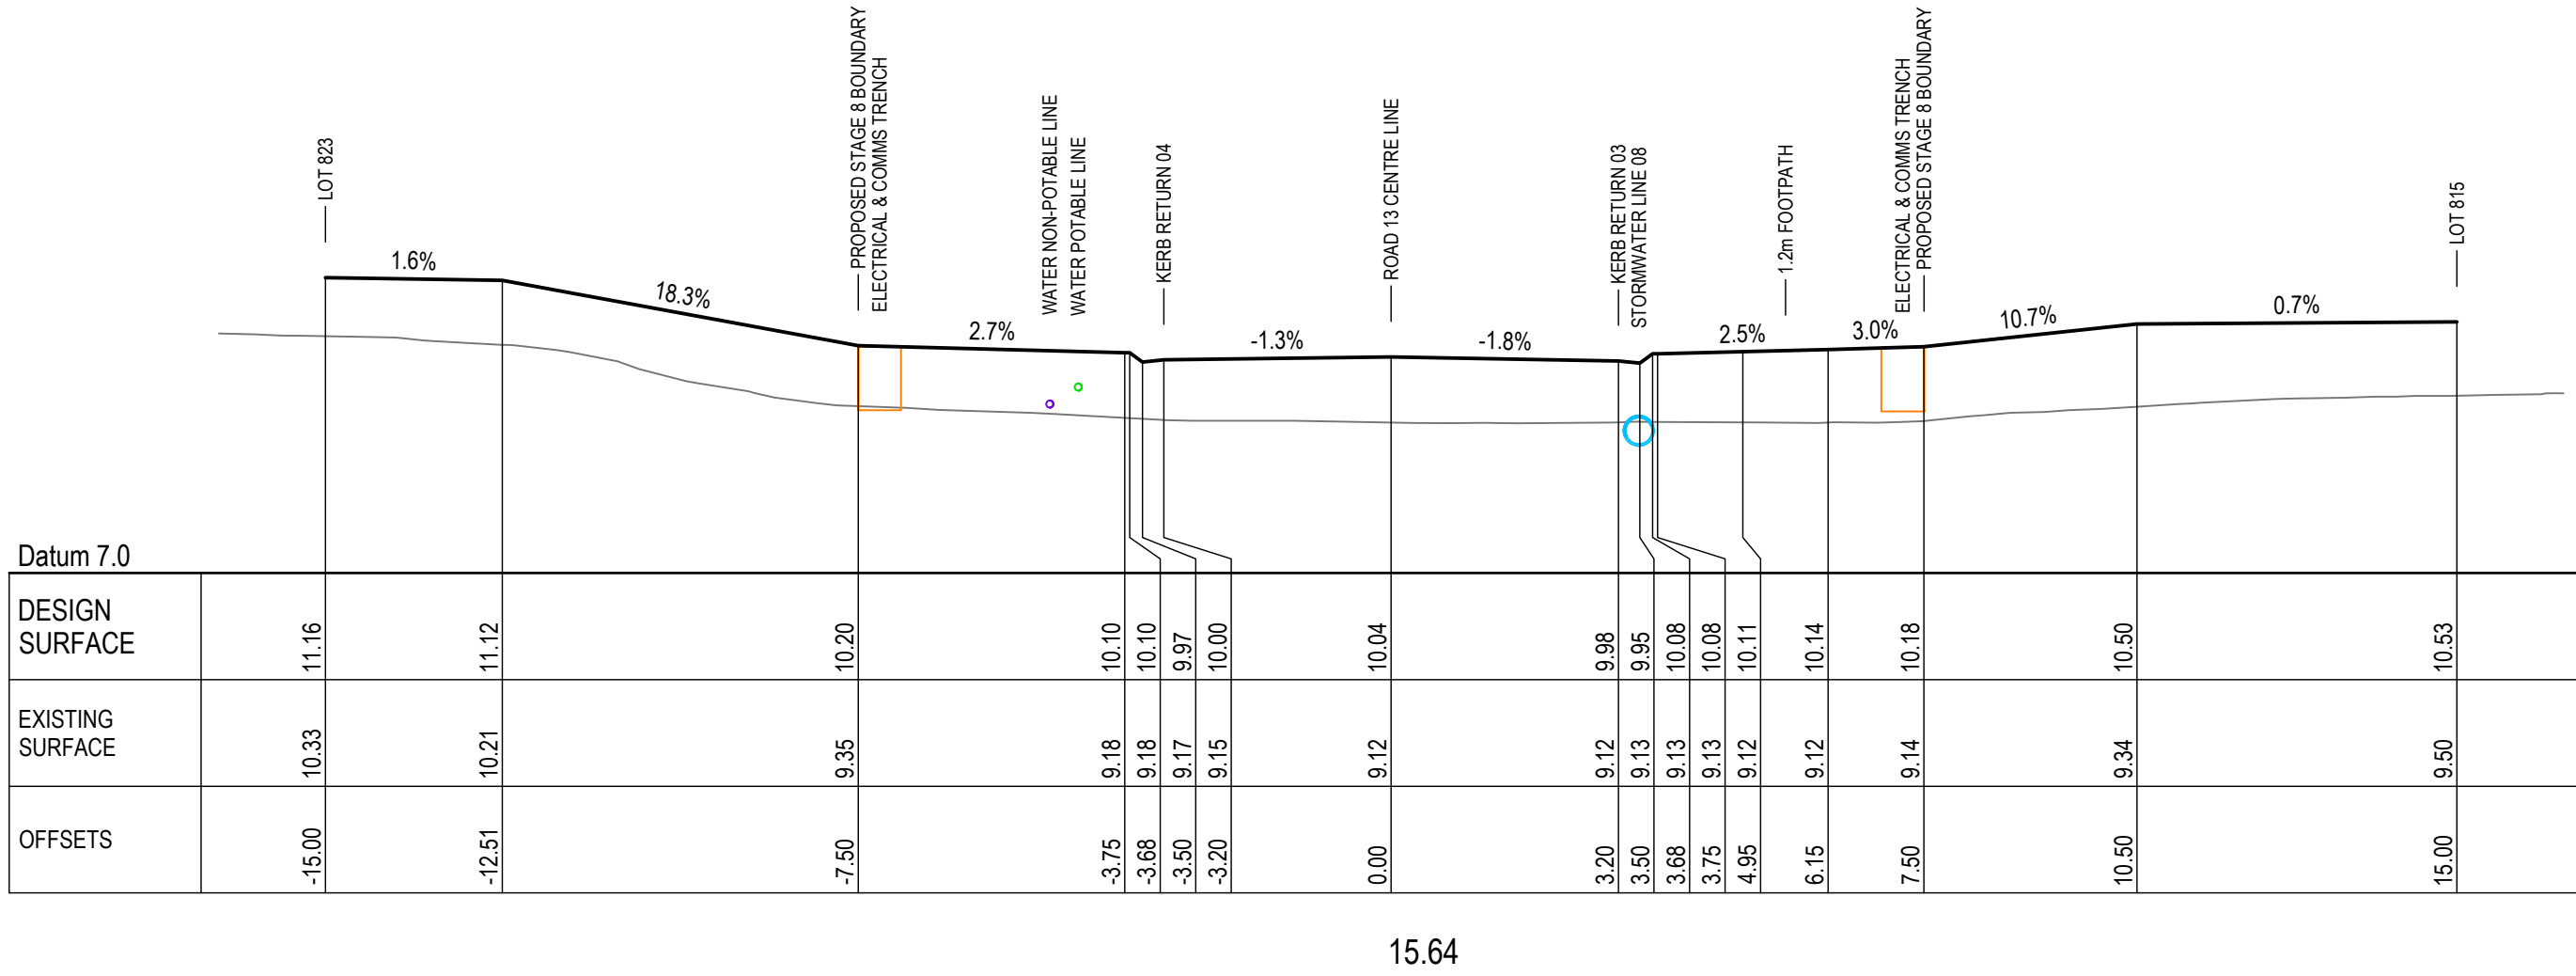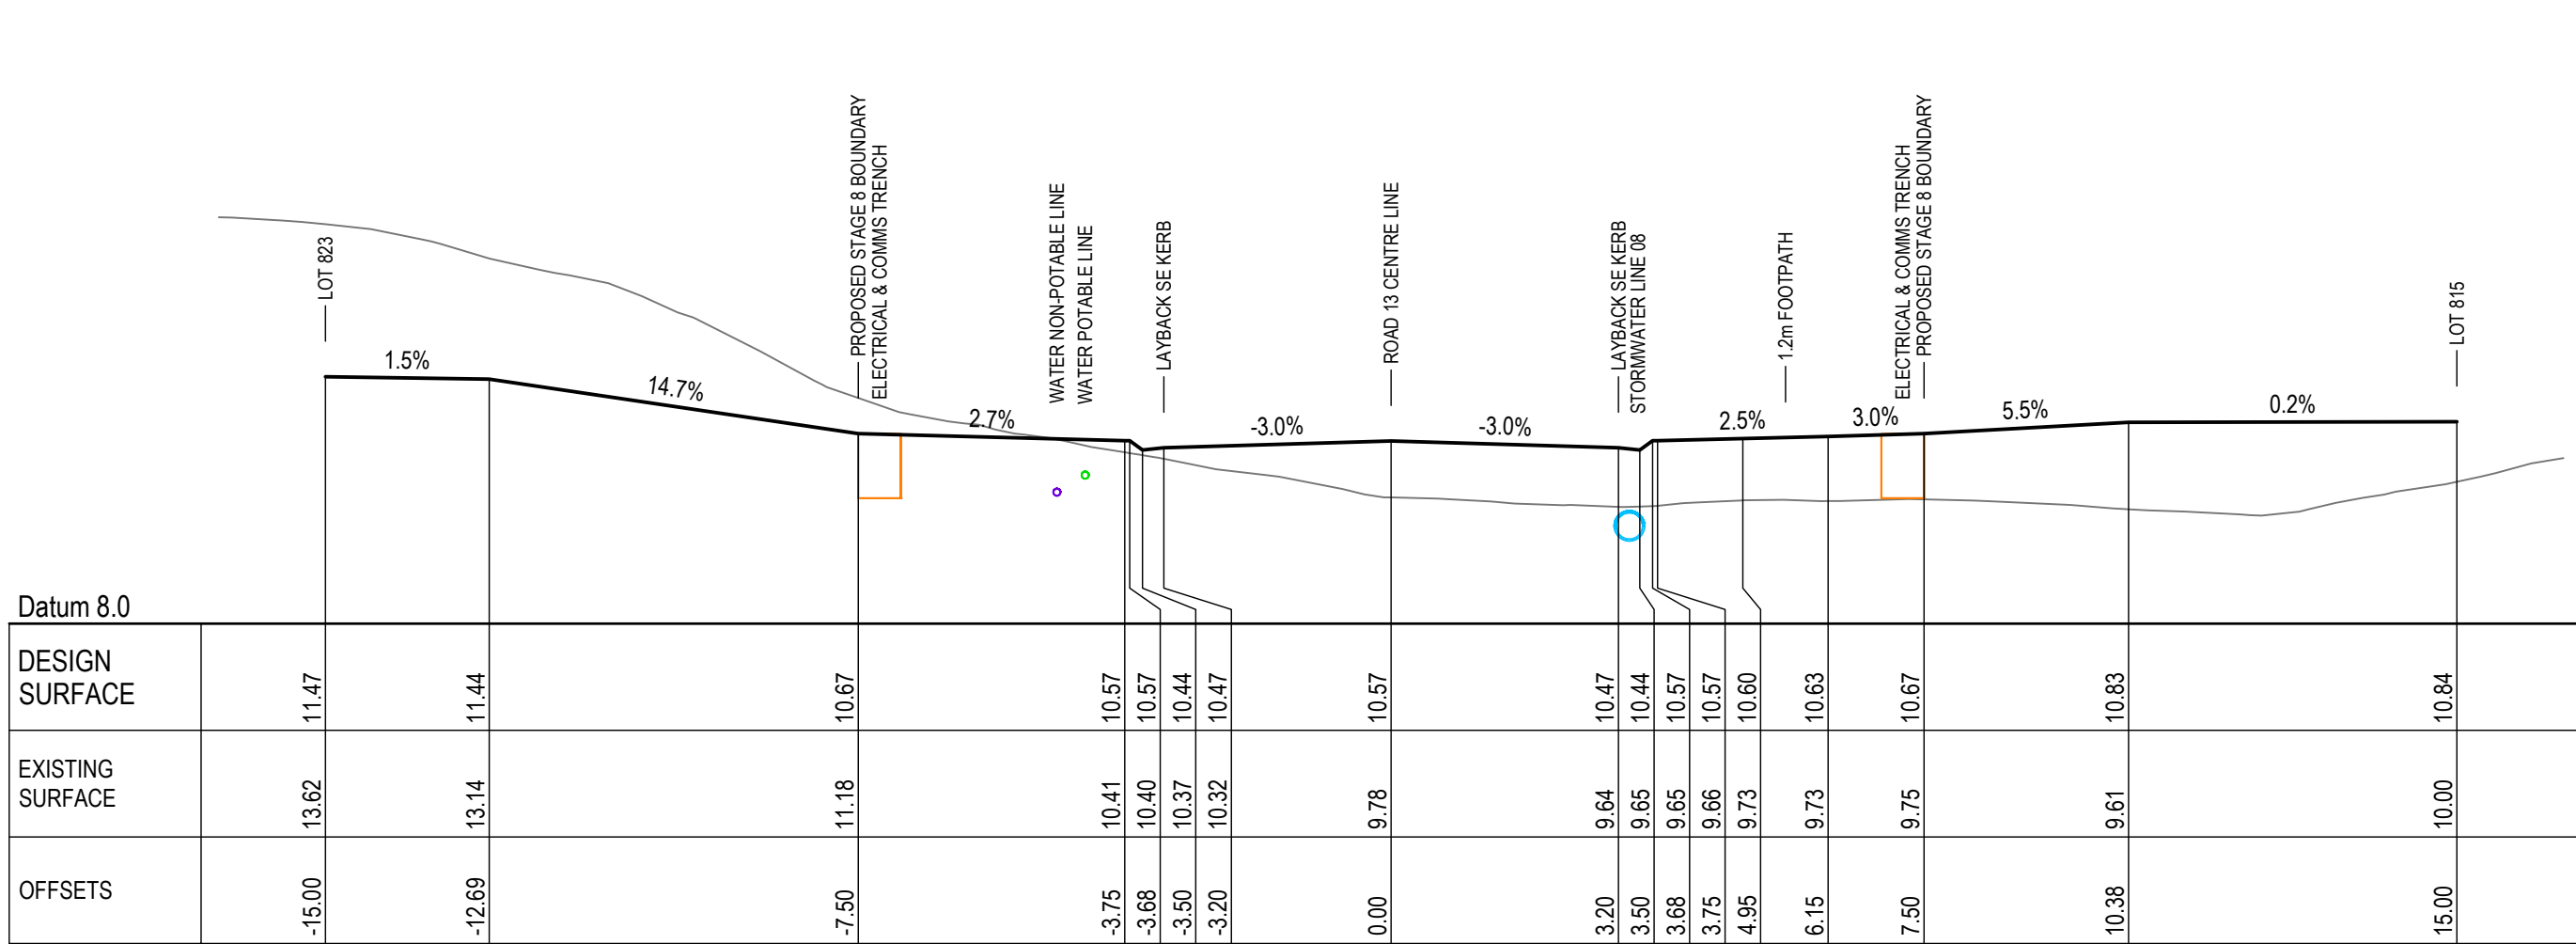

K:\C-REF-017197-The Sanctuary\02_Engineering\Stages 8 and 9\2_SWG\SWG217197_Stage 8_SWC_Sections.dwg - A1(1)-RD_XS 06_24 February 2026_jenae



REV.	DATE	DESCRIPTION	
A	31.10.2025	ISSUED FOR APPROVAL	JSC

DATUM: AHD


SCALE: AS SHOWN @ A1

NOTE: DO NOT SCALE OFF DRAWINGS. USE FIGURED DIMENSIONS ONLY. REPORT ANY DISCREPANCIES TO THE AUTHOR. THIS DRAWING BEING THE PROPERTY OF KING & CAMPBELL PTY LTD, IS PROTECTED BY COPYRIGHT AND MUST NOT BE USED, REPRODUCED OR COPIED WHOLLY, OR IN PART WITHOUT THE WRITTEN PERMISSION OF KING & CAMPBELL PTY LTD.
© King & Campbell Pty Ltd

PROJECT NO:	7197	DRAWING TITLE:	ROAD 13 CROSS SECTIONS CH 70.00 TO 88.61			
DA NO.:	2014-114					
DESIGNED BY:	JSC/BC	PROJECT:	THE SANCTUARY STAGE 8 LOT 300, DP 1307775 - JOHN OXLEY DRIVE, THURMSTER			
DRAWN BY:	JSC					
CHECKED BY:	BC	CLIENT:	BIRD IN THE HAND 2 PTY LTD.			
DATE CREATED:	JULY 2025					
		DRAWING NO:	7197_Stage 8_SWC_Sections	SHEET:	22 OF 36	REVISION:
						A

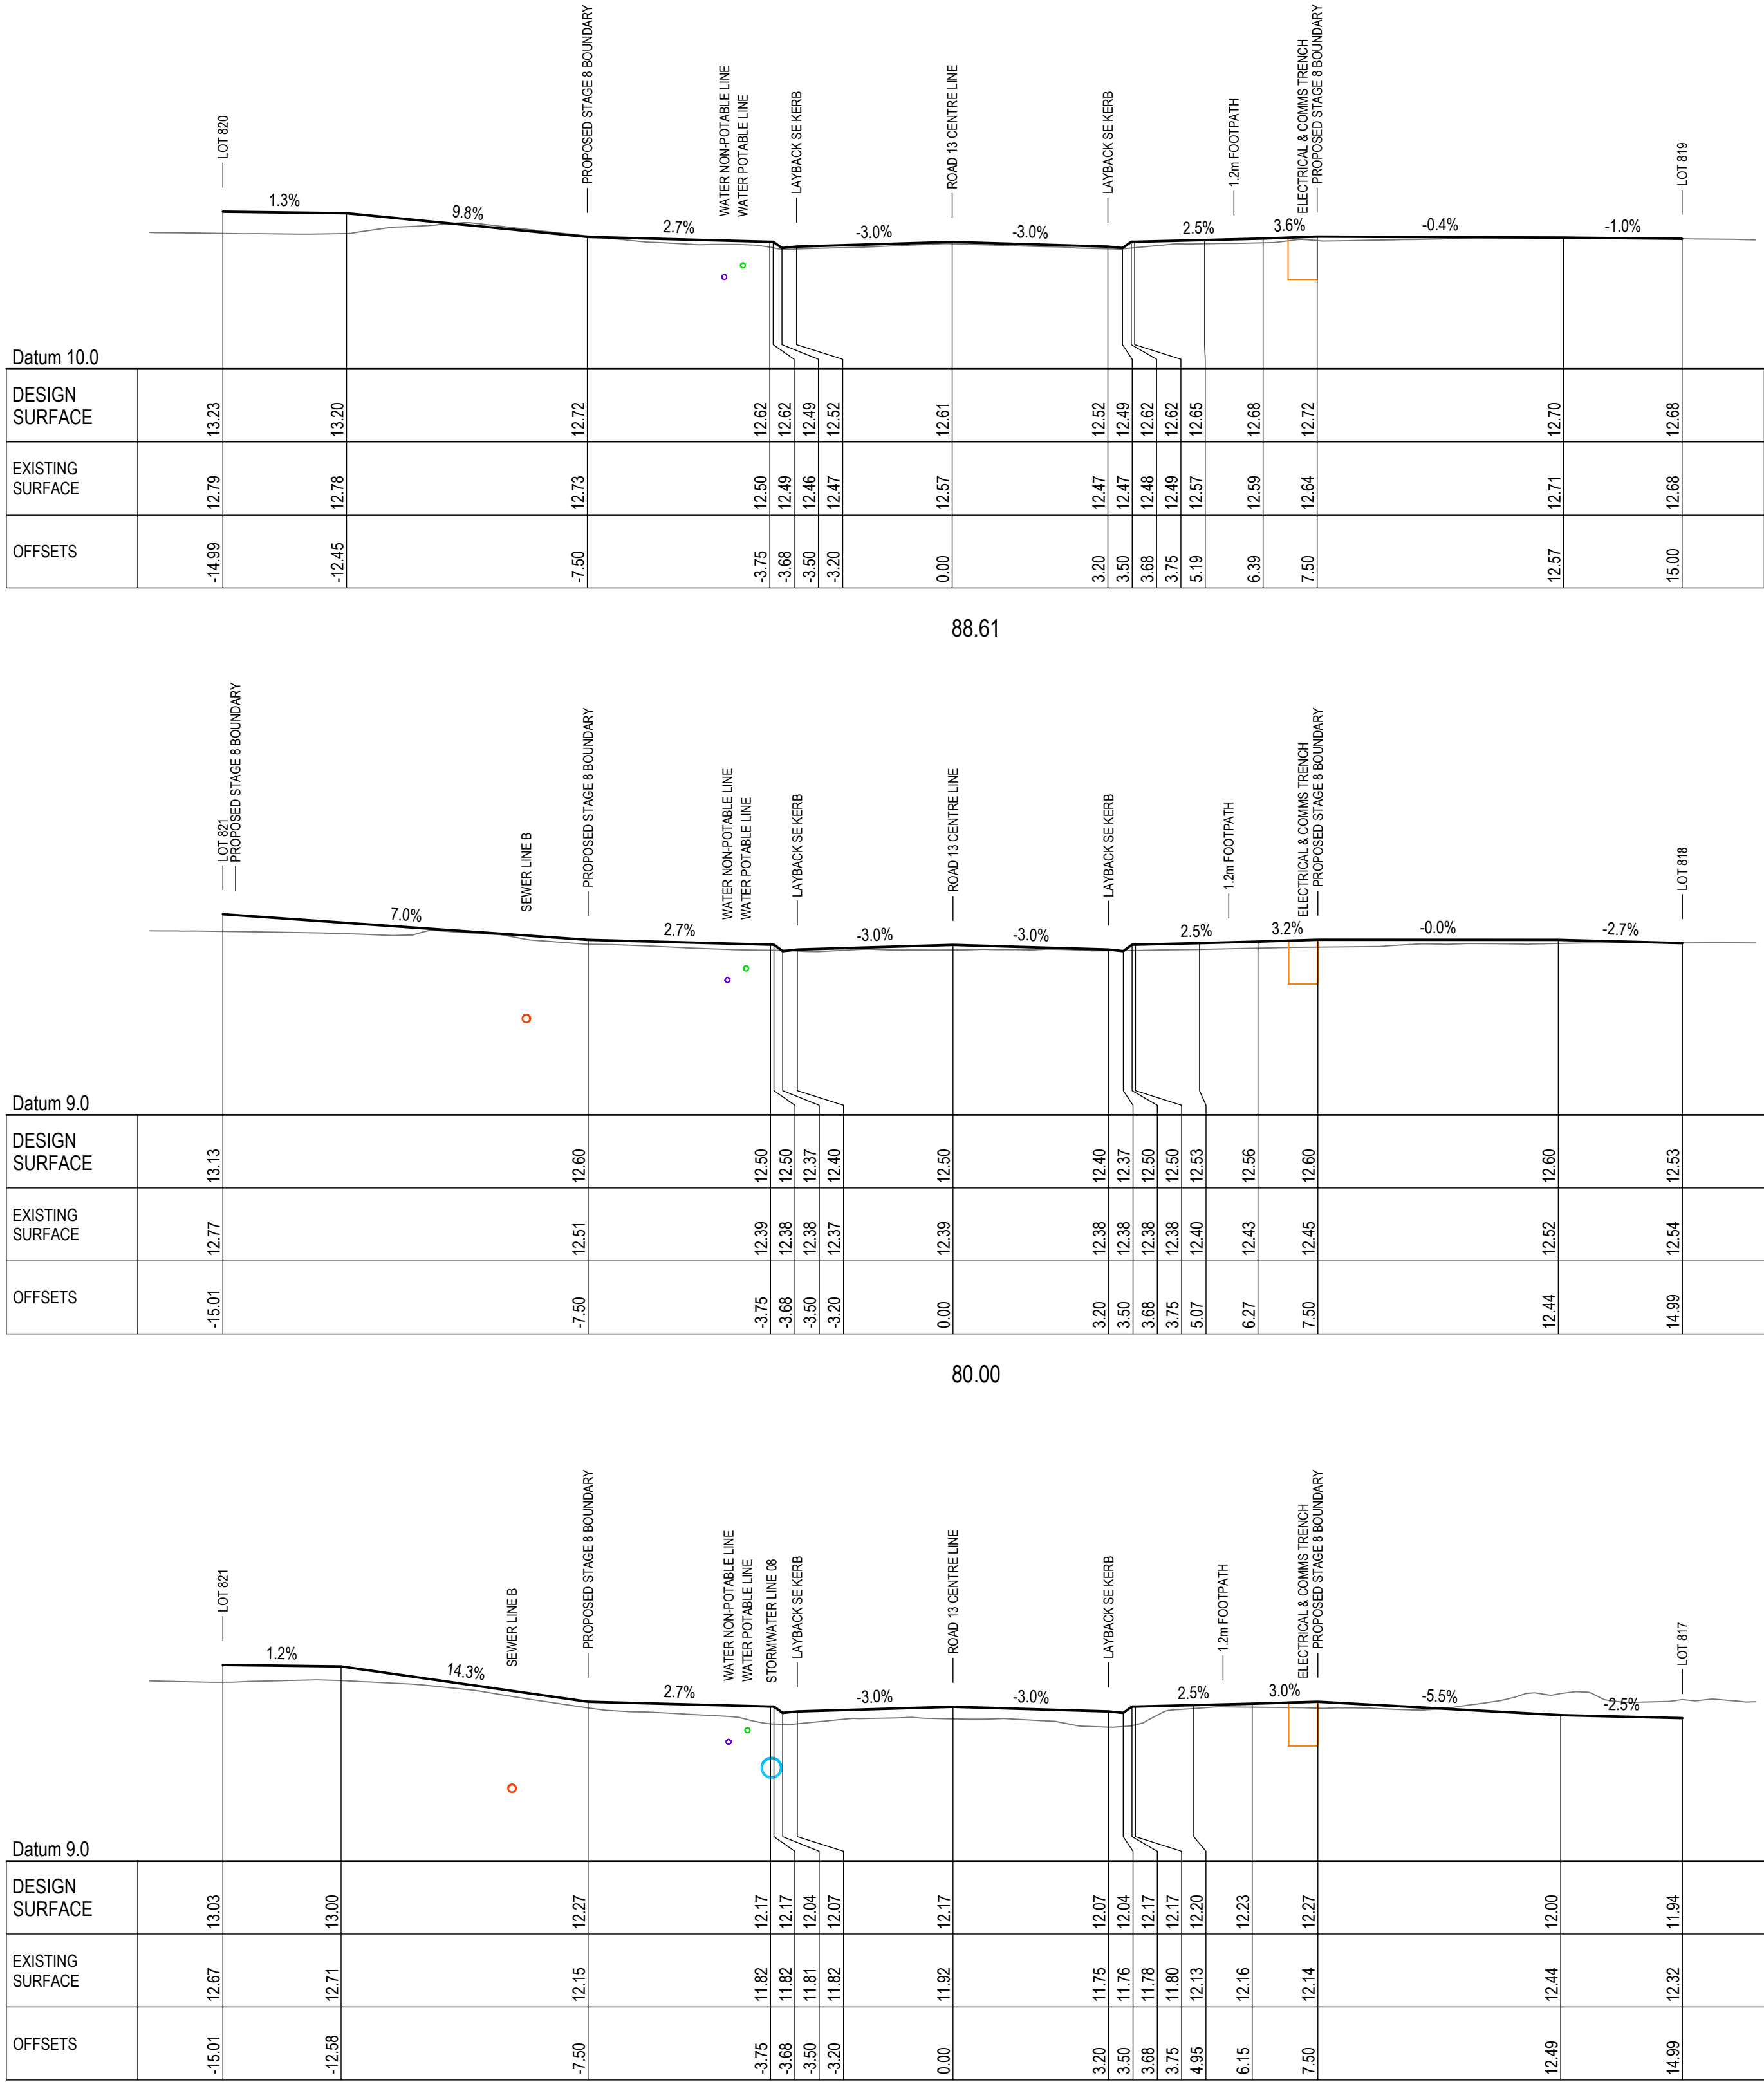


M:\C-REF-01797_The Sanctuary\02_Engineering\Stages 8 and 9\2-STG 8 SWC\2107_Stage 8_SWC_Plan.dwg A1(K) KR1, 24 February 2026, jmmec

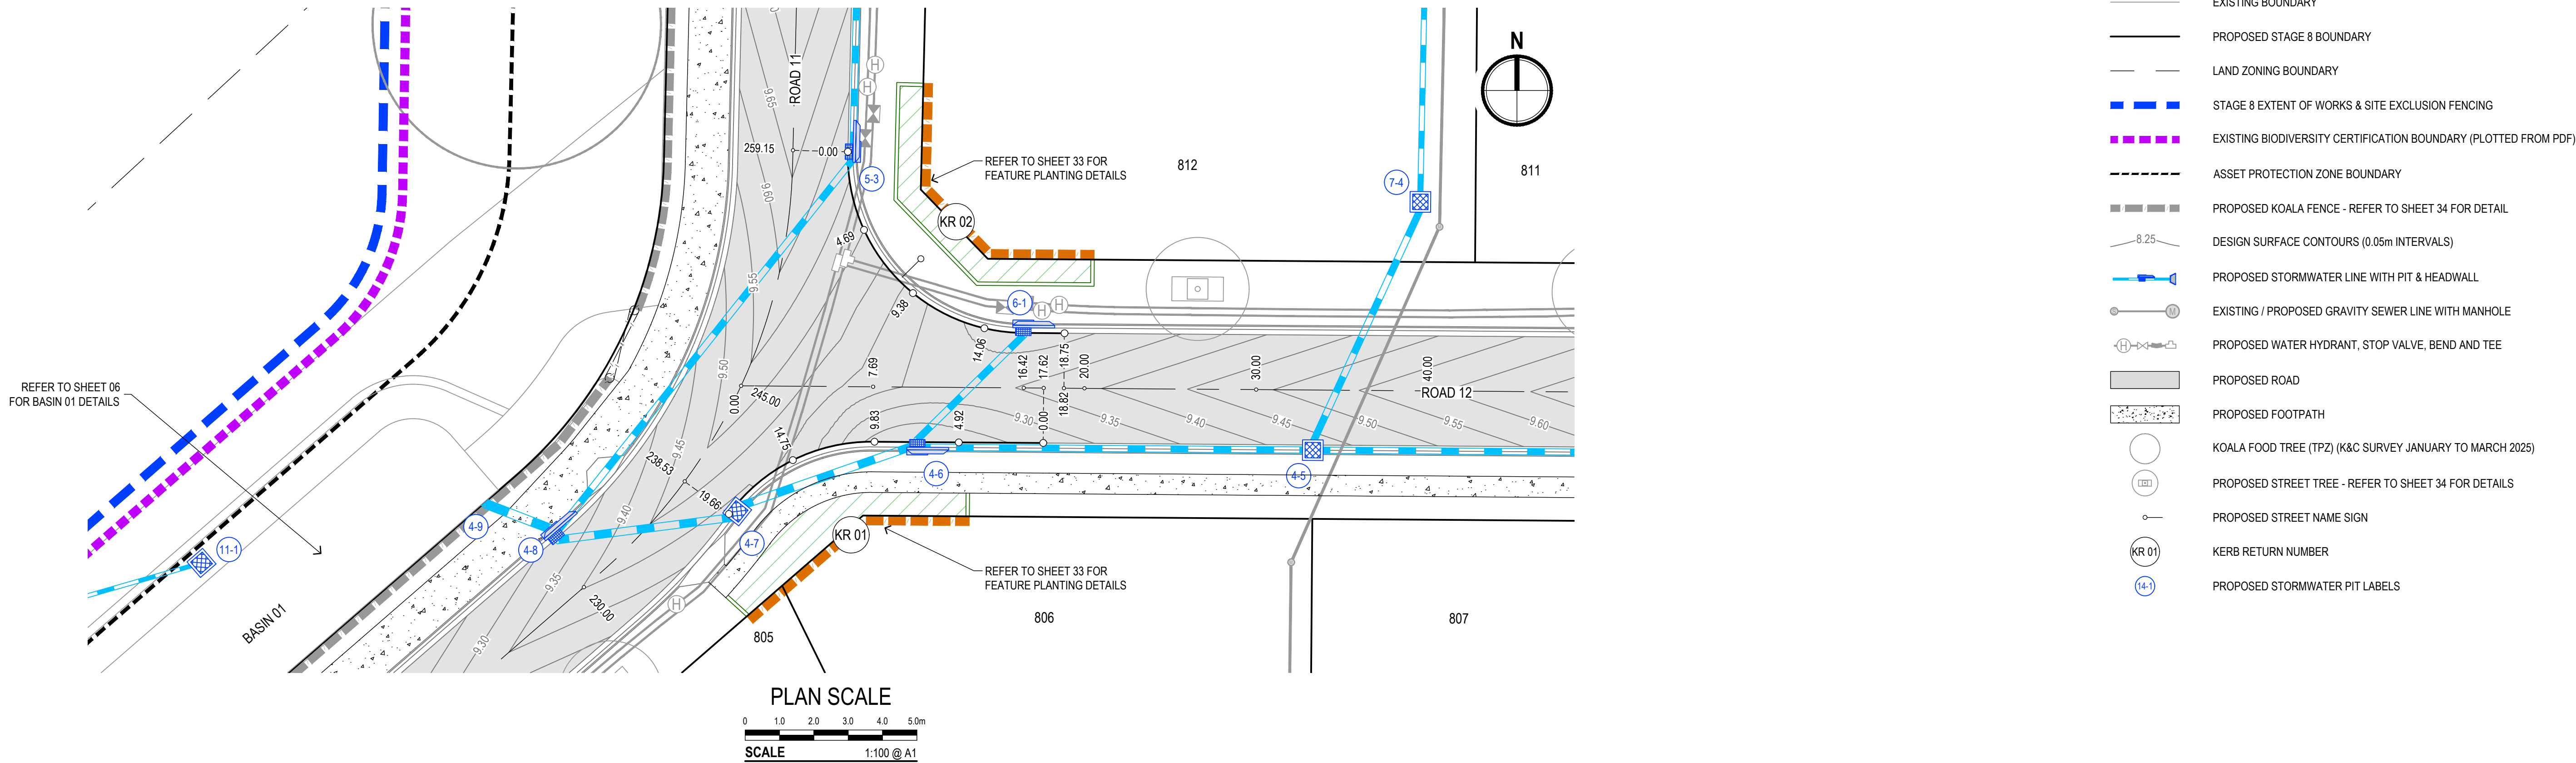


K:\C-REF-017197_The Sanctuary\02_Engineering\Stages 8 and 9\2-STG 8 SWC\2107_Stage 8_SWC_Plan.dwg A1(K) KR2 24 February 2026 jameec

REFER TO SHEET 07
FOR BASIN 02 DETAILS

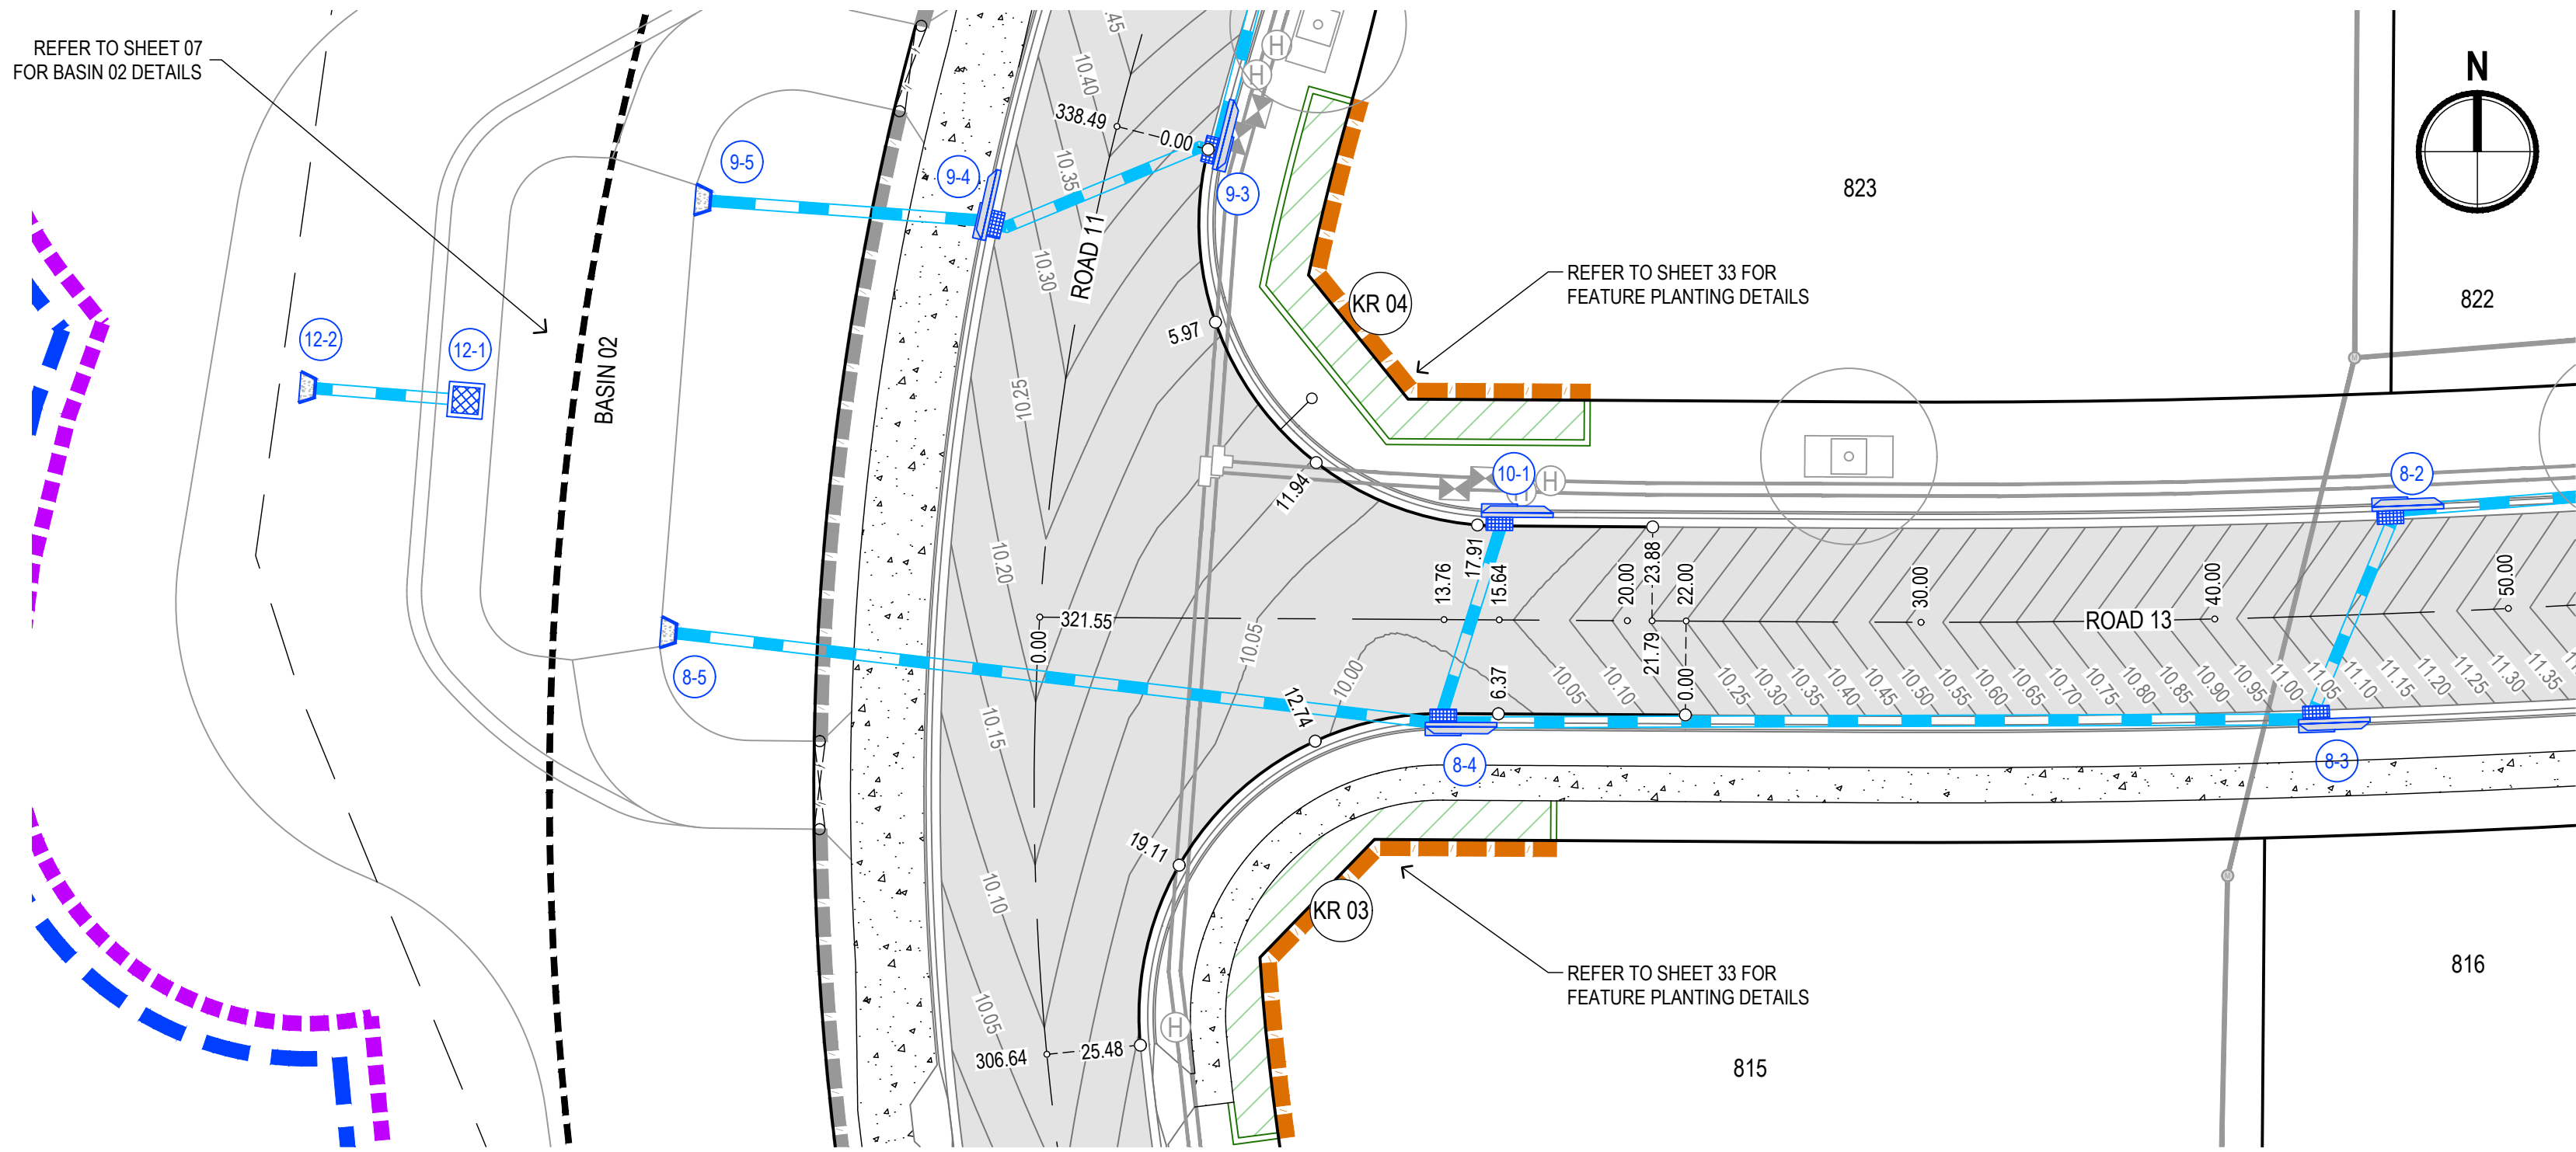


PLAN SCALE





LEGEND

- EXISTING BOUNDARY
- PROPOSED STAGE 8 BOUNDARY
- LAND ZONING BOUNDARY
- STAGE 8 EXTENT OF WORKS & SITE EXCLUSION FENCING
- EXISTING BIODIVERSITY CERTIFICATION BOUNDARY (PLOTTED FROM PDF)
- ASSET PROTECTION ZONE BOUNDARY
- PROPOSED KOALA FENCE - REFER TO SHEET 34 FOR DETAIL
- DESIGN SURFACE CONTOURS (0.05m INTERVALS)
- PROPOSED STORMWATER LINE WITH PIT & HEADWALL
- EXISTING / PROPOSED GRAVITY SEWER LINE WITH MANHOLE
- PROPOSED WATER HYDRANT, STOP VALVE, BEND AND TEE
- PROPOSED ROAD
- PROPOSED FOOTPATH
- KOALA FOOD TREE (TPZ) (K&C SURVEY JANUARY TO MARCH 2025)
- PROPOSED STREET TREE - REFER TO SHEET 34 FOR DETAILS
- PROPOSED STREET NAME SIGN
- KERB RETURN NUMBER
- PROPOSED STORMWATER PIT LABELS

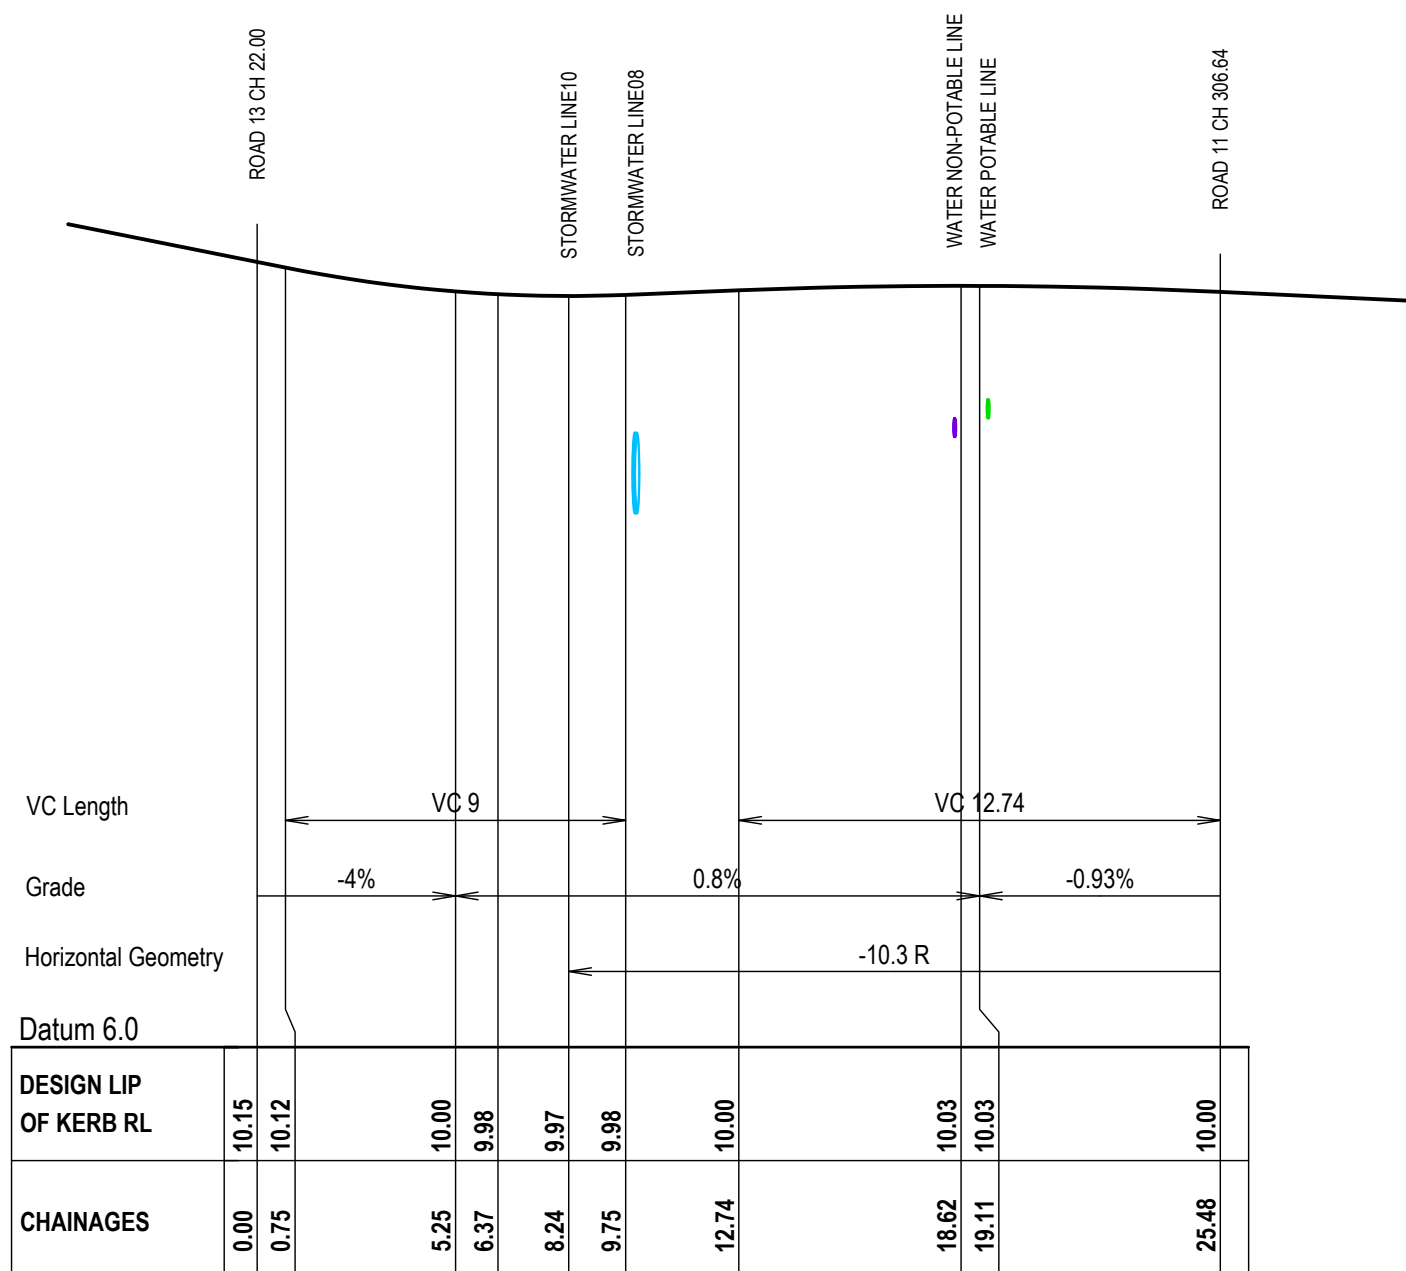

KERB RETURN KR 03

LONG SECTION SCALES

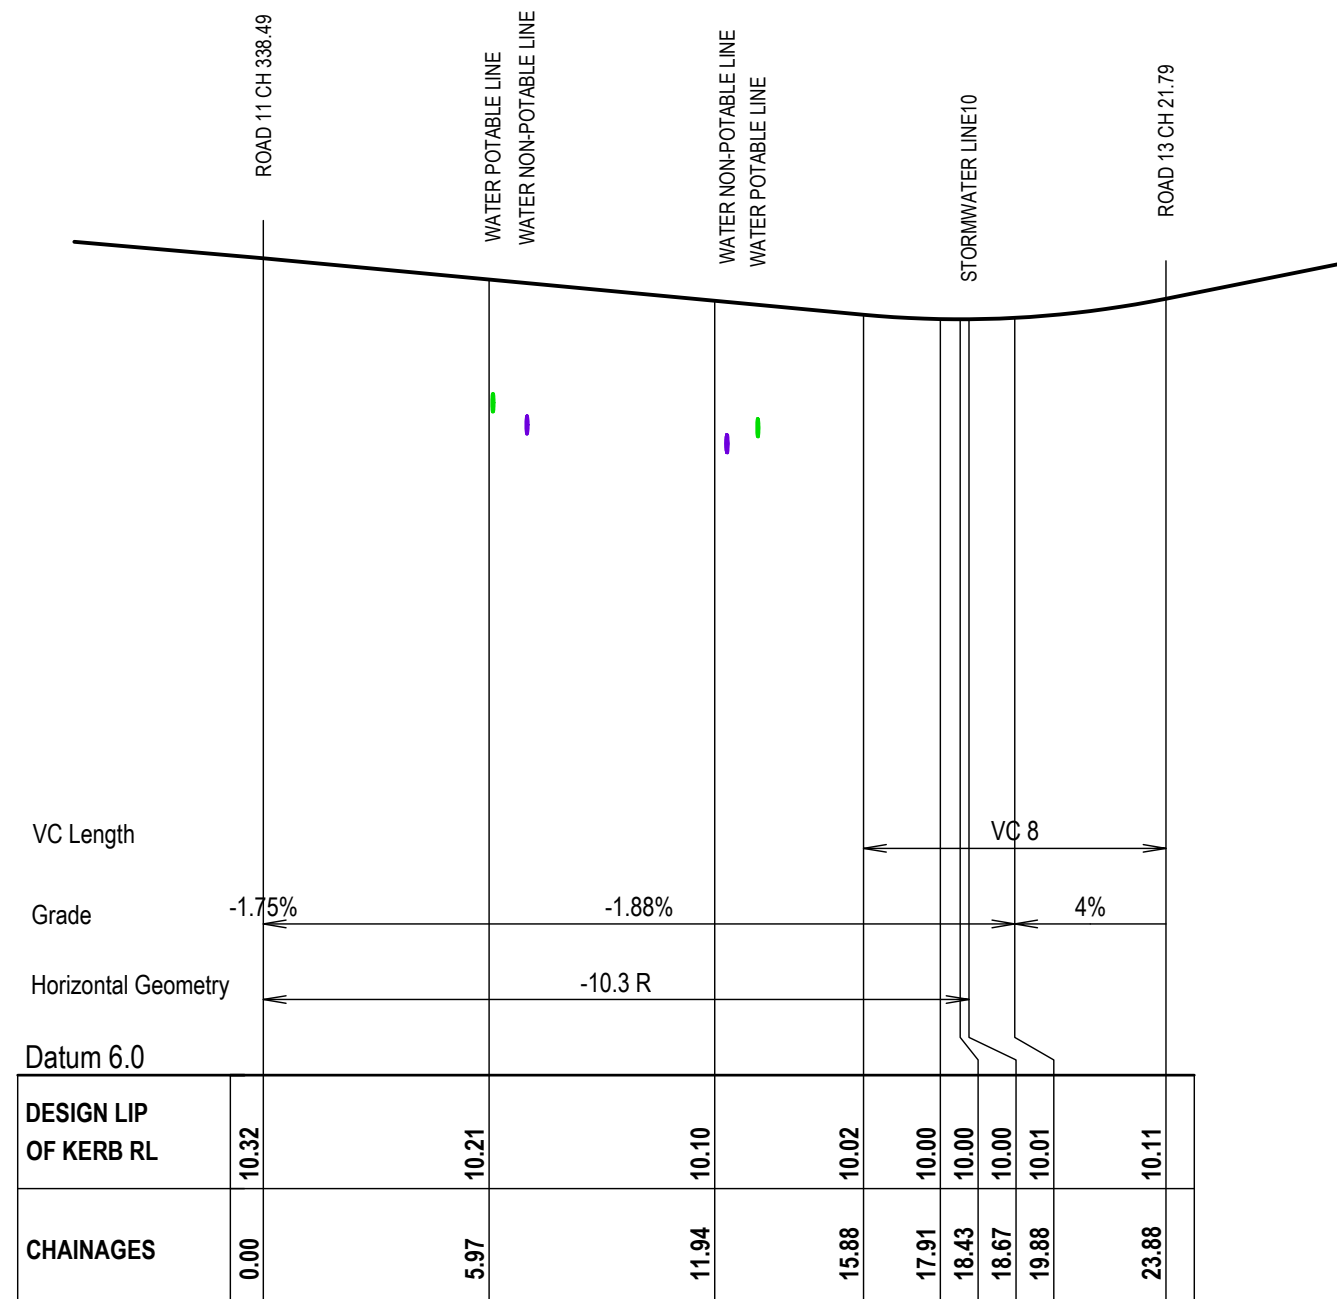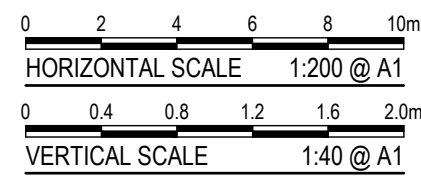

KERB RETURN KR 04



THIS DRAWING INCLUDES INFORMATION IN COLOUR. IF YOU HAVE A BLACK AND WHITE COPY YOU DON'T HAVE ALL THE INFORMATION. THIS NOTE IS COLOURED RED.

KING + CAMPBELL

King & Campbell Pty Ltd
www.kingcampbell.com.au
A: PO Box 243 Port Macquarie NSW 2444
T: 02 6586 2555
F: 02 6583 4064
E: info@kingcampbell.com.au

REV.	DATE	DESCRIPTION	BY
A	31.10.2025	ISSUED FOR APPROVAL	JSC

DATUM: AHD
SCALE: 1:200 @ A1
(1:400 @ A3)


NOTE: DO NOT SCALE OFF DRAWINGS. USE FIGURED DIMENSIONS ONLY. REPORT ANY DISCREPANCIES TO THE AUTHOR. THIS DRAWING BEING THE PROPERTY OF KING & CAMPBELL PTY LTD, IS PROTECTED BY COPYRIGHT AND MUST NOT BE USED, REPRODUCED OR COPIED WHOLLY, OR IN PART WITHOUT THE WRITTEN PERMISSION OF KING & CAMPBELL PTY LTD.

© King & Campbell Pty Ltd

PROJECT NO:	7197	DRAWING TITLE:	ROAD 13 INTERSECTION DETAIL PLAN - KR 03 & 04
DA NO.:	2014-114	PROJECT:	THE SANCTUARY STAGE 8 LOT 300, DP 1307775 - JOHN OXLEY DRIVE, THURMSTER
DESIGNED BY:	JSC/BC	CLIENT:	BIRD IN THE HAND 2 PTY LTD.
DRAWN BY:	JSC	DRAWING NO:	7197_Stage 8_SWC_Plan
CHECKED BY:	BC	SHEET:	24 OF 36
DATE CREATED:	JULY 2025	REVISION:	A

NOT TO BE USED FOR CONSTRUCTION UNLESS SUBDIVISION WORKS CERTIFICATE ISSUED FOR THE WORKS

A1

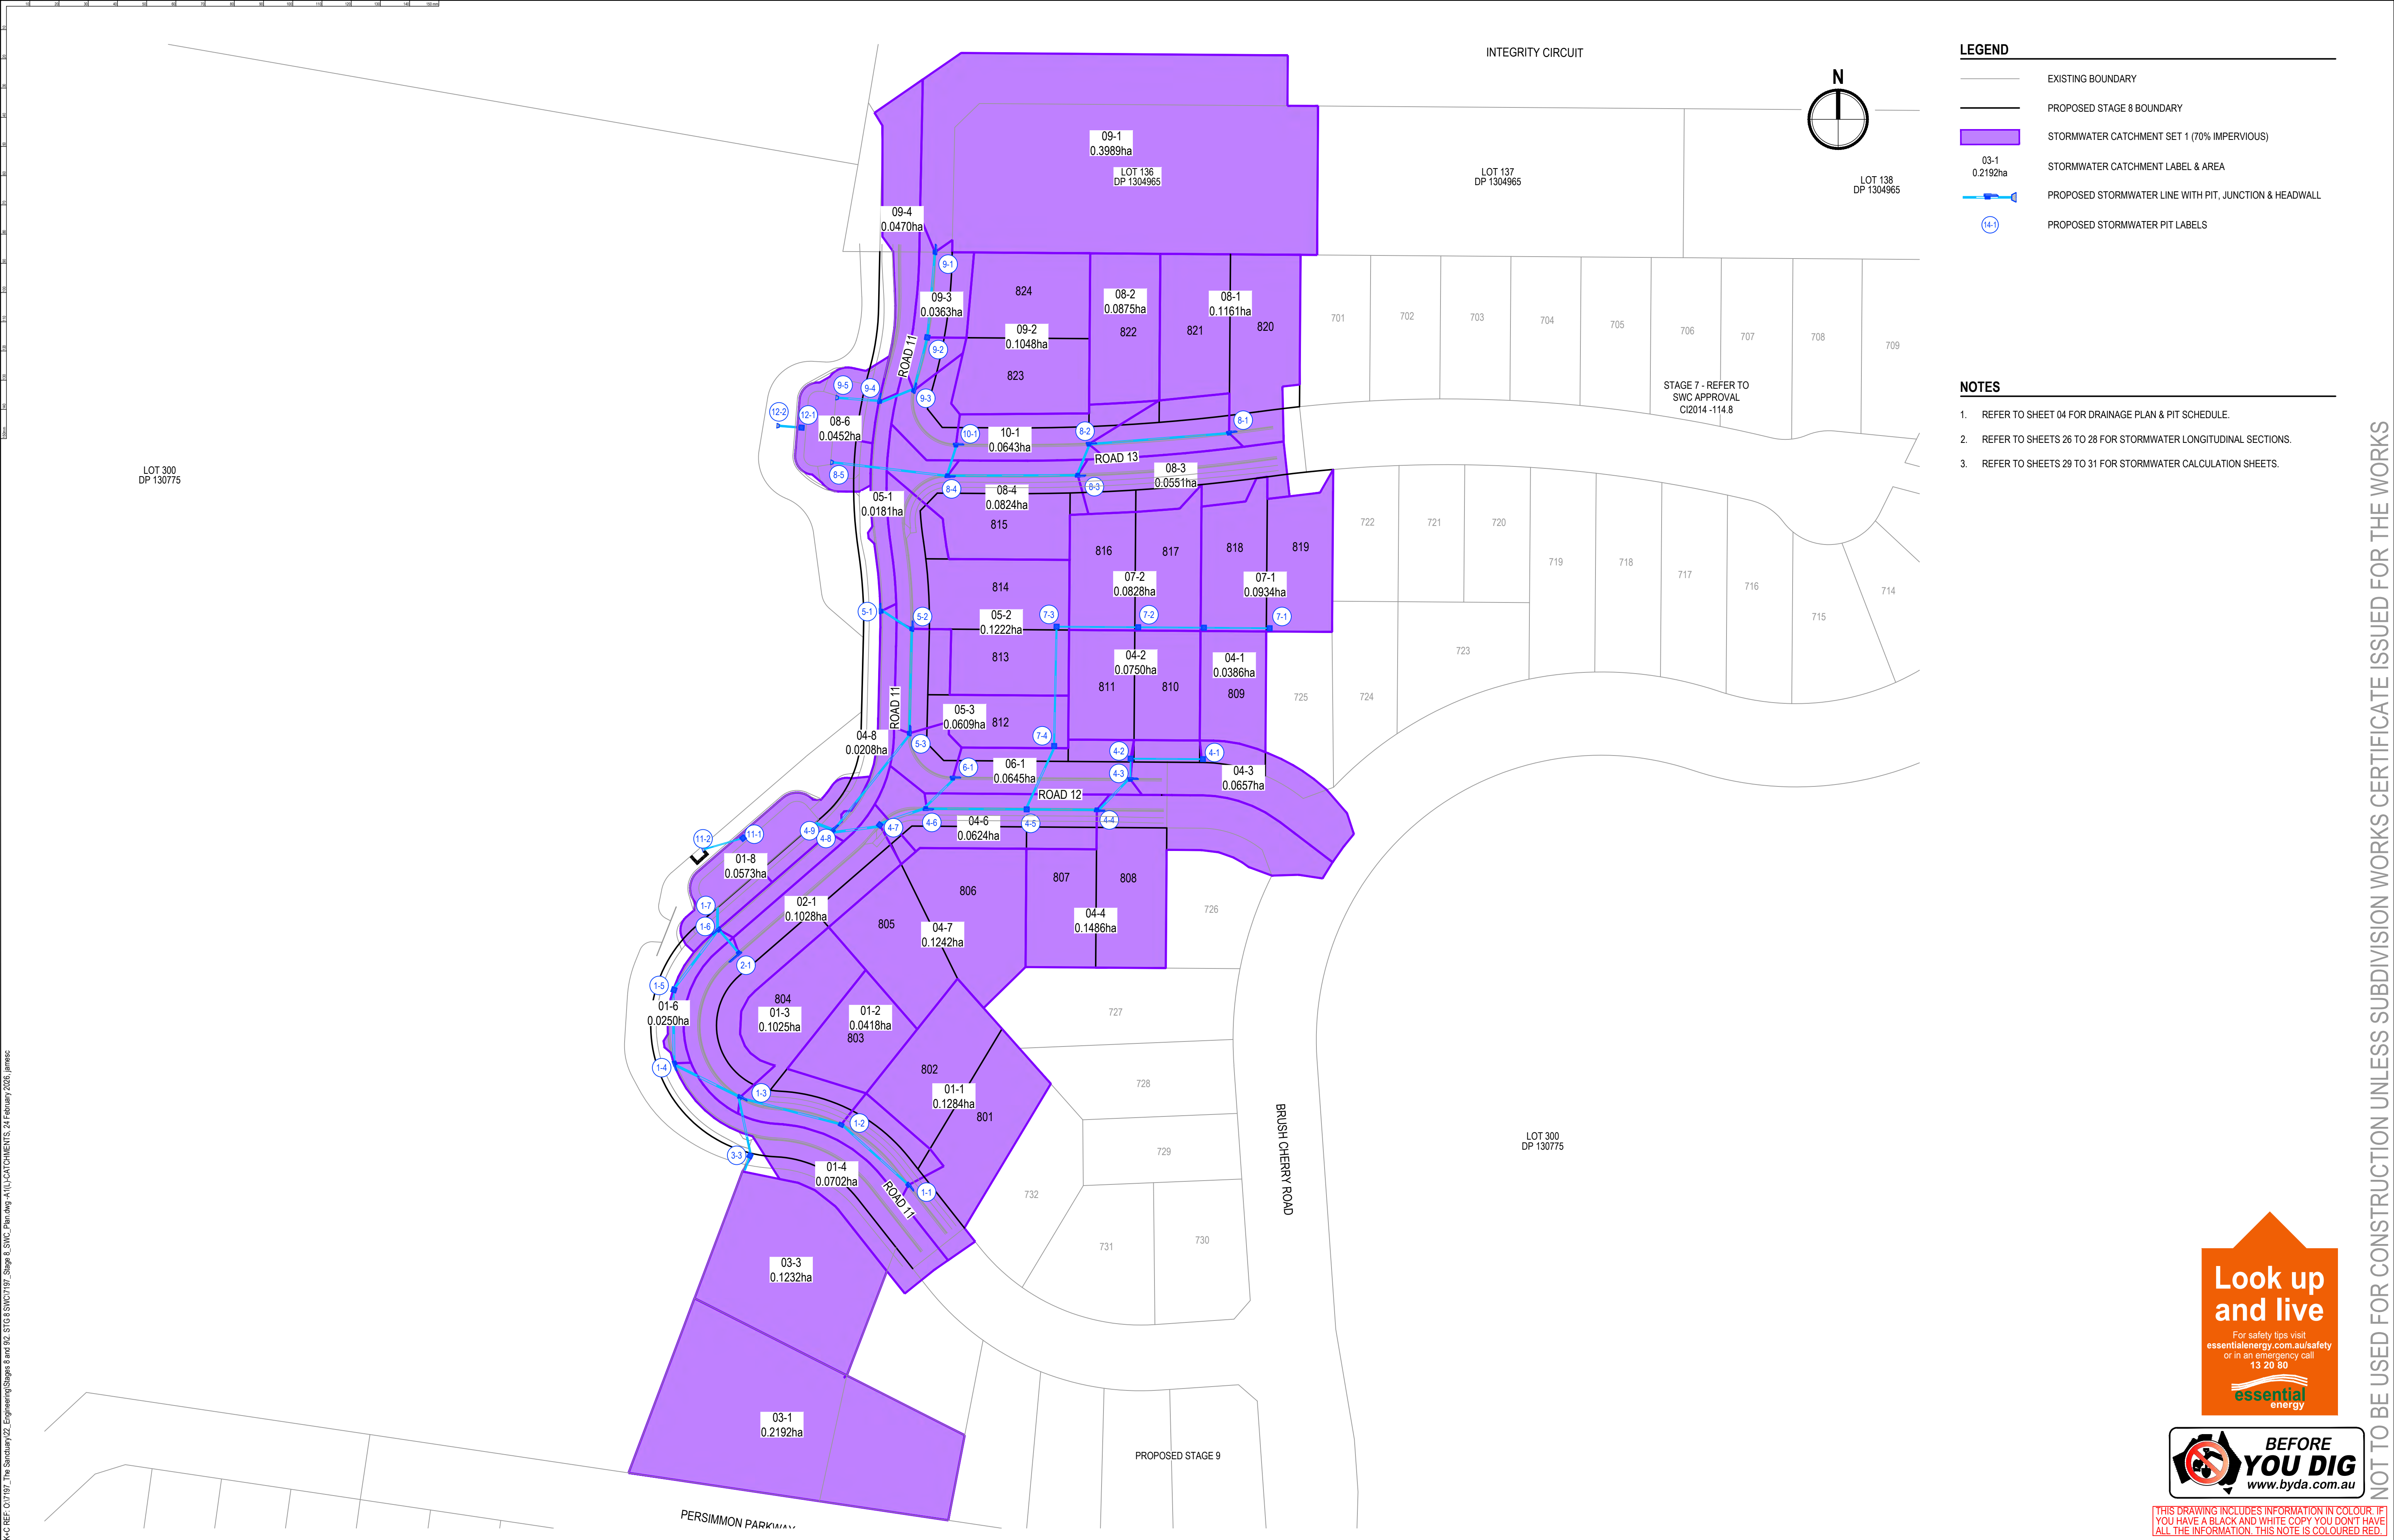

K:\C-REF-01797_The Sanctuary\02_Engineering\Stages 8 and 9\2_STAGE 8 SWC\1707_Stage 8_SWC_Plan.dwg A1(1) CATCHMENTS, 24 February 2025, jamesc

REV.	DATE	DESCRIPTION	BY
A	31.10.2025	ISSUED FOR APPROVAL	JSC


PROJECT NO:	7197	DRAWING TITLE:	STORMWATER CATCHMENT PLAN	A1
DA NO.:	2014-114	DESIGNED BY:	JSC/BC	PROJECT:
DRAWN BY:	JSC	CHECKED BY:	BC	THE SANCTUARY STAGE 8 LOT 300, DP 1307775 - JOHN OXLEY DRIVE, THURMSTER
DATE CREATED:	JULY 2025	CLIENT:	BIRD IN THE HAND 2 PTY LTD.	DRAWING NO:
				7197_Stage 8_SWC_Plan
				SHEET:
				25 OF 36
				REVISION:
				A





THIS DRAWING INCLUDES INFORMATION IN COLOUR. IF YOU HAVE A BLACK AND WHITE COPY YOU DON'T HAVE ALL THE INFORMATION. THIS NOTE IS COLOURED RED.

NOT TO BE USED FOR CONSTRUCTION UNLESS SUBDIVISION WORKS CERTIFICATE ISSUED FOR THE WORKS


K:\C-REF-017197_The Sanctuary\02_Engineering\Stages 8 and 9\2 STG 8 SWC\1707_Stage 8_SWC_Sections.dwg - A1(1)-SW.LS (1) 24 February 2026, jrmcc

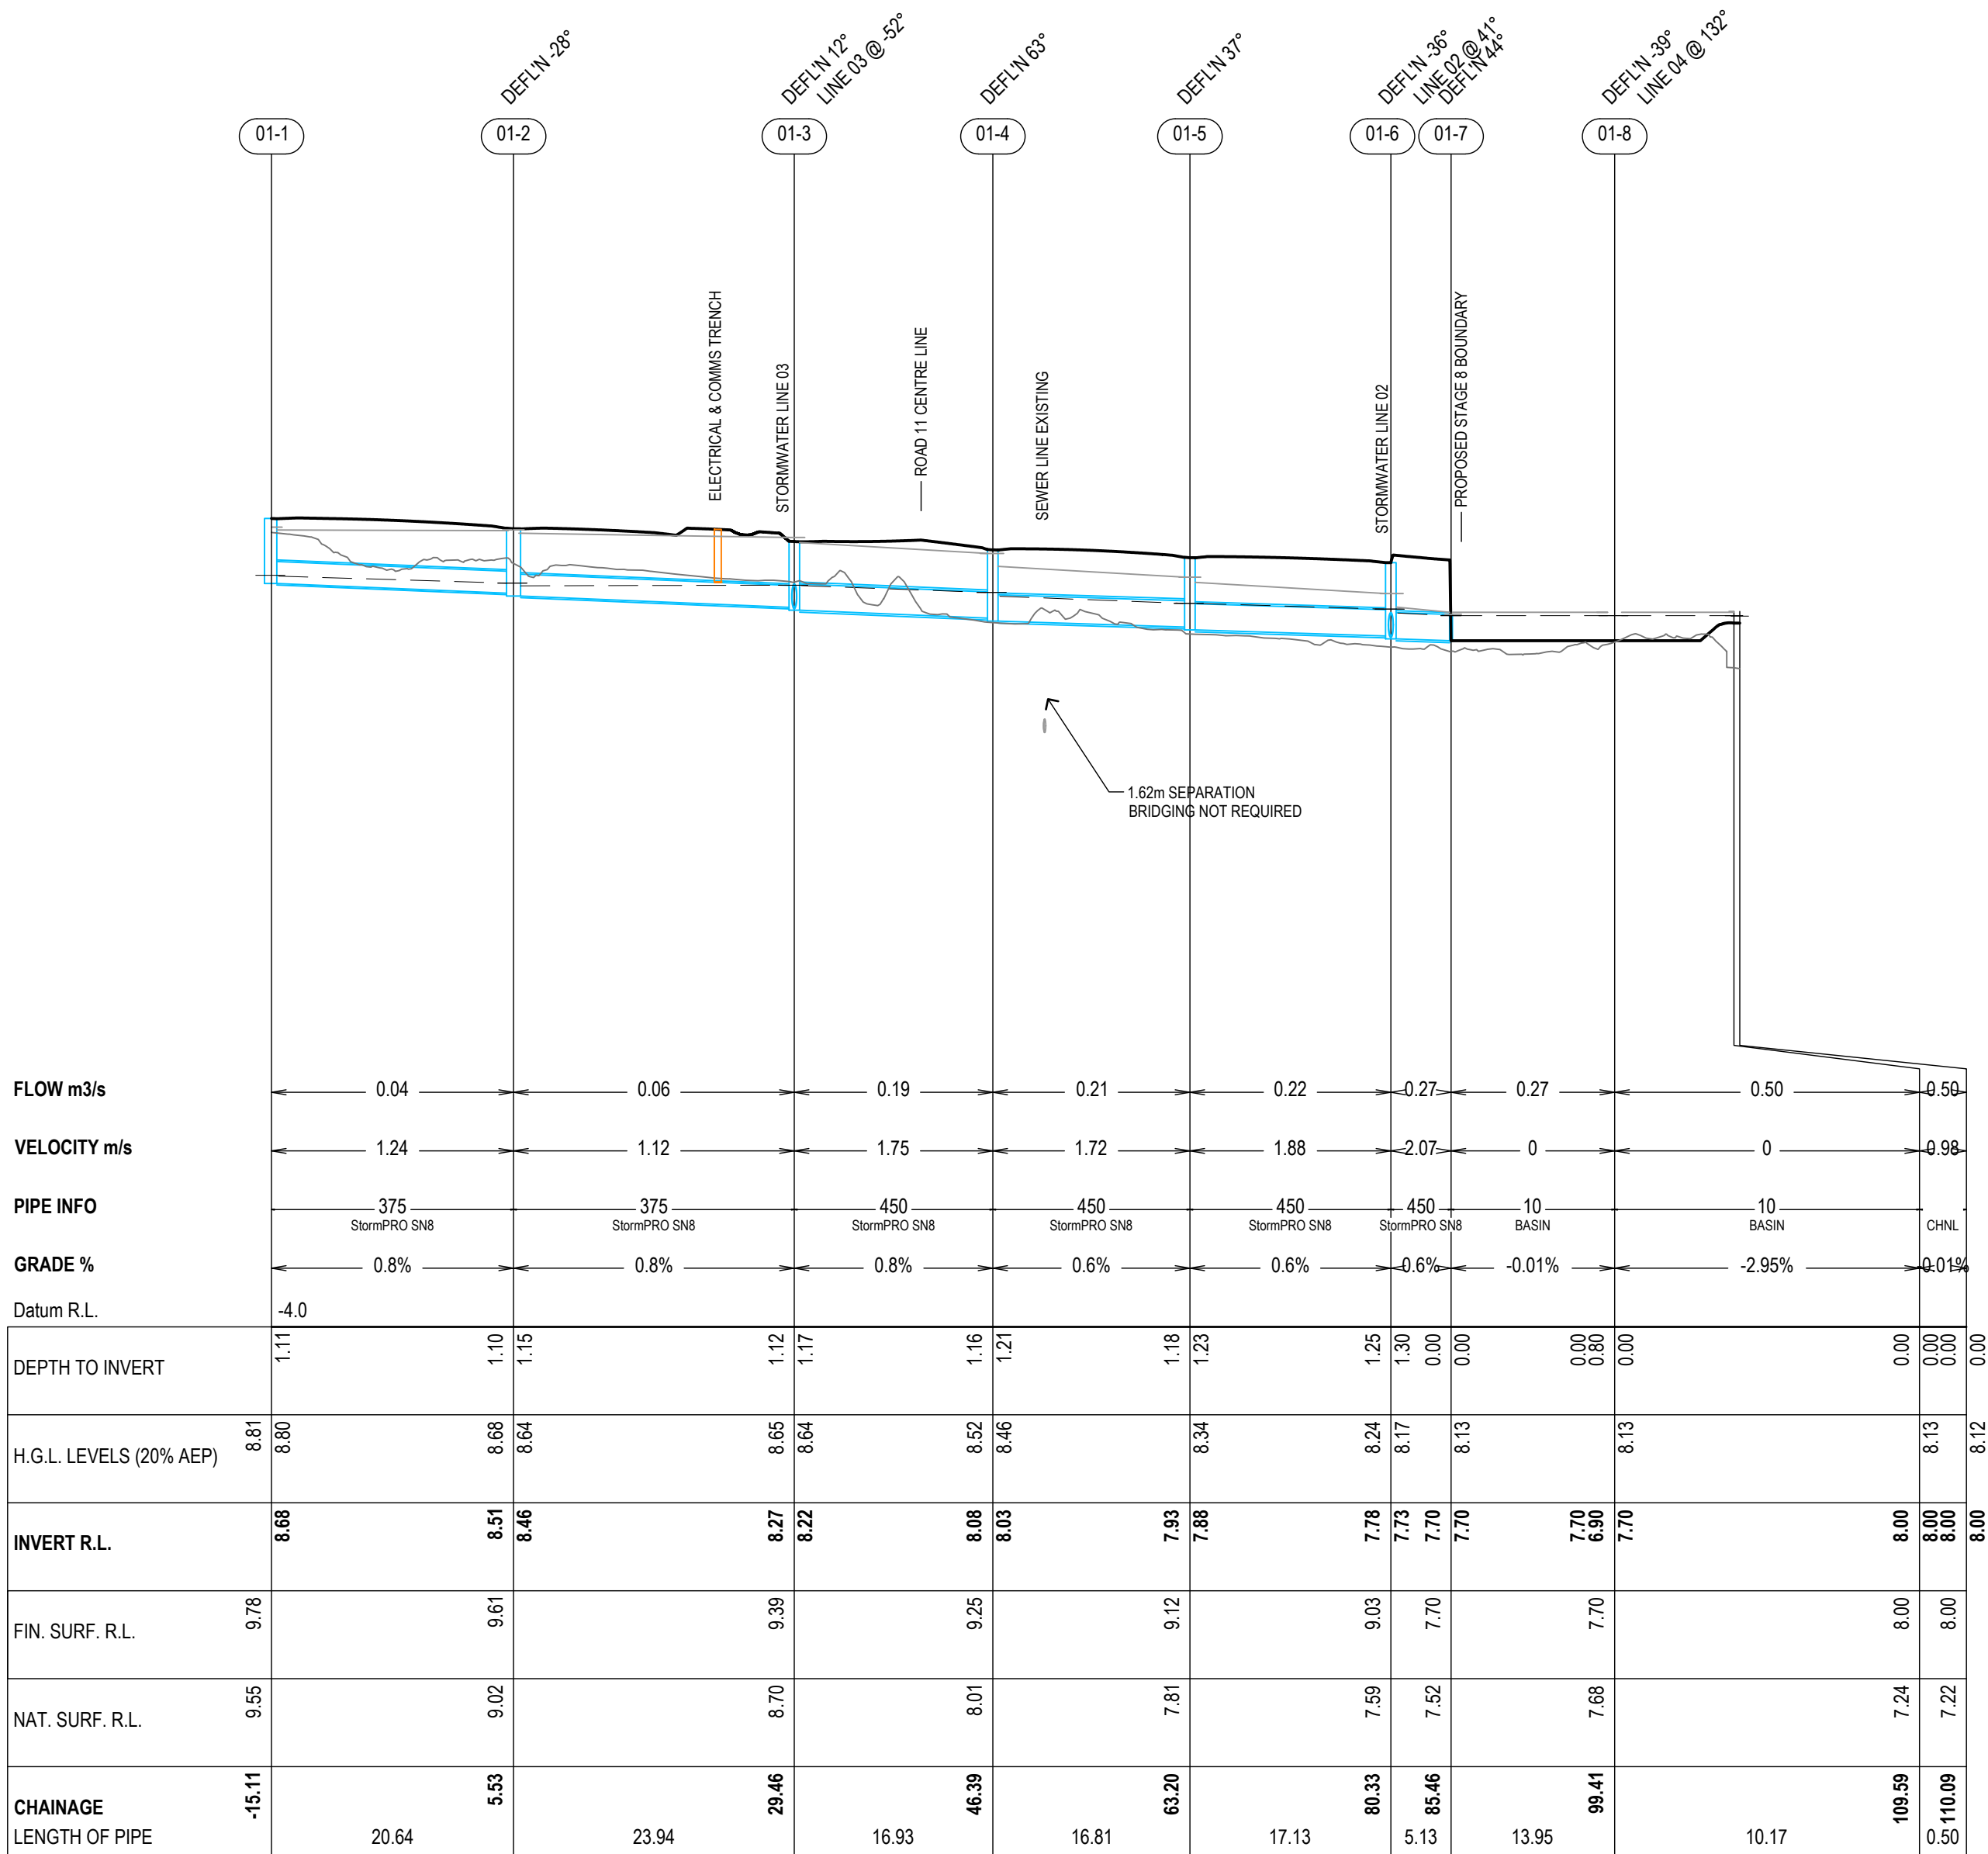


LINE 01

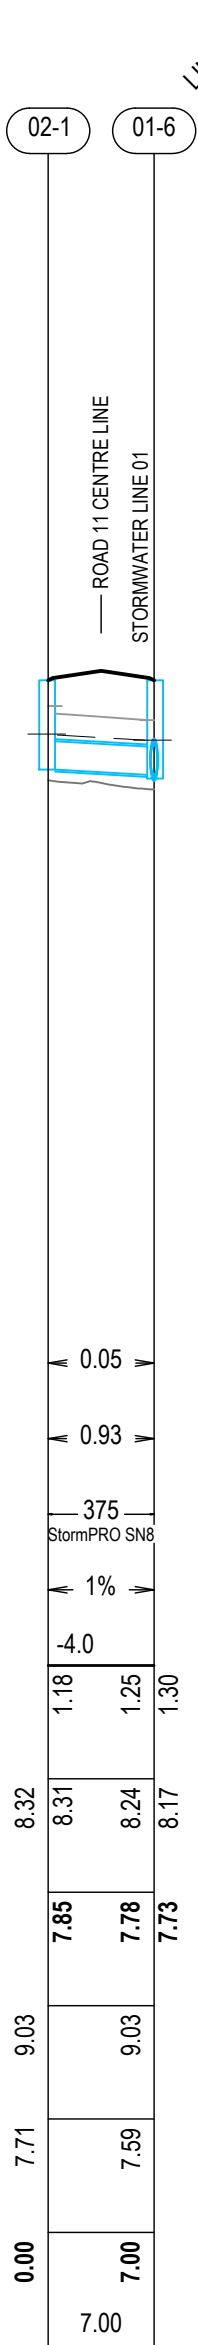

LINE 02

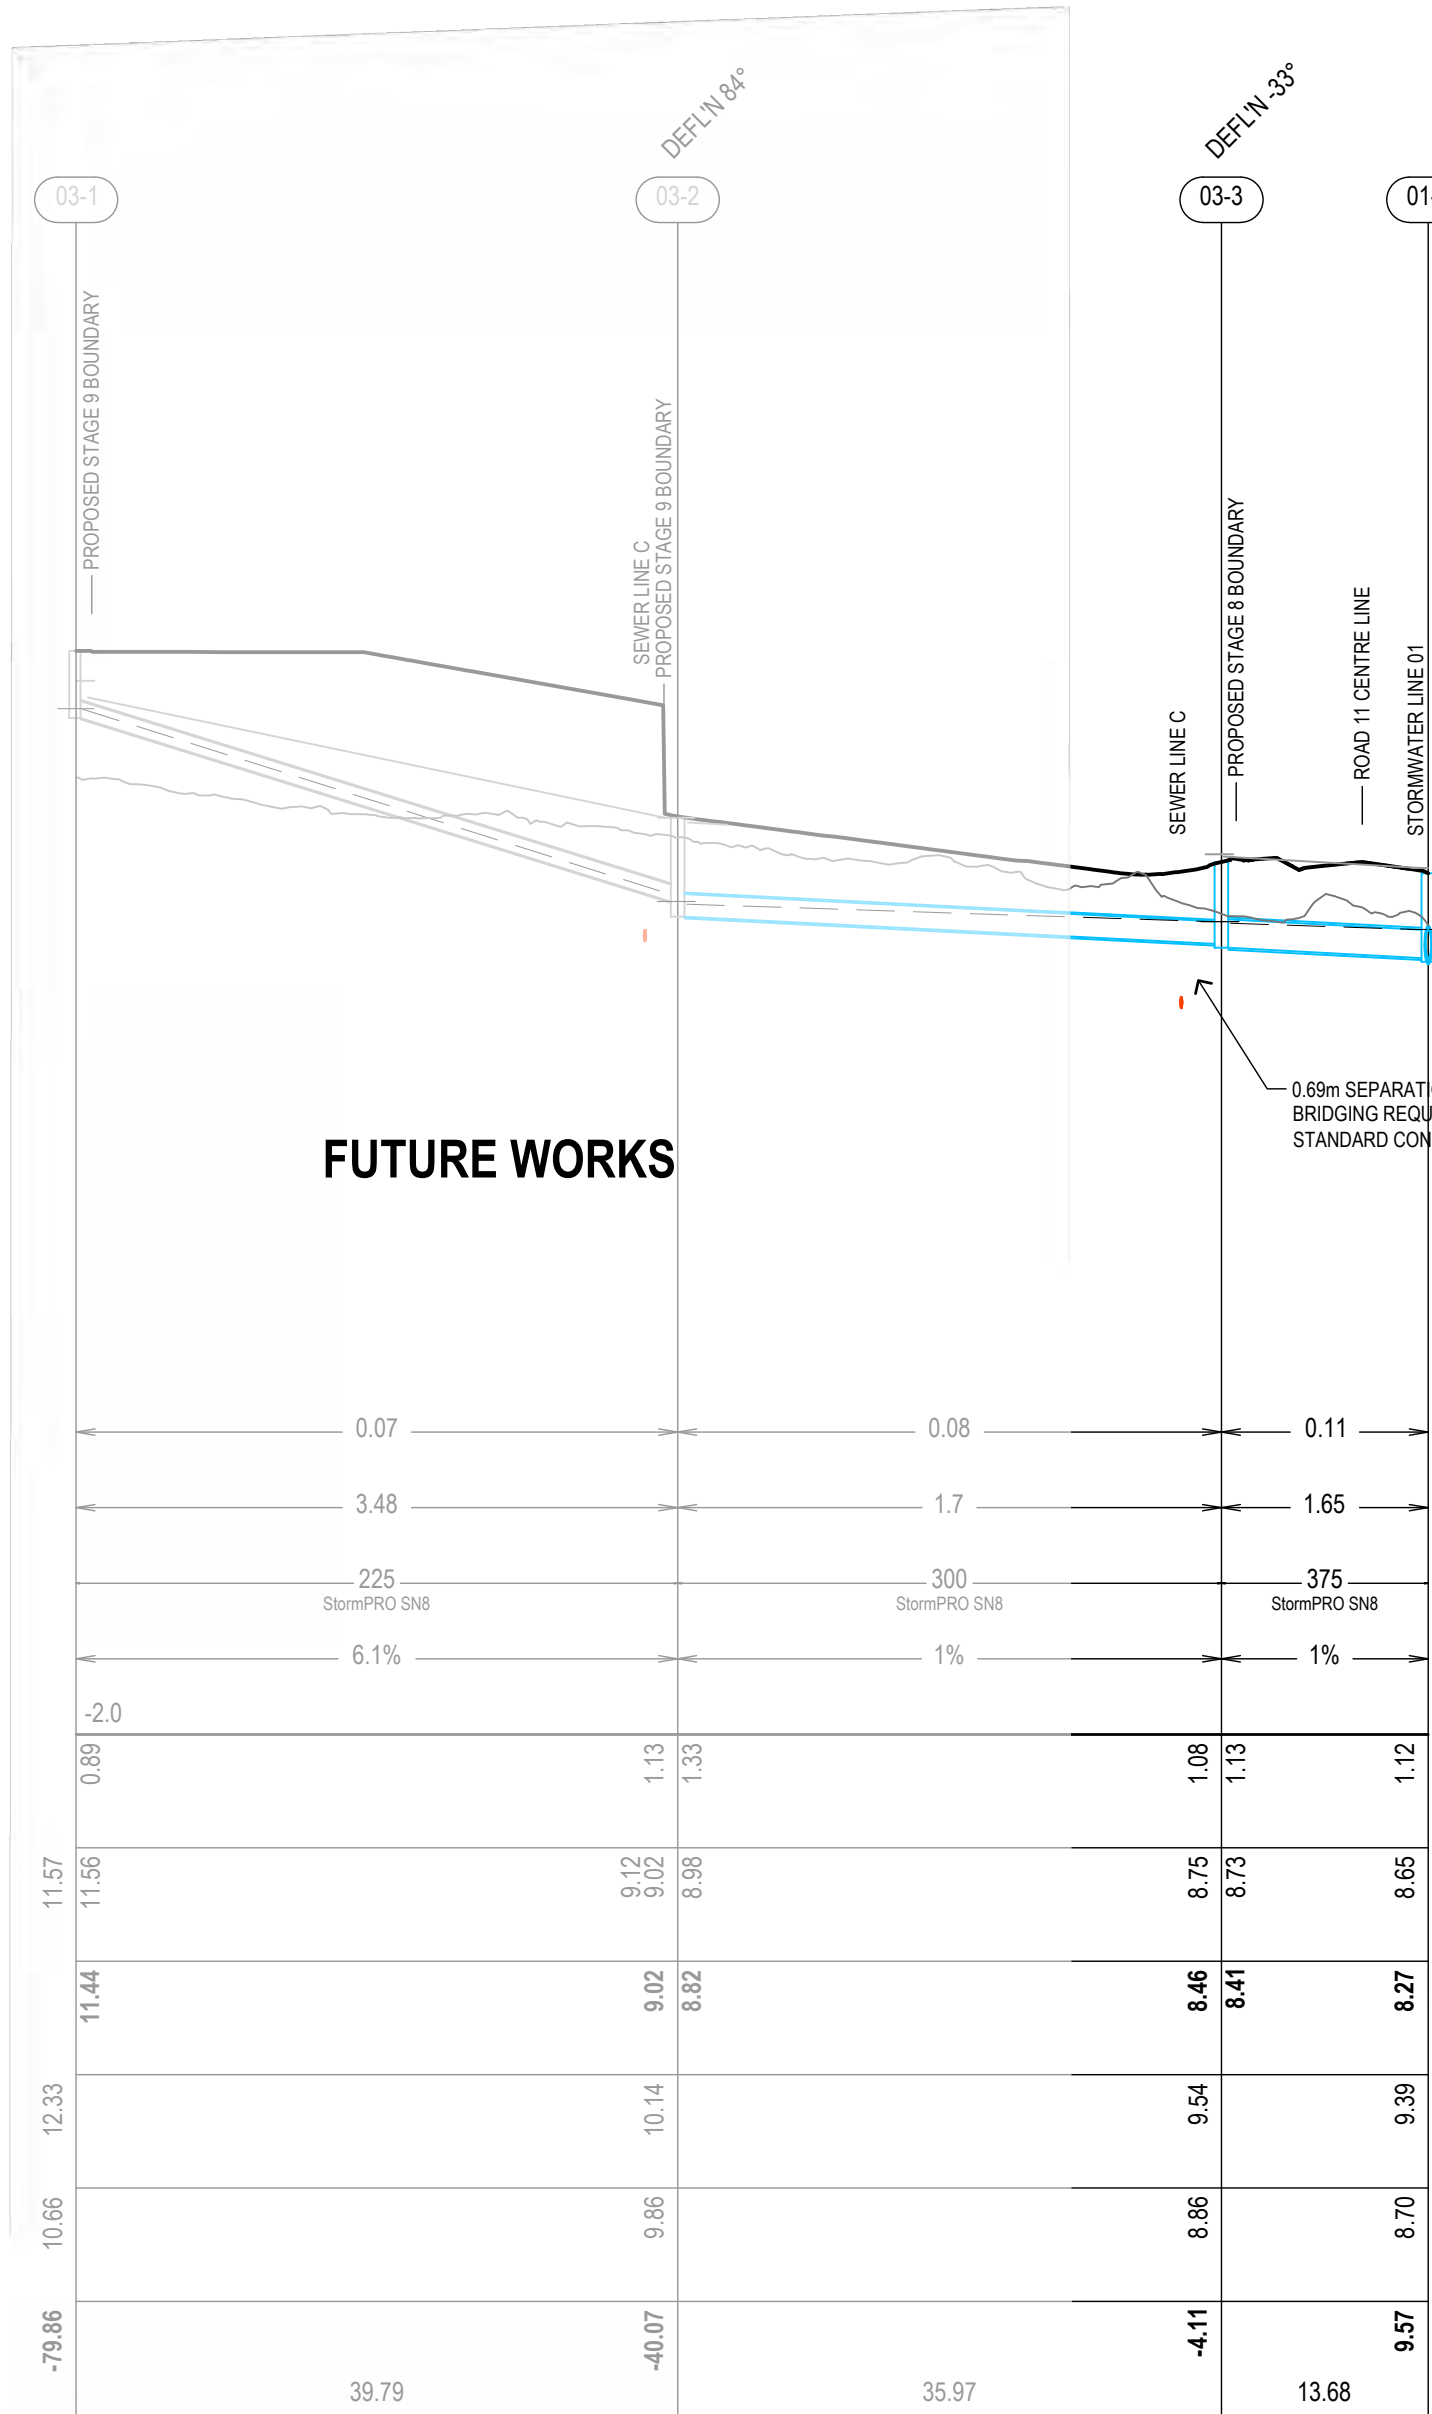

LINE 03

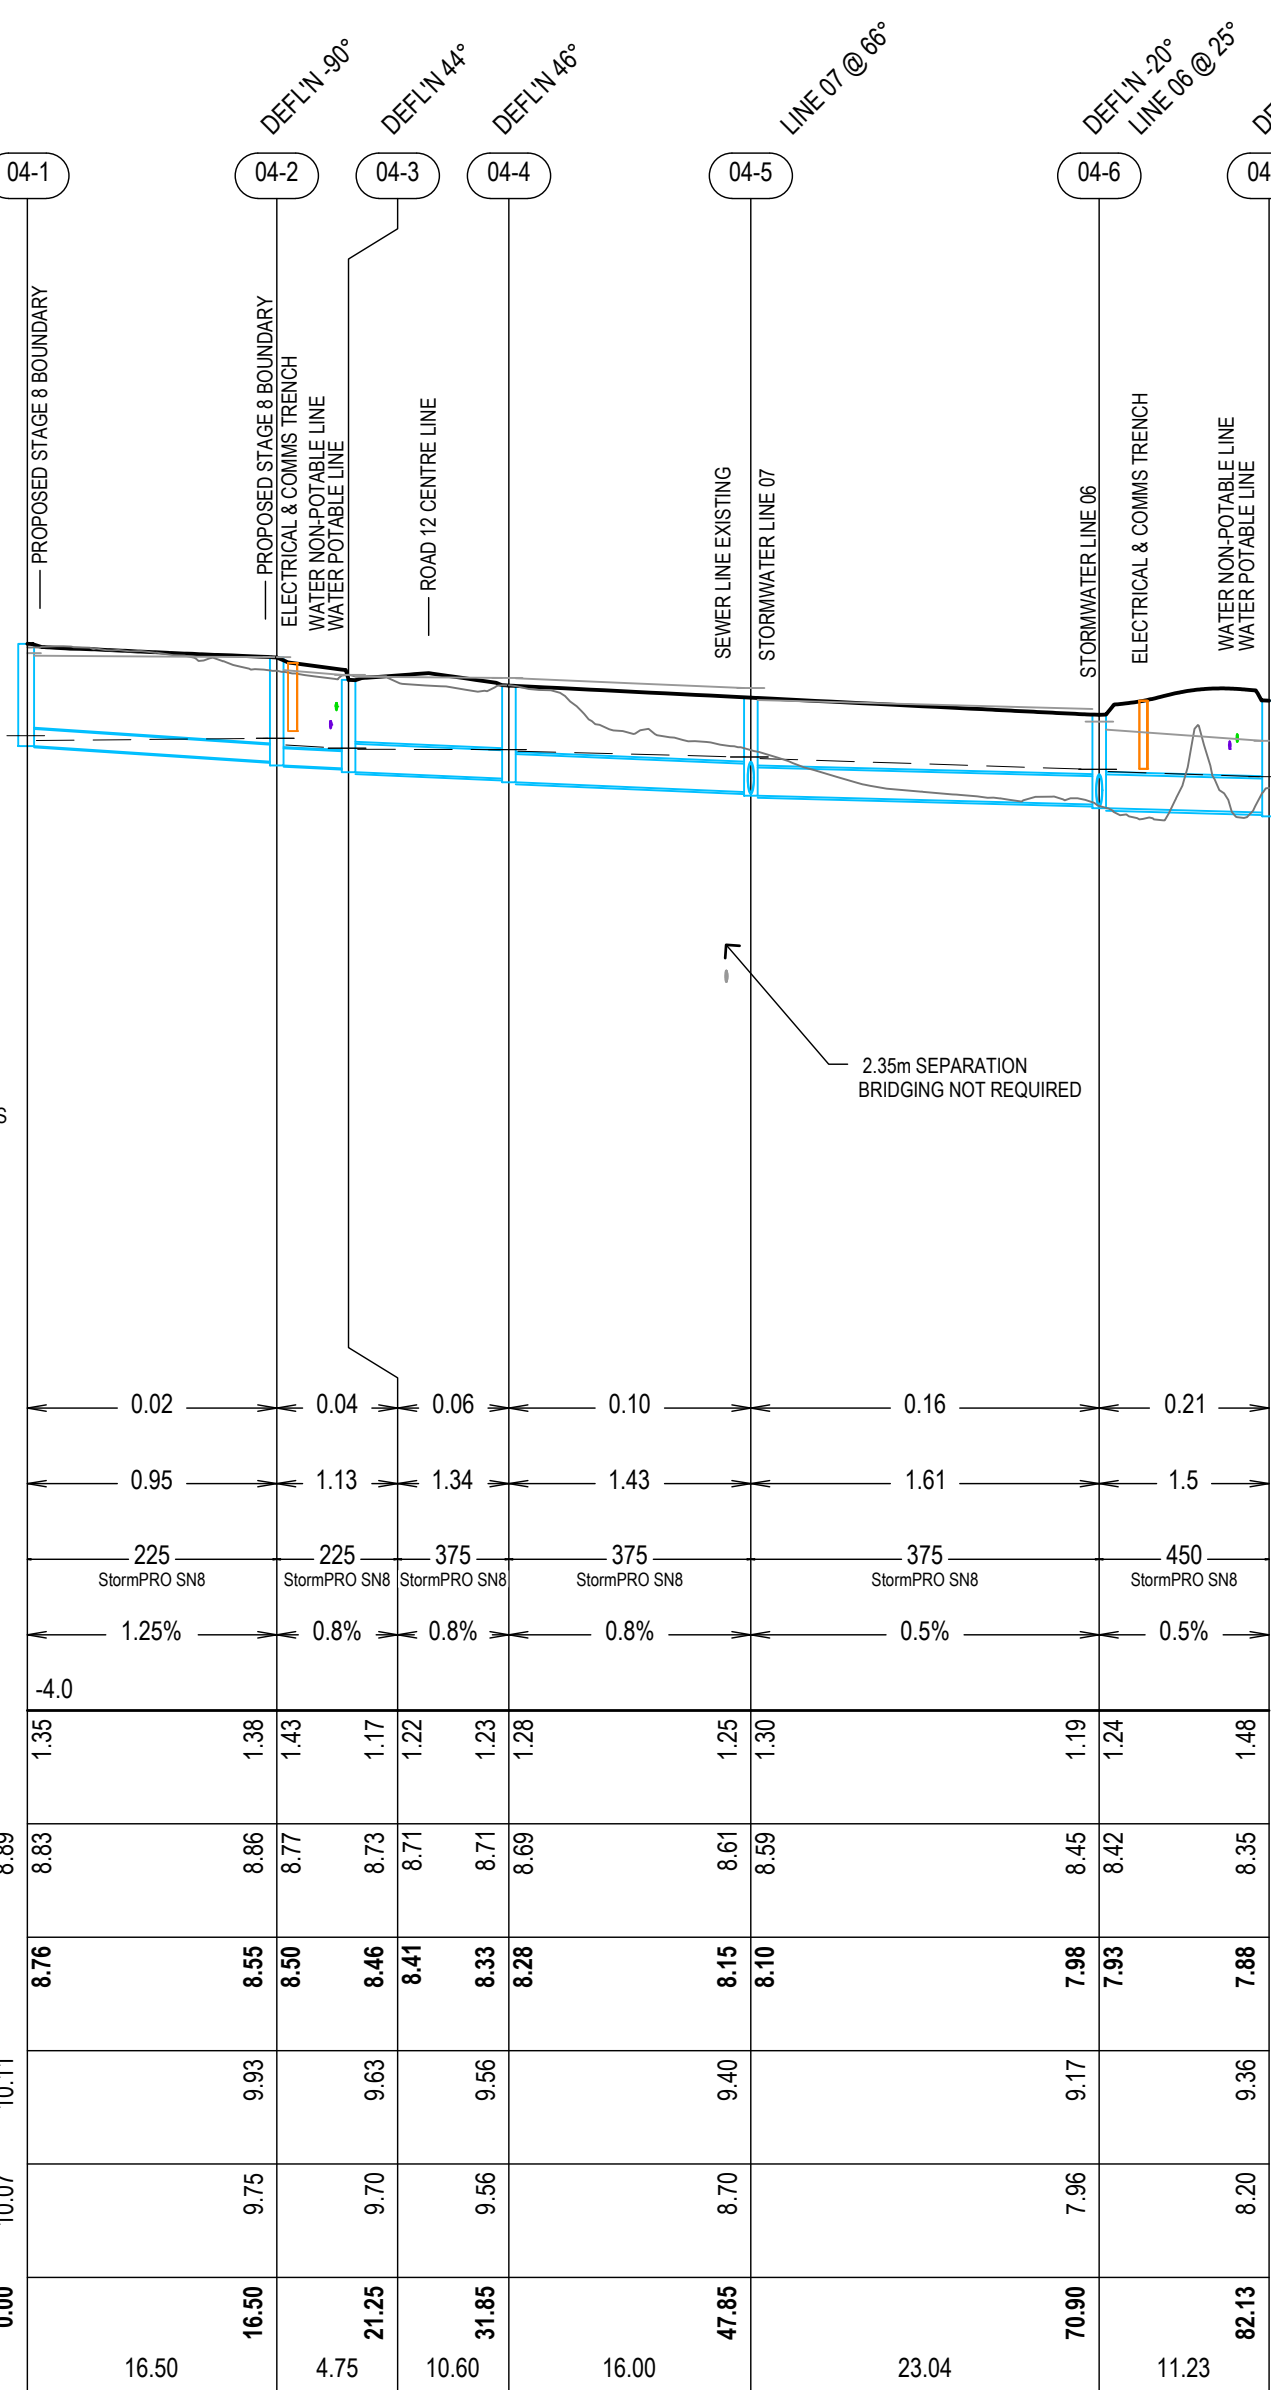


LINE 04

REV.	DATE	DESCRIPTION
A	31.10.2025	ISSUED FOR APPROVAL


DATUM:	AHD	SCALE:	AS SHOWN @ A1
NOTE: DO NOT SCALE OFF DRAWINGS. USE FIGURED DIMENSIONS ONLY. REPORT ANY DISCREPANCIES TO THE AUTHOR. THIS DRAWING BEING THE PROPERTY OF KING & CAMPBELL PTY LTD, IS PROTECTED BY COPYRIGHT AND MUST NOT BE USED, REPRODUCED OR COPIED WHOLLY, OR IN PART WITHOUT THE WRITTEN PERMISSION OF KING & CAMPBELL PTY LTD. © King & Campbell Pty Ltd			

PROJECT NO:	7197	DRAWING TITLE:	STORMWATER LONGITUDINAL SECTION - LINE 01 TO 04		
DA NO:	2014-114	PROJECT:	THE SANCTUARY STAGE 8 LOT 300, DP 1307775 - JOHN OXLEY DRIVE, THURMSTER		
DESIGNED BY:	JSC/BC	CLIENT:	BIRD IN THE HAND 2 PTY LTD.	DRAWING NO:	7197_Stage 8_SWC_Sections
DRAWN BY:	JSC			SHEET:	26 OF 36
CHECKED BY:	BC			REVISION:	A
DATE CREATED:	JULY 2025				


M:\C-REF-017197_The Sanctuary\02_Engineering\Stages 8 and 9\2-STG 8 SWC Sections.dwg - A1(1)-SW_LS 02_24 February 2026_james

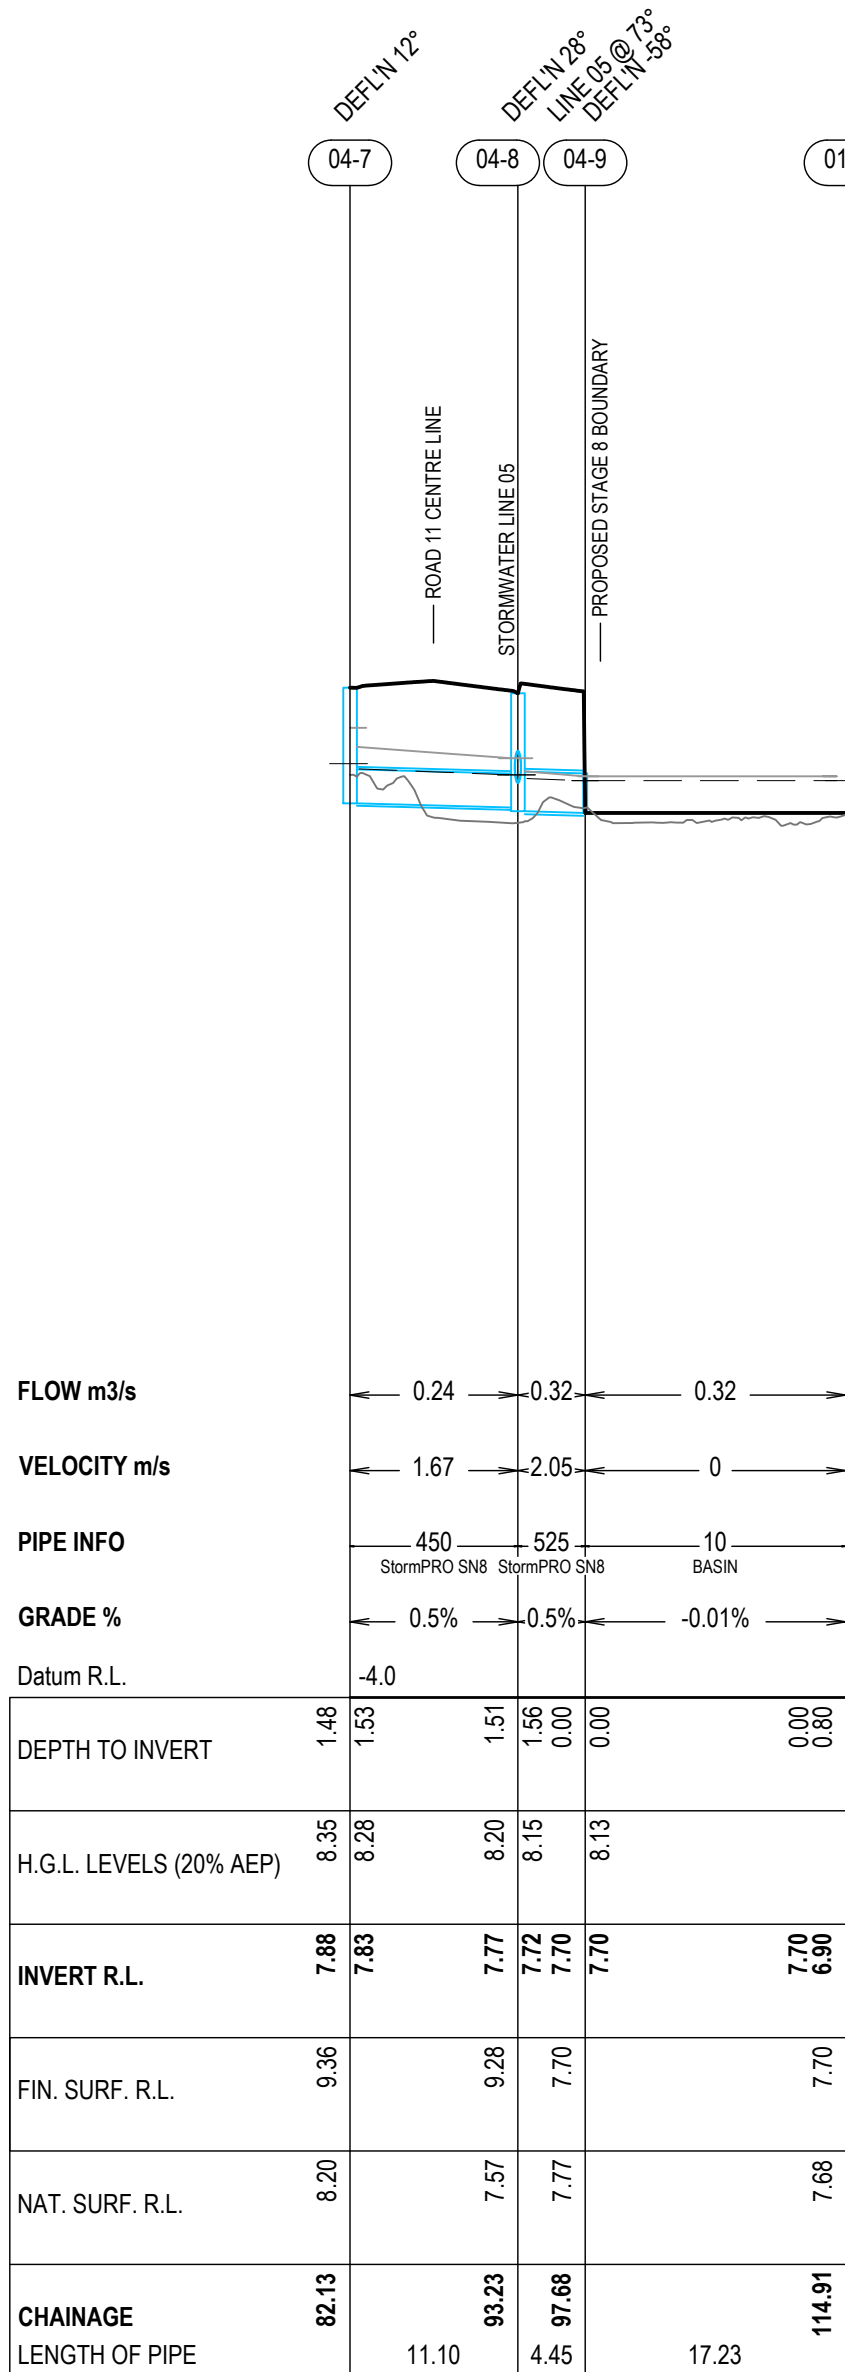


LINE 04

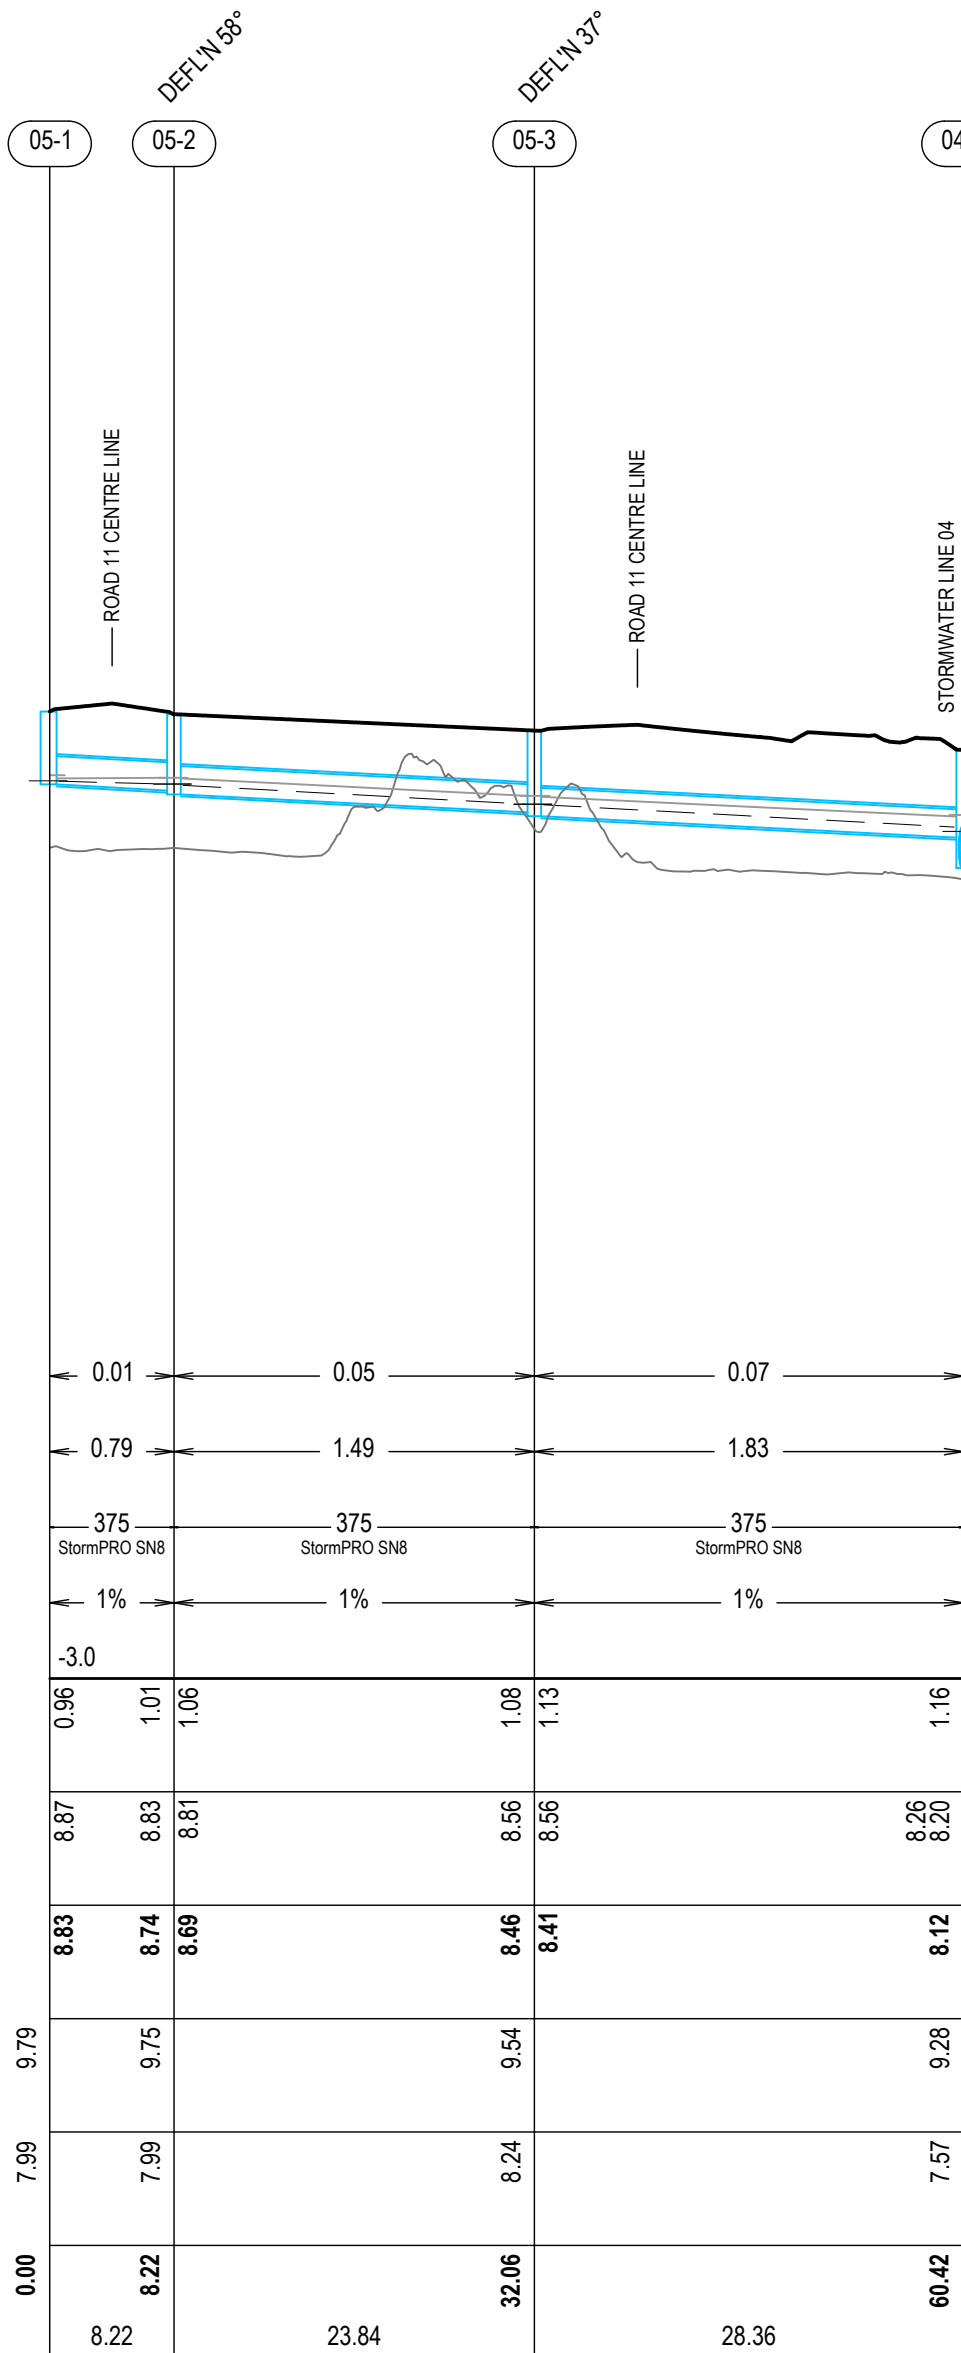


LINE 05

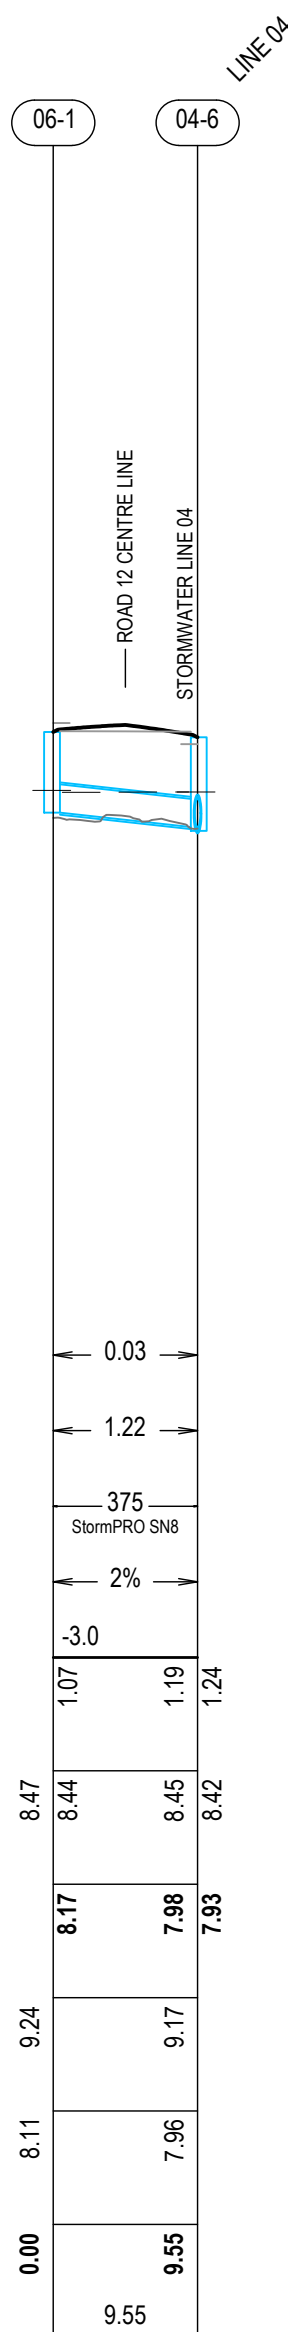

LINE 06

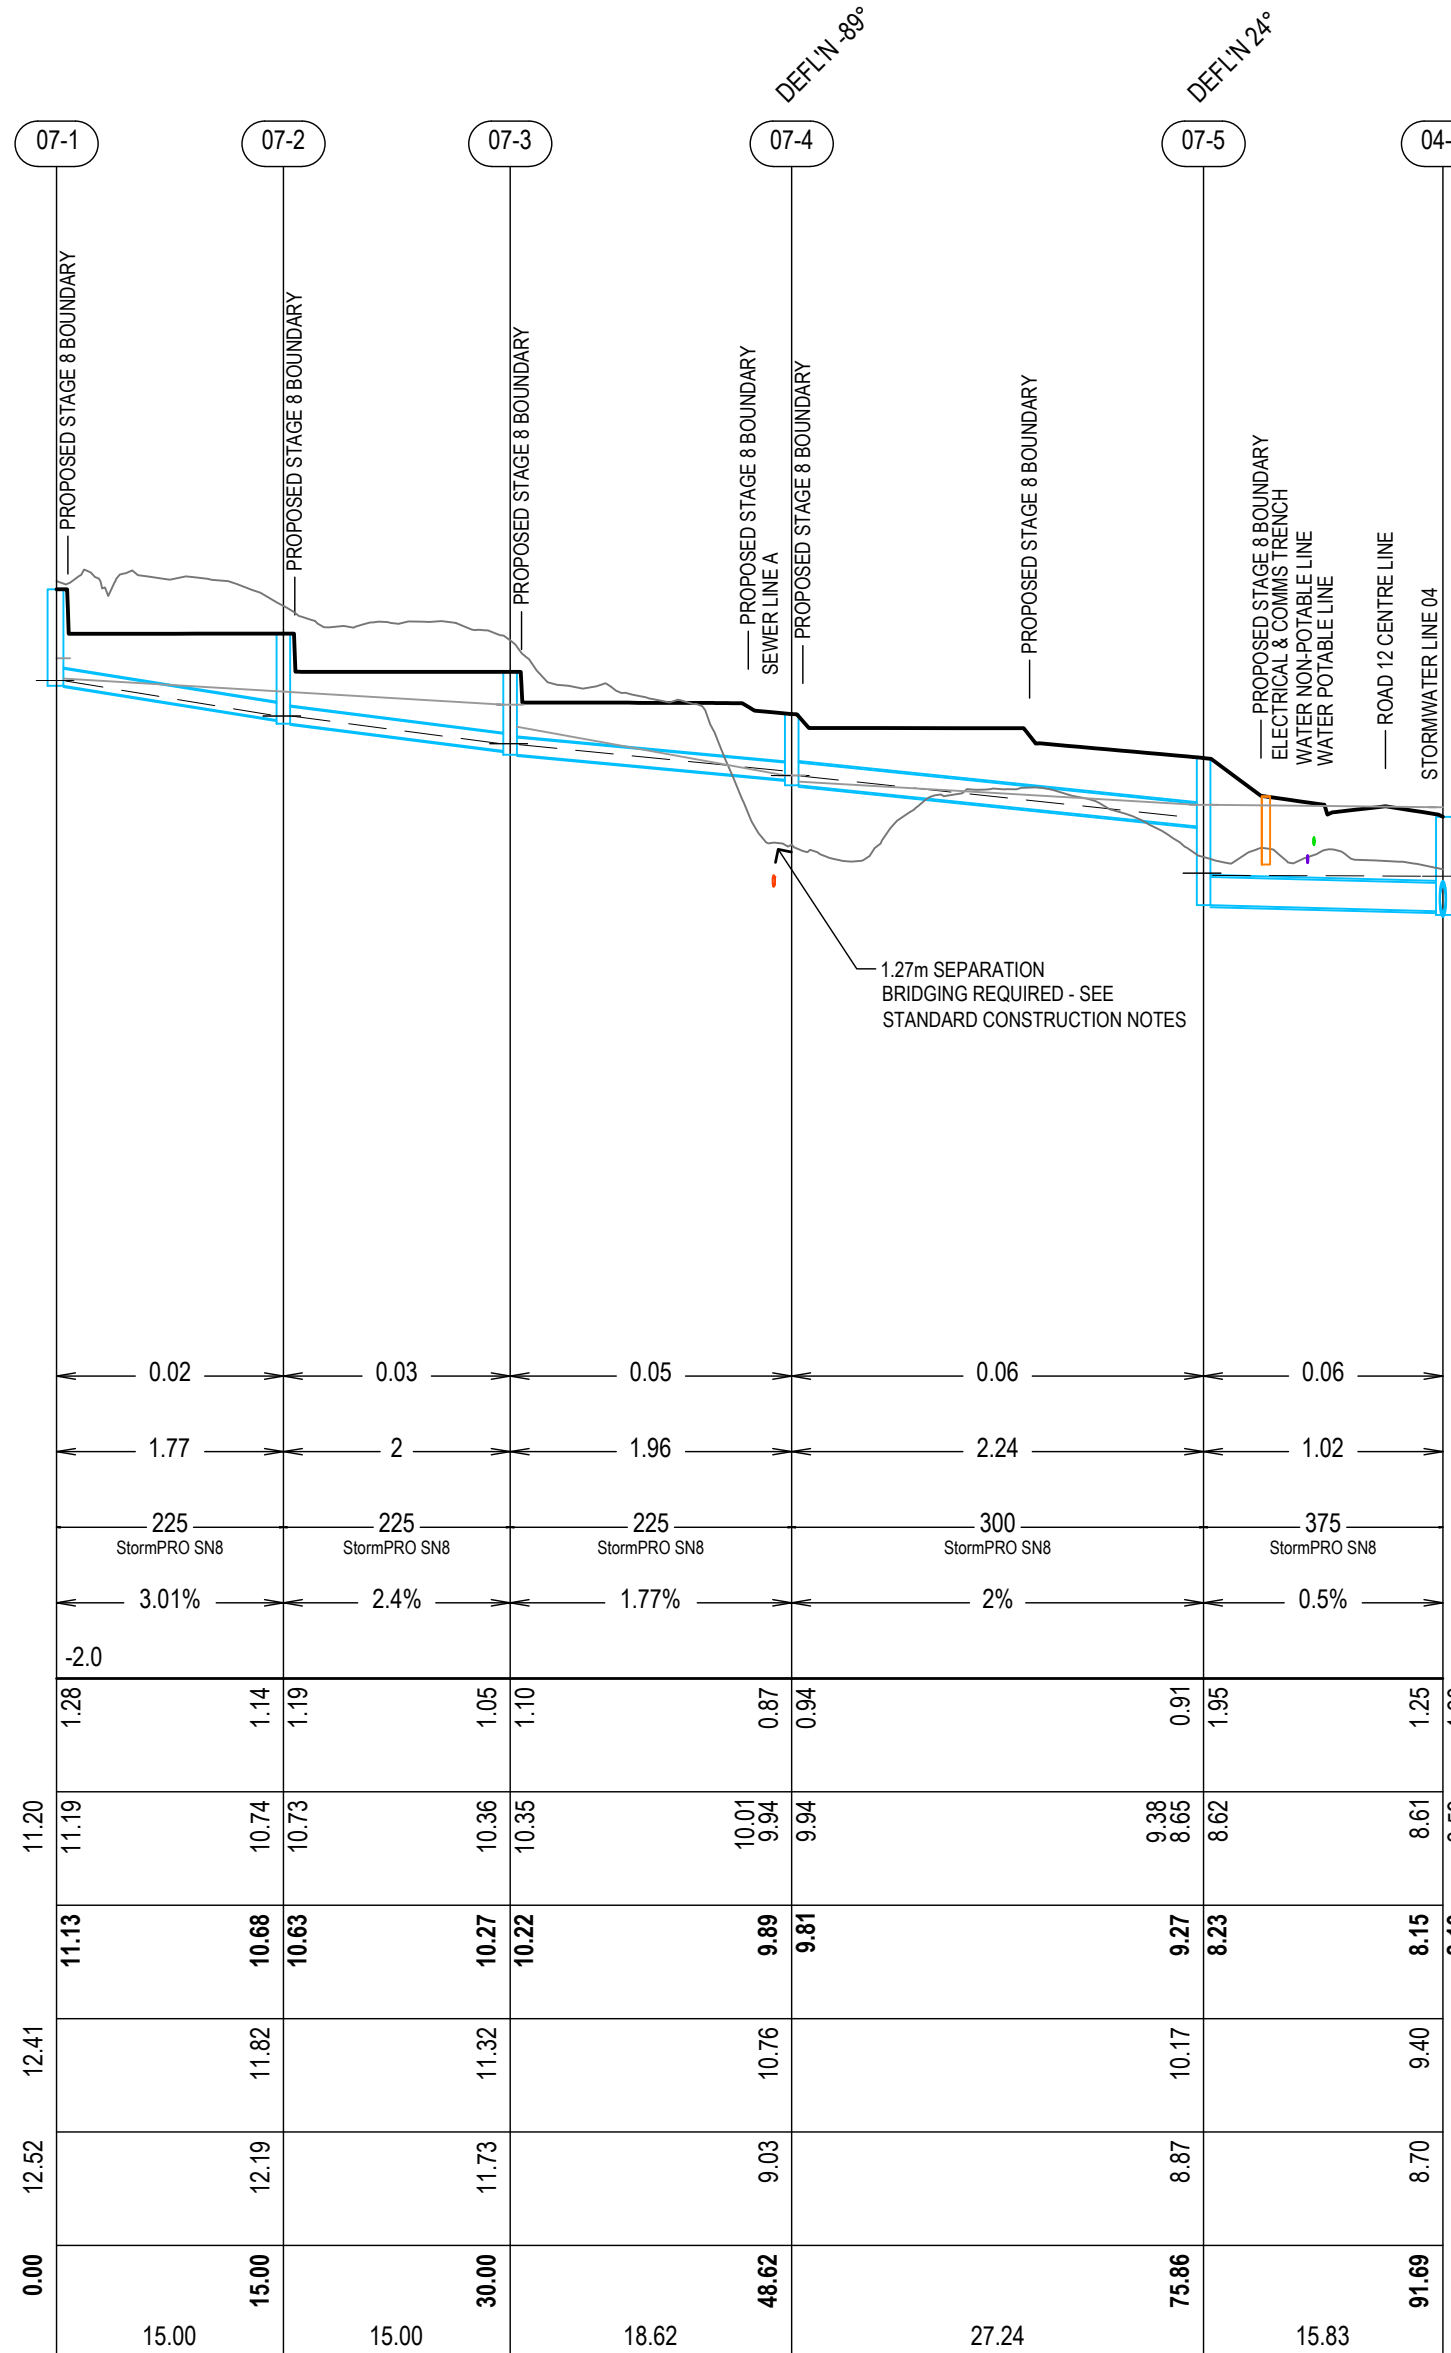

LINE 07

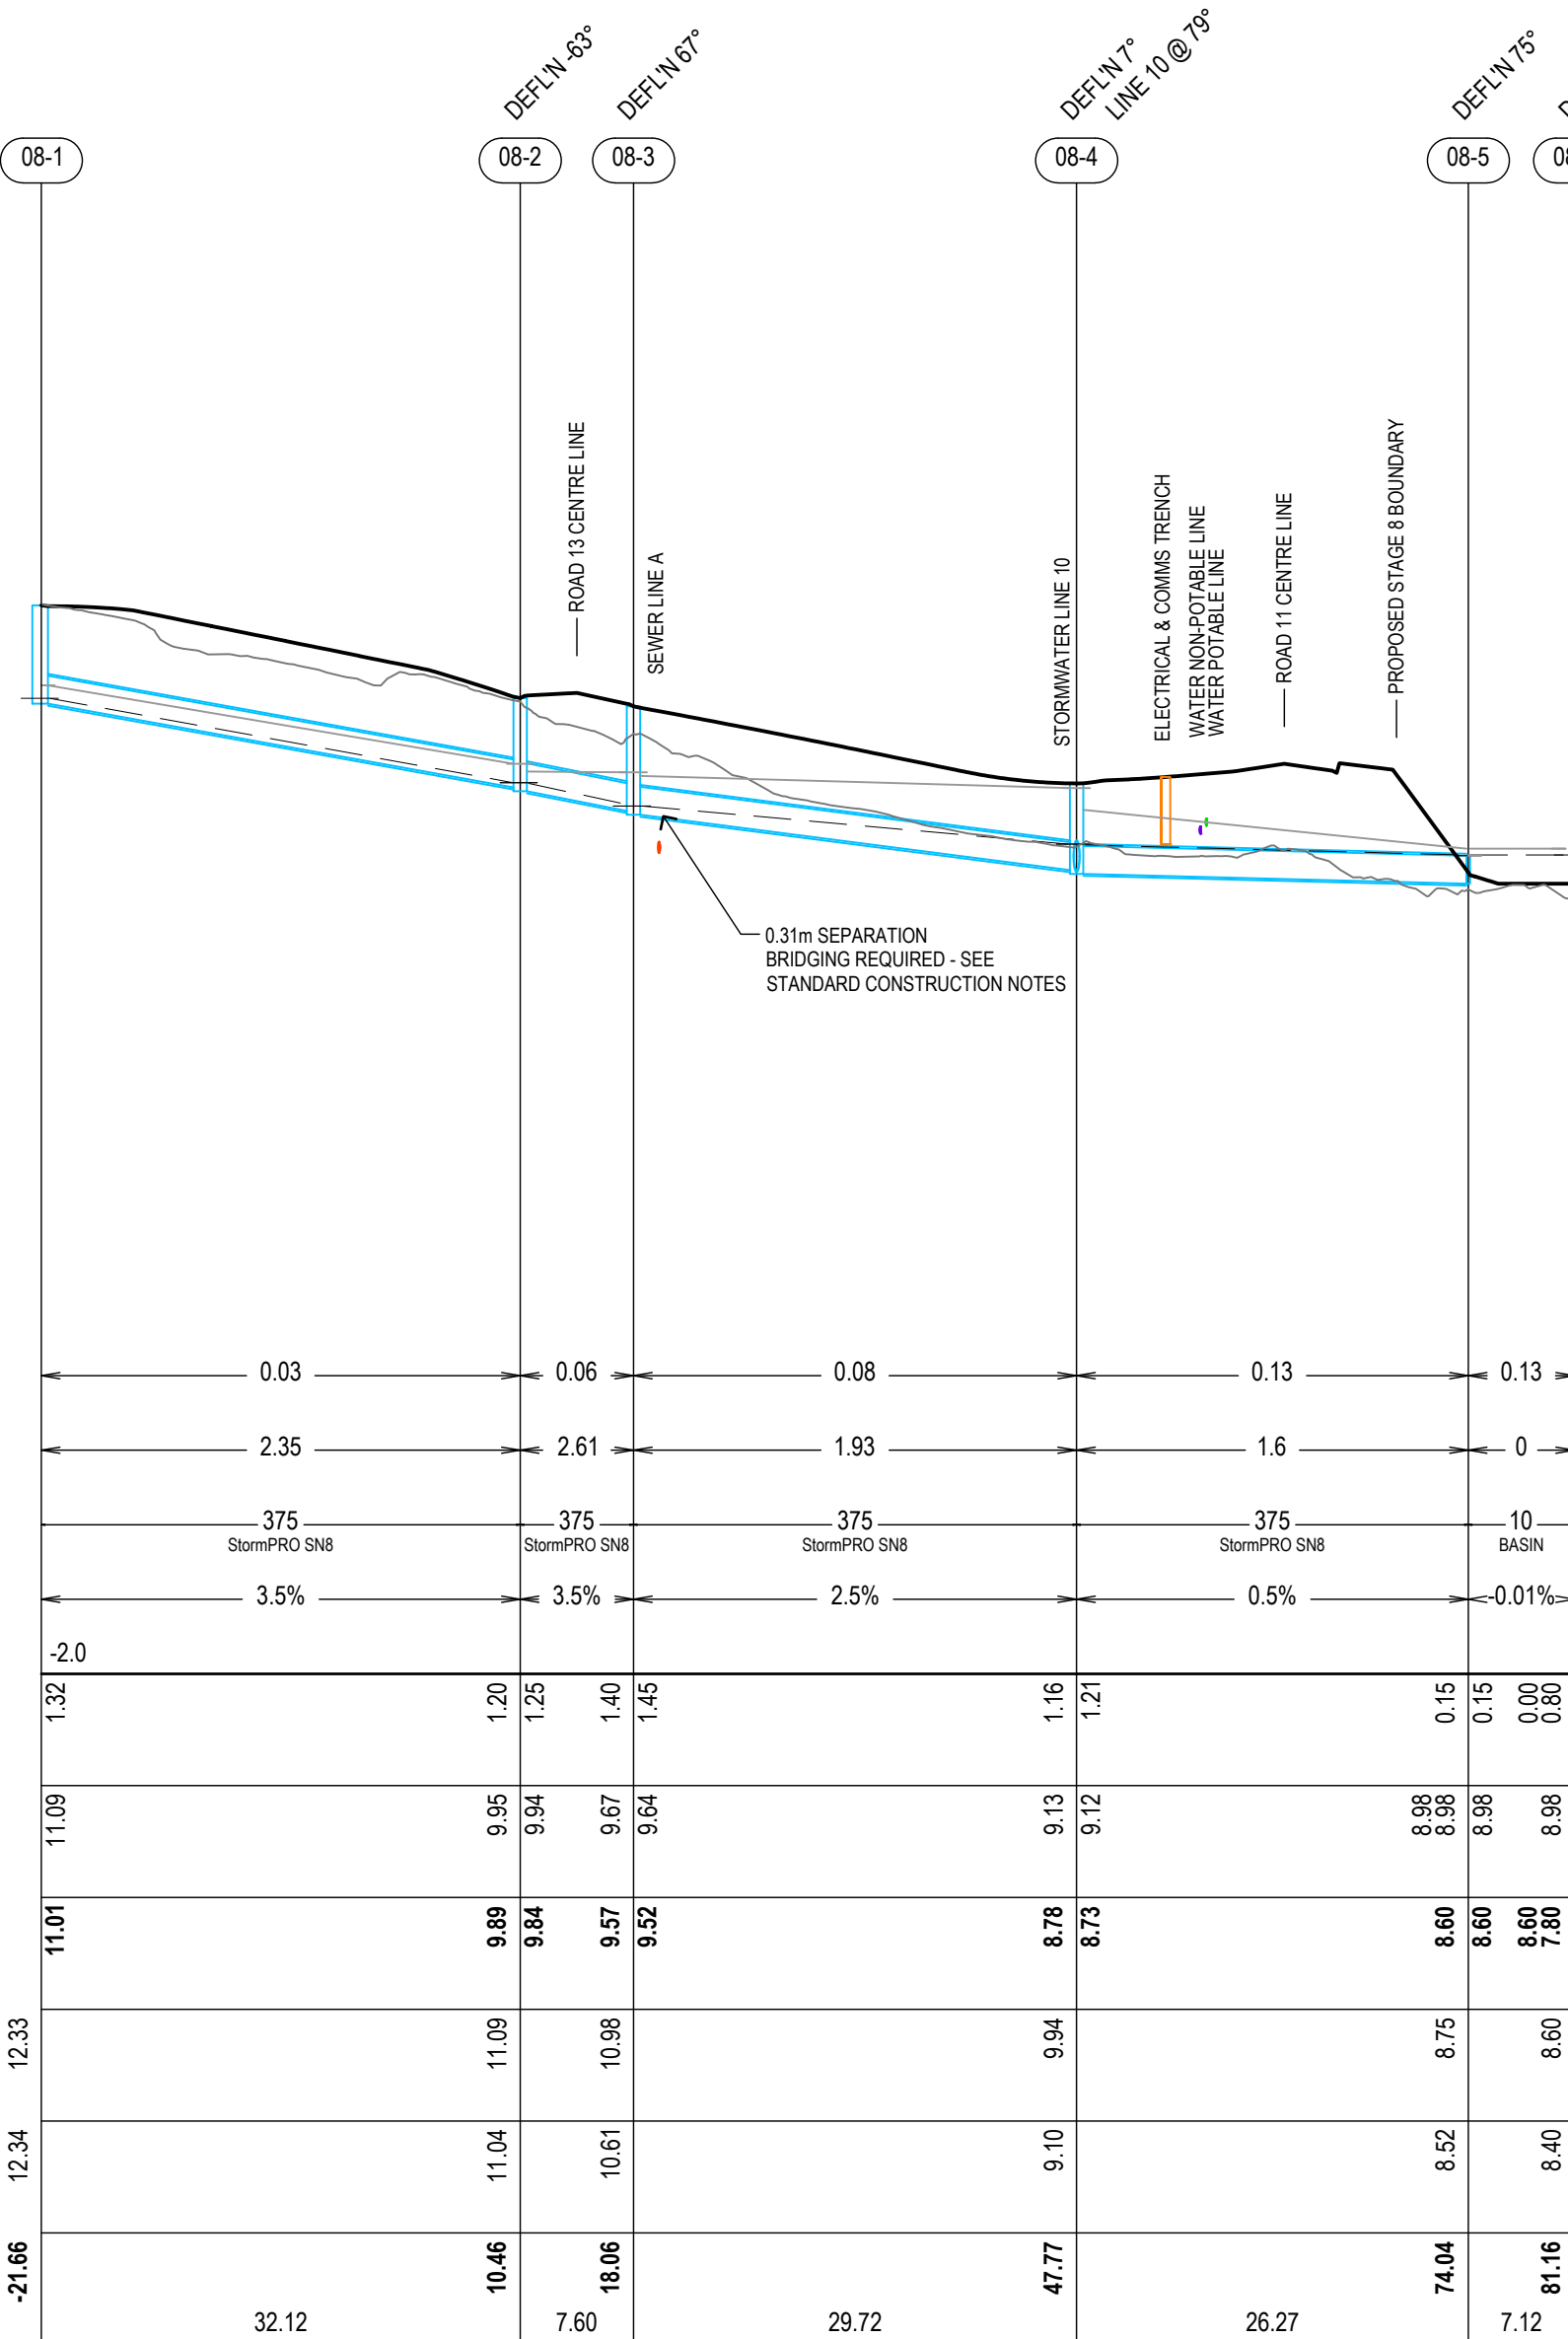

LINE 08


REV.	DATE	DESCRIPTION
A	31.10.2025	ISSUED FOR APPROVAL

DATUM: AHD
SCALE: AS SHOWN @ A1


NOTE: DO NOT SCALE OFF DRAWINGS. USE FIGURED DIMENSIONS ONLY. REPORT ANY DISCREPANCIES TO THE AUTHOR. THIS DRAWING BEING THE PROPERTY OF KING & CAMPBELL PTY LTD, IS PROTECTED BY COPYRIGHT AND MUST NOT BE USED, REPRODUCED OR COPIED WHOLLY, OR IN PART WITHOUT THE WRITTEN PERMISSION OF KING & CAMPBELL PTY LTD.
© King & Campbell Pty Ltd

PROJECT NO:	7197	DRAWING TITLE:	STORMWATER LONGITUDINAL SECTION - LINE 04 TO 08			
DA NO.:	2014-114	PROJECT:	THE SANCTUARY STAGE 8 LOT 300, DP 1307775 - JOHN OXLEY DRIVE, THURMSTER			
DESIGNED BY:	JSC/BC	CLIENT:	BIRD IN THE HAND 2 PTY LTD.	DRAWING NO:	7197_Stage 8_SWC_Sections	SHEET: 27 OF 36
DRAWN BY:	JSC			REVISION:	A	
CHECKED BY:	BC					
DATE CREATED:	JULY 2025					


M:\C-REF-017197_The Sanctuary\02_Engineering\Stages 8 and 9\2-STG 8 SWC\7197_Stage 8_SWC_Sections.dwg -A1(1)-SW.LS (3) 24 February 2026, jrmcc

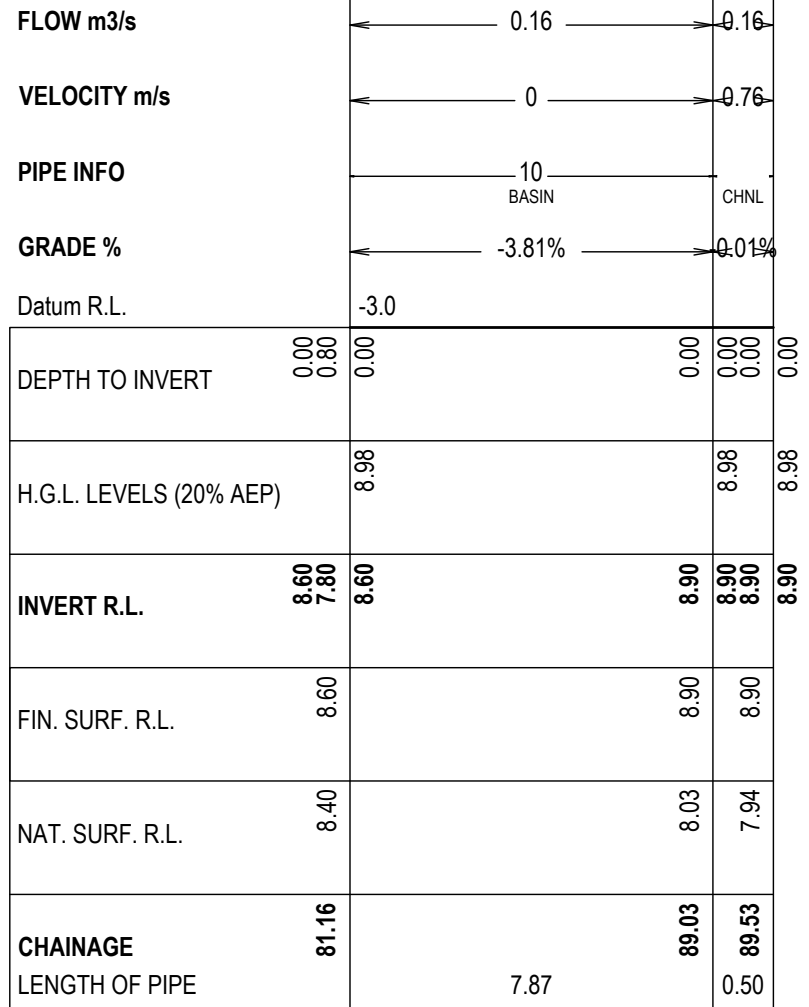


LINE 08

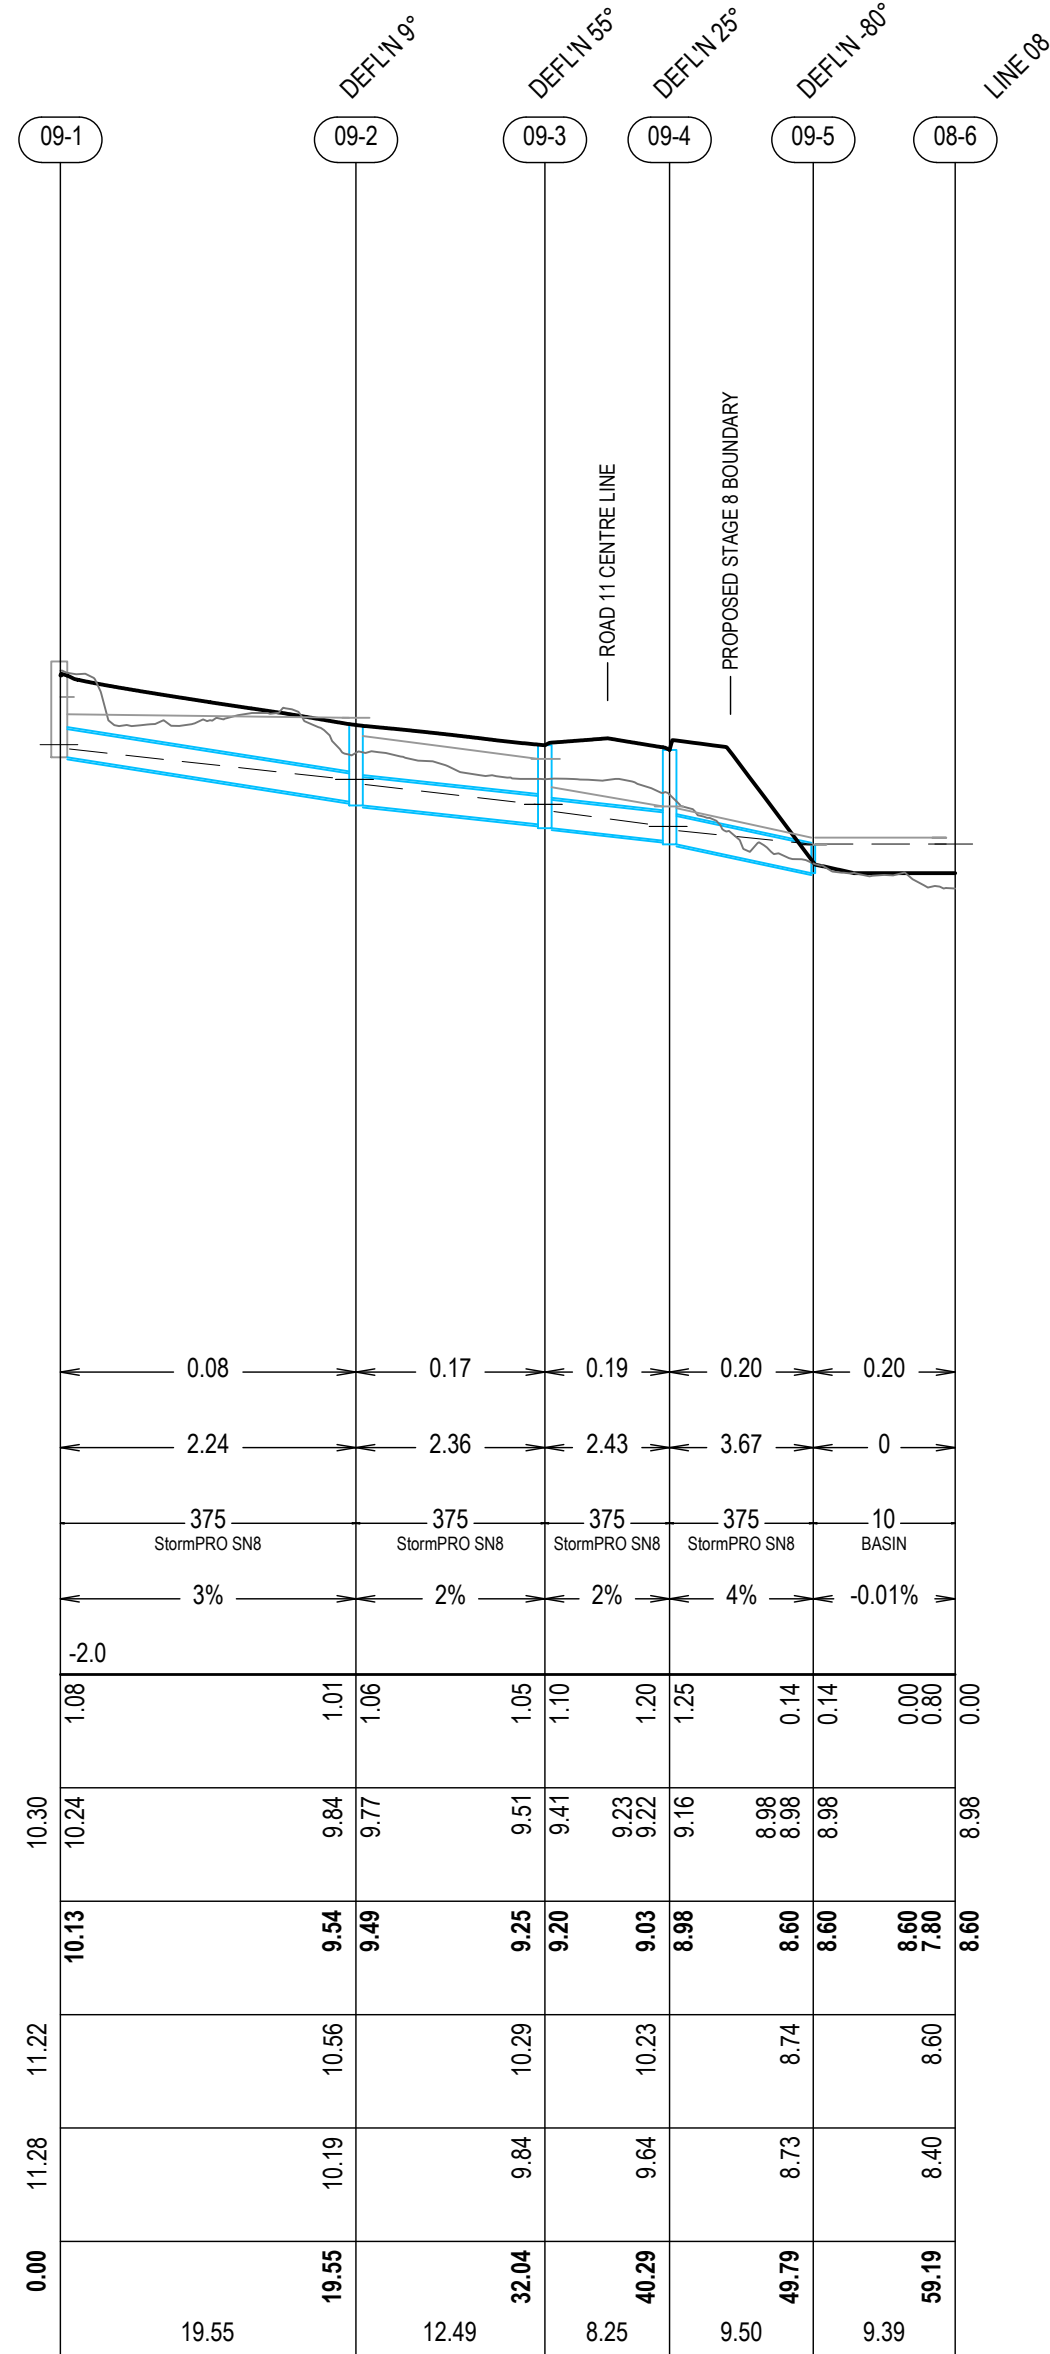


LINE 09

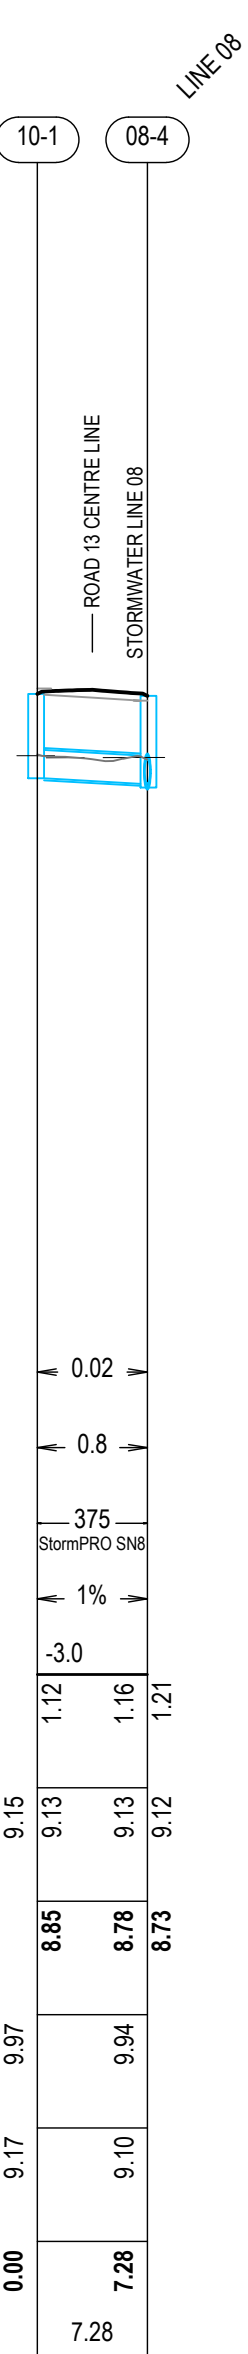


LINE 10

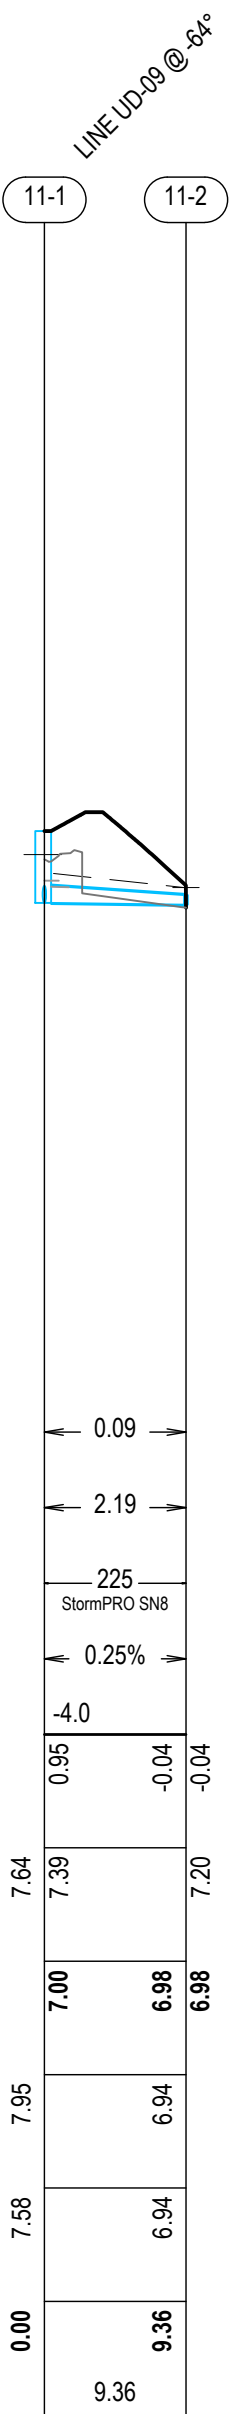

LINE 11

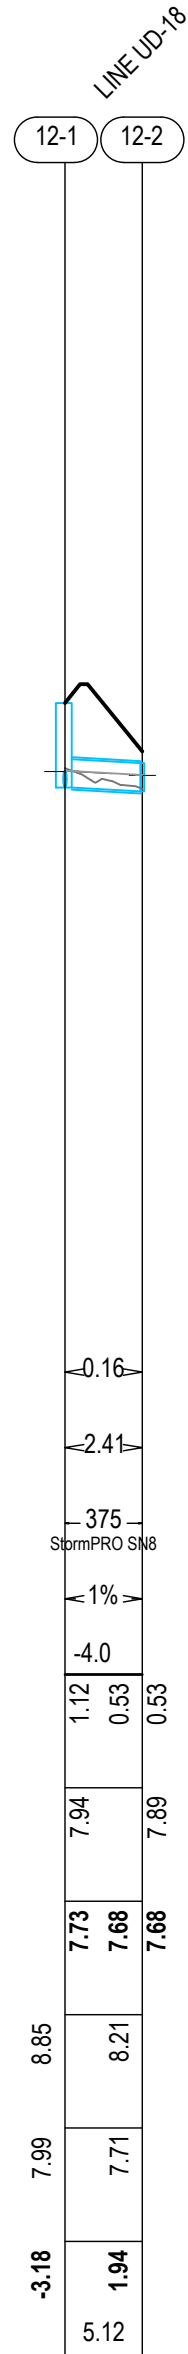

LINE 12



REV.	DATE	DESCRIPTION	
A	31.10.2025	ISSUED FOR APPROVAL	JSC

DATUM: AHD

SCALE: AS SHOWN @ A1

NOTE: DO NOT SCALE OFF DRAWINGS. USE FIGURED DIMENSIONS ONLY. REPORT ANY DISCREPANCIES TO THE AUTHOR. THIS DRAWING BEING THE PROPERTY OF KING & CAMPBELL PTY LTD, IS PROTECTED BY COPYRIGHT AND MUST NOT BE USED, REPRODUCED OR COPIED WHOLLY, OR IN PART WITHOUT THE WRITTEN PERMISSION OF KING & CAMPBELL PTY LTD. © King & Campbell Pty Ltd

PROJECT NO:	7197	DRAWING TITLE:	STORMWATER LONGITUDINAL SECTION - LINE 09 TO 12			
DA NO.:	2014-114					
DESIGNED BY:	JSC/BC	PROJECT:	THE SANCTUARY STAGE 8 LOT 300, DP 1307775 - JOHN OXLEY DRIVE, THURMSTER			
DRAWN BY:	JSC					
CHECKED BY:	BC	CLIENT:	BIRD IN THE HAND 2 PTY LTD.			
DATE CREATED:	JULY 2025					
		DRAWING NO:	7197_Stage 8_SWC_Sections	SHEET:	28 OF 36	REVISION:
						A

12d Dynamic Drainage Hydrology & Hydraulics Results

RUNOFF METHOD ILSAX 2

RETURN PERIOD 30

AEP/ARI AEP

EVENT MINOR

STORM DURATIONS RUN 120 90 60 45 30 25 20 15 10

NOTES All Results are maximums and Flows are in L/s
Negative Flow Values Indicate Reverse Flows

	NODE	CATCHMENTS (ha)			% IMPERVIOUS			Tc (min)					CATCHMENT FLOW (L/s)			APPROACH FLOW (L/s)	INLET CAPTURED FLOW (L/s)	MINOR SAG (%)	EFFICIENCIES				UNCAPTURED FLOW (L/s)	BYPASS NODE	BYPASS FLOW (L/s)	BYPASS HGL (m)	MID CH DEPTH (m)	NODE				LOST FLOW (L/s)	LINK HGL		Ku (AT MAX HEADLOSS)	Ku HEADLOSS
NAME	TYPE	AREA 1	AREA 2	AREA 3	AREA 1	AREA 2	AREA 3	IMPERV 1	PERV 1	IMPERV 2	PERV 2	IMPERV 3	PERV 3	SET 1	SET 2				SET 3	MINOR ONGRADE (%)	MAJOR SAG (%)	MAJOR ONGRADE (%)						HGL (m)	GRADE LEVEL (m)	INVERT LEVEL (m)	DEPTH (m)		UPSTREAM (m)	DOWNSTREAM (m)		
01-1	Grated Gully Pit 1.8m Lintel	0.1284			70	10		6	6					46			46	36	80	90	80	90	10	01-2	10	9.836	0.052	8.814	9.784	8.677	1.108		8.805	8.646		7
01-2	Junction Pit 0.6m x 0.9m	0.0418			70	10		6	6					15			24	21	80	90	80	90	2	01-3	2	9.644	0.033	8.646	9.611	8.461	1.149		8.591	8.602		1.9
01-3	Grated Gully Pit 1.8m Lintel	0.1025			70	10		6	6					36			39	31	80	90	80	90	7	02-1	7	9.439	0.048	8.602	9.391	8.22	1.171		8.59	8.482		1.3
01-4	Grated Gully Pit 1.8m Lintel	0.0702			70	10		6	6					25			25	22	80	90	80	90	3	01-5	3	9.289	0.039	8.482	9.249	8.035	1.215		8.391	8.297		1.5
01-5	Junction Pit 0.9m x 0.9m				70	10								3			3	3	80	90	80	90	0	01-6	0	9.133	0.017	8.297	9.116	7.884	1.233		8.285	8.214		0.5
01-6	Grated Gully Pit 1.8m Lintel	0.025						6	6					9			10	8	80	90	80	90	3	01-8	0	9.055	0.024	8.214	9.031	7.731	1.3		8.153	8.117		0.6
01-7	Headwall																0	0	100	100	100	100	0			8.148	0	8.117	8.148	7.7	0.448		8.117	8.117		0
01-8	BASIN	0.0573							6	6				21			21	21	100	100	100	100	3			8.5	0	8.117	8.5	7.7	1.6		8.117	8.117		0
01-9	CHNL																0	0	100	100	100	100	0			8.2	0	8.117	8.2	8	0.2		8.117	8.109		0
01-10	CHNL				70	10											0	0	100	100	100	100	0			8	0	8.109	8.2	8	0.2					
02-1	Grated Gully Pit 3.0m Lintel	0.1028			70	10		6	6					38			47	47	80	90	80	90	4	01-6	0	9.083	0.052	8.285	9.031	7.851	1.18		8.283	8.214		9.7
03-1	Flush Grate Surface Inlet Pit 0.9m x 0.9m	0.2074			70	10		6	6					73			73	73	80	90	80	90	1	03-2	0	12.376	0.062	10.892	12.315	10.755	1.56		10.891	9.008		7
03-2	Flush Grate Surface Inlet Pit 0.9m x 0.9m				70	10											0	0	80	90	80	90	0	LOST	0	10.025	0	9.008	10.025	8.816	1.209		8.981	8.708		1.8
03-3	Junction Pit 0.9m x 0.9m	0.1198			70	10		6	6					43			43	38	80	90	80	90	4	LOST	4	9.578	0.004	8.708	9.574	8.41	1.164		8.696	8.602		1.6
04-1	Flush Grate Surface Inlet Pit 0.9m x 0.9m	0.0386			70	10		6	6					14			14	12	80	90	80	90	1	04-3	1	10.091	0.002	8.983	10.09	8.904	1.186		8.966	8.927		7
04-2	Junction Pit 0.9m x 0.9m	0.075			70	10		6	6					27			27	24	80	90	80	90	3	04-3	3	9.91	0.002	8.927	9.908	8.647	1.26		8.794	8.747		4.8
04-3	Grated Gully Pit 1.8m Lintel	0.0657			70	10		6	6					23			27	24	80	90	80	90	4	06-1	2	9.665	0.03	8.747	9.635	8.561	1.073		8.726	8.702		1.1
04-4	Grated Gully Pit 1.8m Lintel	0.1486			70	10		6	6					53			53	40	80	90	80	90	12	04-5	12	9.616	0.056	8.702	9.56	8.427	1.133		8.7	8.577		2.3
04-5	Junction Pit 0.9m x 0.9m				70	10								12			12	12	80	90	80	90	1	04-6	1	9.434	0.026	8.577	9.408	8.249	1.159		8.563	8.405		0.6
04-6	Grated Gully Pit 1.8m Lintel	0.0624			70	10		6	6					22			24	23	80	90	80	90	5	04-7	0	9.265	0.046	8.405	9.218	8.014	1.204		8.404	8.317		0.8
04-7	Junction Pit 0.9m x 0.9m	0.1242			70	10		6	6					44			44	40	80	90	80	90	4	02-1	4	9.397	0.041	8.317	9.356	7.874	1.482		8.284	8.185		1
04-8	Grated Gully Pit 1.8m Lintel	0.0208			70	10		6	6					7			7	7	80	90	80	90	1	01-6	1	9.302	0.02	8.185	9.282	7.736	1.547		8.15	8.117		0.6
04-9	Headwall				70	10											0	0	100	100	100	100	0			8.223	0	8.117	8.223	7.7	0.523		8.117	8.117		0
05-1	Grated Gully Pit 1.8m Lintel	0.0181			70	10		6	6					6			8	7	80	90	80	90	1	04-8	0	9.802	0.012	8.888	9.789	8.84	0.949		8.883	8.833		9.7
05-2	Grated Gully Pit 1.8m Lintel	0.1222			70	10		6	6					43			43	35	80	90	80	90	9	05-3	8	9.805	0.05	8.833	9.755	8.708	1.047		8.821	8.572		5.7
05-3	Grated Gully Pit 1.8m Lintel	0.0609			70	10		6	6					22			30	25	80	90	80	90	5	06-1	1	9.559	0.021	8.567	9.538	8.419	1.119		8.562	8.267		2
06-1	Grated Gully Pit 1.8m Lintel	0.0645			70	10		6	6					23			25	18	80	90	80	90	14	04-6	0	9.3	0.039	8.424	9.26	8.255	1.005		8.388	8.405		9.7
07-1	Flush Grate Surface Inlet Pit 0.9m x 0.9m	0.0934			70	10		6	6					33			33	33	80	90	80	90	0	07-2	0	12.443	0.036	10.244	12.407	10.124	2.283		10.241	9.658		7
07-2	Flush Grate Surface Inlet Pit 0.9m x 0.9m	0.0828			70	10		6	6					29			29	29	80	90	80	90	6	06-1	0	11.348	0.033	9.658	11.315	9.474	1.841		9.63	9.236		2
07-3	Junction Pit 0.9m x 0.9m				70	10											0	0	80	90	80	90	0	05-3	0	10.756	0	9.182	10.756	9.052	1.704		9.177	8.622		2
07-4	Junction Pit 0.9m x 0.9m				70	10											0	0	80	90	80	90	0			10.175	0	8.606	10.175	8.457	1.718		8.606	8.577		0
08-1	Grated Gully Pit 1.8m Lintel	0.1161			70	10		6	6					41			41	33	80	90	80	90	8	08-2	8	12.378	0.038	11.248	12.34	11.182	1.158		11.247	9.643		7
08-2	Grated Gully Pit 1.8m Lintel	0.0875			70	10		6	6					31			39	31	80	90	80	90	7	10-1	7	10.7	0.041	9.641	10.659	9.526	1.133		9.638	9.381		2.2
08-3	Grated Gully Pit 1.8m Lintel	0.0551			70	10		6	6					19			19	18	80	90	80	90	2	08-4	2	10.551	0.026	9.381	10.525	9.21	1.315		9.374	9.14		1.8
08-4	Grated Gully Pit 1.8m Lintel	0.0824			70	10		6	6					29			31	30	80	90	80	90	7	05-2	0	9.984	0.055	9.14	9.929	8.863	1.066		9.102	8.984		1.3
08-5	Headwall				70	10											0	0	80	90	80	90	0			8.974	0	8.976	8.974	8.6	0.374		8.984	8.984		0
08-6	BASIN	0.0452			70	10		6	6					16			16	16	100	100	100	100	0			9.5	0	8.984	9.5	8.6	1.7		8.984	8.984		0
08-7	CHNL				70	10											0	0	100	100	100	100	0			9.1	0	8.984	9.1	8.9	0.2		8.984	8.976		0
08-8	CHNL				70	10											0	0	100	100	100	100	0			8.9	0	8.976	9.1	8.9	0.2					
09-1	Grated Gully Pit 1.8m Lintel	0.3989			70	10		6	6					141			141	81	80	90	80	90	60	09-2	60	11.472	0.072	10.298	11.4	10.131	1.269		10.24	9.839		7
09-2	Junction Pit 0.9m x 0.9m	0.1048			70	10		6																												

K:\C-REF-017197_The Sanctuary\02_Engineering\Stages 8 and 9\2 STG 8 SWC\017197_Stage 8_SWC_Stormwater Calcs.dwg 41(L) - MINOR 20% 5 May 2022 -Isaac

20% AEP STORM EVENT CHECKS

12d Dynamic Drainage Hydrology & Hydraulics Results

RUNOFF METHOD ILSAX 2
RETURN PERIOD 20
AEP/ARI AEP
EVENT MINOR

NODE		OUTLET PIPE													PIT		
NAME	NAME	DIAMETER (mm)	NUMBER OF PIPES	SEPARATION (m)	TYPE	LENGTH (m)	MIN COVER (M)	FLOW (L/s)	CAPACITY DEPTH RATIO	VELOCITY (m/s)	PIT FREEBOARD (m)	BYPASS FLOW (L/s)	U/S WIDTH (m)	D/S WIDTH (m)	U/S Vd RATIO	D/S Vd RATIO	FLOW DEPTH (m)
01-1	01-1 to 01-2	375	1	0.1	StormPRO SN8	20.64	0.7	37	0.16	1.23	0.97	10	1.12	1.12	0.02	0.02	0.05
01-2	01-2 to 01-3	375	1	0.1	StormPRO SN8	23.94	0.73	57	0.25	1.03	0.96	2	0.45	0.96	0.01	0.01	0.03
01-3	01-3 to 01-4	450	1	0.1	StormPRO SN8	16.93	0.69	198	0.54	1.75	0.79	7	0.96	1.12	0.02	0.02	0.05
01-4	01-4 to 01-5	450	1	0.1	StormPRO SN8	16.81	0.71	218	0.69	1.75	0.77	3	0.66	0.61	0.01	0.01	0.04
01-5	01-5 to 01-6	450	1	0.1	StormPRO SN8	17.14	0.75	221	0.69	1.96	0.84	0	0.19	0.28	0	0	0.02
01-6	01-6 to 01-7	450	1	0.1	StormPRO SN8	5.13		271	0.86	2.25	0.82	0	0	0	0	0	0.02
01-7	01-7 to 01-8	10	1	0.1	BASIN	13.95	-0.81	271			0.04						0
01-8	01-8 to 01-9	10	1	0.1	BASIN	10.17	-0.96	431			0.38						0
01-9	01-9 to 01-10	200	1	0.1	CHNL	0.5		431	1.34	0.94	0.09						0
01-10											-0.11						0
02-1	02-1 to 01-6	375	1	0.1	StormPRO SN8	7	0.81	46	0.18	0.5	0.75	0	0	0	0	0	0.05
03-1	03-1 to 03-2	225	1	0.1	StormPRO SN8	37.77	0.95	73	0.5	2.97	1.42	0	0	0	0	0	0.06
03-2	03-2 to 03-3	300	1	0.1	StormPRO SN8	35.66	0.71	77	0.55	1.54	1.02	0	0	0	0	0	0
03-3	03-3 to 01-3	375	1	0.1	StormPRO SN8	13.98	0.68	111	0.44	1.56	0.87	4	6	6	0	0	0
04-1	04-1 to 04-2	225	1	0.1	StormPRO SN8	16.5	0.92	14	0.18	0.68	1.11	1	6	6	0	0	0
04-2	04-2 to 04-3	225	1	0.1	StormPRO SN8	4.5	0.92	37	0.64	1.09	0.98	3	6	6	0	0	0
04-3	04-3 to 04-4	375	1	0.1	StormPRO SN8	10.6	0.67	60	0.27	1.33	0.89	2	0.39	0.69	0.01	0.01	0.03
04-4	04-4 to 04-5	375	1	0.1	StormPRO SN8	16	0.71	99	0.44	1.46	0.86	12	1.24	1.24	0.03	0.03	0.06
04-5	04-5 to 04-6	375	1	0.1	StormPRO SN8	23.04	0.74	169	0.75	1.84	0.83	1	0.29	0.9	0.01	0	0.03
04-6	04-6 to 04-7	450	1	0.1	StormPRO SN8	11.23	0.72	205	0.56	1.81	0.83	-1	0.21	0.66	0	0	0.05
04-7	04-7 to 04-8	450	1	0.1	StormPRO SN8	11.1	1	241	0.66	2.03	1.04	4	0.72	1.14	0.01	0.01	0.04
04-8	04-8 to 04-9	525	1	0.1	StormPRO SN8	4.45		310	0.56	2.46	1.1	1	0.22	0.28	0	0	0.02
04-9	04-9 to 01-8	10	1	0.1	BASIN	17.23	-0.81	310			0.11						0
05-1	05-1 to 05-2	375	1	0.1	StormPRO SN8	8.22	0.58	7	0.03	0.76	0.9	0	0.14	0.22	0	0	0.01
05-2	05-2 to 05-3	375	1	0.1	StormPRO SN8	23.84	0.64	42	0.17	1.47	0.92	8	1.04	1.04	0.02	0.02	0.05
05-3	05-3 to 04-8	375	1	0.1	StormPRO SN8	28.36	0.71	67	0.27	1.78	0.97	1	0.23	0.65	0	0	0.02
06-1	06-1 to 04-6	375	1	0.1	StormPRO SN8	9.55	0.64	21	0.06	0.52	0.84	0	0	0	0	0	0.04
07-1	07-1 to 07-2	225	1	0.1	StormPRO SN8	30	1.27	33	0.36	1.58	2.16	0	0	0	0	0	0.04
07-2	07-2 to 07-3	225	1	0.1	StormPRO SN8	18.62	1.2	61	0.66	2.03	1.66	0	0	0	0	0	0.03
07-3	07-3 to 07-4	300	1	0.1	StormPRO SN8	27.24	1.21	61	0.31	2.26	1.57	0	0	0	0	0	0
07-4	07-4 to 04-5	375	1	0.1	StormPRO SN8	15.83	0.66	61	0.25	1.24	1.57						0
08-1	08-1 to 08-2	375	1	0.1	StormPRO SN8	32.12	0.71	33	0.06	2.64	1.09	8	0.61	0.74	0.03	0.03	0.04
08-2	08-2 to 08-3	375	1	0.1	StormPRO SN8	7.61	0.77	65	0.14	2.3	1.02	7	0.74	1.32	0.03	0.02	0.04
08-3	08-3 to 08-4	375	1	0.1	StormPRO SN8	29.72	0.6	82	0.33	1.63	1.14	2	0.29	1.22	0.01	0.01	0.03
08-4	08-4 to 08-5	375	1	0.1	StormPRO SN8	26.27		141	0.56	1.96	0.79	0	0	0	0	0	0.05
08-5	08-5 to 08-6	10	1	0.1	BASIN	7.12	-0.81	141			0						0
08-6	08-6 to 08-7	10	1	0.1	BASIN	7.87	-0.95	145			0.53						0
08-7	08-7 to 08-8	200	1	0.1	CHNL	0.5		145	0.77	0.76	0.12						0
08-8											-0.08						0
09-1	09-1 to 09-2	375	1	0.1	RCP Class 3	19.55	0.62	81	0.19	2.12	1.1	60	1.7	1.7	0.09	0.09	0.07
09-2	09-2 to 09-3	375	1	0.1	StormPRO SN8	12.49	0.65	171	0.48	2.26	0.72	10	0.91	0.91	0.03	0.03	0.05
09-3	09-3 to 09-4	375	1	0.1	StormPRO SN8	8.25	0.73	190	0.53	2.41	0.79	3	0.33	1.37	0.02	0.01	0.03
09-4	09-4 to 09-5	375	1	0.1	StormPRO SN8	9.5		204	0.41	3.75	1.03	1	6	6	0	0	0
09-5	09-5 to 08-6	10	1	0.1	BASIN	9.39	-0.81	204			0						0
10-1	10-1 to 08-4	375	1	0.1	StormPRO SN8	7.28	0.57	31	0.13	0.61	0.73	0	0	0	0	0	0.06
11-1	11-1 to 11-2	375	1	0.1	StormPRO SN8	11.03	0.65	114	0.64	1.11	0.68	0	0	0	0	0	0
11-2	11-2 to 11-3	375	1	0.1	StormPRO SN8	3.99		114	0.64	1.31	0.82						0
11-3											-0.22						0
12-1	12-1 to 12-2	375	1	0.1	StormPRO SN8	5.12		155	0.61	2.4	0.91	0	0	0	0	0	0

5% AEP STORM EVENT CHECKS

12d Dynamic Drainage Hydrology & Hydraulics Results

RUNOFF METHOD ILSAX 2
RETURN PERIOD 5
AEP/ARI AEP
EVENT MINOR

NODE		OUTLET PIPE													PIT			
NAME	NAME	DIAMETER (mm)	NUMBER OF PIPES	SEPARATION (m)	TYPE	LENGTH (m)	MIN COVER (M)	FLOW (L/s)	CAPACITY DEPTH RATIO	VELOCITY (m/s)	PIT FREEBOARD (m)	BYPASS FLOW (L/s)	U/S WIDTH (m)	D/S WIDTH (m)	U/S Vd RATIO	D/S Vd RATIO	FLOW DEPTH (m)	
01-1	01-1 to 01-2	375	1	0.1	StormPRO SN8	20.64	0.7	52	0.23	1.03	0.53	19	1.5	1.5	0.03	0.03	0.06	
01-2	01-2 to 01-3	375	1	0.1	StormPRO SN8	23.94	0.73	81	0.36	0.72	0.41	4	0.67	1.27	0.01	0.01	0.04	
01-3	01-3 to 01-4	450	1	0.1	StormPRO SN8	16.93	0.69	270	0.74	1.71	0.26	13	1.27	1.66	0.03	0.02	0.06	
01-4	01-4 to 01-5	450	1	0.1	StormPRO SN8	16.81	0.71	297	0.97	1.94	0.34	6	0.96	0.93	0.02	0.02	0.05	
01-5	01-5 to 01-6	450	1	0.1	StormPRO SN8	17.14	0.75	302	0.99	1.95	0.53	1	0.23	0.38	0	0	0.02	
01-6	01-6 to 01-7	450	1	0.1	StormPRO SN8	5.13		382	1.21	2.51	0.65	0	0	0	0	0	0.03	
01-7	01-7 to 01-8	10	1	0.1	BASIN	13.95	-0.81	382			0						0	
01-8	01-8 to 01-9	10	1	0.1	BASIN	10.17	-0.96	717			0.34						0	
01-9	01-9 to 01-10	200	1	0.1	CHNL	0.5		717	2.47	1.09	0.04						0	
01-10											-0.15						0	
02-1	02-1 to 01-6	375	1	0.1	StormPRO SN8	7	0.81	67	0.27	0.61	0.5	0	0	0	0	0	0.07	
03-1	03-1 to 03-2	225	1	0.1	StormPRO SN8	37.77	0.95	103	0.69	2.83	0.99	0	0	0	0	0	0.08	
03-2	03-2 to 03-3	300	1	0.1	StormPRO SN8	35.66	0.71	104	0.72	1.42	0.41	0	0	0	0	0	0	
03-3	03-3 to 01-3	375	1	0.1	StormPRO SN8	13.98	0.68	151	0.6	1.38	0.28	6	6	6	0	0	0	
04-1	04-1 to 04-2	225	1	0.1	StormPRO SN8	16.5	0.92	20	0.27	0.57	0.65	3	6	6	0	0	0	
04-2	04-2 to 04-3	225	1	0.1	StormPRO SN8	4.5	0.92	49	0.81	1.19	0.45	4	6	6	0	0	0	
04-3	04-3 to 04-4	375	1	0.1	StormPRO SN8	10.6	0.67	80	0.36	1.09	0.34	5	0.77	1.27	0.02	0.01	0.04	
04-4	04-4 to 04-5	375	1	0.1	StormPRO SN8	16	0.71	126	0.56	1.28	0.34	23	1.61	1.61	0.04	0.04	0.07	
04-5	04-5 to 04-6	375	1	0.1	StormPRO SN8	23.04	0.74	227	1.01	2.07	0.34	2	0.41	1.3	0.01	0	0.03	
04-6	04-6 to 04-7	450	1	0.1	StormPRO SN8	11.23	0.72	297	0.8	1.84	0.47	-1	0.24	0.79	0	0	0.06	
04-7	04-7 to 04-8	450	1	0.1	StormPRO SN8	11.1	1	339	0.93	2.15	0.78	5	0.87	1.68	0.02	0.01	0.05	
04-8	04-8 to 04-9	525	1	0.1	StormPRO SN8	4.45		449	0.79	2.71	0.98	1	0.27	0.38	0	0	0.02	
04-9	04-9 to 01-8	10	1	0.1	BASIN	17.23	-0.81	449			0.06						0	
05-1	05-1 to 05-2	375	1	0.1	StormPRO SN8	8.22	0.58	16	0.04	0.57	0.88	0	0.19	0.27	0	0	0.01	
05-2	05-2 to 05-3	375	1	0.1	StormPRO SN8	23.84	0.64	55	0.22	1.47	0.89	16	1.39	1.39	0.03	0.03	0.06	
05-3	05-3 to 04-8	375	1	0.1	StormPRO SN8	28.36	0.71	92	0.36	1.87	0.93	4	0.48	1.25	0.02	0.01	0.04	
06-1	06-1 to 04-6	375	1	0.1	StormPRO SN8	9.55	0.64	35	0.4	0.52	0.44	0	0	0	0	0	0.06	
07-1	07-1 to 07-2	225	1	0.1	StormPRO SN8	30	1.27	46	0.5	1.52	2.04	0	0	0	0	0	0.05	
07-2	07-2 to 07-3	225	1	0.1	StormPRO SN8	18.62	1.2	88	0.95	2.31	1.41	0	0	0	0	0	0.04	
07-3	07-3 to 07-4	300	1	0.1	StormPRO SN8	27.24	1.21	87	0.44	2.27	1.44	0	0	0	0	0	0	
07-4	07-4 to 04-5	375	1	0.1	StormPRO SN8	15.83	0.66	89	0.35	0.85	1.04	0	0	0	0	0	0	
08-1	08-1 to 08-2	375	1	0.1	StormPRO SN8	32.12	0.71	44	0.08	2.61	1.09	15	0.93	1.13	0.05	0.04	0.05	
08-2	08-2 to 08-3	375	1	0.1	StormPRO SN8	7.61	0.77	92	0.19	2.08	0.96	15	1.13	2.04	0.04	0.02	0.05	
08-3	08-3 to 08-4	375	1	0.1	StormPRO SN8	29.72	0.6	109	0.43	1.57	1.03	4	0.53	1.72	0.02	0.01	0.04	
08-4	08-4 to 08-5	375	1	0.1	StormPRO SN8	26.27		197	0.78	2.15	0.54	0	0	0	0	0	0.07	
08-5	08-5 to 08-6	10	1	0.1	BASIN	7.12	-0.81	197			0						0	
08-6	08-6 to 08-7	10	1	0.1	BASIN	7.87	-0.95	331			0.47						0	
08-7	08-7 to 08-8	200	1	0.1	CHNL	0.5		331	1.35	0.97	0.06						0	
08-8											-0.13						0	
09-1	09-1 to 09-2	375	1	0.1	RCP Class 3	19.55	0.62	106	0.24	1.19	0.86	98	2.07	2.09	0.12	0.12	0.08	
09-2	09-2 to 09-3	375	1	0.1	StormPRO SN8	12.49	0.65	236	0.66	2.15	0.31	15	1.13	1.13	0.04	0.04	0.05	
09-3	09-3 to 09-4	375	1	0.1	StormPRO SN8	8.25	0.73	271	0.74	2.6	0.5	5	0.75	2.13	0.02	0.01	0.04	
09-4	09-4 to 09-5	375	1	0.1	StormPRO SN8	9.5	0.73	281	0.56	3.82	0.67	3	6	6	0	0	0	
09-5	09-5 to 08-6	10	1	0.1	BASIN	9.39	-0.81	291			0						0	
10-1	10-1 to 08-4	375	1	0.1	StormPRO SN8	7.28	0.57	50	0.2	0.5	0.47	0	0	0	0	0	0.08	
11-1	11-1 to 11-2	375	1	0.1	StormPRO SN8	11.03	0.65	116	0.65	1.13	0.67	0	0	0	0	0	0	
11-2	11-2 to 11-3	375	1	0.1	StormPRO SN8	3.99		116	0.65	1.31	0.81						0	
11-3											-0.22						0	
12-1	12-1 to 12-2	375	1	0.1	StormPRO SN8	5.12		158	0.63	2.42	0.9	0	0	0	0	0	0	

K:\C-REF-017197_The Sanctuary\02_Engineering\Stages 8 and 9\2 STG 8 SWC\7197_Stage 8_SWC_Stormwater Calcs.dwg 41(L) MAJOR 1% 5 May 2022, blanc

1% AEP STORM EVENT CHECKS

12d Dynamic Drainage Hydrology & Hydraulics Results

RUNOFF METHOD ILSAX 2
RETURN PERIOD 1
AEP/ARI AEP
EVENT MAJOR

NODE		OUTLET PIPE									PIT						
NAME	NAME	DIAMETER (mm)	NUMBER OF PIPES	SEPARATION (m)	TYPE	LENGTH (m)	MIN COVER (M)	FLOW (L/s)	CAPACITY DEPTH RATIO	VELOCITY (m/s)	PIT FREEBOARD (m)	BYPASS FLOW (L/s)	U/S WIDTH (m)	D/S WIDTH (m)	U/S Vd RATIO	D/S Vd RATIO	FLOW DEPTH (m)
01-1	01-1 to 01-2	375	1	0.1	StormPRO SN8	20.64	0.7	59	0.26	0.59	0.19	29	1.84	1.84	0.04	0.04	0.07
01-2	01-2 to 01-3	375	1	0.1	StormPRO SN8	23.94	0.73	109	0.49	1	0.07	5	0.85	1.61	0.02	0.01	0.05
01-3	01-3 to 01-4	450	1	0.1	StormPRO SN8	16.93	0.69	319	0.88	2.03	-0.07	22	1.61	2.28	0.04	0.02	0.07
01-4	01-4 to 01-5	450	1	0.1	StormPRO SN8	16.81	0.71	352	1.12	2.23	0.08	10	1.19	1.16	0.02	0.02	0.05
01-5	01-5 to 01-6	450	1	0.1	StormPRO SN8	17.14	0.75	360	1.14	2.29	0.35	1	0.28	0.7	0	0	0.03
01-6	01-6 to 01-7	450	1	0.1	StormPRO SN8	5.13		463	1.47	2.94	0.52	0	0	0	0	0	0.04
01-7	01-7 to 01-8	10	1	0.1	BASIN	13.95	-0.81	463			0						0
01-8	01-8 to 01-9	10	1	0.1	BASIN	10.17	-0.96	936			0.32						0
01-9	01-9 to 01-10	200	1	0.1	CHNL	0.5		936	3.1	1.18	0						0
01-10											-0.18						0
02-1	02-1 to 01-6	375	1	0.1	StormPRO SN8	7	0.81	95	0.38	0.88	0.36	0	0	0	0	0	0.09
03-1	03-1 to 03-2	225	1	0.1	StormPRO SN8	37.77	0.95	128	0.87	3.19	-0.1	11	6	6	0	0	0.1
03-2	03-2 to 03-3	300	1	0.1	StormPRO SN8	35.66	0.71	136	0.97	1.92	-0.01	21	6	6	0	0	0.01
03-3	03-3 to 01-3	375	1	0.1	StormPRO SN8	13.98	0.68	182	0.72	1.65	-0.02	50	6	6	0.01	0.01	0.02
04-1	04-1 to 04-2	225	1	0.1	StormPRO SN8	16.5	0.92	23	0.31	0.59	0.12	4	6	6	0	0	0
04-2	04-2 to 04-3	225	1	0.1	StormPRO SN8	2.5	0.92	62	1.06	1.56	0	14	6	6	0	0	0
04-3	04-3 to 04-4	375	1	0.1	StormPRO SN8	10.6	0.67	106	0.47	0.97	-0.06	21	1.59	1.78	0.03	0.02	0.07
04-4	04-4 to 04-5	375	1	0.1	StormPRO SN8	16	0.71	156	0.69	1.41	-0.1	63	2.44	3.3	0.07	0.06	0.09
04-5	04-5 to 04-6	375	1	0.1	StormPRO SN8	23.04	0.74	271	1.21	2.47	-0.12	128	2.36	4.45	0.06	0.07	0.09
04-6	04-6 to 04-7	450	1	0.1	StormPRO SN8	11.23	0.72	369	1.01	2.57	-0.15	-1	0.26	0.93	0.01	0	0.15
04-7	04-7 to 04-8	450	1	0.1	StormPRO SN8	11.1	1	449	1.15	2.66	0.53	7	1.03	2.29	0.02	0.01	0.05
04-8	04-8 to 04-9	525	1	0.1	StormPRO SN8	4.45		560	1.02	2.64	0.86	1	0.31	0.7	0.01	0.01	0.03
04-9	04-9 to 01-8	10	1	0.1	BASIN	17.23	-0.81	560			0.04						0
05-1	05-1 to 05-2	375	1	0.1	StormPRO SN8	8.22	0.58	15	0.06	0.57	0.84	1	0.24	0.31	0	0	0.02
05-2	05-2 to 05-3	375	1	0.1	StormPRO SN8	23.84	0.64	71	0.29	1.46	0.84	26	1.72	1.72	0.04	0.04	0.07
05-3	05-3 to 04-8	375	1	0.1	StormPRO SN8	28.36	0.71	119	0.47	1.88	0.88	8	1.2	2.77	0.04	0.02	0.05
06-1	06-1 to 04-6	375	1	0.1	StormPRO SN8	9.55	0.64	103	0.29	0.47	-0.1	-26	6.7	27.78	0.01	0	0.07
07-1	07-1 to 07-2	225	1	0.1	StormPRO SN8	30	1.27	58	0.66	1.44	1.13	0	0	0	0	0	0.06
07-2	07-2 to 07-3	225	1	0.1	StormPRO SN8	18.62	1.2	110	1.18	2.88	0.46	0	0	0	0	0	0.05
07-3	07-3 to 07-4	300	1	0.1	StormPRO SN8	27.24	1.21	115	0.58	1.63	0.81	0	0	0	0	0	0
07-4	07-4 to 04-5	375	1	0.1	StormPRO SN8	15.83	0.66	110	0.44	1.05	0.62						0
08-1	08-1 to 08-2	375	1	0.1	StormPRO SN8	32.12	0.71	54	0.1	2.42	1.08	25	1.15	1.41	0.06	0.05	0.05
08-2	08-2 to 08-3	375	1	0.1	StormPRO SN8	7.61	0.77	118	0.25	1.91	0.45	26	1.41	3.22	0.05	0.02	0.06
08-3	08-3 to 08-4	375	1	0.1	StormPRO SN8	29.72	0.6	138	0.55	1.3	0.43	7	0.76	3.16	0.02	0.01	0.04
08-4	08-4 to 08-5	375	1	0.1	StormPRO SN8	26.27		310	1.23	2.65	0.05	0	0.16	1.73	0	0	0.11
08-5	08-5 to 08-6	10	1	0.1	BASIN	7.12	-0.81	310			0						0
08-6	08-6 to 08-7	10	1	0.1	BASIN	7.87	-0.95	509			0.43						0
08-7	08-7 to 08-8	200	1	0.1	CHNL	0.5		509	2.54	1.08	0.04						0
08-8											-0.16						0
09-1	09-1 to 09-2	375	1		RCP Class 3	19.55	0.62	125	0.29	1.13	0.47	146	2.41	2.46	0.15	0.15	0.09
09-2	09-2 to 09-3	375	1	0.1	StormPRO SN8	12.49	0.65	287	0.81	2.61	-0.09	113	2.59	2.59	0.1	0.1	0.09
09-3	09-3 to 09-4	375	1	0.1	StormPRO SN8	8.25	0.73	322	0.91	3.07	0.19	56	2.03	3.28	0.07	0.04	0.08
09-4	09-4 to 09-5	375	1	0.1	StormPRO SN8	9.5		344	0.68	3.26	0.76	5	6	6	0	0	0
09-5	09-5 to 08-6	10	1	0.1	BASIN	9.39	-0.81	344			0						0
10-1	10-1 to 08-4	375	1	0.1	StormPRO SN8	7.28	0.57	83	0.35	0.8	-0.11	38	8.49	18.45	0.01	0	0.11
11-1	11-1 to 11-2	375	1	0.1	StormPRO SN8	11.03	0.65	117	0.66	1.13	0.66	0	0	0	0	0	0
11-2	11-2 to 11-3	375	1	0.1	StormPRO SN8	3.99		117	0.66	1.31	0.81						0
11-3											-0.22						0
12-1	12-1 to 12-2	375	1	0.1	StormPRO SN8	5.12		160	0.64	2.43	0.9	0	0	0	0	0	0

REV.	DATE	DESCRIPTION	BY
A	31.10.2025	ISSUED FOR APPROVAL	JSC

DATUM:

SCALE:

NOTE: DO NOT SCALE OFF DRAWINGS. USE FIGURED DIMENSIONS ONLY. REPORT ANY DISCREPANCIES TO THE AUTHOR. THIS DRAWING BEING THE PROPERTY OF KING & CAMPBELL PTY LTD, IS PROTECTED BY COPYRIGHT AND MUST NOT BE USED, REPRODUCED OR COPIED WHOLLY, OR IN PART WITHOUT THE WRITTEN PERMISSION OF KING & CAMPBELL PTY LTD.
© King & Campbell Pty Ltd

PROJECT NO:	7197	DRAWING TITLE:	STORMWATER RESULTS - MAJOR 1% AEP										A1			
DA NO.:	2014-114															
DESIGNED BY:	JSC/BC	PROJECT:	THE SANCTUARY STAGE 8 LOT 300, DP 1307775 - JOHN OXLEY DRIVE, THURMSTER													
DRAWN BY:	JSC															
CHECKED BY:	BC	CLIENT:	BIRD IN THE HAND 2 PTY LTD.											DRAWING NO:	SHEET:	REVISION:
DATE CREATED:	JULY 2025													7197_Stage 8_SWC_Stormwater Calcs	31 OF 36	A

K:\C-REF_01797_The Sanctuary\02_Engineering\Stages 8 and 9\2 STG 8 SWC\7197_Stage 8_SWC_Sections.dwg - A1(1)-SEW(1) S1 01_24 February 2025_james

SEWER CONSTRUCTION NOTES:
*GRADE IS CALCULATED FROM INSIDE FACE OF MANHOLES.
DEPTH TO INVERT IS CALCULATED FROM TOP OF MANHOLE (75mm ABOVE FINISHED SURFACE R.L.).
ENSURE MANHOLES ARE CONSTRUCTED TO LEVELS AS SHOWN.

EQUIVALENT TENEMENTS
MINIMUM
MAXIMUM

PIPE INFO

GRADE %

Datum R.L.

DEPTH TO INVERT	2.05	2.25	2.22	0.55
INVERT R.L.	10.20	9.22	8.94	8.45
TOP OF MANHOLE LEVEL	12.25	11.47	11.15	9.01
CHAINAGE	0.00	20.12	32.28	68.73
LENGTH OF PIPE	19.47	17.16	30.45	

LINE A

King & Campbell Pty Ltd
www.kingcampbell.com.au
A: PO Box 243 Port Macquarie NSW 2444
T: 02 6586 2555
F: 02 6583 4064
E: info@kingcampbell.com.au

REV.	DATE	DESCRIPTION
A	31.10.2025	ISSUED FOR APPROVAL

DATUM: AHD

SCALE: AS SHOWN @ A1


NOTE: DO NOT SCALE OFF DRAWINGS. USE FIGURED DIMENSIONS ONLY. REPORT ANY DISCREPANCIES TO THE AUTHOR. THIS DRAWING BEING THE PROPERTY OF KING & CAMPBELL PTY LTD, IS PROTECTED BY COPYRIGHT AND MUST NOT BE USED, REPRODUCED OR COPIED WHOLLY, OR IN PART, WITHOUT THE WRITTEN PERMISSION OF KING & CAMPBELL PTY LTD.
© King & Campbell Pty Ltd

PROJECT NO:	7197
DA NO.:	2014-114
DESIGNED BY:	JSC/BC
DRAWN BY:	JSC
CHECKED BY:	BC
DATE CREATED:	JULY 2025

DRAWING TITLE:	SEWER LONGITUDINAL SECTION - LINE A TO C
PROJECT:	THE SANCTUARY STAGE 8 LOT 300, DP 1307775 - JOHN OXLEY DRIVE, THURMSTER
CLIENT:	BIRD IN THE HAND 2 PTY LTD.

DRAWING NO:	SHEET:	REVISION:
7197_Stage 8_SWC_Sections	32 OF 36	A

KING + CAMPBELL

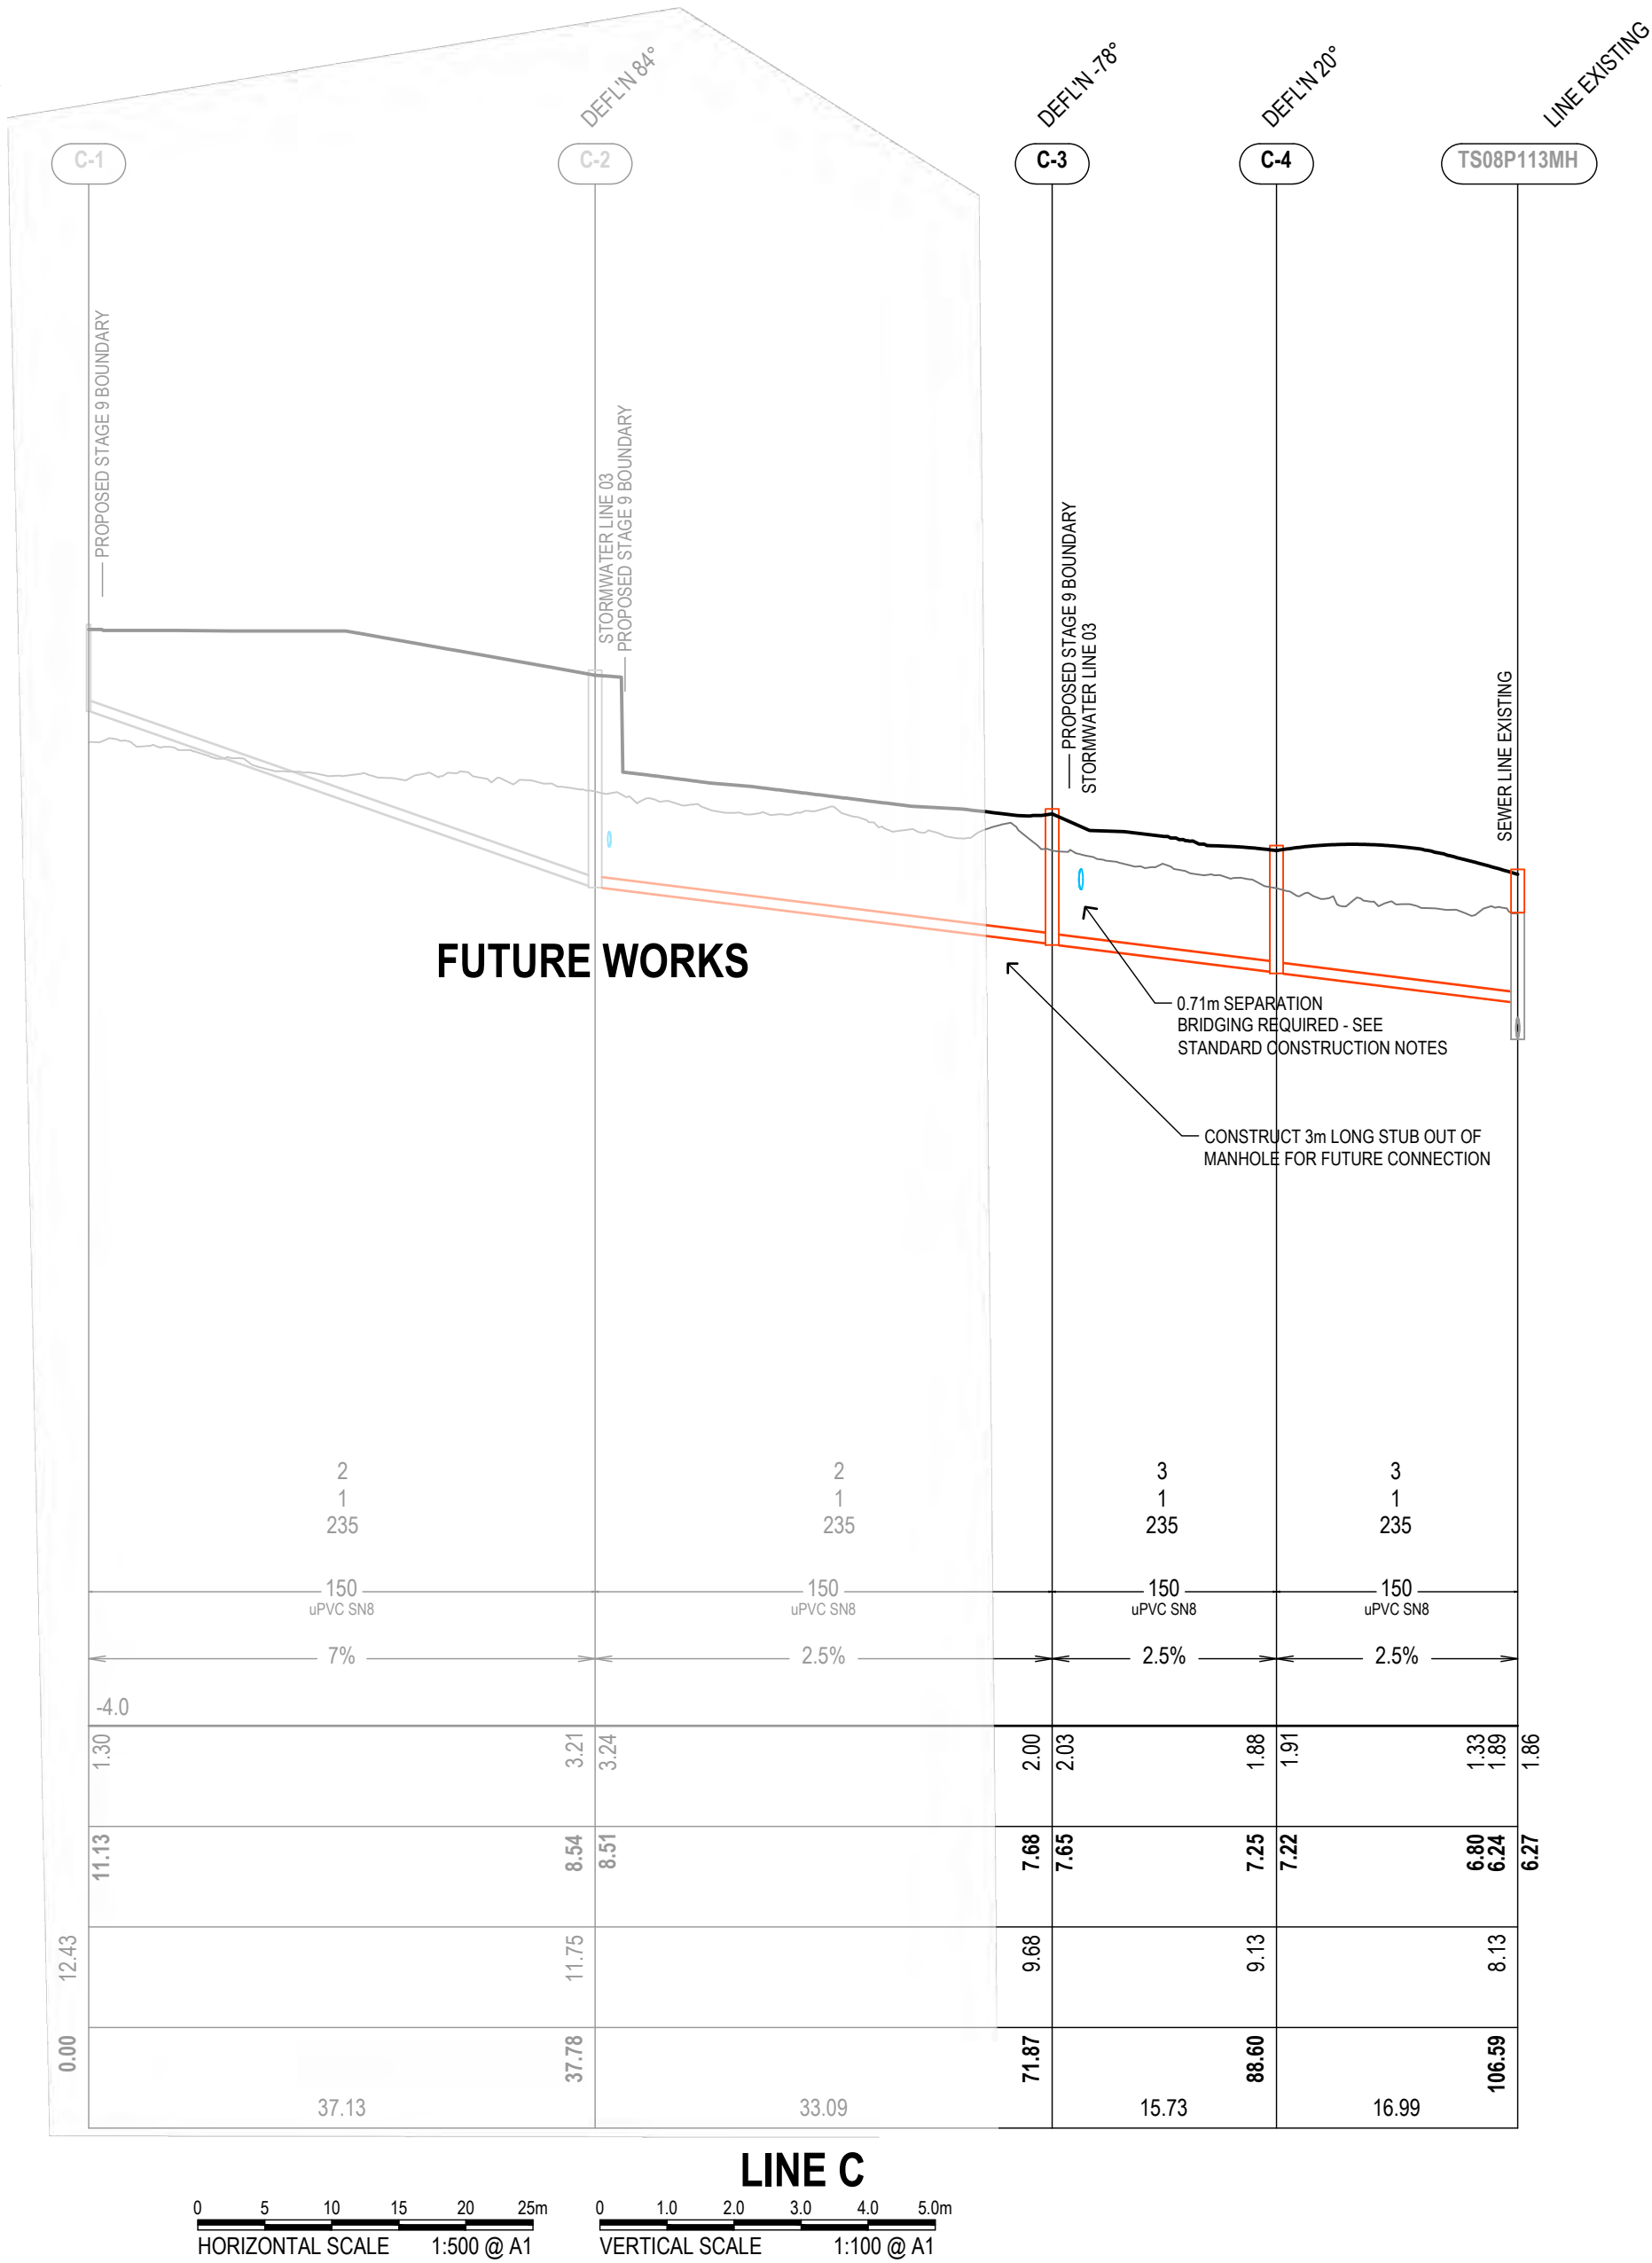

NOT TO BE USED FOR CONSTRUCTION UNLESS SUBDIVISION WORKS CERTIFICATE ISSUED FOR THE WORKS

A1

K:\C-REF-01797_The Sanctuary\02_Engineering\Stages 8 and 9\2-STG8 SWC\2107_Stage 8_SWC_Plan.dwg 4/11/2024 12:24 February 2026 jamesc

Look up
and live


For safety tips visit
essentialenergy.com.au/safety
or in an emergency call
13 20 80

essential
energy



BEFORE
YOU DIG

www.byda.com.au

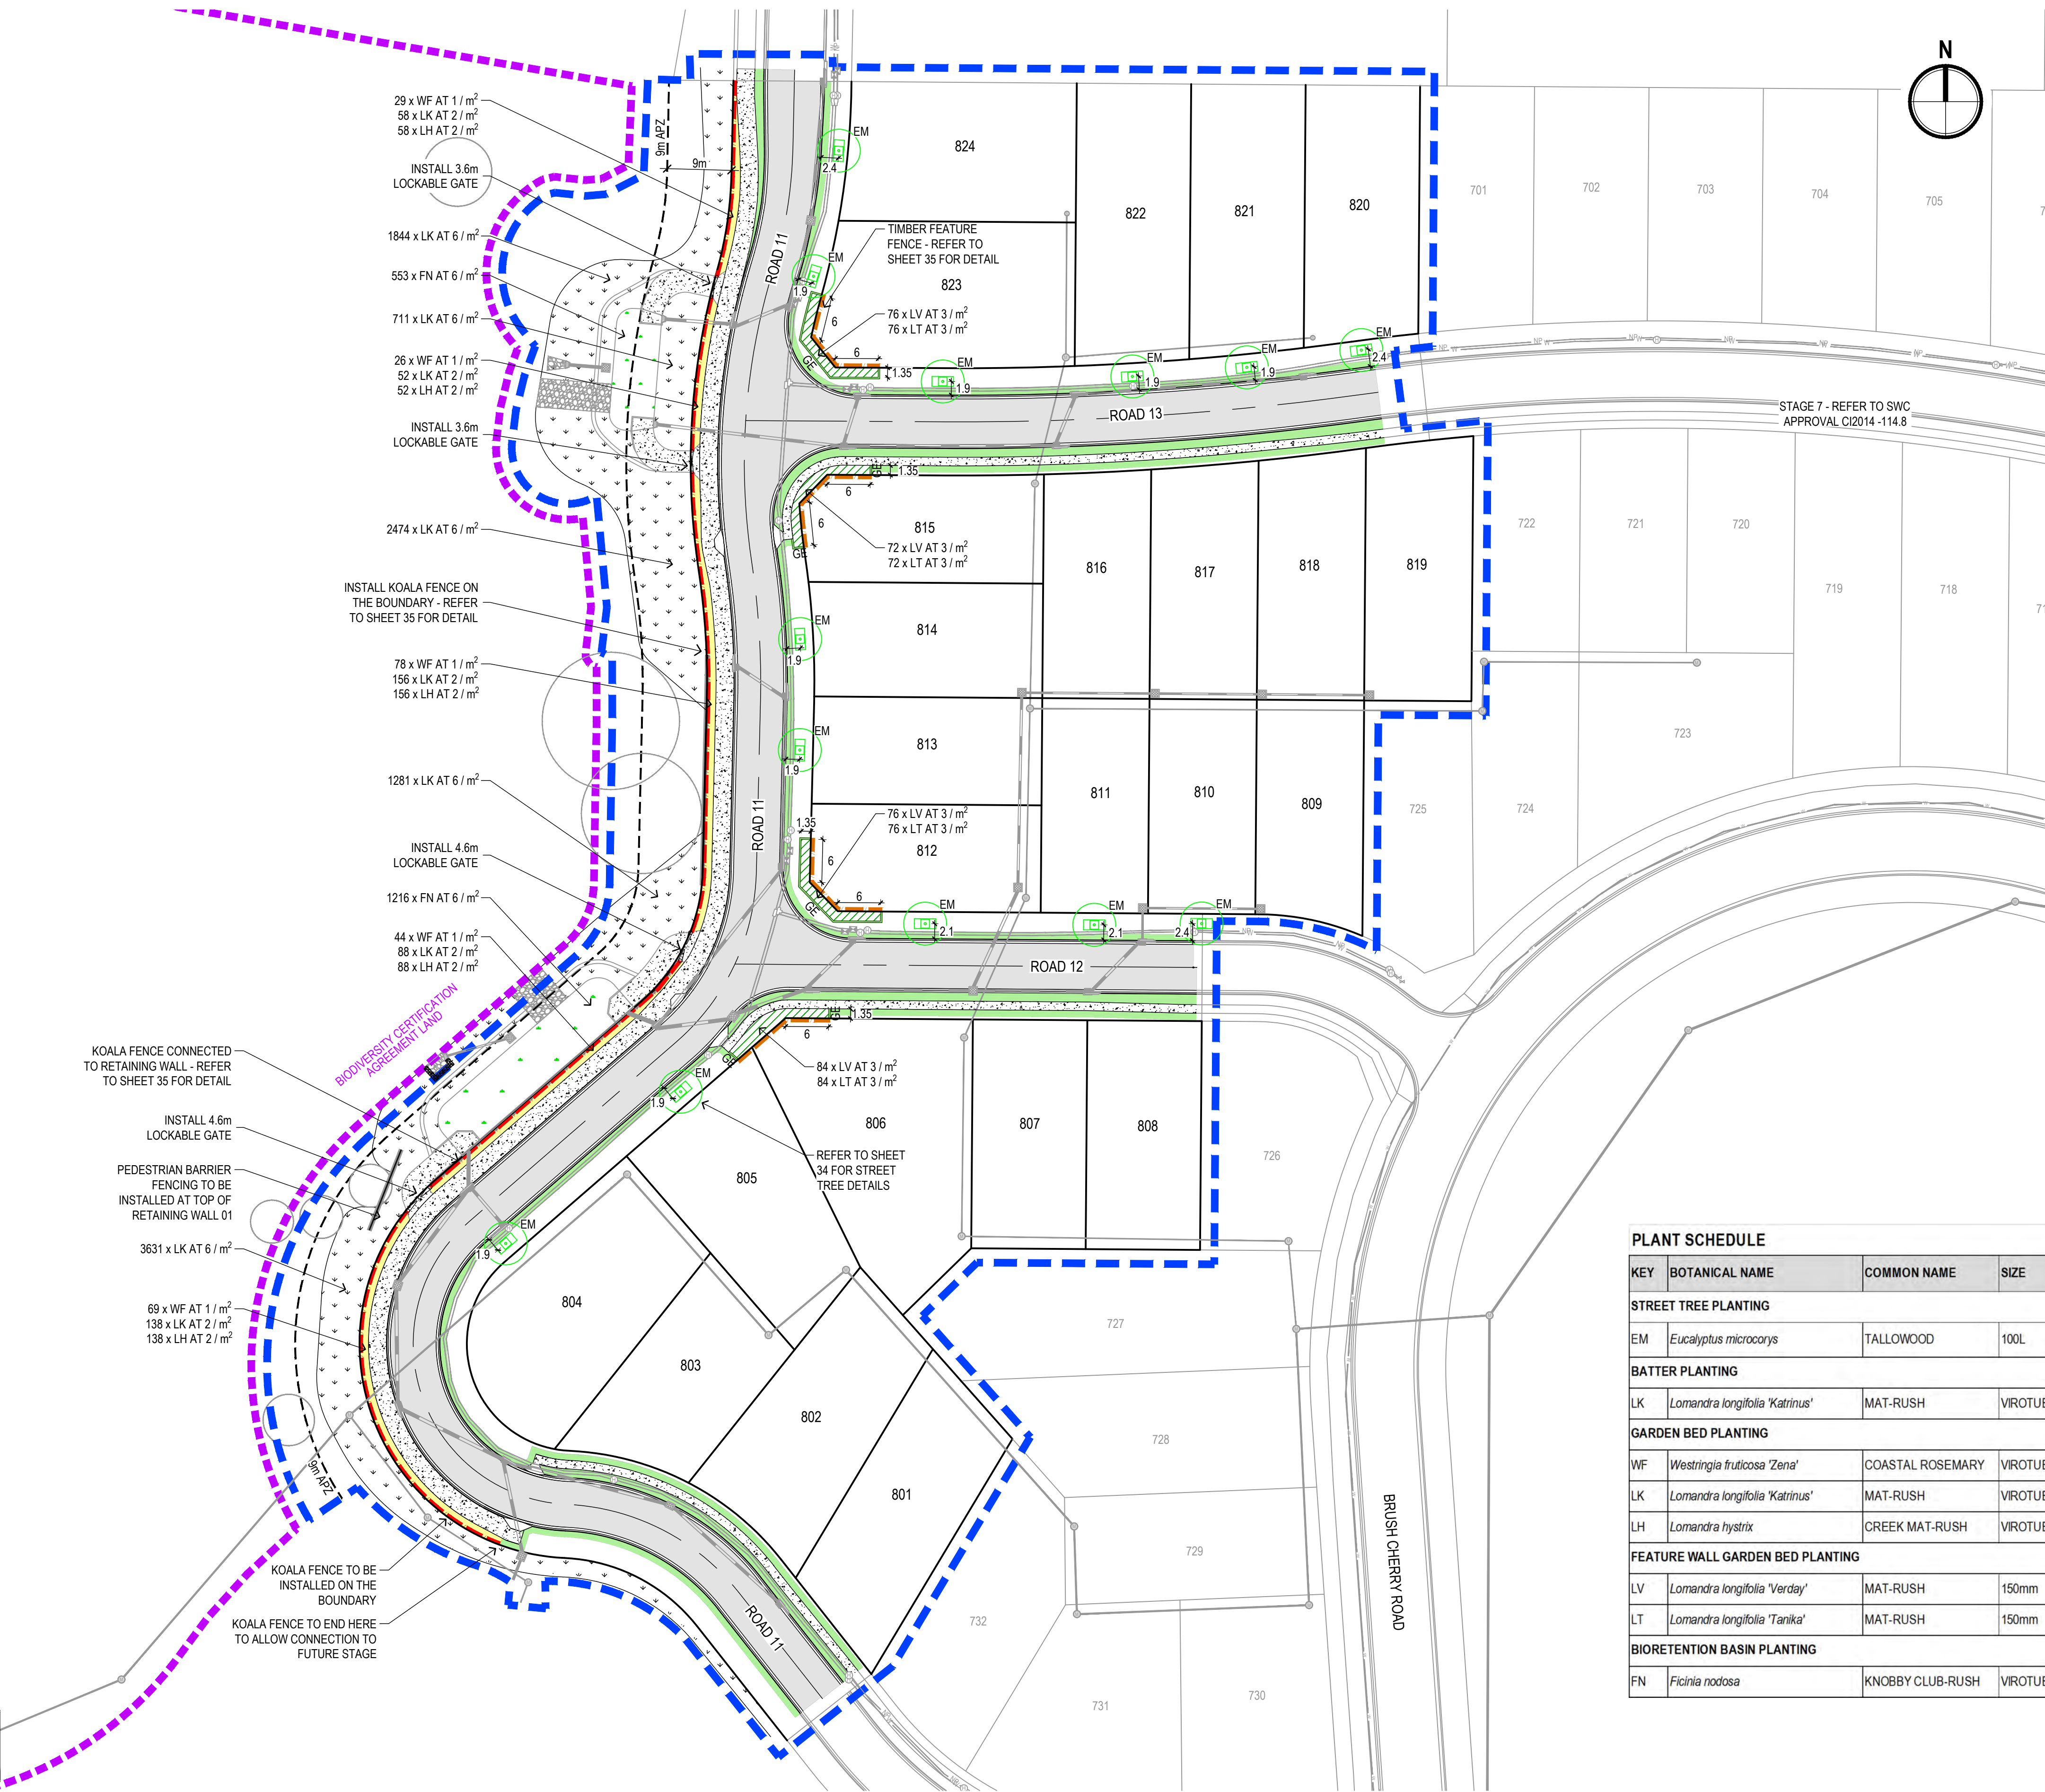

LEGEND

EXISTING BOUNDARY

PROPOSED STAGE 8 BOUNDARY

STAGE 8 EXTENT OF WORKS & SITE EXCLUSION FENCING

EXISTING BIODIVERSITY CERTIFICATION BOUNDARY (PLOTTED FROM PDF)

ASSET PROTECTION ZONE BOUNDARY

PROPOSED KOALA FENCE - REFER TO SHEET 35 FOR DETAIL

PROPOSED TIMBER FEATURE FENCE LOCATED WITHIN LOT - REFER TO SHEET 35 FOR DETAIL

PROPOSED 3.6m LOCKABLE GATE

PROPOSED CONCRETE SLEEPER RETAINING WALL

PROPOSED ROAD

PROPOSED CONCRETE FOOTPATH / BASIN ACCESS TRACK

PROPOSED BIOFILTRATION BASIN PLANTING

PROPOSED BATTER PLANTING

PROPOSED GARDEN BED PLANTING - REFER TO SHEET 35 FOR DETAIL

PROPOSED FEATURE WALL GARDEN BED PLANTING - REFER TO SHEET 35 FOR DETAIL

PROPOSED TURF - REFER TO SHEET 35 FOR DETAIL

PROPOSED TIMBER GARDEN EDGE - REFER TO SHEET 35 FOR DETAIL

KOALA FOOD TREE (TPZ) (K&C SURVEY JANUARY TO MARCH 2025)

PROPOSED STREET TREE - REFER TO SHEET 34 FOR DETAIL

TALLOWOOD (EUCALYPTUS MICROCORYS)

NOTES

1. PROVIDE TURFING TO A MINIMUM OF 900 mm BEHIND KERB AND EACH SIDE OF FOOTPATH WHERE NOT SPECIFIED OTHERWISE ON LANDSCAPING PLANS. TURF TO BE KIKUYU (OR ALTERNATIVE TYPE APPROVED BY COUNCIL).

2. REFER TO SHEETS 34 & 35 FOR LANDSCAPING DETAILS AND SHEET 36 FOR NOTES.


PLANT SCHEDULE						
KEY	BOTANICAL NAME	COMMON NAME	SIZE	SPACING/RATE	QUANTITIES	NOTE
STREET TREE PLANTING						
EM	<i>Eucalyptus microcorys</i>	TALLOWOOD	100L	AS SHOWN	13	TREES TO BE SUPPLIED AND CERTIFIED TO AS 2303:2018 - TREE STOCK FOR LANDSCAPE USE
BATTER PLANTING						
LK	<i>Lomandra longifolia 'Katrinus'</i>	MAT-RUSH	VIROTUBE	6 / m ²	9941	
GARDEN BED PLANTING						
WF	<i>Westringia fruticosa 'Zena'</i>	COASTAL ROSEMARY	VIROTUBE	1 / m ²	246	
LK	<i>Lomandra longifolia 'Katrinus'</i>	MAT-RUSH	VIROTUBE	2 / m ²	492	
LH	<i>Lomandra hystrix</i>	CREEK MAT-RUSH	VIROTUBE	2 / m ²	492	
FEATURE WALL GARDEN BED PLANTING						
LV	<i>Lomandra longifolia 'Verday'</i>	MAT-RUSH	150mm	3 / m ²	308	
LT	<i>Lomandra longifolia 'Tanika'</i>	MAT-RUSH	150mm	3 / m ²	308	
BIORETENTION BASIN PLANTING						
FN	<i>Ficinia nodosa</i>	KNOBBY CLUB-RUSH	VIROTUBE	6 / m ²	1769	

THIS DRAWING INCLUDES INFORMATION IN COLOUR. IF YOU HAVE A BLACK AND WHITE COPY YOU DON'T HAVE ALL THE INFORMATION. THIS NOTE IS COLOURED RED.

REV.	DATE	DESCRIPTION	BY
A	31.10.2025	ISSUED FOR APPROVAL	JSC

DATUM: AHD

SCALE: 1:500 @ A1
(1:1000 @ A3)




NOTE: DO NOT SCALE OFF DRAWINGS. USE FIGURED DIMENSIONS ONLY. REPORT ANY DISCREPANCIES TO THE AUTHOR. THIS DRAWING, BEING THE PROPERTY OF KING & CAMPBELL PTY LTD, IS PROTECTED BY COPYRIGHT AND MUST NOT BE USED, REPRODUCED OR COPIED WHOLLY, OR IN PART WITHOUT THE WRITTEN PERMISSION OF KING & CAMPBELL PTY LTD.
© King & Campbell Pty Ltd

PROJECT NO:	7197	DRAWING TITLE:	STREET LANDSCAPE PLAN				A1
DA NO.:	2014-114						
DESIGNED BY:	JSC/BC	PROJECT:	THE SANCTUARY STAGE 8 LOT 300, DP 1307775 - JOHN OXLEY DRIVE, THURMSTER				
DRAWN BY:	JSC						
CHECKED BY:	BC						
DATE CREATED:	JULY 2025	CLIENT:	BIRD IN THE HAND 2 PTY LTD.		DRAWING NO:	SHEET:	REVISION:
					7197_Stage 8_SWC_Plan	33 OF 36	A


NOT TO BE USED FOR CONSTRUCTION UNLESS SUBDIVISION WORKS CERTIFICATE ISSUED FOR THE WORKS

NOTE:
CERTIFICATION DEMONSTRATING COMPLIANCE WITH AS 2303:2015
TREE STOCK FOR LANDSCAPE USE, SHALL BE PROVIDED WITH TREE
STOCK SUPPLIED TO SITE IN CONTAINERS GREATER THAN OR
EQUAL TO 20L. ANY STOCK SUPPLIED WITHOUT CERTIFICATION WILL
BE REJECTED BY THE PRINCIPAL.

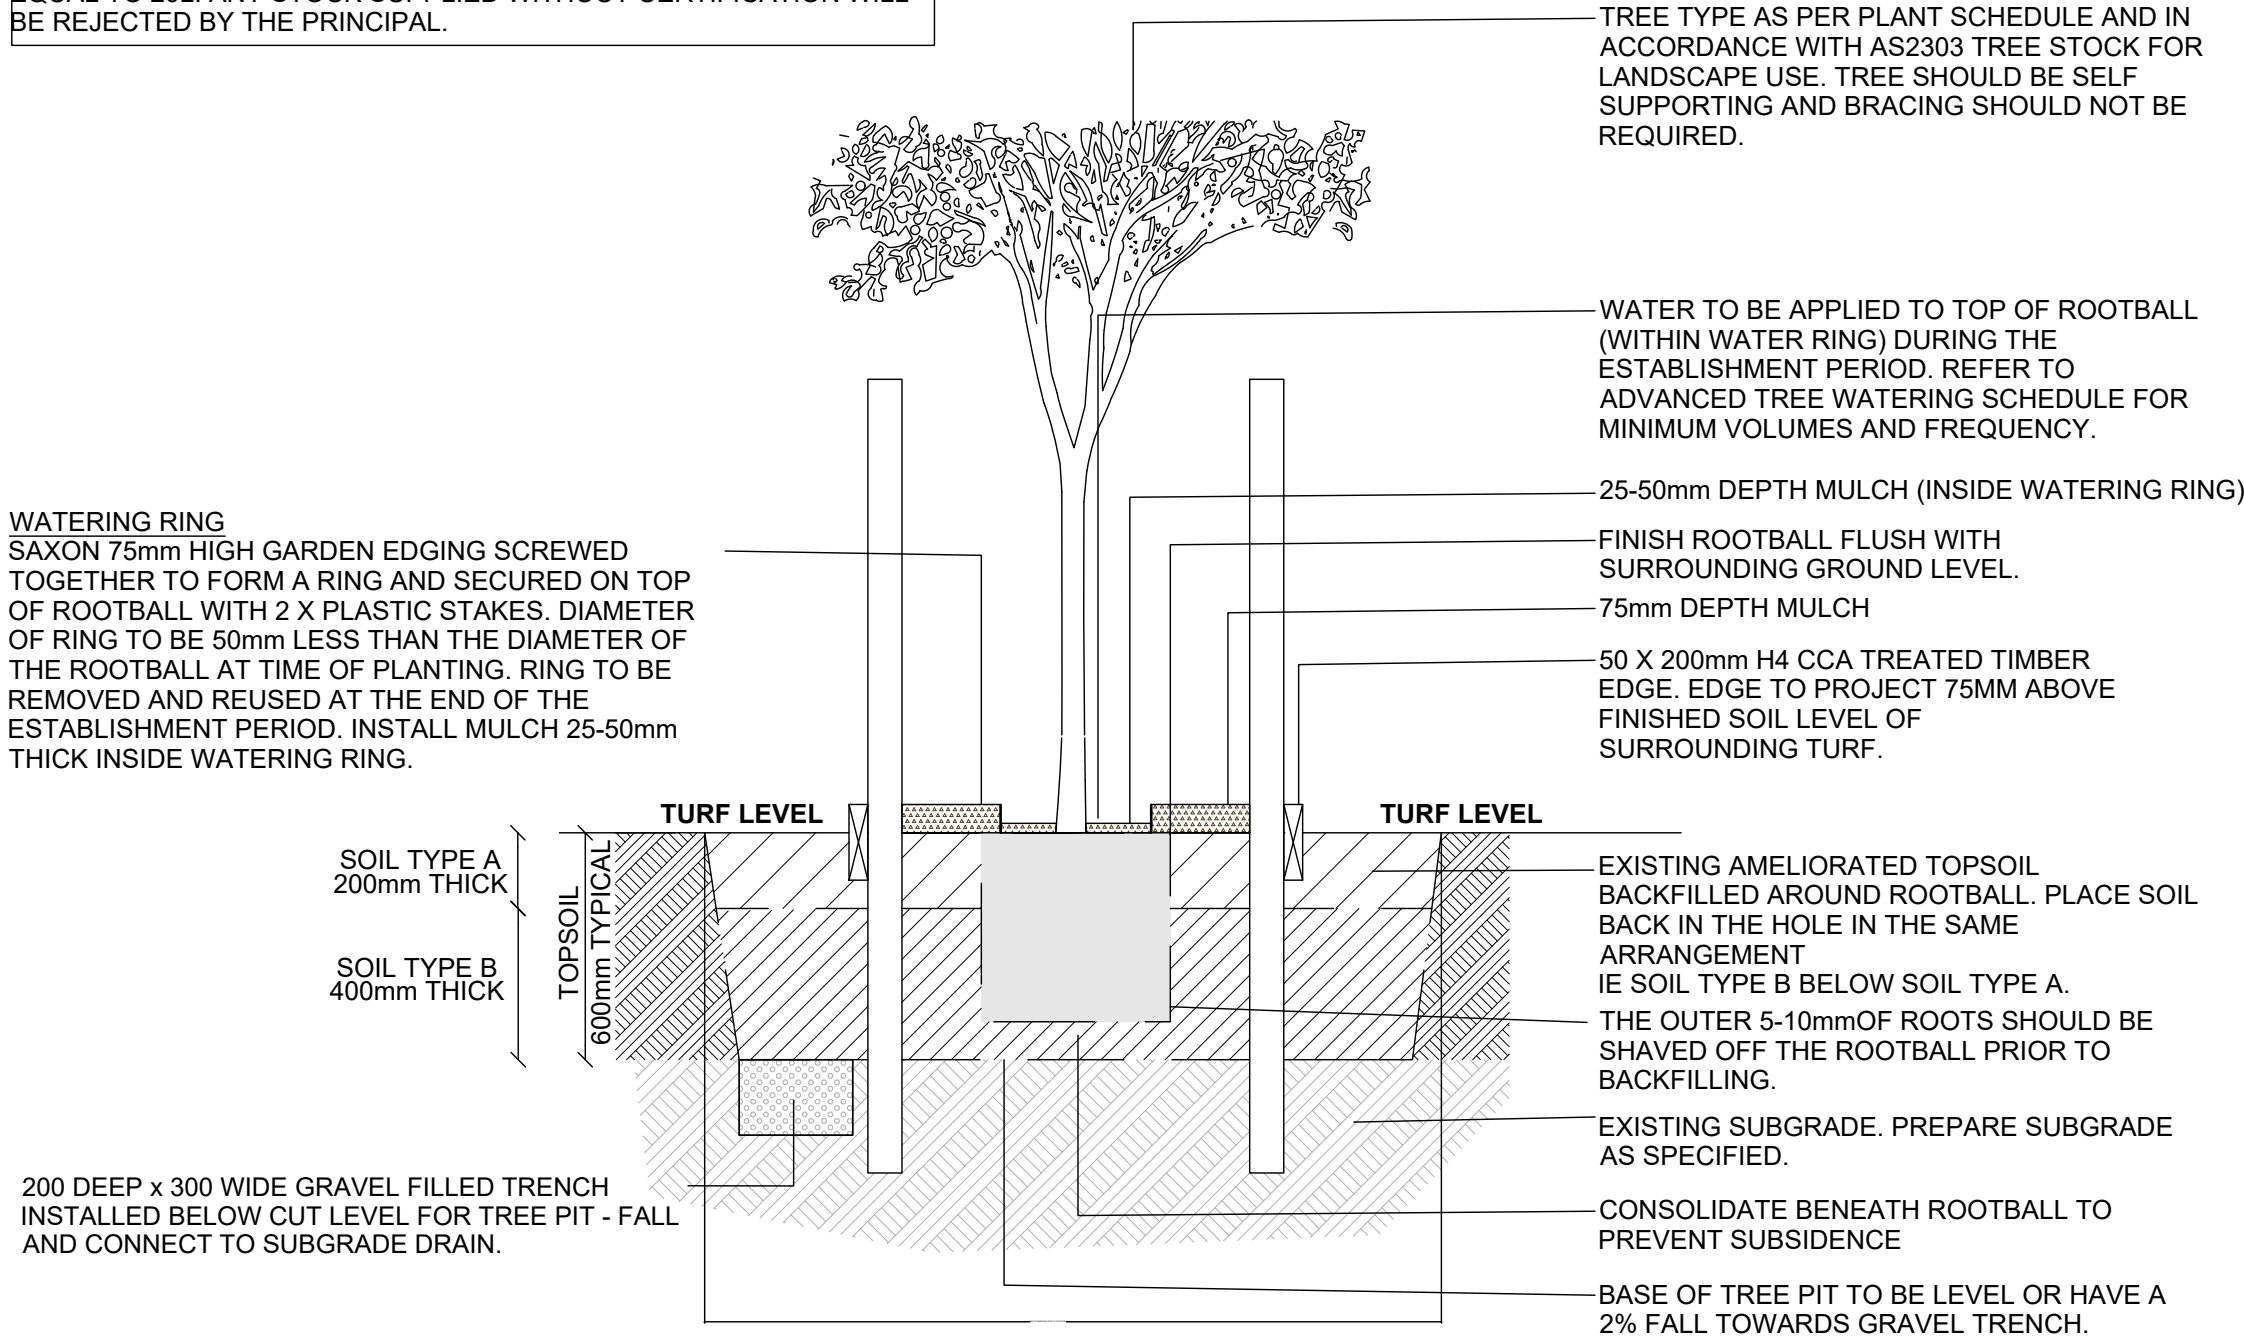


STREET TREE - SECTION DETAIL
(75-200L CONTAINER SIZE)

1:20 @ A1

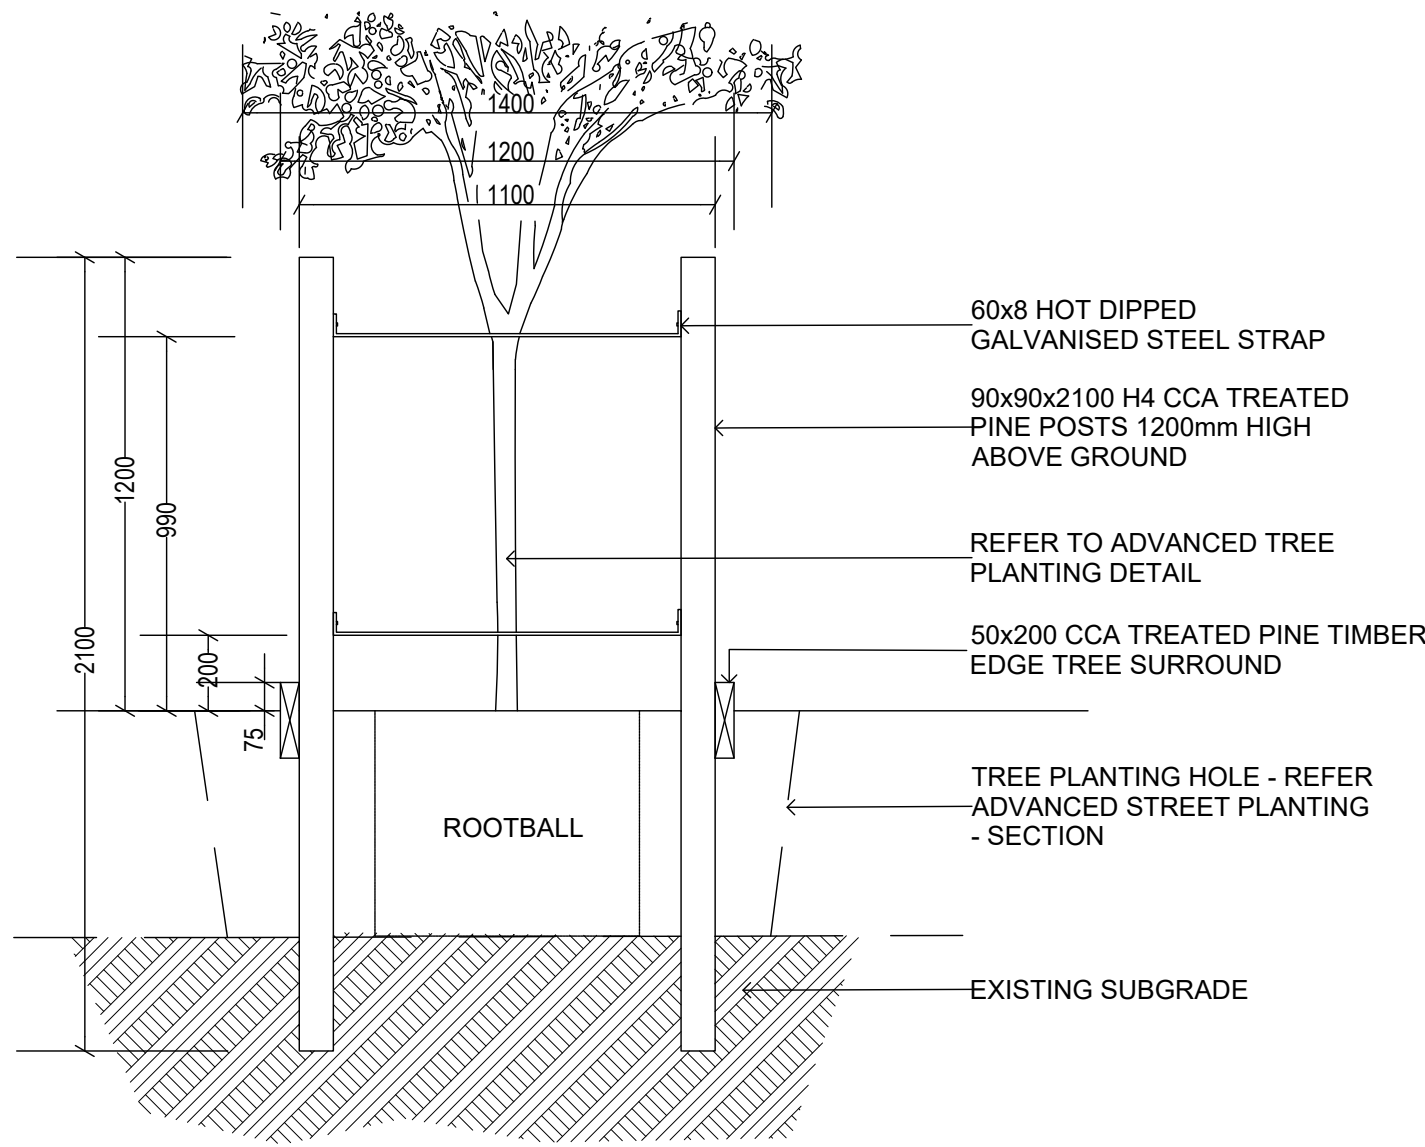


ADVANCED STREET PLANTING GUARD - SECTION DETAIL

1:20 @ A1

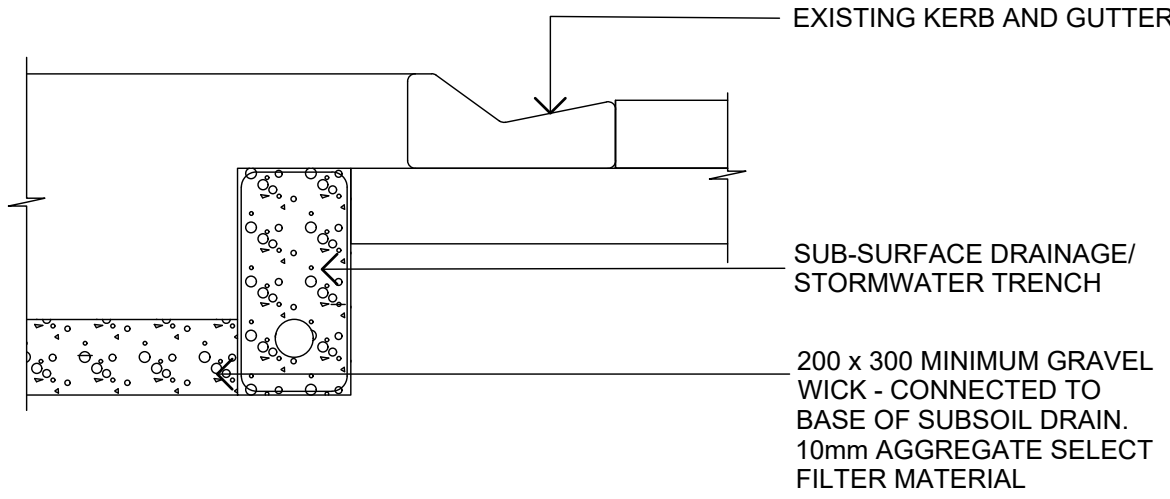

DRAINAGE WICK & SUBGRADE
DRAIN CONNECTION DETAIL

1:20 @ A1

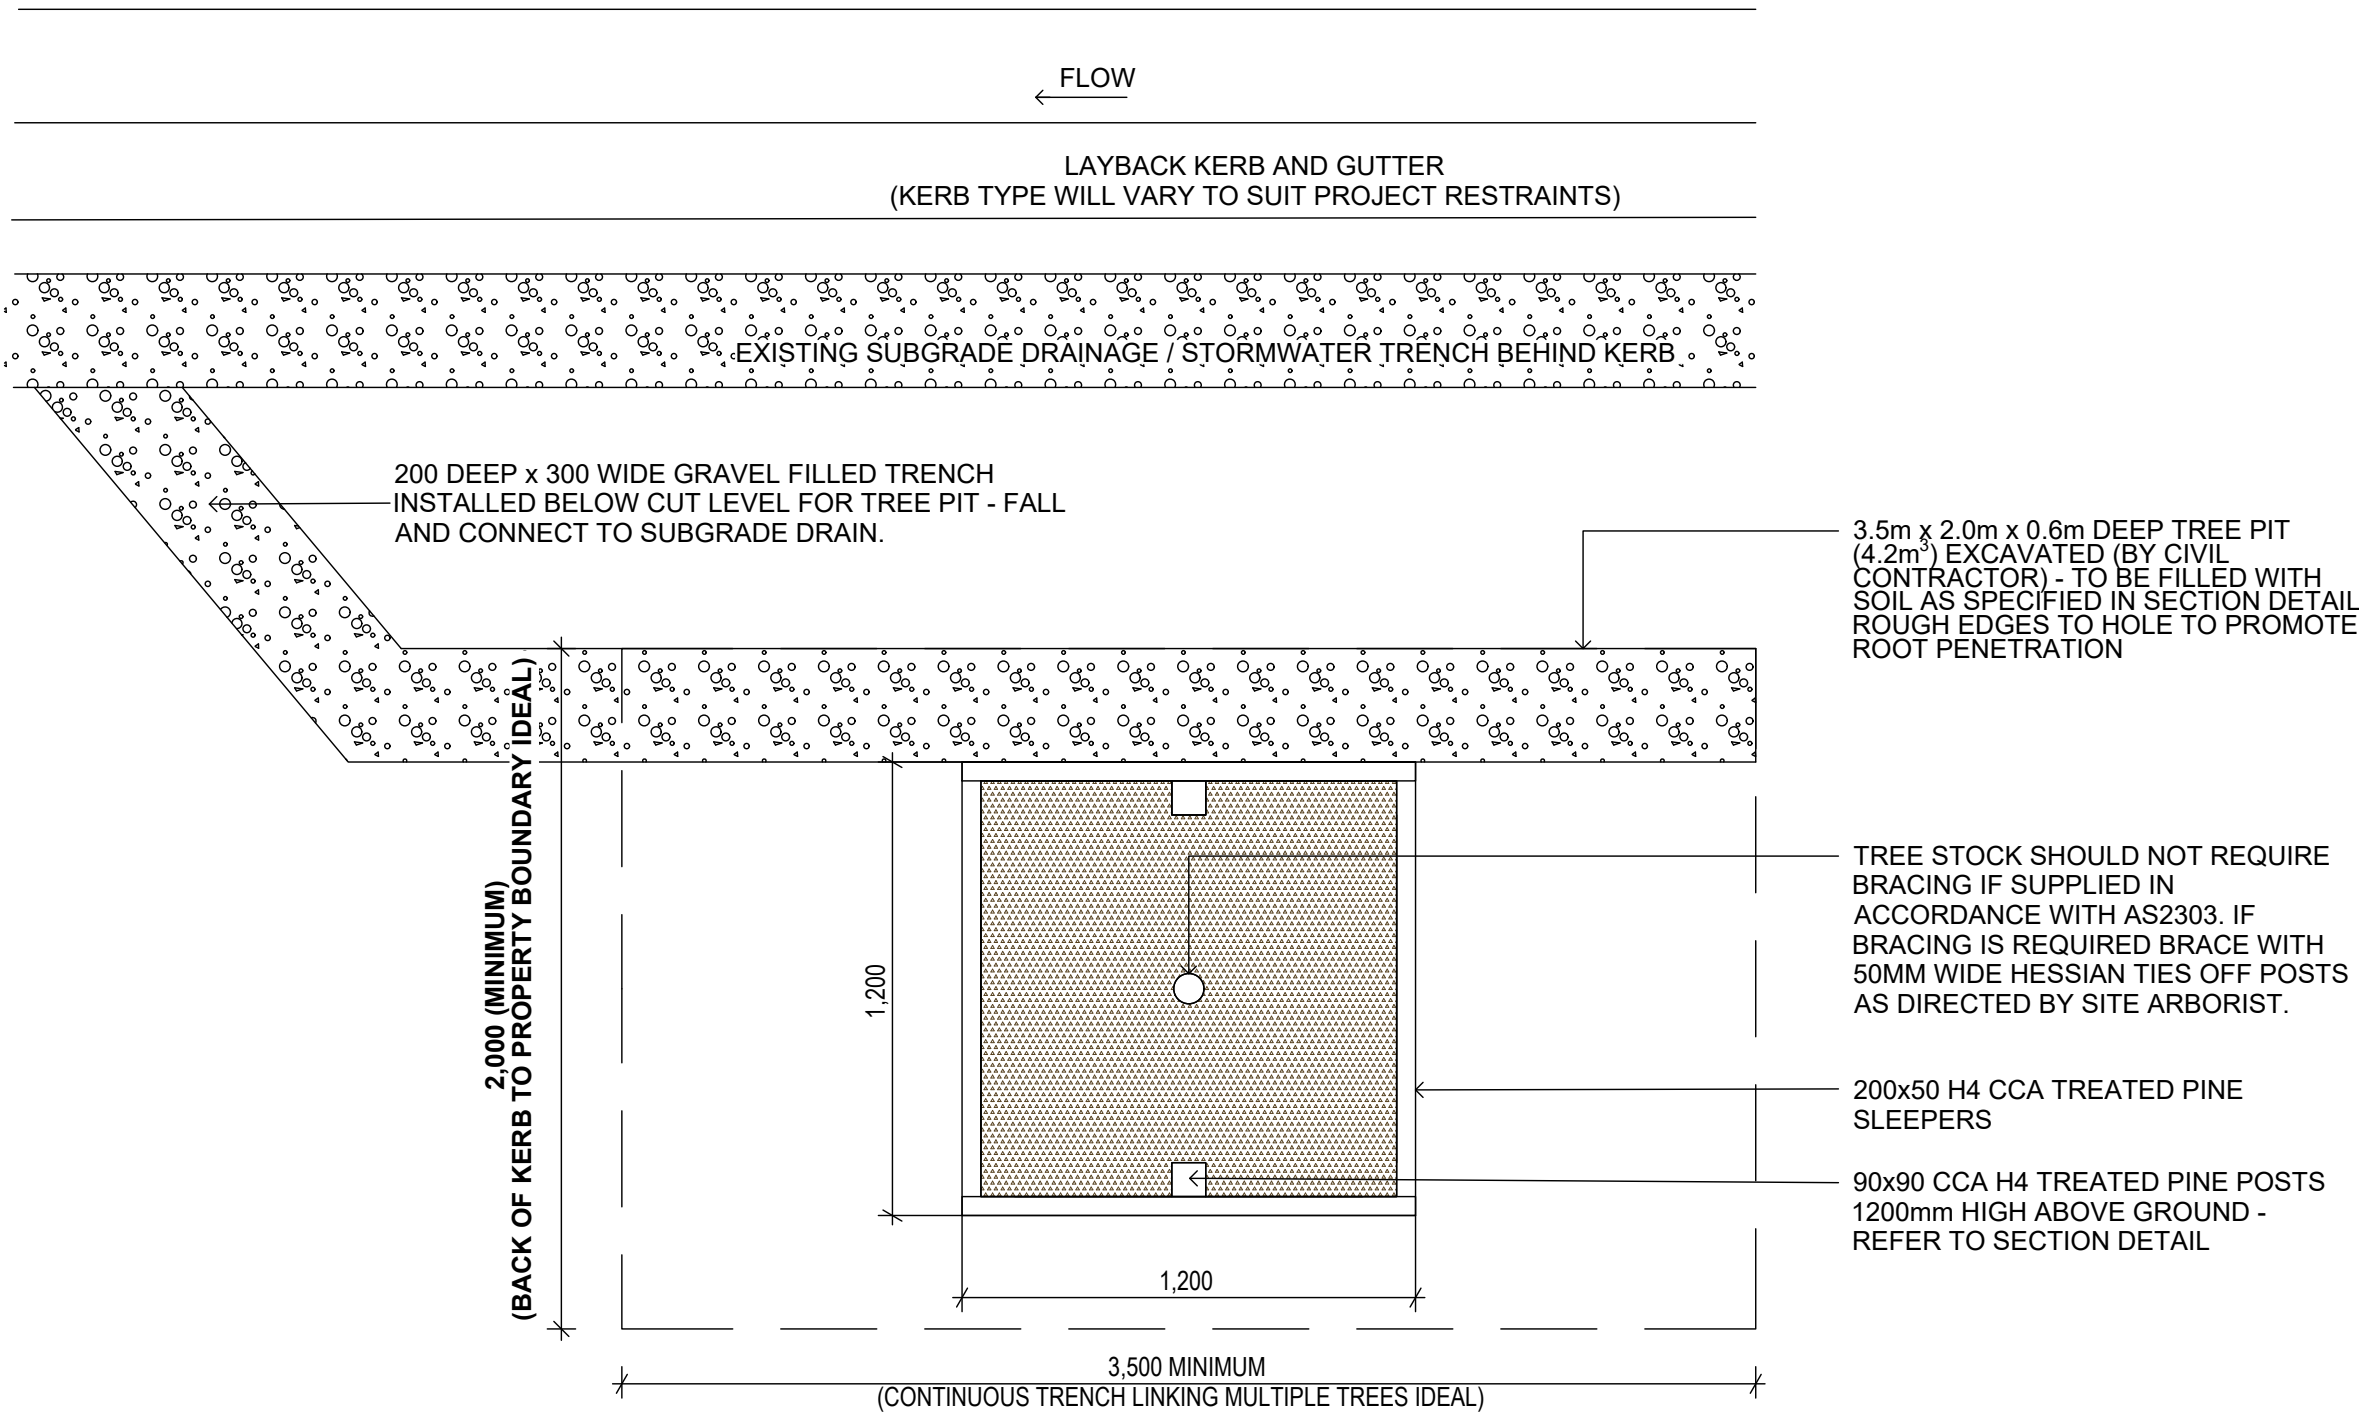


STREET TREE PLAN DETAIL
(75-200L CONTAINER SIZE)

1:20 @ A1

KOALA FOOD TREE OFFSET PLANTING DETAIL

1:20 @ A1

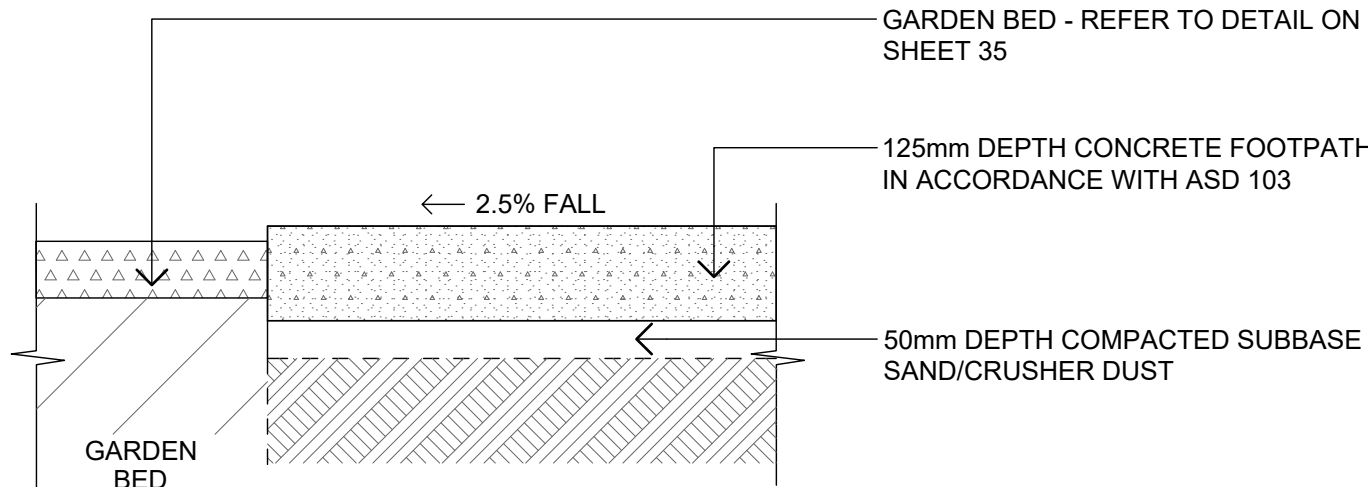

CONCRETE FOOTPATH DETAIL (125mm DEPTH)

1:10 @ A1

THIS DRAWING INCLUDES INFORMATION IN COLOUR. IF
YOU HAVE A BLACK AND WHITE COPY YOU DON'T HAVE
ALL THE INFORMATION. THIS NOTE IS COLOURED RED.

KING + CAMPBELL

King & Campbell Pty Ltd
www.kingscampbell.com.au
A: PO Box 243 Port Macquarie NSW 2444
T: 02 6586 2555
F: 02 6583 4064
E: info@kingscampbell.com.au

REV.	DATE	DESCRIPTION	BY
A	31.10.2025	ISSUED FOR APPROVAL	JSC

DATUM:

SCALE: AS SHOWN


NOTE: DO NOT SCALE OFF DRAWINGS. USE FIGURED DIMENSIONS ONLY. REPORT ANY
DISCREPANCIES TO THE AUTHOR. THIS DRAWING, BEING THE PROPERTY OF KING & CAMPBELL
PTY LTD, IS PROTECTED BY COPYRIGHT AND MUST NOT BE USED, REPRODUCED OR COPIED
WHOLLY, OR IN PART WITHOUT THE WRITTEN PERMISSION OF KING & CAMPBELL PTY LTD.
© King & Campbell Pty Ltd

PROJECT NO:	7197	DRAWING TITLE:	LANDSCAPE DETAILS SHEET 01
DA NO.:	2014-114	PROJECT:	THE SANCTUARY STAGE 8 LOT 300, DP 1307775 - JOHN OXLEY DRIVE, THURMSTER
DESIGNED BY:	JSC/BC	CLIENT:	BIRD IN THE HAND 2 PTY LTD.
DRAWN BY:	JSC	DRAWING NO:	7197_Stage 8_SWC_Plan
CHECKED BY:	BC	SHEET:	34 OF 36
DATE CREATED:	JULY 2025	REVISION:	A

A1


NOT TO BE USED FOR CONSTRUCTION UNLESS SUBDIVISION WORKS CERTIFICATE ISSUED FOR THE WORKS

M:\C-REF-017197_The Sanctuary\02_Engineering\Stages 8 and 9\2 STG 8 SWC\2107_Stage 8_SWC_Plan.dwg 4/11/2025 JSC:JAL:2025 JAL:2025 24 February 2025 janesec

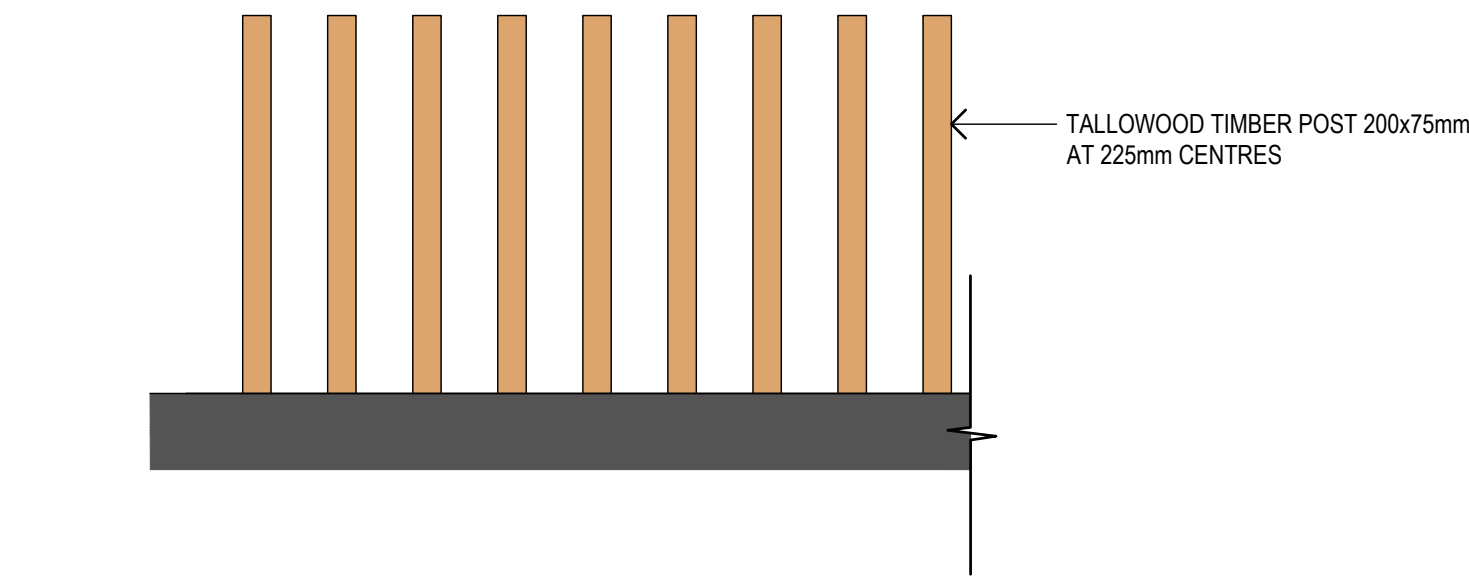


TIMBER FEATURE FENCE ELEVATION DETAIL

1:20 @A1

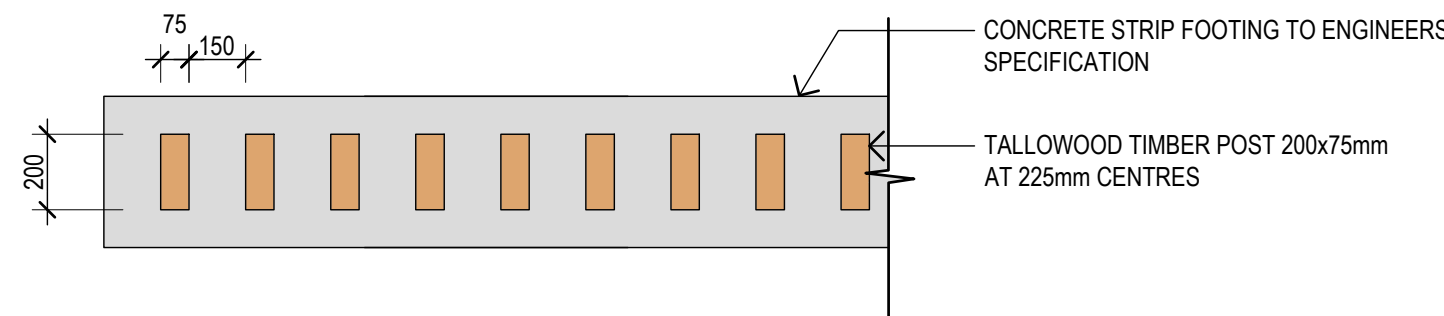


TIMBER FEATURE FENCE PLAN DETAIL

1:20 @A1

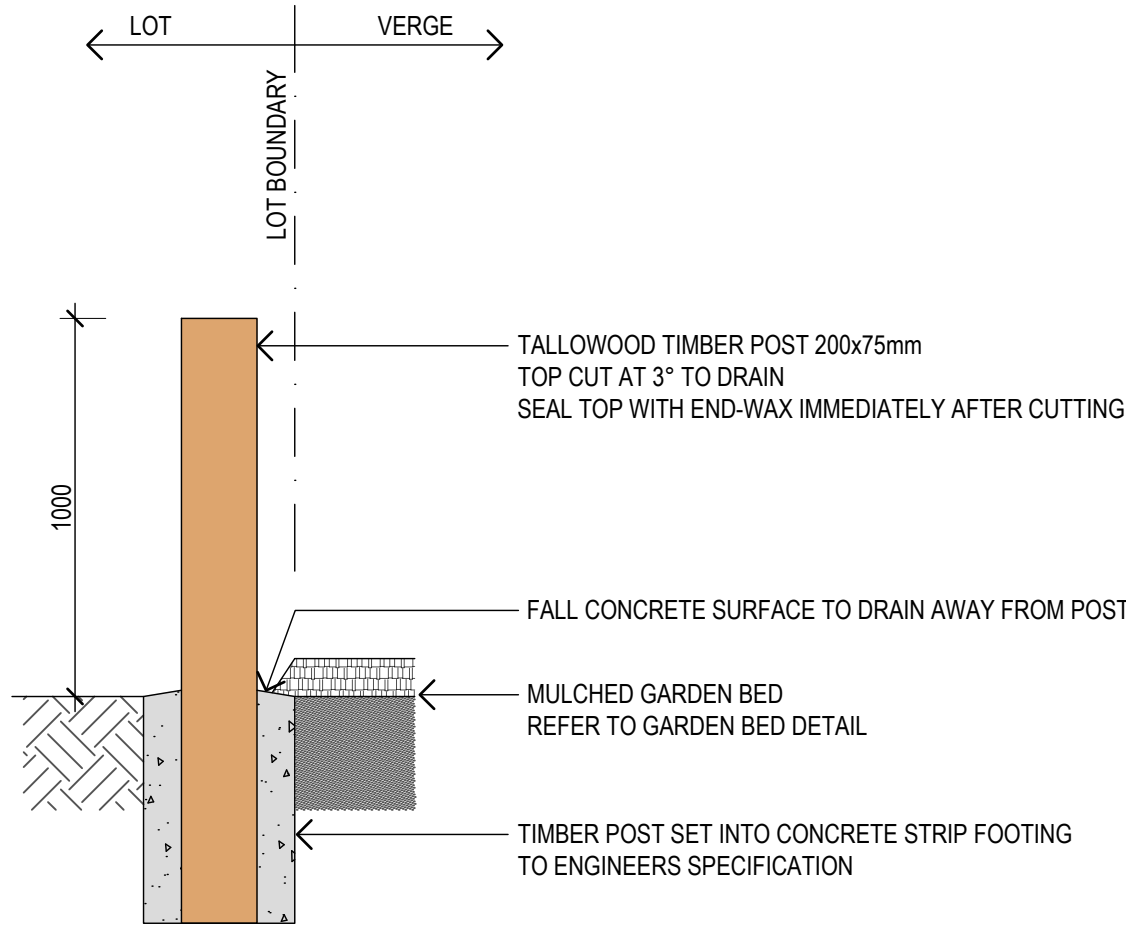


TIMBER FEATURE FENCE SECTION DETAIL

1:20 @ A1

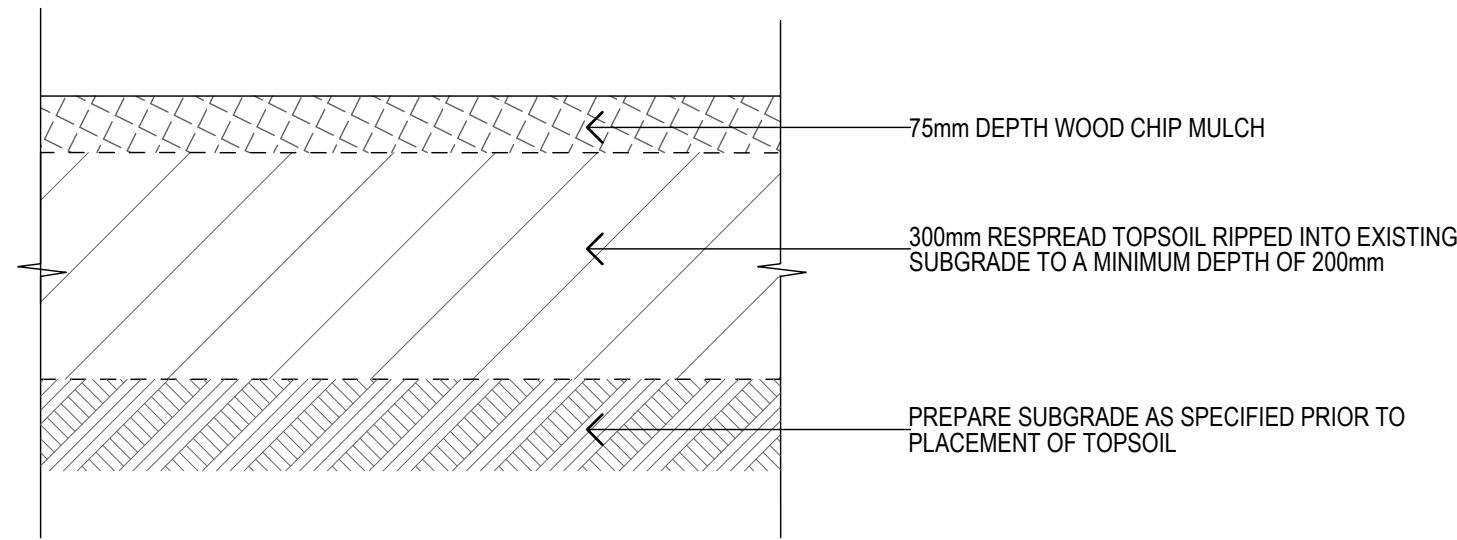


GARDEN BED DETAIL

1:10 @ A1

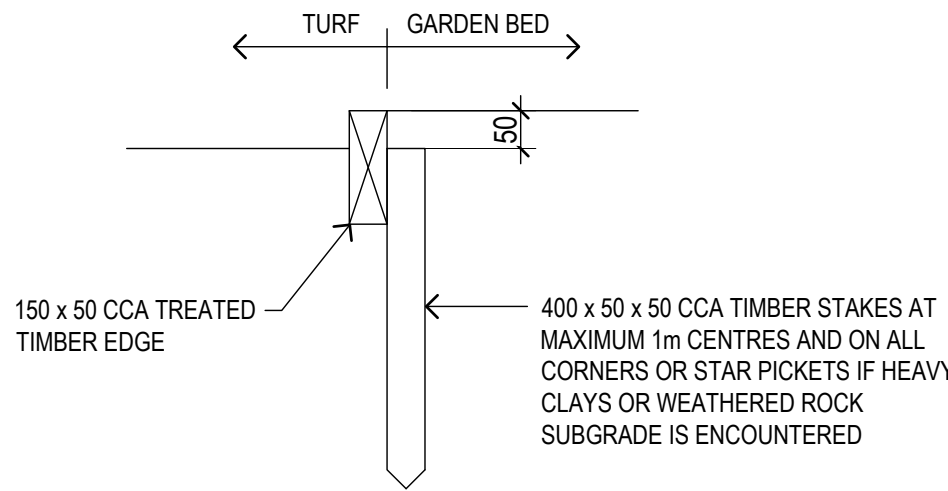


TIMBER EDGING DETAIL

1:10 @ A1

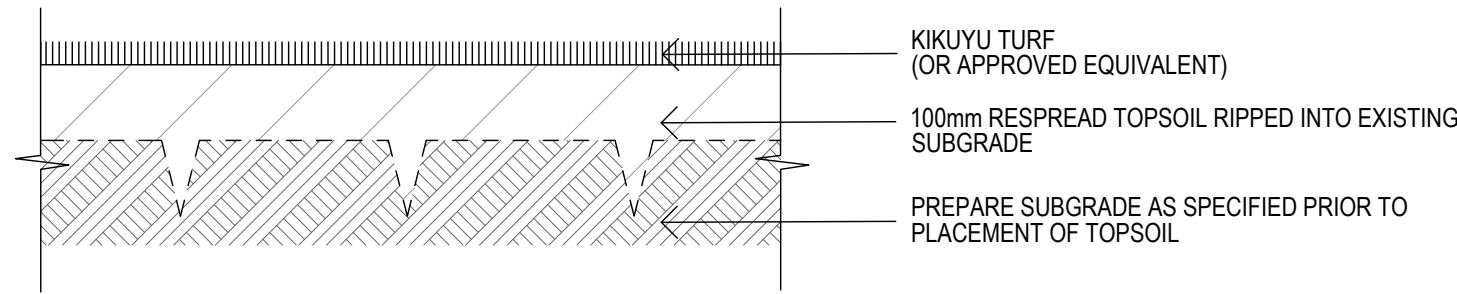


ORNAMENTAL TURF DETAIL

1:10 @ A1

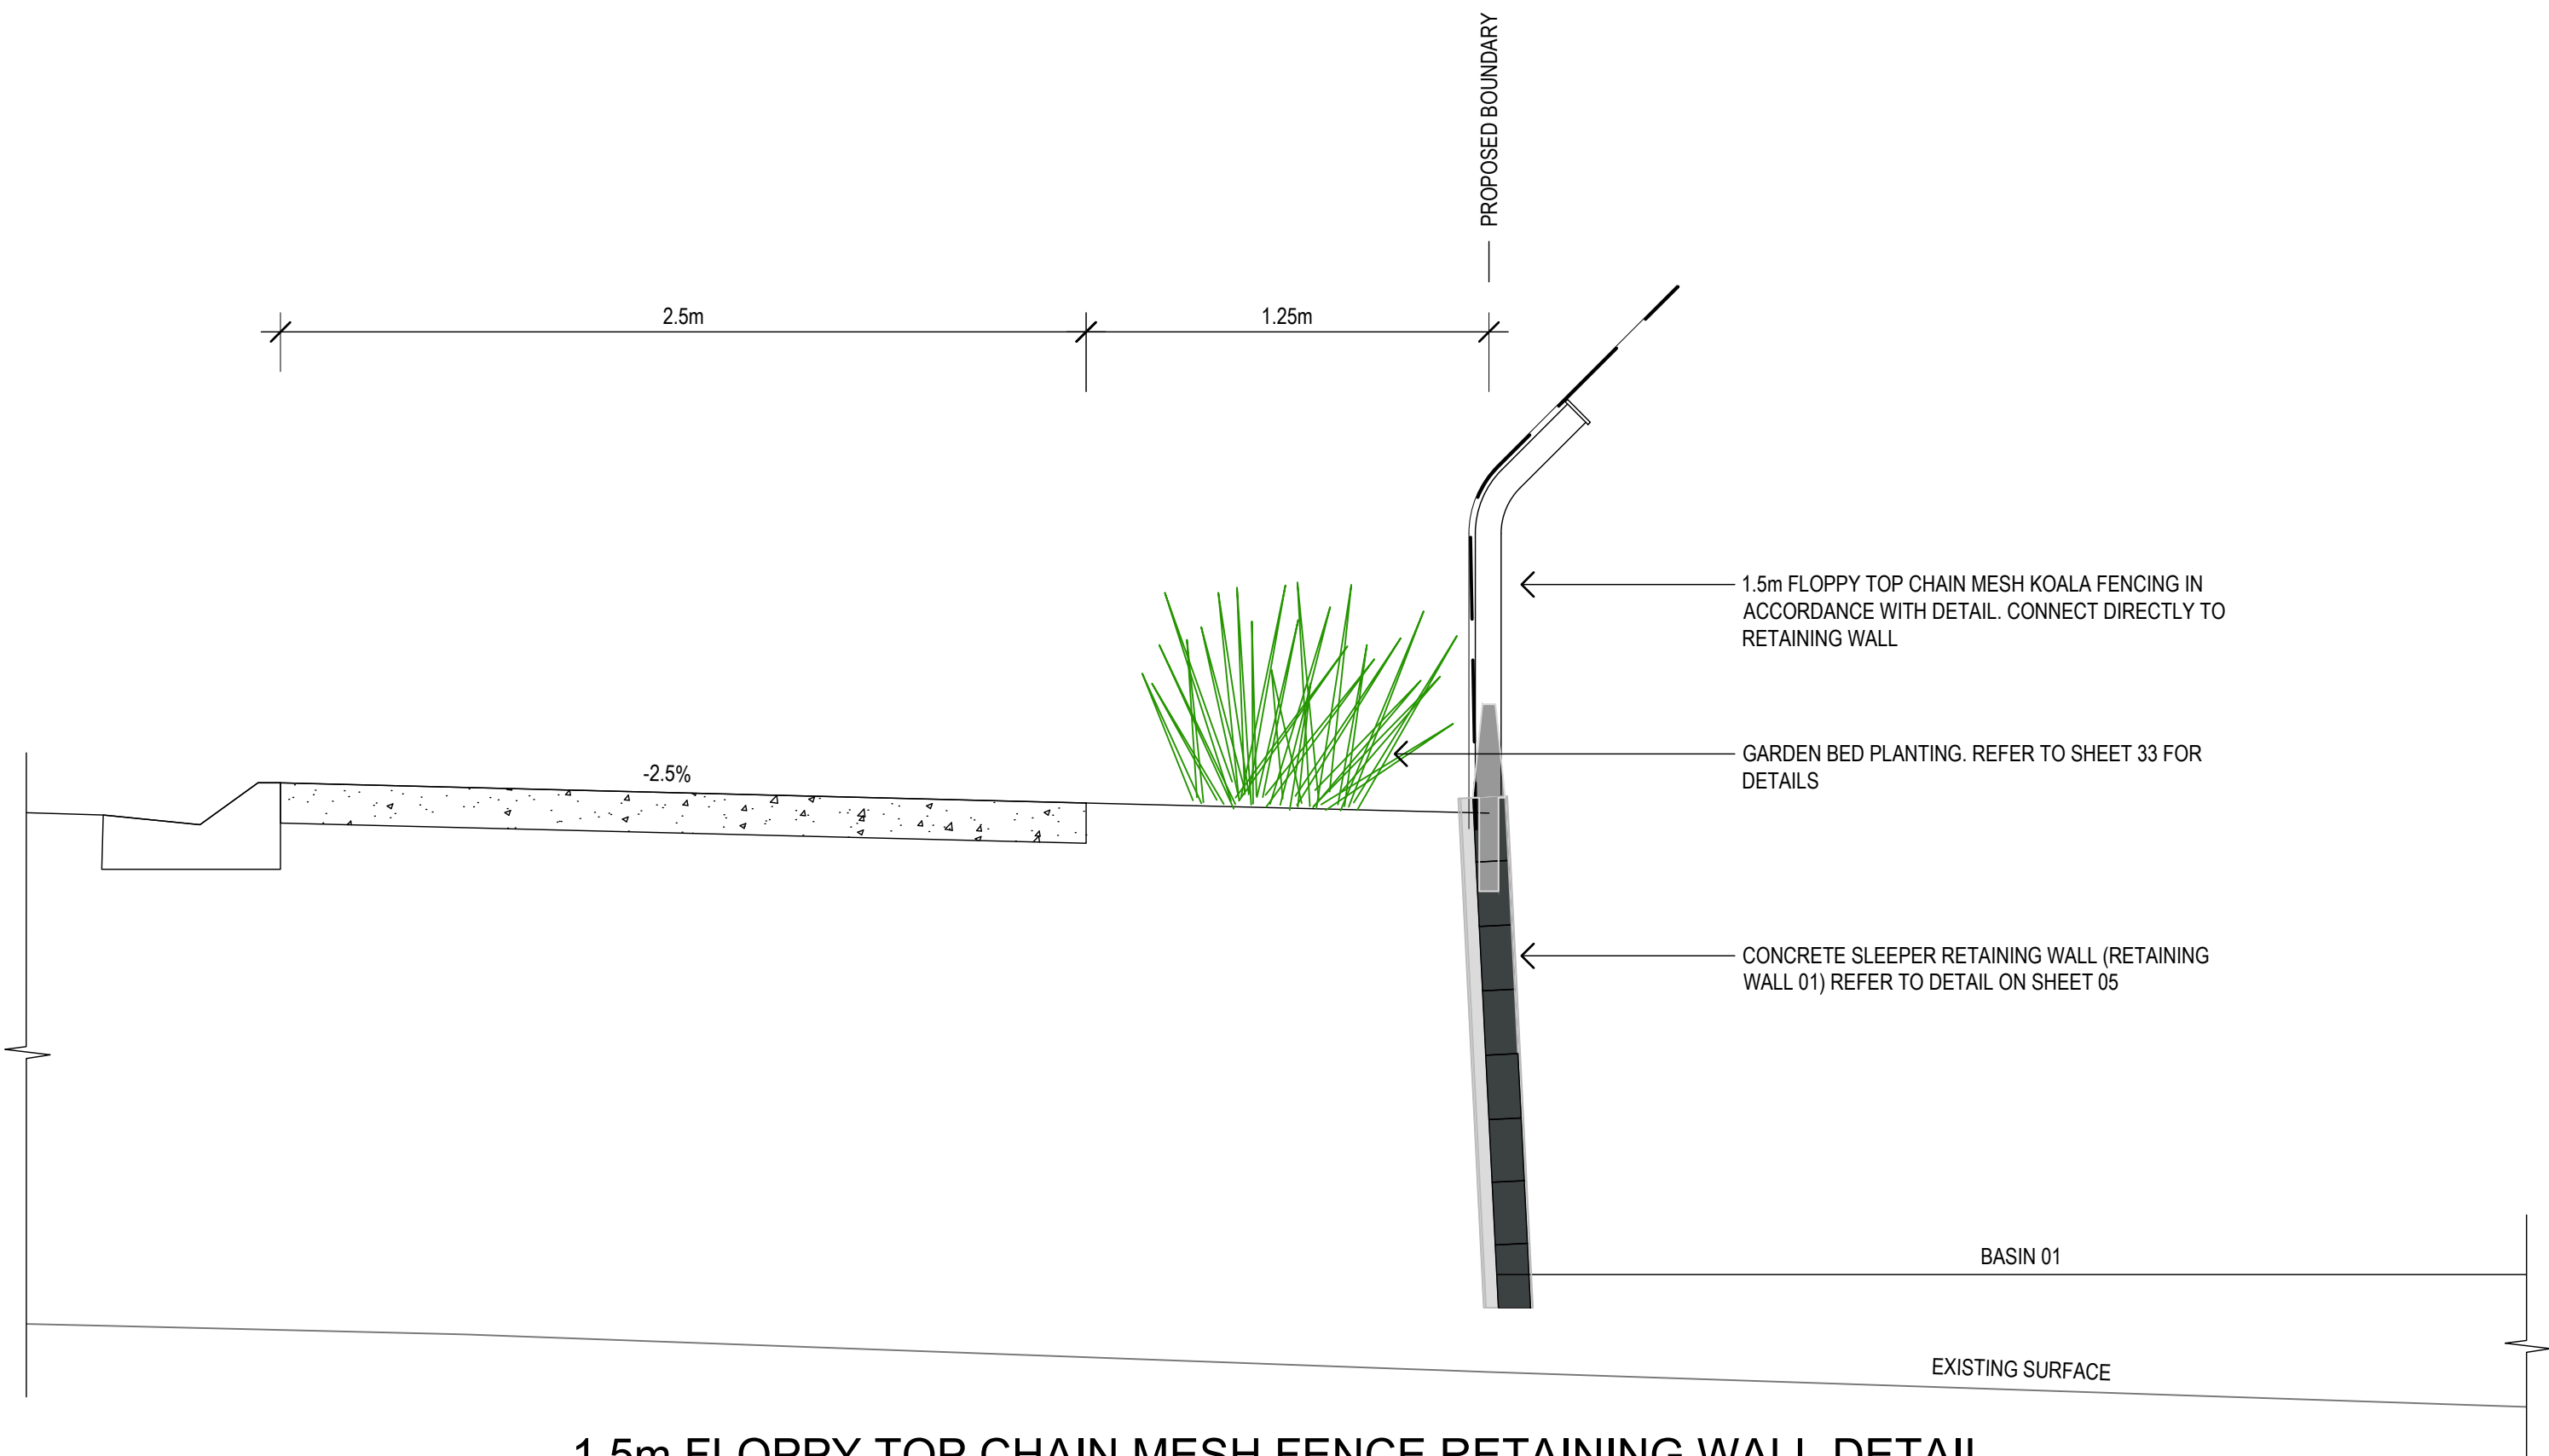

1.5m FLOPPY TOP CHAIN MESH FENCE RETAINING WALL DETAIL

1:20 @ A1

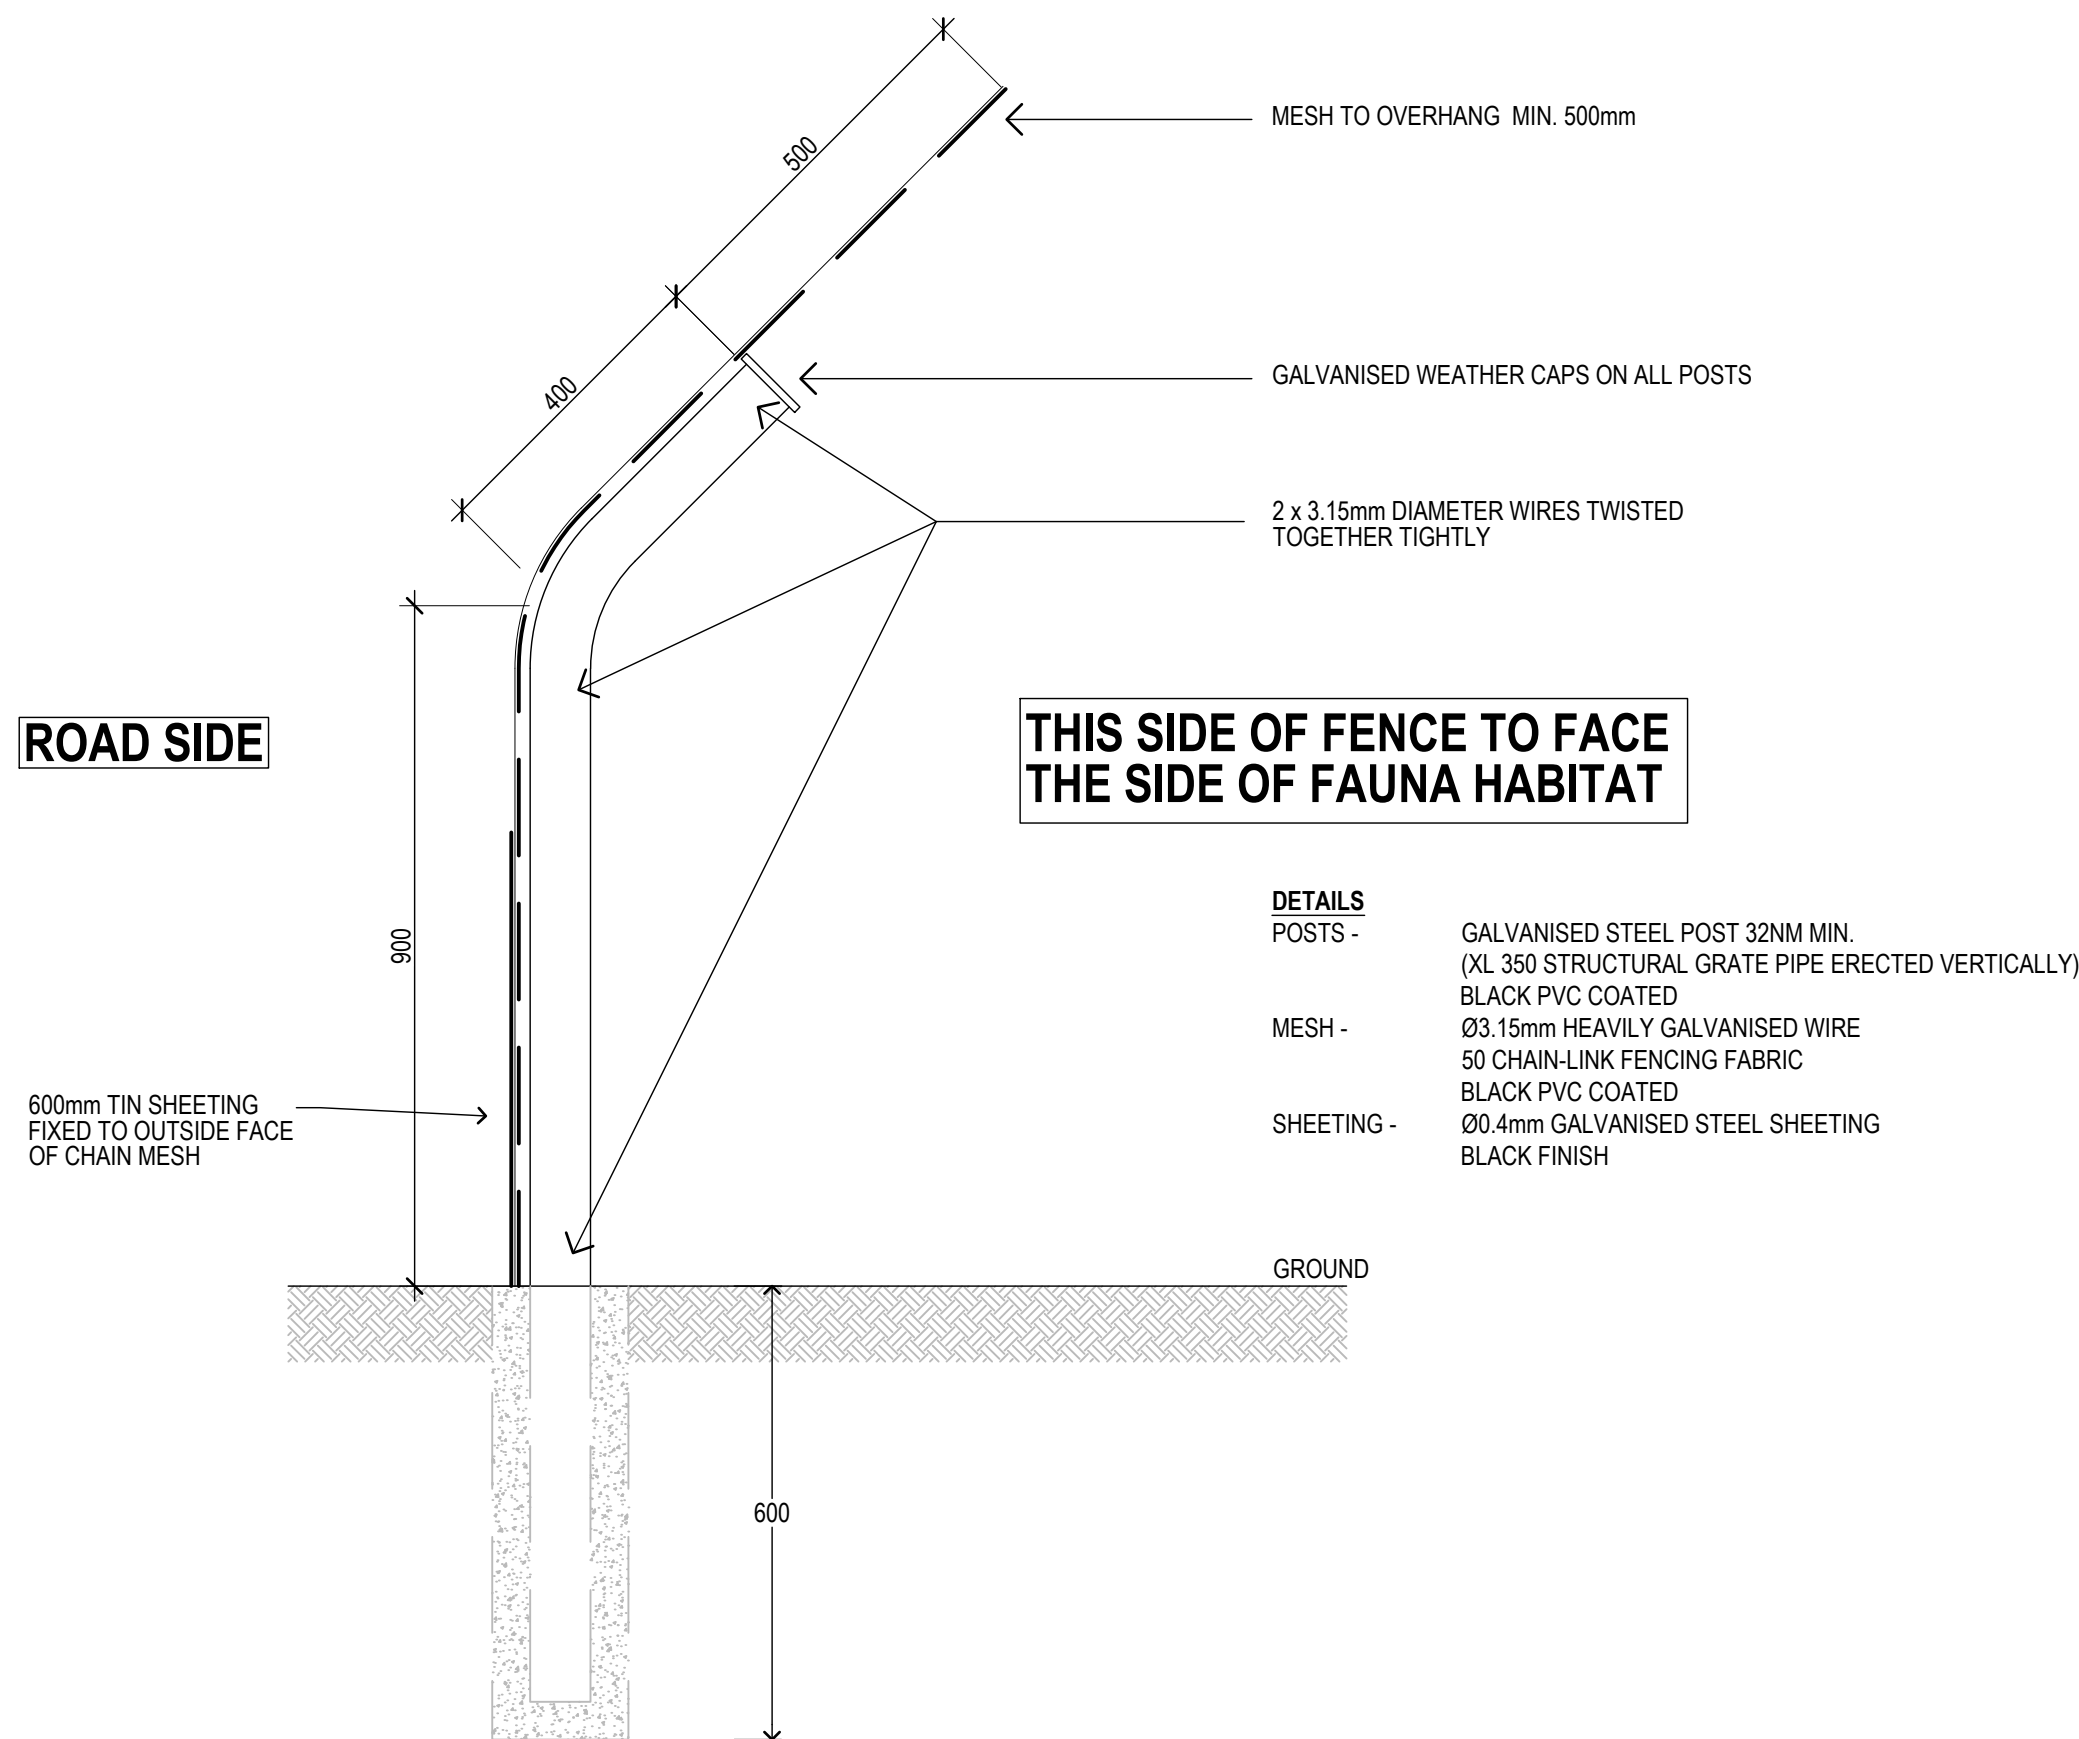

1.5m FLOPPY TOP CHAIN MESH FENCE DETAIL

1:10 @ A1

THIS DRAWING INCLUDES INFORMATION IN COLOUR. IF YOU HAVE A BLACK AND WHITE COPY YOU DON'T HAVE ALL THE INFORMATION. THIS NOTE IS COLOURED RED.

KING + CAMPBELL

King & Campbell Pty Ltd
www.kingcampbell.com.au
A: PO Box 243 Port Macquarie NSW 2444
T: 02 6586 2555
F: 02 6583 4064
E: info@kingcampbell.com.au

REV.	DATE	DESCRIPTION	BY
A	31.10.2025	ISSUED FOR APPROVAL	JSC

DATUM: SCALE: AS SHOWN


NOTE: DO NOT SCALE OFF DRAWINGS. USE FIGURED DIMENSIONS ONLY. REPORT ANY DISCREPANCIES TO THE AUTHOR. THIS DRAWING BEING THE PROPERTY OF KING & CAMPBELL PTY LTD, IS PROTECTED BY COPYRIGHT AND MUST NOT BE USED, REPRODUCED OR COPIED WHOLLY, OR IN PART WITHOUT THE WRITTEN PERMISSION OF KING & CAMPBELL PTY LTD.

© King & Campbell Pty Ltd

PROJECT NO:	7197	DRAWING TITLE:	LANDSCAPE DETAILS SHEET 02
DA NO.:	2014-114	PROJECT:	THE SANCTUARY STAGE 8 LOT 300, DP 1307775 - JOHN OXLEY DRIVE, THURMSTER
DESIGNED BY:	JSC/BC	CLIENT:	BIRD IN THE HAND 2 PTY LTD.
DRAWN BY:	JSC	DRAWING NO:	7197_Stage 8_SWC_Plan
CHECKED BY:	BC	SHEET:	35 OF 36
DATE CREATED:	JULY 2025	REVISION:	A

NOT TO BE USED FOR CONSTRUCTION UNLESS SUBDIVISION WORKS CERTIFICATE ISSUED FOR THE WORKS

A1

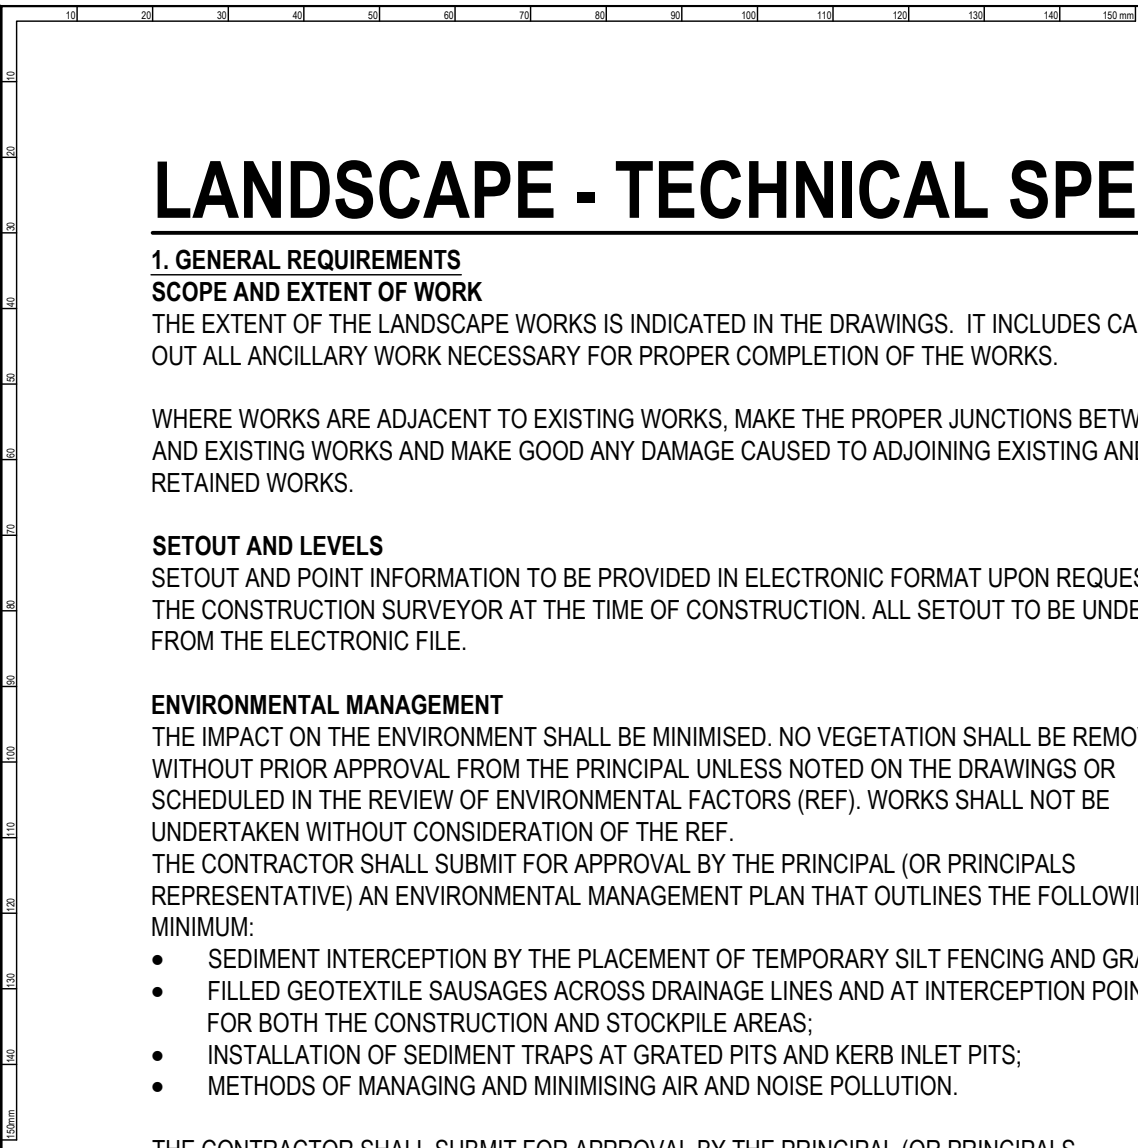

LANDSCAPE - TECHNICAL SPECIFICATION

1. GENERAL REQUIREMENTS

SCOPE AND EXTENT OF WORK

THE EXTENT OF THE LANDSCAPE WORKS IS INDICATED IN THE DRAWINGS. IT INCLUDES CARRYING OUT ALL ANCILLARY WORK NECESSARY FOR PROPER COMPLETION OF THE WORKS.

WHERE WORKS ARE ADJACENT TO EXISTING WORKS, MAKE THE PROPER JUNCTIONS BETWEEN NEW AND EXISTING WORKS AND MAKE GOOD ANY DAMAGE CAUSED TO ADJOINING EXISTING AND RETAINED WORKS.

SETOUT AND LEVELS

SETOUT AND POINT INFORMATION TO BE PROVIDED IN ELECTRONIC FORMAT UPON REQUEST TO THE CONSTRUCTION SURVEYOR AT THE TIME OF CONSTRUCTION. ALL SETOUT TO BE UNDERTAKEN FROM THE ELECTRONIC FILE.

ENVIRONMENTAL MANAGEMENT

THE IMPACT ON THE ENVIRONMENT SHALL BE MINIMISED. NO VEGETATION SHALL BE REMOVED WITHOUT PRIOR APPROVAL FROM THE PRINCIPAL UNLESS NOTED ON THE DRAWINGS OR SCHEDULED IN THE REVIEW OF ENVIRONMENTAL FACTORS (REF). WORKS SHALL NOT BE UNDERTAKEN WITHOUT CONSIDERATION OF THE REF.
THE CONTRACTOR SHALL SUBMIT FOR APPROVAL BY THE PRINCIPAL (OR PRINCIPALS REPRESENTATIVE) AN ENVIRONMENTAL MANAGEMENT PLAN THAT OUTLINES THE FOLLOWING AS A MINIMUM:

- SEDIMENT INTERCEPTION BY THE PLACEMENT OF TEMPORARY SILT FENCING AND GRAVEL
- FILLED GEOTEXTILE SAUSAGES ACROSS DRAINAGE LINES AND AT INTERCEPTION POINTS FOR BOTH THE CONSTRUCTION AND STOCKPILE AREAS;
- INSTALLATION OF SEDIMENT TRAPS AT GRATED PITS AND KERB INLET PITS;
- METHODS OF MANAGING AND MINIMISING AIR AND NOISE POLLUTION.

THE CONTRACTOR SHALL SUBMIT FOR APPROVAL BY THE PRINCIPAL (OR PRINCIPALS REPRESENTATIVE) A TRAFFIC CONTROL PLAN (IN ACCORDANCE WITH AS1742.3). PRIOR TO COMMENCEMENT OF CONSTRUCTION.

WORKMANSHIP AND MATERIAL QUALITY

MATERIALS AND WORKMANSHIP ARE TO CONFORM TO THE CURRENT EDITION OF APPLICABLE AUSTRALIAN STANDARD SPECIFICATIONS AND CODES. ANY WORK OR MATERIALS, WHICH, IN THE OPINION OF THE PRINCIPAL (OR THEIR REPRESENTATIVE), DO NOT MEET APPROPRIATE INDUSTRY STANDARDS OF WORKMANSHIP OR QUALITY, WILL BE REJECTED. REJECTED WORK SHALL BE REMOVED AND REINSTALL TO AN ACCEPTABLE STANDARD AT NO ADDITIONAL COST TO THE PRINCIPAL.

WORKMANSHIP & INSTALLATION SAMPLES

WHERE SPECIFIED, PROVIDE SAMPLES OF FINISHED INSTALLED WORKS FOR APPROVAL BY THE PRINCIPAL (OR THEIR REPRESENTATIVE) PRIOR TO PROCEEDING. INCLUDE TYPICAL JUNCTIONS, JOINTS, CUTS, FINISHES AND COLOURS OF THE NOMINATED SAMPLE. IF NOT APPROVED, SAMPLES ARE TO BE RECTIFIED OR REMOVED AND REPLACED AS REQUIRED BY THE CONTRACT MANAGER. APPROVED SAMPLES MAY BE RETAINED TO FORM A PART OF THE COMPLETED WORKS. ALL REMAINING WORKS ARE TO MEET AND MATCH THE QUALITY OF THE APPROVED SAMPLE.

2. CLEARING, DEMOLITION AND SITE PREPARATION

STRIPPING AND STOCKPILING TOPSOIL

STRIPPING OF TOPSOIL SHOULD OCCUR IMMEDIATELY BEFORE BULK EARTHWORKS AND DONE IN SUCH A MANNER AS TO MINIMISE EROSION AND SEDIMENT LOSS FROM SITE. SOIL MOISTURE CONTENT SHOULD BE MONITORED TO ENSURE THE SOIL STRUCTURE IS NOT ADVERSELY IMPACTED THROUGH EXCAVATION DURING EXTREMELY WET OR DRY CONDITIONS. AVOID THE INCLUSION OF SUBSOIL. IN THE TOPSOIL STRIPPING, STRIP TOPSOIL TO A DEPTH RECOMMENDED BASED ON SOIL TESTING RESULTS.

STOCKPILES SHOULD BE NO HIGHER THAN 2m IN DEPTH AND LOCATED 5M OR MORE FROM CONCENTRATED WATER FLOWS. PROTECT STOCKPILE UPSLOPE USING DIVERSION DRAINS. DOWNSLOPE SEDIMENT LOSS SHOULD BE MINIMISED THOUGH THE USE OF SILT FENCING OR OTHER APPROVED METHODS. LABEL STOCKPILE WITH ORIGIN AND DATE. IF STOCKPILES ARE TO BE IN PLACE FOR LONGER THAN 3 MONTHS, SOW WITH A SEASONALLY APPROPRIATE ANNUAL COVER CROP.

FINE TRIMMING AND GRADING

GRADE AND TRIM BULK SUBGRADE SURFACES TO A DEPTH BELOW FINISHED SURFACE LEVELS AS DETERMINED BY THE SPECIFIED DEPTHS OF COVERING MATERIALS. BERMS, SWALES AND BATTERS MAY REQUIRE FINE GRADING AND SHAPING TO THE LANDSCAPE ARCHITECT'S DIRECTION. SHAPING SHALL BE CARRIED OUT BY AN EXPERIENCED MACHINE OPERATOR OR SHAPER. SUCH WORK SHALL INCLUDE:

- ROUNDING OF RIDGE LINE PROFILES;
- GRADUATING RIDGE LINES AND FORMATION OF TRANSITION CURVES AT TOP AND BOTTOM OF BATTERS;
- TRIMMING TO REDUCE BULK EXCAVATION SLOPE STEEPNESS;
- GRADUAL TAPERING TO INTERSECTIONS WITH WALLS AND PAVEMENTS;
- GRADING TRANSITIONS TO FENCE LINES;
- GRADING TRANSITIONS TO MEET BACK OF ROAD EDGES AND KERBS.

UNLESS OTHERWISE NOTED FINAL GRADING SHALL ACHIEVE 1 IN 100 MINIMUM FALLS TO DRAINAGE.

SITE SUBGRADE PREPARATION

BEFORE LAYING TOPSOIL, THE FOLLOWING SUBGRADE TREATMENT MUST BE APPLIED TO ALL FINISHED SUBGRADE AREAS:

- REMOVE ROCKS >100mm DIAMETER;
- REMOVE RUBBISH SUCH AS CONSTRUCTION GENERATED WASTE, PLASTICS, METALS AND GLASS;
- APPLY ADDITIVES TO AMELIORATE THE SUBGRADE IN ACCORDANCE WITH THE RECOMMENDATIONS FROM THE SOIL TEST REPORT;
- CHISEL, DISC PLOUGH OR USE AN EXCAVATOR WITH A TYNE ATTACHMENT TO LOOSEN THE SUBGRADE AND MIX THE AMELIORANTS TO 200mm DEPTH TO INCORPORATE;
- HARROW TO BREAK UP CLODS BUT DO NOT SMOOTH (LEAVE THE SURFACE 'KEYED' TO ACCEPT THE TOPSOIL);
- PROTECT SUBGRADE FROM TRAFFICKING, COMPACTION AND CRUST FORMATION UNTIL THE TOPSOIL/PLANTING SOIL SPREAD IS SPREAD.

SUBSOIL DRAINAGE

PROVIDE SUBSOIL DRAINAGE IN ACCORDANCE WITH THE DRAWINGS AND DETAILS. WITH SUITABLE FALLS AND CONNECTION TO BIO-RETENTION AREA, STORMWATER PITS OR OTHER APPROVED RECEIVING DRAINAGE DEVICE.

3. HARDSCAPE

PAVEMENT FINISHES GENERALLY

PAVEMENTS ARE TO BE CONSTRUCTED TRUE TO THE DOCUMENTED LINE AND LEVELS WITHOUT LOCAL IRREGULARITIES. FOR PAVEMENTS:

- CURVED EDGES ARE TO HAVE SMOOTH TRANSITIONS FREE FROM KINKS;
- LEVEL DIFFERENCE LESS THAN 3mm BETWEEN DIFFERENT PAVING SURFACES OR PAVERS (UNLESS SPECIFICALLY INDICATED ON GRADING PLAN);
- MAXIMUM DEVIATION FROM A 3m STRAIGHT EDGE PLACED ANYWHERE ON SURFACE OF 12mm;
- LESS THAN 10mm DEPTH OF WATER PONDING (15 MINUTES AFTER RAIN HAS STOPPED);
- NO MOVEMENT OR HOLLOW SOUND WHEN WALKED UPON.

PAVING UNITS AND EXPANSION JOINTS, CRACK CONTROL JOINTS ARE TO BE LAID OUT AS INDICATED ON THE DRAWINGS. UNLESS OTHERWISE DOCUMENTED, CUTS ARE TO BE CARRIED OUT TO ACHIEVE A GAP OF NO MORE THAN 3mm BETWEEN ADJOINING PAVING UNITS OR OTHER ADJOINING SURFACES OR STRUCTURES. ENSURE POSITIVE DRAINAGE TO THE ADJOINING GARDENS, KERB AND DRAINAGE INLET GRATES TO PREVENT PONDING.

EACH DIFFERENT PAVEMENT TYPE IS TO HAVE A UNIFORM FINISH AND COLOUR. UNLESS OTHERWISE DOCUMENTED STEPS ARE TO HAVE A CONSTANT TREAD & RISER HEIGHT FOR EACH SET/FLIGHT.

SLIP RESISTANCE

UNLESS OTHERWISE SPECIFIED, ALL LANDSCAPE PATHWAYS AND PAVING (A POTENTIALLY ACCESSIBLE WALL COPINGS) SHALL COMPLY WITH THE FOLLOWING MINIMUM SLIP RESISTANCE RATINGS IN ACCORDANCE WITH ASINZS 4586:2013. (APPENDIX A - WET PENDULUM TEST)

GENERAL PATHWAYS AND PEDESTRIAN PAVEMENTS (TYPICALLY SLOPES LESS THAN 1:50)
WET PENDULUM TEST = P3, P4 OR P5 (CLASS X,W OR V-UNDER 2003 VERSION)
OIL-WET RAMP TEST = R11, R12 OR R13

GENERAL PATHWAYS AND PEDESTRIAN PAVEMENTS (TYPICALLY UP TO SLOPES OF 1:20)
WET PENDULUM TEST = P4 OR P5 (CLASS W OR V-UNDER 2003 VERSION)
OIL-WET RAMP TEST = R12 OR R13

GENERAL PATHWAYS AND PEDESTRIAN PAVEMENTS (FOR SLOPES BETWEEN 1:20 AND 1:14, OR ABOVE)
WET PENDULUM TEST = P5 (CLASS V- UNDER 2003 VERSION)
OIL-WET RAMP TEST = R13

INFORMATIONAL NOTE: WOOD FLOAT OR BROOM FINISHED INSITU CONCRETE WILL TYPICALLY PROVIDE A CLASS P5 RATING USING WET PENDULUM TEST AND CLASS C FOR WET BARE FOOT TEST AND R13.

UNLESS OTHERWISE SPECIFIED ALL PAVING AROUND SWIMMING POOLS OR WATER PLAY AREAS SHALL COMPLY WITH THE FOLLOWING SLIP RESISTANCE RATINGS IN ACCORDANCE WITH ASINZS 4586:2004. (WET BAREFOOT RAMP TEST):-
CLASS C FOR WATER PLAY AREAS OR SWIMMING POOL SURROUNDS.

APPLICABLE TEST METHODS

- WET PENDULUM TEST - APPENDIX A ASINZS 4586:2013 SHALL TYPICALLY BE USED AS THE TEST METHOD FOR PEDESTRIAN PATHWAYS AND RAMPS;
- WET BAREFOOT RAMP TEST - APPENDIX C ASINZS 4586:2013 SHALL ONLY BE USED AS THE TEST FOR SWIMMING POOL AND WATER PLAY AREA SURROUNDS;
- OIL-WET RAMP TEST - APPENDIX C ASINZS 4586:2013 SHALL TYPICALLY NOT BE USED FOR LANDSCAPE APPLICATIONS.

CONCRETE PAVING & FOOTINGS

FOUNDATIONS & PREPARATION
FOUNDATIONS FOR CONCRETE STRUCTURES SHALL BE EXCAVATED TO NEAT LINES AND FORMED AT THE REQUIRED DEPTH BELOW THE SURFACE LEVEL. ALL SOFT, YIELDING AND OTHERWISE UNSUITABLE MATERIAL SHALL BE REMOVED AND REPLACED WHERE NECESSARY WITH APPROVED MATERIAL, AND THE FOUNDATIONS SHALL BE THOROUGHLY COMPACTED AND FINISHED TO A FIRM SMOOTH SURFACE OF UNIFORM BEARING VALUE. UNLESS OTHERWISE PERMITTED, EXCAVATED MATERIAL SHALL NOT BE DEPOSITED ON EXISTING GRASSSED AREAS. EXCAVATION SHALL BE DEEP ENOUGH TO ALLOW FOR THE TOP SURFACE OF THE SLAB TO FINISH JUST BELOW OR FLUSH WITH THE TOP OF ADJOINING GRASS SURFACES AND PAVEMENT LEVELS (OR 25-50mm BELOW ADJOINING GARDEN LEVELS).

FORMWORK
FORMWORK FOR CONCRETE PAVING SHALL BE FIXED BOARDS OF SEASONED, DRESSED TIMBER PLANKS OR EQUIVALENT. FORMS SHALL BE DESIGNED AND CONSTRUCTED SO THAT THEY CAN BE REMOVED WITHOUT INJURING THE CONCRETE AND SHALL BE BUILT TRUE TO LINE AND BRACED IN A SUBSTANTIAL AND UNYIELDING MANNER. FORMS SHALL BE FREE OF WARPS, KINKS OR BENDS.

REINFORCEMENT - PEDESTRIAN PAVEMENTS
REINFORCEMENT SHALL BE SL62 MESH UNLESS OTHERWISE NOTED. REINFORCEMENT IS TO BE PLACED 30mm BELOW THE TOP SURFACE OF THE PAVEMENT AND NOT CLOSER THAN 40MM TO THE SIDES. REINFORCEMENT SHALL BE SECURED AGAINST DISPLACEMENT ARISING FROM THE FLOW OR WORKING OF THE CONCRETE, AND SHALL BE TIED WITH NO. 16 SWG BLACK IRON WIRE OR TACK WELDED AT ALL CROSSINGS.

STRENGTH
UNLESS OTHERWISE NOTED, CONCRETE SHALL BE A MINIMUM STRENGTH OF 25 MPa AND SHALL BE PROPERLY COMPACTED VIA VIBRATING SCREEDS OR POKERS.

FALLS AND FINISH
UNLESS OTHERWISE DETAILED, FOOTPATHS SHALL BE CONSTRUCTED WITH A MINIMUM 2% (1:50) CROSS FALL, FALLING WITH GENERAL GRADES OF THE AREA. LONGITUDINAL GRADES NORMALLY SHALL BE IN THE RANGE OF 0.5% TO 2.5%, IF COLOURED CONCRETE IS SPECIFIED IT SHALL BE INTEGRALLY AND FULL-THICKNESS COLOURED.

AFTER PLACING AND COMPACTION, CONCRETE SHALL BE FINISHED TO A SMOOTH EVEN SURFACE BY MEANS OF STEEL FLOATS AND OTHER SUITABLE EQUIPMENT. ON COMPLETION OF STEEL FLOATING AND BEFORE INITIAL SET, THE SURFACES OF CONCRETE PATHS SHALL BE EITHER WOOD FLOATED OR BROOMED TO A 'NON-SKID' TEXTURE. THIS SHALL BE ACHIEVED BY DRAWING A MOISTENED NYLON BROOM LIGHTLY ACROSS THE SURFACE AT RIGHT ANGLES TO THE DIRECTION OF THE PATH OR PAVING. EDGES SHALL BE TOOLED TO CREATE A 5m PENCIL ROUND EDGE.

CONTRACTION JOINTS SHALL BE FORMED BY MAKING A CUT 3mm WIDE FOR AT LEAST ONE QUARTER OF THE DEPTH OF THE PAVING. UNLESS OTHERWISE SPECIFIED OR DETAILED, THE SPACING OF CONTRACTION JOINTS SHALL BE APPROXIMATE TO THE WIDTH OF THE PATH WITH MINOR ADJUSTMENTS TO AVOID SHORT CLOSING LENGTHS. JOINT SPACING SHALL NOT TYPICALLY NORMALLY EXCEED THREE (3) METRES.

EXPANSION JOINTS SHALL BE CONSTRUCTED FOR THE FULL DEPTH OF THE PAVING USING 15mm WIDE BITUMINOUS EXPANSION JOINTS. THEY SHALL BE PROVIDED WHEREVER THE PAVING ABUTS FIXED STRUCTURES, SUCH AS BUILDINGS AND MANHOLES, TRANSVERSELY AT MAXIMUM INTERVALS OF 15 METRES ALONG THE LENGTH OF THE PATHWAY AND AT PATH INTERSECTIONS. JOINT ARISES ABUTTING BITUMINOUS EXPANSION JOINTS SHALL BE TOOLED OFF.

PROTECT GREEN CONCRETE FROM RAIN, FLOWING WATER AND, WHERE POSSIBLE, GRAFFITI. PROVIDE PROTECTION AS NECESSARY TO PREVENT CRACKING OF THE CONCRETE DUE TO TEMPERATURE CHANGES DURING THE CURING PERIOD. REINSTATE ADJACENT SURFACES AFTER STRIPPING OF FORMWORK.

EDGING

EDGES ARE TO BE CONSTRUCTED TRUE TO THE DOCUMENTED LINE AND LEVELS WITHOUT LOCAL IRREGULARITIES. FOR EDGES:-

- CURVED EDGES ARE TO HAVE SMOOTH TRANSITIONS FREE FROM KINKS;
- VERTICAL ALIGNMENT CURVES ARE TO HAVE SMOOTH TRANSITIONS FREE FROM KINKS AND SUDDEN CHANGES FOLLOWING THE ADJOINING DESIGNED GRADES AND LEVELS.

FENCING

FENCES ARE TO BE CONSTRUCTED TRUE TO THE DOCUMENTED LINE AND LEVELS AND VERTICAL WITH SUFFICIENT RIGIDITY AND DEPTH OF POST AND FOOTINGS TO WITHSTAND NORMALLY EXPECTED USE AND LATERAL FORCES. UNLESS OTHERWISE SPECIFIED OR DETAILED POSTS SHALL BE MAXIMUM SPACING OF 2.4m AND BE EMBEDDED WITHIN THE GROUND TO AT LEAST ¼ THE HEIGHT OF THE FENCE HEIGHT.

WALL FINISHES

WALLS ARE TO BE CONSTRUCTED TRUE TO THE DOCUMENTED LINE AND LEVELS AND VERTICAL (UNLESS OTHERWISE DOCUMENTED). WALLS ARE TO BE LESS THAN 1% FROM VERTICAL. HORIZONTAL WALL MEMBERS AND RUNS ARE TO NOT SAG. CAPPING IS TO BE LEVEL IN BOTH DIRECTIONS. THERE IS TO BE NO MORE THAN 2mm DIFFERENCE IN HEIGHT BETWEEN ADJOINING FACING SEGMENTS OR BETWEEN ADJOINING CAPPING SEGMENTS. EXPANSION JOINTS, FACING AND COPING SEGMENTS ARE TO BE SET OUT AS INDICATED ON THE DRAWINGS AND AS DIRECTED ON SITE BY THE CONTRACT MANAGER. UNLESS OTHERWISE DOCUMENTED, CUTS ARE TO BE CARRIED OUT TO ACHIEVE A GAP OF NO MORE THAN 3MM BETWEEN ADJOINING SEGMENTS OR OTHER ADJOINING SURFACES OR STRUCTURES. SLIP RESISTANCE FOR THE CAPPING IS TO COMPLY WITH ASINZS 4586:2013 WHERE IT IS REASONABLE TO ANTICIPATE IT BEING ACCESSIBLE TO PEDESTRIANS. SELECT MATERIALS AND INCLUDE ADMIXTURES WITHIN CONCRETES AND MORTARS TO PREVENT THE OCCURRENCE OF EFFLORESCENCE.

4. SOFTSCAPE

MULCH

ANY SOIL CONDITIONERS SHALL COMPLY WITH AS4454-2003 COMPOSTS, SOIL CONDITIONERS AND MULCHES. UNLESS OTHERWISE NOTED MULCH SHALL BE A MINIMUM OF 50mm DEPTH AND A MAXIMUM OF 75mm DEPTH. MULCH TYPES SHALL BE:-

- 15mm GRADED AGED HORTICULTURAL PINE BARK FINES. (ALL AREAS EXCEPT BIOFILTERS/ DETENTION BASINS);
- RECYCLED WOOD WASTE SUCH AS ANL FOREST BLEND OR APPROVED EQUIVALENT. (ALL AREAS EXCEPT BIOFILTERS/ DETENTION BASINS);
- BIOFILTER / DETENTION BASINS SHALL BE ROUNDED 20mm DIAMETER NEPEAN RIVER GRAVEL OR APPROVED EQUIVALENT.

HERBICIDES

GENERAL USE HERBICIDES SHALL BE:-

- A GLYPHOSATE BASED NON-RESIDUAL HERBICIDE SUCH AS "ROUNDUP® BIACTIVE™"

SUBMIT DETAILS OF ANY OTHER PROPOSED HERBICIDES PRIOR TO USE. FOLLOW ALL PUBLISHED SAFETY AND MATERIAL HANDLING DATA AND PROPERLY STORE ALL CHEMICALS USED ON SITE. HERBICIDES SHALL BE DILUTED TO MANUFACTURER'S RECOMMENDATIONS IN CLEAN WATER WITH COLOURED DYE ADDED.

FERTILISERS & WETTING AGENTS

UNLESS OTHERWISE NOTED SPECIFIED FERTILISER SHALL BE A SLOW RELEASE PELLETISED FORM SUITABLE FOR USE WITH AUSTRALIAN NATIVE PLANTS:-

- OSMOCOTE™ PLUS TRACE ELEMENTS - TOTAL ALL PURPOSE SLOW RELEASE FERTILISER OR
- OSMOCOTE® PLUS TRACE ELEMENTS - NATIVE GARDENS SLOW RELEASE FERTILISER FOR PHOSPHOROUS SENSITIVE NATIVE PLANTING.

UNLESS OTHERWISE NOTED, THE APPLICATION RATE FOR THE ABOVE SHALL BE 50g/m².

UNLESS OTHERWISE NOTED THE SOIL WETTING AGENT SHALL BE:-

- AMGROW "WETTASOIL" GRANULAR SOIL WETTING AGENT BROADCAST ONTO THE SURFACE OF GARDEN AREAS OR LAWN AREAS PRIOR TO PLANTING.

UNLESS OTHERWISE NOTED, THE APPLICATION RATE FOR THE ABOVE SHALL BE:-

- 30g/m² FOR CLAY SOILS;
- 40g/m² FOR LOAM AND ORGANIC SOIL BLENDS;
- 50g/m² FOR SANDS AND SANDY SOILS.

SOIL CONDITIONERS

UNLESS OTHERWISE NOTED SPECIFIED SOIL CONDITIONERS SHALL BE SUPPLIED BY TERRACOTTEM, PROVIDE GROWTH STIMULANTS, AND INCREASE THE NUTRIENT AND WATER HOLDING CAPACITY OF THE SOIL:-

- TERRACOTTEM ARBOR SHALL BE USED IN ALL GARDEN BEDS AND APPLIED AT A RATE OF 200g PER m²;
- TERRACOTTEM TURF SHALL BE USED IN ALL TURF AREAS AND APPLIED AT A RATE OF 150g PER m².

TREE PLANTING, GARDEN AND LAWN AREA PREPARATION

ENSURE THE INSTALLED, OR NATURAL, SUB GRADES, ARE NOT TOXIC TO NORMAL PLANT GROWTH OR UNNATURALLY OVERLY COMPACTED. NOTIFY CONTRACT MANAGER IMMEDIATELY IF THERE ARE ANY CONCERNS WITH REGARD TO THE SUBSOIL CONDITIONS.

SOIL

SITE WON TOPSOIL SHALL BE TESTED BY SESL AUSTRALIA OR AN APPROVED SOIL LABORATORY AND REUSED ONSITE WHERE POSSIBLE. SITE WON SOIL SHOULD BE AMELIORATED IN ACCORDANCE WITH THE LABORATORY RECOMMENDATIONS FOR THE INTENDED PLANT SPECIES MIX AND PLANTING APPLICATION. IMPORTED SOILS SHOULD BE USED WHERE SITE SOILS ARE NOT SUITABLE FOR REUSE OR THE VOLUME REQUIRED IS INSUFFICIENT.

ALL IMPORTED PLANTING SOIL IS TO COMPLY WITH REQUIREMENTS OF AS 4419-2003 SOILS FOR LANDSCAPING AND GARDEN USE. ALL PLANTING SOIL SHALL BE FREE OF MATERIALS, RUBBISH, DEBRIS AND SUBSTANCES THAT ARE TOXIC TO LIVING ORGANISMS, OR WOULD OTHERWISE BE DECLARED CONTAMINATED. ALL IMPORTED GARDEN SOIL SHALL BE FREE OF WEED SEEDS.

ALL PLANTING SOIL TO BE CONSOLIDATED BUT NOT COMPACTED AND HAVE PARTICLE SIZES GREATER THAN THE SUBSOIL.

THE PHYSICAL AND CHEMICAL PROPERTIES OF EACH SOIL TYPE SHALL BE WITHIN THE ACCEPTABLE RANGES SPECIFIED IN THE 'SOIL PROPERTIES SPECIFICATION TABLE' AND SUPPORTED BY COMPREHENSIVE DATA SHEETS AND TEST RESULTS. TEST RESULTS MUST BE SUBMITTED TO THE CONTRACT MANAGER TO DEMONSTRATE COMPLIANCE PRIOR TO USE.

ISOLATED TREE PLANTING PIT EXCAVATION AND SPOIL

UNLESS OTHERWISE SPECIFIED OR DIRECTED, SURPLUS EXCAVATED MATERIAL MUST BE IMMEDIATELY REMOVED FROM THE SITE. THIS INCLUDES DEBRIS RESULTING FROM SITE CLEARANCE AND EXCAVATED MATERIAL NOT RE-USABLE AS TOPSOIL, FILLING, MULCH OR THE LIKE. EXCAVATE TO AN EQUIVALENT DEPTH OF THE NEW TREE ROOTBALL MEASURED FROM THE UNDERSIDE OF ANY CONCRETE BASE SLABS OR PAVEMENT, OR AS SHOWN ON THE DETAILS. DO NOT DISTURB EXISTING SERVICES, AND EXCAVATE BY HAND AROUND ANY EXISTING SERVICES AS REQUIRED. ALLOW ADDITIONAL DEPTH TO ACHIEVE SPECIFIED FALLS FOR SUBSOIL DRAINAGE LINES AND TO SATISFY FINISHED LEVELS.

SAFETY PRECAUTIONS MUST BE IN PLACE TO PREVENT PUBLIC ENTRY TO WORKSITE AREA/ EXCAVATED TREES PITS WHEN IN PUBLIC STREETS.

PLANTS, PLANTING AND FERTILISING

ALL TREES SHALL COMPLY WITH AUSTRALIAN STANDARD 2303:2015 'TREE STOCK FOR LANDSCAPE USE'. INSPECT AND APPROVE ALL PLANTS IMMEDIATELY AFTER BEING UNLOADED TO CHECK FOR QUANTITY, QUALITY, VIGOUR, HEALTH, AND OTHER REQUIREMENTS. TREES SUPPLIED IN CONTAINERS 100L OR GREATER SHALL INDICATE THE NORTHERLY ASPECT DURING GROWING IN THE NURSERY AND ENSURE IT IS CLEARLY MARKED UNTIL IT IS PLACED IN THAT SAME ORIENTATION IN ITS FINAL POSITION IN THE PLANTING HOLE. PREPARE PLANTING AREAS AND INSTALL SOIL AS DETAILED. IF NOT OTHERWISE SHOWN ON DETAILED DRAWINGS, TYPICALLY EXCAVATE THE PLANTING HOLES A MINIMUM OF THREE TIMES THE DIAMETER OF THE CONTAINER ROOT BALL AND FOR 25L TO 75L CONTAINERS 100mm DEEPER THAN THE ROOT BALL UNLESS OTHERWISE DETAILED. BREAK UP AND LOOSEN COMPACTED SIDES OF THE HOLE TO PREVENT CONFINEMENT OF ROOT GROWTH. ALL TREES 100L AND LARGER SHALL HAVE THE OUTER 5-10mm OF ROOTS SHAVED OFF THE ROOTBALL PRIOR TO BACKFILLING.

THOROUGHLY WATER ALL PLANTS IMMEDIATELY AFTER UNLOADING ONSITE AT A RATE OF 50% OF THE ROOTBALL VOLUME EG. 100L FOR 200L TREES TO ENSURE THE ROOTBALL THOROUGHLY WETTED. CONTINUE DAILY WATERING AT THE RATE OF 25% OF ROOTBALL VOLUME UNTIL PLANTED. WHEN THE HOLE IS THE CORRECT SIZE AND NOT BEFORE, REMOVE THE PLANT FROM THE CONTAINER WITH MINIMUM DISTURBANCE TO THE ROOT BALL AND THEN PLACE IT IN ITS FINAL POSITION, AT THE CENTRE OF THE HOLE. ENSURE THAT TOPSOIL IS NOT PLACED OVER THE TOP OF THE ROOT BALL. THE PLANT STEM SHALL REMAIN THE SAME HEIGHT ABOVE GROUND LEVEL AS IT WAS IN THE CONTAINER. SOIL IS TO BE LIGHTLY TAMPED DURING BACKFILLING TO AVOID EXCESSIVE AIR POCKETS FORMING OR LATER SUBSIDENCE. THOROUGHLY WATER AT A RATE OF 50% OF ROOTBALL VOLUME IMMEDIATELY AFTER PLANTING. LIGHTLY RAKE REMAINING GARDEN AREAS TO AN EVEN GRADE SO THAT THE SOIL LEVEL WILL BE 50-75mm BELOW ADJACENT FINISHED LEVELS, TO ACCOMMODATE THE ADDITION OF MULCH AND FORM TEMPORARY WATERING BUNDS AROUND PLANTS, AS DETAILED.

PLACE SLOW RELEASE ORGANIC FERTILISER AROUND THE SOIL SURFACE OF THE PLANTS AT TIME OF PLANTING, PRIOR TO MULCHING AT THE RATE SPECIFIED.

SUSPEND ALL PLANTING DURING UNSATISFACTORY WEATHER CONDITIONS INCLUDING THE FOLLOWING:-

- DURING VERY HIGH WIND CONDITIONS (ESPECIALLY WHEN HOT / DRY);
- IN PERIODS OF EXTREME HEAT (IE. + 35°C);
- WHEN SOIL IS EXTREMELY WET OR WATERLOGGED; AND
- DURING PERIODS OF EXPECTED FROST.

AFTER PLANTING, REMOVE ALL RUBBISH, PLANT TAGS AND NURSERY STAKES AND CONTAINERS FROM THE SITE.

TEMPORARY STAKING OF TREES

ALL TREES SUPPLIED ARE TO BE SELF SUPPORTING AS SPECIFIED. ALL NURSERY STAKES AND TIES ARE TO BE REMOVED PRIOR TO PLANTING. ONLY STAKE TREES IF IT IS DETAILED OR OTHERWISE SPECIFIED. IF PREVAILING ENVIRONMENTAL FACTORS SUCH AS VERY STRONG WINDS OR POTENTIAL DAMAGE OR VANDALISM DICTATE, THE PLANTS MAY BE STAKED AS PER METHODS DESCRIBED BELOW.

ONLY AT THE DIRECTION OF THE CONTRACT MANAGER, IF ANY PLANTS ARE FOUND TO NOT BE SELF SUPPORTING, AND ARE NOT REJECTED, THE PLANTS SHALL BE STAKED AT THE CONTRACTORS EXPENSE. TREES (100L AND OVER) SHALL BE STAKED WITH TWO 50 X 50 X 1800mm HARDWOOD STAKES SPACED ON EITHER SIDE OF THE TREE. ALL OTHER SMALL TREES (25L - 75L) SHALL BE STAKED USING TWO 38 X 38 X 1500mm HARDWOOD STAKES, OR EQUIVALENT.

TIE EACH PLANT TO THE STAKES IN A LOOSE FIGURE "8" USING A 50mm WIDE HESSIAN STRAP. ENSURE THE TIE IS SLACK TO FACILITATE MOVEMENT OF THE STEM. STAKES ARE NOT TO BE DRIVEN THROUGH THE ROOTBALL AND ARE TO BE LOCATED ON THE WINDWARD SIDE OF THE TREE, IF WINDS HAVE A PREVAILING DIRECTION.

ALL STAKES AND TIES SHALL BE REMOVED PRIOR TO FINAL COMPLETION. IF TREES ARE STILL NOT SELF SUPPORTING AT THIS TIME THEY SHALL BE REPLACED, AT THE CONTRACTORS EXPENSE, WITH SELF SUPPORTING SPECIMENS OF THE SAME SIZE AND SPECIES AS ORIGINALLY SPECIFIED.

TURF PLACEMENT

THE CONTRACTOR SHALL LAY TURF AS INDICATED ON DRAWINGS AND AS SPECIFIED IN THE SCHEDULE. ALL TURF WILL BE LAID AS SOON AS IT ARRIVES ON SITE. PREPARE TURF UNDERLAY, USING THE SPECIFIED SOIL MIX SPREAD AND COMPACTED TO AN EXTENT WHERE EXCESSIVE HEAL PRINTS ARE AVOIDED WHEN IT IS WALKED OVER. FINAL SHAPING AND SMOOTHING OF THE LAWN AREA WILL BE CONDUCTED USING AN APPROPRIATE TOPDRESSING "FLOAT", TO THE FINISHED LEVELS. CARE SHOULD BE TAKEN TO REMOVE ALL SURFACE IMPERFECTIONS AND LARGE SOIL LUMPS.

A HEADER COURSE OF SODS WILL BE LAID PARALLEL AND ADJACENT TO ALL EDGES TO THE TURF AREA. THE TURF SODS SHALL THEN BE PLACED HORIZONTALLY ACROSS THE SLOPE IN A 'STRETCHER' BOND PATTERN, WITH ALL JOINTS BUTTED FIRMLY TOGETHER AND NEATLY CUT IN. ANY DAMAGED OR SUB-STANDARD AREAS SHALL BE CUT OUT AND REPLACED. ANY REMAINING SMALL GAPS BETWEEN TURF SODS ARE TO BE FILLED IN WITH TURF UNDERLAY SOIL. ON STEEP SLOPES, OR DRAINAGE CHANNELS, PEG THE TURF AS NECESSARY TO PREVENT DOWN SLOPE MOVEMENT, AND REMOVE THE PEGS WHEN THE TURF IS ESTABLISHED.

HIGH POINTS OR IMPERFECTIONS MAY BE LIGHTLY TAMPED OUT UPON COMPLETION OF LAYING TO FORM AN EVEN SURFACE. ALL TURF IS TO FINISH FLUSH WITH ADJACENT SURFACES. ALL TURF SHALL BE WATERED THE SAME DAY IT IS LAID. TOPDRESSING OR ROLLING SHALL NOT BE UNDERTAKEN UNTIL LAWN IS ESTABLISHED.

BOARDS, PLANKS OR OTHER MEANS WILL BE EMPLOYED TO AVOID DAMAGE TO THE BASE COURSE SCREED AND NEWLY LAYED TURF DURING THE LAYING PROCESS. PROTECTION WILL ALSO BE PROVIDED TEMPORARILY TO PREVENT DAMAGE LIKELY TO BE CAUSED BY PEDESTRIAN OR VEHICULAR MOVEMENT AND ONGOING BUILDING WORKS. THIS WILL NOT BE LEFT IN PLACE LONGER THAN IS NECESSARY TO PREVENT DAMAGE AND WILL BE REMOVED AT THE CONCLUSION OF EACH WORKING DAY.

ALLOW FOR REPLACING ALL AREAS WHERE THE TURF HAS FAILED TO PROVIDE A HEALTHY COVER WITHIN 30 DAYS FROM THE DATE OF LAYING. CONTRACTOR SHALL PROVIDE COMMENT AS TO WHY THE TURF MAY HAVE FAILED SO THAT RECTIFICATION MEASURES CAN BE TAKEN PRIOR TO RE-TURFING. TOPDRESSING, SHOULD IT BE DEEMED NECESSARY BY THE CONTRACT MANAGER, WILL NOT BE CONDUCTED WITHIN 6 WEEKS OF LAYING THE TURF. TOPDRESSING SHALL ONLY BE CONDUCTED TO REMOVE APPARENT SURFACE DEPRESSIONS AND WILL NOT CONSTITUTE AN ADDITION COST. TOPDRESSING SOIL SHALL BE THE SAME SOIL MIX AS THAT USED FOR THE TURF AREA BASE COURSE TO AVOID LAYERING OF THE SOIL PROFILE. TOPDRESSING WILL BE LIGHTLY APPLIED DRY AND LEVELLED AND WORKED INTO THE LAWN USING AN APPROPRIATE TOPDRESSING "FLOAT".

6. ESTABLISHMENT MAINTENANCE

EXTENT & TASKS

THE CONTRACTOR SHALL MONITOR AND MAINTAIN ALL PLANTING AND ASSOCIATED LANDSCAPING WORKS FOR THE DURATION OF THE MAINTENANCE PERIOD. THIS SHALL GENERALLY INCLUDE WATERING, FAILED PLANT REPLACEMENTS, PEST AND DISEASE CONTROL, WEED CONTROL AND MONITORING. MAINTENANCE IS TO BE CARRIED OUT TO ALL AREAS WHERE NEW PLANTING, IS INSTALLED. WEEDING SHALL EXTEND AROUND AND IN BETWEEN INDIVIDUAL PLANTS AND UP TO PATH, KERBS OR OTHER DEFINING EDGES. CARRY OUT ALL MAINTENANCE ACTIVITIES FOR ALL NEW GARDEN AND LAWN AREAS AS REQUIRED TO ENSURE THE PLANTS AND TURF BECOME ESTABLISHED WITHIN THE MAINTENANCE PERIOD AND ARE KEPT IN A HEALTHY AND TIDY STATE IN ACCORDANCE WITH BEST HORTICULTURAL PRACTICES.

WATERING

PLANTS ARE TO BE WATERED UPON COMPLETION OF PLANTING AND THEN MONITORED FOR WATER STRESS BY THE CONTRACTOR. WATERING REQUIREMENTS WILL BE SUBJECT TO SEASON AND PREVAILING WEATHER CONDITIONS. PLANTS THAT FAIL DUE TO WILTING AND WATER STRESS SHALL BE REPLACED AT THE CONTRACTORS EXPENSE. REFER TO ADVANCED TREE WATERING SCHEDULE FOR MINIMUM WATERING REQUIREMENTS FOR TREES GREATER THAN OR EQUAL TO 45L CONTAINER SIZE.

PESTS AND DISEASES

ALL TREES ARE TO BE VISUALLY INSPECTED FOR THE PRESENCE OF PERSISTENT AND DAMAGING INSECT PESTS OR DISEASES AT LEAST ONCE EVERY 4 WEEKS, OR UPON WRITTEN NOTIFICATION FROM THE CONTRACT MANAGER OF A POTENTIAL PROBLEM. THE PEST AND / OR DISEASE AND ITS EXTENT AND PREVALENCE IS TO BE IDENTIFIED AND RECORDED ALONG WITH THE RECOMMENDED CONTROL AND ACTION TO BE TAKEN.

THIS DRAWING INCLUDES INFORMATION IN COLOUR. IF YOU HAVE A BLACK AND WHITE COPY YOU DON'T HAVE ALL THE INFORMATION. THIS NOTE IS COLOURED RED.

REV.	DATE	DESCRIPTION	BY
A	31.10.2025	ISSUED FOR APPROVAL	JSC

PROJECT NO:	7197
DA NO.:	2014-114
DESIGNED BY:	JSC/BC
DRAWN BY:	JSC
CHECKED BY:	BC
DATE CREATED:	JULY 2025

DRAWING TITLE:	LANDSCAPING NOTES
PROJECT:	THE